




Local Government Energy Audit: Energy Audit Report

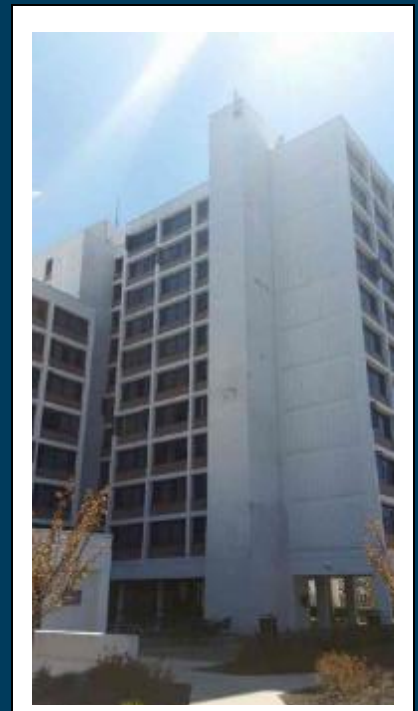

Bohn Hall

I Normal Avenue

Montclair, New Jersey 07043

Montclair State University

July 9, 2018

Final Report by:

TRC Energy Services



Copyright ©2017 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Disclaimer

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

Table of Contents

1	Executive Summary.....	1
1.1	Facility Summary	1
1.2	Your Cost Reduction Opportunities.....	1
	Energy Conservation Measures.....	1
	Energy Efficient Practices	4
	On-Site Generation Measures.....	4
1.3	Implementation Planning.....	5
2	Facility Information and Existing Conditions	7
2.1	Project Contacts	7
2.2	General Site Information.....	7
2.3	Building Occupancy	7
2.4	Building Envelope	7
2.5	On-Site Generation.....	8
2.6	Energy-Using Systems	8
	Lighting System	8
	Steam to Hot Water Heating System	9
	Direct Expansion Air Conditioning System (DX)	9
	Domestic Water Heating System	9
	Building Plug Load	9
2.7	Water-Using Systems	9
3	Site Energy Use and Costs.....	10
3.1	Total Cost of Energy	10
3.2	Electricity Usage	11
3.3	Steam Usage.....	12
3.4	Benchmarking.....	13
3.5	Energy End-Use Breakdown	15
4	Energy Conservation Measures	16
4.1	High Priority ECMs.....	16
4.1.1	Lighting Upgrades.....	17
	ECM 1: Install LED Fixtures	17
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	18
	ECM 3: Retrofit Fixtures with LED Lamps.....	18
	ECM 4: Install LED Exit Signs.....	19
4.1.2	Lighting Control Measures	20
	ECM 5: Install Occupancy Sensor Lighting Controls	20
	ECM 6: Install Daylight Dimming Controls	21
	ECM 7: Install High/Low Lighting Controls	21
4.1.3	Motor Upgrades	22
	ECM 8: Premium Efficiency Motors.....	22

4.1.4	Variable Frequency Drive Measures	23
	ECM 9: Install VFDs on Constant Volume (CV) HVAC	23
4.1.5	HVAC System Upgrades.....	24
	ECM 10: Install Pipe Insulation.....	24
4.1.6	Domestic Hot Water Heating System Upgrades	25
	ECM 11: Install Low-Flow DHW Devices.....	25
4.1.7	Plug Load Equipment Control - Vending Machines.....	26
	ECM 12: Vending Machine Control	26
5	Energy Efficient Practices	27
	Reduce Air Leakage	27
	Close Doors and Windows	27
	Use Window Treatments/Coverings	27
	Perform Proper Lighting Maintenance.....	27
	Develop a Lighting Maintenance Schedule	27
	Turn Off Unneeded Motors.....	28
	Reduce Motor Short Cycling.....	28
	Ensure Economizers are Functioning Properly.....	28
	Clean Evaporator/Condenser Coils on AC Systems	28
	Clean and/or Replace HVAC Filters	28
	Repair/Replace Steam Traps	28
	Perform Maintenance on Compressed Air Systems	29
	Plug Load Controls.....	29
	Water Conservation	29
6	On-Site Generation Measures	30
6.1	Photovoltaic.....	30
6.2	Combined Heat and Power	31
7	Demand Response	32
8	Project Funding / Incentives	33
8.1	SmartStart	34
8.2	Pay for Performance - Existing Buildings.....	35
8.3	Energy Savings Improvement Program	36
9	Energy Purchasing and Procurement Strategies	37
9.1	Retail Electric Supply Options.....	37
9.2	Retail Natural Gas Supply Options	37

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

Table of Figures

Figure 1 – Previous 12 Month Utility Costs..... 2

Figure 2 – Potential Post-Implementation Costs 2

Figure 3 – Summary of Energy Reduction Opportunities 2

Figure 4 – Project Contacts 7

Figure 5 - Building Schedule..... 7

Figure 6 - Utility Summary 10

Figure 7 - Energy Cost Breakdown 10

Figure 8 - Electric Usage & Demand..... 11

Figure 9 - Electric Usage & Demand..... 11

Figure 10 –Steam Usage 12

Figure 11 - Energy Use Intensity Comparison – Existing Conditions..... 13

Figure 12 - Energy Use Intensity Comparison – Following Installation of Recommended Measures 13

Figure 13 - Energy Balance (% and kBtu/SF) 15

Figure 14 – Summary of High Priority ECMs 16

Figure 15 – Summary of Lighting Upgrade ECMs..... 17

Figure 16 – Summary of Lighting Control ECMs 20

Figure 17 – Summary of Motor Upgrade ECMs 22

Figure 18 – Summary of Variable Frequency Drive ECMs 23

Figure 19 - Summary of HVAC System Improvement ECMs 24

Figure 20 - Summary of Domestic Water Heating ECMs 25

Figure 21 - Summary of Domestic Water Heating ECMs 26

Figure 22 - ECM Incentive Program Eligibility..... 33

I EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) Report for Bohn Hall.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist New Jersey higher education facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

I.1 Facility Summary

Bohn Hall is a 139,737 square foot facility. The building has 16 floors that include dorm rooms, lounges, and offices.

Lighting at Bohn Hall consists primarily of a mixture of T5, T8, and T12 fluorescent sources, compact fluorescent lamps (CFLs), and some incandescent fixtures, all of which are inefficient as compared to currently available alternatives. Cooling is provided a combination of packaged and split-system air-conditioning units. Steam is provided from the District Energy Plant to Bohn Hall's mechanical room, where it is converted to heating and domestic hot water by steam to water heat exchangers. Heating hot water is distributed to the building's radiators and heating units. A thorough description of the facility and our observations are located in Section 2.

I.2 Your Cost Reduction Opportunities

Energy Conservation Measures

TRC evaluated 12 measures which together represent an opportunity for Bohn Hall to reduce annual energy costs by \$89,566 and annual greenhouse gas emissions by 577,777 lbs CO₂e. We estimate that if all high priority measures are implemented as recommended, the project will pay for itself in 2.2 years. TRC has defined high priority measures as the evaluated measures that have a simple payback less than the typical equipment life of the proposed equipment. The breakdown of existing and potential utility costs after project implementation are illustrated in Figure 1 and Figure 2, respectively. Together these measures represent an opportunity to reduce Bohn Hall's annual energy use by 11%.

Figure 1 – Previous 12 Month Utility Costs


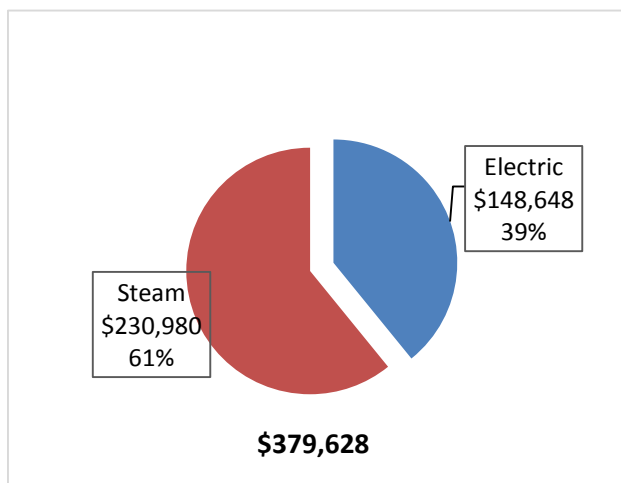


Figure 2 – Potential Post-Implementation Costs

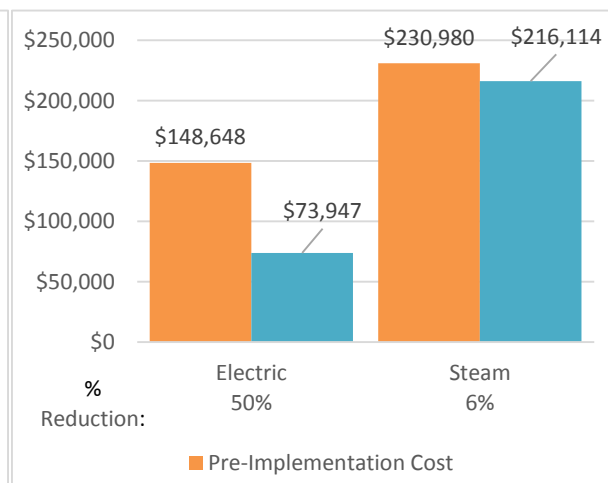

A detailed description of Bohn Hall’s existing energy use can be found in Section 3.

Estimates of the total cost, energy savings, and financial incentives for the evaluated energy efficient upgrades are summarized below in Figure 3. A brief description of each category can be found below and a description of savings opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

Energy Conservation Measure	High Priority?	Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)	
Lighting Upgrades													
		372,932	0	0	41.3	0.0	\$62,652.65	\$110,855.57	\$9,470.00	\$101,385.57	1.6	375,540	
ECM 1	Install LED Fixtures	Yes	790			0.2	0.0	\$132.65	\$1,499.40	\$10.00	\$1,489.40	11.2	795
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	130,562			9.8	0.0	\$21,934.39	\$37,752.67	\$2,425.00	\$35,327.67	1.6	131,475
ECM 3	Retrofit Fixtures with LED Lamps	Yes	237,376			31.0	0.0	\$39,879.20	\$62,999.11	\$7,035.00	\$55,964.11	1.4	239,036
ECM 4	Install LED Exit Signs	Yes	4,205			0.3	0.0	\$706.41	\$8,604.40	\$0.00	\$8,604.40	12.2	4,234
Lighting Control Measures													
		29,340	0	0	2.4	0.0	\$4,929.10	\$18,780.00	\$1,880.00	\$16,900.00	3.4	29,545	
ECM 5	Install Occupancy Sensor Lighting Controls	Yes	18,307			1.5	0.0	\$3,075.58	\$11,880.00	\$1,540.00	\$10,340.00	3.4	18,435
ECM 6	Install Daylight Dimming Controls	Yes	422			0.1	0.0	\$70.95	\$500.00	\$340.00	\$160.00	2.3	425
ECM 7	Install High/Low Lighting Controls	Yes	10,611			0.8	0.0	\$1,782.57	\$6,400.00	\$0.00	\$6,400.00	3.6	10,685
Motor Upgrades													
		7,350	0	0	0.8	0.0	\$1,234.79	\$6,599.07	\$0.00	\$6,599.07	5.3	7,401	
ECM 8	Premium Efficiency Motors	Yes	7,350			0.8	0.0	\$1,234.79	\$6,599.07	\$0.00	\$6,599.07	5.3	7,401
Variable Frequency Drive (VFD) Measures													
		31,860	0	0	4.4	0.0	\$5,352.49	\$14,952.48	\$2,660.00	\$12,292.48	2.3	32,083	
ECM 9	Install VFDs on Constant Volume (CV) HVAC	Yes	31,860			4.4	0.0	\$5,352.49	\$14,952.48	\$2,660.00	\$12,292.48	2.3	32,083
HVAC System Improvements													
		0	0	0	0.0	115.0	\$1,925.06	\$870.00	\$0.00	\$870.00	0.5	16,837	
ECM 10	Install Pipe Insulation	Yes	0			0.0	115.0	\$1,925.06	\$870.00	\$0.00	\$870.00	0.5	16,837
Domestic Water Heating Upgrade													
		0	0	0	0.0	773.2	\$12,940.82	\$57,882.00	\$0.00	\$57,882.00	4.5	113,185	
ECM 11	Install Low-Flow Domestic Hot Water Devices	Yes	0			0.0	773.2	\$12,940.82	\$57,882.00	\$0.00	\$57,882.00	4.5	113,185
Plug Load Equipment Control - Vending Machine													
		3,163	0	0	0.0	0.0	\$531.42	\$690.00	\$0.00	\$690.00	1.3	3,185	
ECM 12	Vending Machine Control	Yes	3,163			0.0	0.0	\$531.42	\$690.00	\$0.00	\$690.00	1.3	3,185
TOTALS FOR HIGH PRIORITY MEASURES			444,646	0	0	48.9	888.2	\$89,566.34	\$210,629.13	\$14,010.00	\$196,619.13	2.2	577,777
TOTALS FOR ALL EVALUATED MEASURES			444,646	0	0	48.9	888.2	\$89,566.34	\$210,629.13	\$14,010.00	\$196,619.13	2.2	577,777

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Lighting Upgrades generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measure save energy by reducing the power used by the lighting components due to improved electrical efficiency.

Lighting Controls measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

Motor Upgrades generally involve replacing older standard efficiency motors with high efficiency standard (IHP 2014). Motors replacements generally assume the same size motors, just higher efficiency. Although occasionally additional savings can be achieved by downsizing motors to better meet current load requirements. This measure saves energy by reducing the power used by the motors, due to improved electrical efficiency.

Variable Frequency Drives (VFDs) are motor control devices. These measures control the speed of a motor so that the motor spins at peak efficiency during partial load conditions. Sensors adapt the speed to flow, temperature, or pressure settings which is much more efficient than using a valve or damper to control flow rates, or running the motor at full speed when only partial power is needed. These measures save energy by controlling motor usage more efficiently.

HVAC System Improvements generally involve the installation of automated controls to reduce heating and cooling demand during periods of reduced demand. These measures could encompass changing temperature setpoints, using outside air for free cooling, or limiting excessive outside air during extreme outdoor air temperature conditions. These measures save energy by reducing the demand on HVAC systems and the amount of time systems operate.

Domestic Hot Water upgrade measures generally involve replacing older inefficient domestic water heating systems with modern energy efficient systems. New domestic hot water heating systems can provide equivalent, or greater, water heating capacity compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel used for domestic hot water heating due to improved heating efficiency or reducing standby losses.

Plug Load Equipment control measures generally involve installing automated devices that limit the power usage or operation of equipment that is plugged into an electric outlets when not in use.

Energy Efficient Practices

TRC also identified 14 low cost (or no cost) energy efficient practices. A facility's energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. Potential opportunities identified at Bohn Hall include:

- Reduce Air Leakage
- Close Doors and Windows
- Use Window Treatments/Coverings
- Perform Proper Lighting Maintenance
- Develop a Lighting Maintenance Schedule
- Turn Off Unneeded Motors
- Reduce Motor Short Cycling
- Ensure Economizers are Functioning Properly
- Clean Evaporator/Condenser Coils on AC Systems
- Clean and/or Replace HVAC Filters
- Repair/Replace Steam Traps
- Perform Maintenance on Compressed Air Systems
- Install Plug Load Controls
- Water Conservation

For details on these Energy efficient practices, please refer to Section 5.

On-Site Generation Measures

TRC evaluated the potential for installing on-site generation for Bohn Hall. Based on the configuration of the site and its loads there is a low potential for installing any PV and combined heat and power self-generation measures.

For details on our evaluation and on-site generation potential, please refer to Section 6.

I.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Pay for Performance - Existing Building (P4P)
- Energy Savings Improvement Program (ESIP)

For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 8.

Larger facilities with an interest in a more comprehensive whole building approach to energy conservation should consider participating in the Pay for Performance (P4P) program. Projects eligible for this project program must meet minimum savings requirements. Final incentives are calculated based on actual measured performance achieved at the end of the project. The application process is more involved, and it requires working with a qualified P4P contractor, but the process may result in greater energy savings overall and more lucrative incentives, up to 50% of project's total cost.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.3 for additional information on the ESIP Program.

The Demand Response Energy Aggregator is a (non-NJCEP) program designed to reduce electric loads at commercial facilities, when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. Demand Response (DR) service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability. By enabling grid operators to call upon commercial facilities to reduce their electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and facilities receive payments whether or not they are called upon to curtail their load during times of peak demand. Refer to Section 7 for additional information on this program.

Additional information on relevant incentive programs is located in Section 8. You may also check the following website for more details: www.njcleanenergy.com/ci

2 FACILITY INFORMATION AND EXISTING CONDITIONS

2.1 Project Contacts

Figure 4 – Project Contacts

Name	Role	E-Mail	Phone #
Customer			
Ana Pinto	Director of Energy Management	pintoa@mail.montclair.edu	973-655-3244
TRC Energy Services			
Michael Smith	Auditor	MJSmith@trcsolutions.com	518-688-3137

2.2 General Site Information

On March 27, 2017, TRC performed an energy audit at Bohn Hall located in Montclair, New Jersey. TRC’s team met with Ana Pinto to review the facility operations and help focus our investigation on specific energy-using systems.

Bohn Hall is a 139,737 square foot facility. The building has 16 floors that include dorm rooms, lounges, and offices.

Lighting at Bohn Hall consists primarily of a mixture of T5, T8, and T12 fluorescent sources, compact fluorescent lamps (CFLs), and some incandescent fixtures, all of which are inefficient as compared to currently available alternatives. Cooling is provided a combination of packaged and split-system air-conditioning units. Steam is provided from the District Energy Plant to Bohn Hall’s mechanical room, where it is converted to heating and domestic hot water by steam to water heat exchangers. Heating hot water is distributed to the building’s radiators and heating units.

2.3 Building Occupancy

The facility is open every day for 52 weeks a year. During a typical day, the facility is occupied by approximately 500 students and staff.

Figure 5 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
Bohn Hall	Weekday	All day
Bohn Hall	Weekend	All day

2.4 Building Envelope

Bohn Hall is a 16-floor building constructed of concrete and structural steel with a masonry facade. The building has a flat built-up roof that is in good condition. The building has metal-framed single pane windows which are in good condition and show little signs of infiltration. The exterior doors are constructed of metal and glass that are in good condition.



2.5 On-Site Generation

The campus has a central cogeneration plant. The cogeneration plant uses natural gas fired turbines to produce electricity. Waste heat from the turbines is used to produce steam. The steam is delivered to some of the buildings on campus and used to produce chilled water which is delivered to some of the buildings on campus. See the campus summary report for additional information regarding the campus cogeneration plant.

Bohn Hall does not have any on-site electric generation capacity.

2.6 Energy-Using Systems

Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

Lighting System

Interior lighting is provided mostly by fixtures which contain linear fluorescent T5 and T8 lamps with electronic ballasts, T12 lamps with magnetic ballasts, and fixtures with compact fluorescent or incandescent screw-in lamps. The linear fluorescent fixtures are located in all areas of the building. Most of the fixtures are 2-lamp or 4-lamp with 2-foot and 4-foot long troffers and also some U-bend lamps. Interior lighting fixtures are mostly controlled by manually operated switches although some occupancy sensors have been installed.

Steam to Hot Water Heating System

The heating hot water (HHW) system consists of one steam to water heat exchanger in the mechanical room that receives steam from the District Energy Plant. From there, the HHW is distributed to the building's radiators and heating units. The HHW is distributed by six 7.5 hp constant speed pumps. The equipment is well-maintained in good condition.

Direct Expansion Air Conditioning System (DX)

There are seven DX systems in the building that primarily serve the 4th and 5th floor offices and classrooms. The equipment includes four split-systems and three packaged AC units. The split-systems range in cooling capacity from approximately 2 to 55 tons with efficiency ratings from 10.3 to 11.0 SEER. The packaged units range in cooling capacity from approximately 1 to 26 tons with efficiency ratings from 11.0 to 12.7 SEER

All of the equipment is approximately 12 years old and in good condition.

Domestic Water Heating System

DHW for the building is provided by three AERCO steam to water heat exchangers. The water is distributed by one constant speed pump. The equipment is in good condition.

Building Plug Load

The facility plug loads include refrigerators, and washers and dryers on each floor. There are also two refrigerated and one non-refrigerated vending machines on site. Due to the nature of the use of the facility, TRC also added a factor of 0.75 w/sf to account for residents' miscellaneous electronics.

2.7 Water-Using Systems

There are approximately 600 dorm room bathrooms and common restrooms at this facility. Aerator flow rates in the facility were found to average 2.2 gallons per minute (gpm). Showerhead flow rates were measured to average 2.5 gpm.

3 SITE ENERGY USE AND COSTS

This building receives electricity through a master meter. It also receives electricity and steam from the campus central cogeneration plant. These utilities were prorated for individual buildings based on building size and function.

Prorated utility data were evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 3.4 for additional information.

3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

Figure 6 - Utility Summary

Utility Summary for Bohn Hall		
Fuel	Usage	Cost
Electricity	2,172,132 kWh	\$148,648
Steam	11,558 kLbs	\$230,980
Total		\$379,628

The current annual energy cost for this facility is \$379,628 as shown in the chart below.

Figure 7 - Energy Cost Breakdown

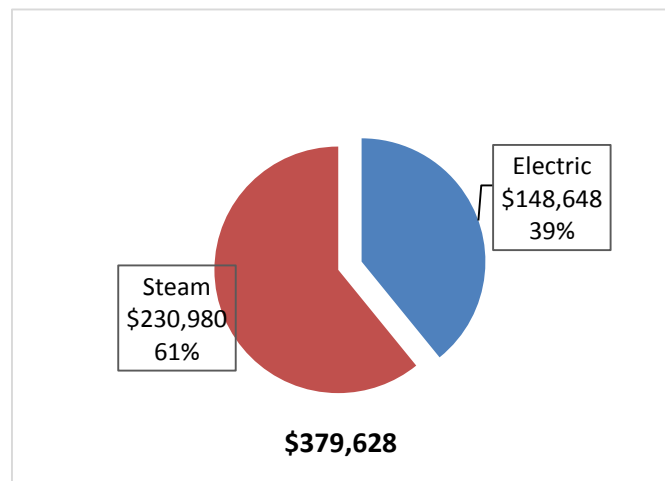

3.2 Electricity Usage

Electricity is provided by PSE&G and the campus cogeneration plant. The average cost for electricity purchased from PSE&G was \$0.168/kWh, which is the blended rate that includes energy supply, distribution, and other charges. This rate is used throughout the analyses in this report to assess energy costs and savings.

Demand data (kW) is absent from the table below because it was not provided for the electric cogeneration plant, therefore, kW totals would be incomplete for this facility. The monthly electricity consumption is shown in the chart below.

Figure 8 - Electric Usage & Demand

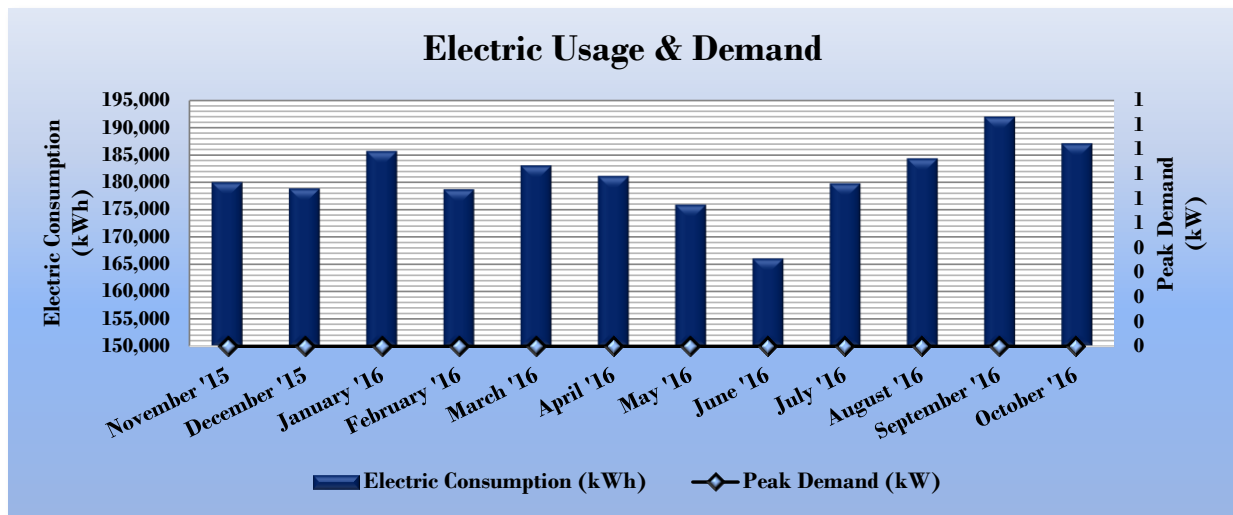


Figure 9 - Electric Usage & Demand

Electric Billing Data for Bohn Hall			
Period Ending	Days in Period	Electric Usage (kWh)	Total Electric Cost
11/30/15	30	179,945	\$10,608
12/31/15	31	178,828	\$13,435
1/31/16	31	185,668	\$11,058
2/28/16	28	178,642	\$25,657
3/31/16	31	183,031	\$10,278
4/30/16	30	181,085	\$10,257
5/31/16	31	175,856	\$10,040
6/30/16	30	166,051	\$10,805
7/31/16	31	179,738	\$11,426
8/31/16	31	184,312	\$12,122
9/30/16	30	191,929	\$11,827
10/31/16	31	187,047	\$11,136
Totals	365	2,172,132	\$148,648
Annual	365	2,172,132	\$148,648

3.3 Steam Usage

Steam is provided by Campus CHP. The average steam cost for the past 12 months is \$19.984/kLb, which is the blended rate used throughout the analyses in this report. The steam consumption is shown in the table below.

Figure 10 –Steam Usage

Steam Billing Data for Bohn Hall			
Period Ending	Days in Period	Steam Usage (kLbs)	Fuel Cost
11/30/15	30	764	\$12,776
12/31/15	31	1,025	\$17,266
1/31/16	31	1,457	\$24,939
2/28/16	28	1,314	\$59,741
3/31/16	31	1,098	\$18,292
4/30/16	30	899	\$14,805
5/31/16	31	683	\$11,674
6/30/16	30	666	\$11,081
7/31/16	31	857	\$14,156
8/31/16	31	895	\$14,795
9/30/16	30	880	\$14,474
10/31/16	31	1,020	\$16,981
Totals	365	11,558	\$230,980
Annual	365	11,558	\$230,980

3.4 Benchmarking

This facility was benchmarked using Portfolio Manager, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

Figure 11 - Energy Use Intensity Comparison – Existing Conditions

Energy Use Intensity Comparison - Existing Conditions		
	Bohn Hall	National Median Building Type: Higher Education - Public
Source Energy Use Intensity (kBtu/ft ²)	285.1	262.6
Site Energy Use Intensity (kBtu/ft ²)	151.8	130.7

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

Figure 12 - Energy Use Intensity Comparison – Following Installation of Recommended Measures

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	Bohn Hall	National Median Building Type: Higher Education - Public
Source Energy Use Intensity (kBtu/ft ²)	243.3	262.6
Site Energy Use Intensity (kBtu/ft ²)	134.6	130.7

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide and may be eligible for ENERGY STAR® certification.

As the electric and gas accounts were shared between various buildings, it was not possible to benchmark these buildings and provide a score individually. A campus wide Portfolio Manager Statement of Energy Performance (SEP) was generated.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 13 - Energy Balance (% and kBtu/SF)

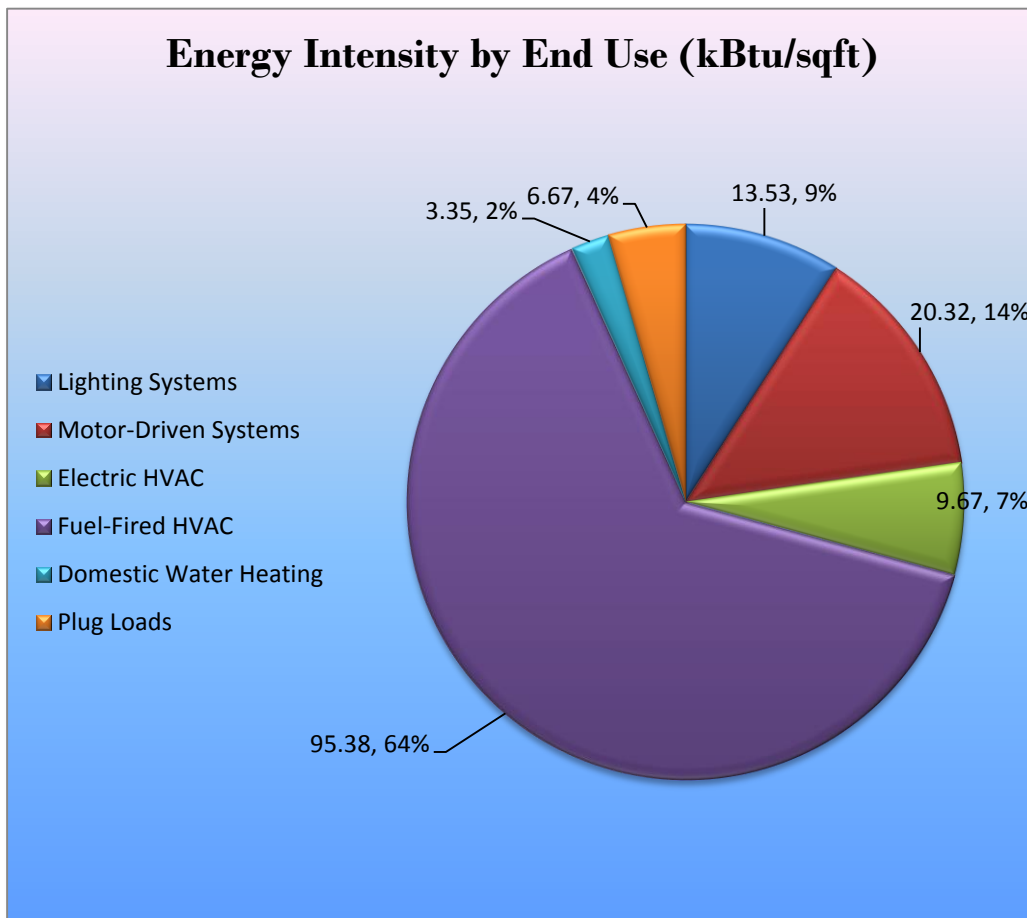

4 ENERGY CONSERVATION MEASURES

Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to the Bohn Hall regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

4.1 High Priority ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 14 – Summary of High Priority ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		372,932	41.3	0.0	\$62,652.65	\$110,855.57	\$9,470.00	\$101,385.57	1.6	375,540
ECM 1	Install LED Fixtures	790	0.2	0.0	\$132.65	\$1,499.40	\$10.00	\$1,489.40	11.2	795
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	130,562	9.8	0.0	\$21,934.39	\$37,752.67	\$2,425.00	\$35,327.67	1.6	131,475
ECM 3	Retrofit Fixtures with LED Lamps	237,376	31.0	0.0	\$39,879.20	\$62,999.11	\$7,035.00	\$55,964.11	1.4	239,036
ECM 4	Install LED Exit Signs	4,205	0.3	0.0	\$706.41	\$8,604.40	\$0.00	\$8,604.40	12.2	4,234
Lighting Control Measures		29,340	2.4	0.0	\$4,929.10	\$18,780.00	\$1,880.00	\$16,900.00	3.4	29,545
ECM 5	Install Occupancy Sensor Lighting Controls	18,307	1.5	0.0	\$3,075.58	\$11,880.00	\$1,540.00	\$10,340.00	3.4	18,435
ECM 6	Install Daylight Dimming Controls	422	0.1	0.0	\$70.95	\$500.00	\$340.00	\$160.00	2.3	425
ECM 7	Install High/Low Lighting Controls	10,611	0.8	0.0	\$1,782.57	\$6,400.00	\$0.00	\$6,400.00	3.6	10,685
Motor Upgrades		7,350	0.8	0.0	\$1,234.79	\$6,599.07	\$0.00	\$6,599.07	5.3	7,401
ECM 8	Premium Efficiency Motors	7,350	0.8	0.0	\$1,234.79	\$6,599.07	\$0.00	\$6,599.07	5.3	7,401
Variable Frequency Drive (VFD) Measures		31,860	4.4	0.0	\$5,352.49	\$14,952.48	\$2,660.00	\$12,292.48	2.3	32,083
ECM 9	Install VFDs on Constant Volume (CV) HVAC	31,860	4.4	0.0	\$5,352.49	\$14,952.48	\$2,660.00	\$12,292.48	2.3	32,083
HVAC System Improvements		0	0.0	115.0	\$1,925.06	\$870.00	\$0.00	\$870.00	0.5	16,837
ECM 10	Install Pipe Insulation	0	0.0	115.0	\$1,925.06	\$870.00	\$0.00	\$870.00	0.5	16,837
Domestic Water Heating Upgrade		0	0.0	773.2	\$12,940.82	\$57,882.00	\$0.00	\$57,882.00	4.5	113,185
ECM 11	Install Low-Flow Domestic Hot Water Devices	0	0.0	773.2	\$12,940.82	\$57,882.00	\$0.00	\$57,882.00	4.5	113,185
Plug Load Equipment Control - Vending Machine		3,163	0.0	0.0	\$531.42	\$690.00	\$0.00	\$690.00	1.3	3,185
ECM 12	Vending Machine Control	3,163	0.0	0.0	\$531.42	\$690.00	\$0.00	\$690.00	1.3	3,185
TOTALS		444,646	48.9	888.2	\$89,566.34	\$210,629.13	\$14,010.00	\$196,619.13	2.2	577,777

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

4.1.1 Lighting Upgrades

Our recommendations for upgrades to existing lighting fixtures are summarized in Figure 15 below.

Figure 15 – Summary of Lighting Upgrade ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		372,932	41.3	0.0	\$62,652.65	\$110,855.57	\$9,470.00	\$101,385.57	1.6	375,540
ECM 1	Install LED Fixtures	790	0.2	0.0	\$132.65	\$1,499.40	\$10.00	\$1,489.40	11.2	795
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	130,562	9.8	0.0	\$21,934.39	\$37,752.67	\$2,425.00	\$35,327.67	1.6	131,475
ECM 3	Retrofit Fixtures with LED Lamps	237,376	31.0	0.0	\$39,879.20	\$62,999.11	\$7,035.00	\$55,964.11	1.4	239,036
ECM 4	Install LED Exit Signs	4,205	0.3	0.0	\$706.41	\$8,604.40	\$0.00	\$8,604.40	12.2	4,234

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 1: Install LED Fixtures

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0
Exterior	790	0.2	0.0	\$132.65	\$1,499.40	\$10.00	\$1,489.40	11.2	795

Measure Description

We recommend replacing existing fixtures containing HID lamps with new high- performance LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	130,562	9.8	0.0	\$21,934.39	\$37,752.67	\$2,425.00	\$35,327.67	1.6	131,475
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

Measure Description

We recommend retrofitting existing fluorescent fixtures by removing T12 fluorescent tubes and ballasts and replacing them with LEDs and LED drivers (if necessary), which are designed to be used retrofitted fluorescent fixtures. The measure uses the existing fixture housing but replaces the rest of the components with more efficient lighting technology. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of fluorescent tubes.

ECM 3: Retrofit Fixtures with LED Lamps

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	233,955	30.3	0.0	\$39,304.42	\$62,120.05	\$6,945.00	\$55,175.05	1.4	235,591
Exterior	3,421	0.7	0.0	\$574.79	\$879.06	\$90.00	\$789.06	1.4	3,445

Measure Description

We recommend retrofitting existing T5, T8, incandescent, and compact fluorescent lighting technologies with LED lamps. Many LED tube lamps are direct replacements for existing fluorescent lamps and can be installed while leaving the fluorescent fixture ballast in place. LED bulbs can be used in existing fixtures as a direct replacement for most other lighting technologies. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of fluorescent tubes and more than 10 times longer than many incandescent lamps.

ECM 4: Install LED Exit Signs

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	4,205	0.3	0.0	\$706.41	\$8,604.40	\$0.00	\$8,604.40	12.2	4,234
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

Measure Description

We recommend replacing all incandescent or compact fluorescent exit signs with LED exit signs. LED exit signs require virtually no maintenance and have a life expectancy of at least 20 years. This measure saves energy by installing LED fixtures, which use less power than other technologies with an equivalent lighting output.

4.1.2 Lighting Control Measures

Our recommendations for lighting control measures are summarized in Figure 16 below.

Figure 16 – Summary of Lighting Control ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		29,340	2.4	0.0	\$4,929.10	\$18,780.00	\$1,880.00	\$16,900.00	3.4	29,545
ECM 5	Install Occupancy Sensor Lighting Controls	18,307	1.5	0.0	\$3,075.58	\$11,880.00	\$1,540.00	\$10,340.00	3.4	18,435
ECM 6	Install Daylight Dimming Controls	422	0.1	0.0	\$70.95	\$500.00	\$340.00	\$160.00	2.3	425
ECM 7	Install High/Low Lighting Controls	10,611	0.8	0.0	\$1,782.57	\$6,400.00	\$0.00	\$6,400.00	3.6	10,685

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 5: Install Occupancy Sensor Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
18,307	1.5	0.0	\$3,075.58	\$11,880.00	\$1,540.00	\$10,340.00	3.4	18,435

Measure Description

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in restrooms, lounges, offices, and laundry rooms. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 6: Install Daylight Dimming Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
422	0.1	0.0	\$70.95	\$500.00	\$340.00	\$160.00	2.3	425

Measure Description

We recommend installing daylight dimming controls that use photosensors to reduce electric lighting in areas when ample daylight lighting is present. Photosensor controls are recommended for fixtures that are adjacent to windows that receive lots of sunlight. As sunlight level increase in the room, fixture lighting is decreased or turned off. This measure reduces energy use in spaces where sufficient lighting levels can be met by ambient daylight.

Optimum light levels and the method of dimming should be determined during lighting design. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 7: Install High/Low Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
10,611	0.8	0.0	\$1,782.57	\$6,400.00	\$0.00	\$6,400.00	3.6	10,685

Measure Description

We recommend installing occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons. Typical areas for such lighting control are hallways.

Lighting fixtures with these controls operate at default low levels when the area is not occupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. The lighting systems are switched to full lighting levels whenever an occupant is detected. Fixtures are automatically switched back to low level after an area has been vacant for a preset period of time. Energy savings results from only providing full lighting levels when it is required.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage needs to be provided to ensure that lights turn on in each area as an occupant approaches.

Additional savings from reduced lighting maintenance may also result from this measure, due to reduced lamp operation.

4.1.3 Motor Upgrades

Our recommendations for motor upgrades are summarized in Figure 17 below.

Figure 17 – Summary of Motor Upgrade ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Motor Upgrades	7,350	0	0	0.8	0.0	\$1,234.79	\$6,599.07	\$0.00	\$6,599.07	5.3	7,401
ECM 8 Premium Efficiency Motors	7,350			0.8	0.0	\$1,234.79	\$6,599.07	\$0.00	\$6,599.07	5.3	7,401

ECM 8: Premium Efficiency Motors

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
7,350	0.8	0.0	\$1,234.79	\$6,599.07	\$0.00	\$6,599.07	5.3	7,401

Measure Description

We recommend replacing standard efficiency motors with IHP 2014 efficiency motors. Our evaluation assumes that existing motors will be replaced with motors of equivalent size and type. Although occasionally additional savings can be achieved by downsizing motors to better meet the motor's current load requirements. The base case motor efficiencies are estimated from nameplate information and our best estimates of motor run hours. Efficiencies of proposed motor upgrades are obtained from the New Jersey's Clean Energy Program Protocols to Measure Resource Savings (2016). Savings are based on the difference between baseline and proposed efficiencies and the assumed annual operating hours.

4.1.4 Variable Frequency Drive Measures

Our recommendations for variable frequency drive (VFD) measures are summarized in Figure 18 below.

Figure 18 – Summary of Variable Frequency Drive ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures	31,860	4.4	0.0	\$5,352.49	\$14,952.48	\$2,660.00	\$12,292.48	2.3	32,083
ECM 9 Install VFDs on Constant Volume (CV) HVAC	31,860	4.4	0.0	\$5,352.49	\$14,952.48	\$2,660.00	\$12,292.48	2.3	32,083

ECM 9: Install VFDs on Constant Volume (CV) HVAC

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
31,860	4.4	0.0	\$5,352.49	\$14,952.48	\$2,660.00	\$12,292.48	2.3	32,083

Measure Description

We recommend installing variable frequency drives (VFDs) to control supply fan motor speeds to convert a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor, if the air handler has one. Zone thermostats will cause the VFD to modulate fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature. Energy savings results from reducing fan speed (and power) when there is a reduced load required for the zone. The magnitude of energy savings is based on the estimated amount of time that fan motors operate at partial load.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing will have to be determined during the final project design. The control system should be programmed to maintain the minimum air flow whenever the compressor is operating.

4.1.5 HVAC System Upgrades

Our recommendation for HVAC system improvement are summarized in Figure 19 below.

Figure 19 - Summary of HVAC System Improvement ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
HVAC System Improvements	0	0.0	115.0	\$1,925.06	\$870.00	\$0.00	\$870.00	0.5	16,837
ECM 10 Install Pipe Insulation	0	0.0	115.0	\$1,925.06	\$870.00	\$0.00	\$870.00	0.5	16,837

ECM 10: Install Pipe Insulation

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	115.0	\$1,925.06	\$870.00	\$0.00	\$870.00	0.5	16,837

Measure Description

We recommend installing insulation on heating system piping. Distribution system losses are dependent on heating water system temperature, the size of the distribution system, and the level of insulation of the piping. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is exposed to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated system efficiency can be significantly reduced.

This measure saves energy by reducing heat losses from the heating distribution system.

4.1.6 Domestic Hot Water Heating System Upgrades

Our recommendations for domestic water heating system improvements are summarized in Figure 20 below.

Figure 20 - Summary of Domestic Water Heating ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade	0	0.0	773.2	\$12,940.82	\$57,882.00	\$0.00	\$57,882.00	4.5	113,185
ECM 11 Install Low-Flow Domestic Hot Water Devices	0	0.0	773.2	\$12,940.82	\$57,882.00	\$0.00	\$57,882.00	4.5	113,185

ECM 11: Install Low-Flow DHW Devices

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	773.2	\$12,940.82	\$57,882.00	\$0.00	\$57,882.00	4.5	113,185

Measure Description

We recommend installing low-flow domestic hot water devices to reduce overall hot water demand. Energy demand from domestic hot water heating systems can be reduced by reducing water usage in general. Faucet aerators and low-flow showerheads can reduce hot water usage, relative to standard showerheads and aerators, which saves energy. Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. This reduces the amount of water used per day resulting in energy and water savings.

4.1.7 Plug Load Equipment Control - Vending Machines

Our recommendations for plug load equipment controls are summarized in Figure 21 below.

Figure 21 - Summary of Domestic Water Heating ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Plug Load Equipment Control - Vending Machine	3,163	0	0	0.0	0.0	\$531.42	\$690.00	\$0.00	\$690.00	1.3	3,185
ECM 12 Vending Machine Control	3,163			0.0	0.0	\$531.42	\$690.00	\$0.00	\$690.00	1.3	3,185

ECM 12: Vending Machine Control

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
3,163	0.0	0.0	\$531.42	\$690.00	\$0.00	\$690.00	1.3	3,185

Measure Description

Vending machines operate continuously, even during non-business hours. It is recommended to install occupancy sensor controls to reduce the energy use. These controls power down vending machines when the vending machine area has been vacant for some time, then power up at regular intervals, as needed, to turn machine lights on or keep the product cool. Energy savings are dependent on vending machine and activity level in the area surrounding the machines.

5 ENERGY EFFICIENT PRACTICES

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

Reduce Air Leakage

Air leakage, or infiltration, occurs when outside air enters a building uncontrollably through cracks and openings. Properly sealing such cracks and openings can significantly reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. This includes caulking or installing weather stripping around leaky doors and windows allowing for better control of indoor air quality through controlled ventilation.

Close Doors and Windows

Ensure doors and windows are closed in conditioned spaces. Leaving doors and windows open leads to a significant increase in heat transfer between conditioned spaces and the outside air. Reducing a facility's air changes per hour (ACH) can lead to increased occupant comfort as well as significant heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Use Window Treatments/Coverings

A substantial amount of heat gain can occur through uncovered or untreated windows, especially older single pane windows and east or west-facing windows. Treatments such as high-reflectivity films or covering windows with shades or shutters can reduce solar heat gain and, consequently, cooling load and can reduce internal heat loss and the associated heating load.

Perform Proper Lighting Maintenance

In order to sustain optimal lighting levels, lighting fixtures should undergo routine maintenance. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust on lamps, fixtures and reflective surfaces. Together, these factors can reduce total illumination by 20% - 60% or more, while operating fixtures continue drawing full power. To limit this reduction, lamps, reflectors and diffusers should be thoroughly cleaned of dirt, dust, oil, and smoke film buildup approximately every 6 – 12 months.

Develop a Lighting Maintenance Schedule

In addition to routine fixture cleaning, development of a maintenance schedule can both ensure maintenance is performed regularly and can reduce the overall cost of fixture re-lamping and re-ballasting. By re-lamping and re-ballasting fixtures in groups, lighting levels are better maintained and the number of site visits by a lighting technician or contractor can be minimized, decreasing the overall cost of maintenance.

Turn Off Unneeded Motors

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Reducing run hours for these motors can result in significant energy savings. Whenever possible, use automatic devices such as twist timers or occupancy sensors to ensure that motors are turned off when not needed.

Reduce Motor Short Cycling

Frequent stopping and starting of motors subjects rotors and other parts to substantial stress. This can result in component wear, reducing efficiency, and increasing maintenance costs. Adjust the load on the motor to limit the amount of unnecessary stopping and starting to improve motor performance.

Ensure Economizers are Functioning Properly

Economizers, when properly configured, can be used to significantly reduce mechanical cooling. However, if the outdoor thermostat or enthalpy control is malfunctioning or the damper is stuck or improperly adjusted, benefits from the economizer may not be fully realized. As such, periodic inspection and maintenance is required to ensure proper operation. This maintenance should be scheduled with maintenance of the facility's air conditioning system and should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position. A malfunctioning economizer can significantly increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air.

Clean Evaporator/Condenser Coils on AC Systems

Dirty evaporators and condensers coils cause a restriction to air flow and restrict heat transfer. This results in increased evaporator and condenser fan load and a decrease in cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

Clean and/or Replace HVAC Filters

Air filters work to reduce the amount of indoor air pollution and increase occupant comfort. Over time, filters become less and less effective as particulate buildup increases. In addition to health concerns related to clogged filters, filters that have reached saturation also restrict air flow through the facility's air conditioning or heat pump system, increasing the load on the distribution fans and decreasing occupant comfort levels. Filters should be checked monthly and cleaned or replaced when appropriate.

Repair/Replace Steam Traps

Properly functioning steam traps ensure that all latent heat in the steam is delivered to the end use by preventing pressurized steam from leaking. Steam traps should be inspected as part of the regular steam system maintenance. Traps that are blocked, venting, or allowing steam to leak through should be repaired or replaced. Repairing or replacing existing steam traps will reduce steam losses.

Perform Maintenance on Compressed Air Systems

Like all electro-mechanical equipment, compressed air systems require periodic maintenance to operate at peak efficiency. A maintenance plan should be developed for process related compressed air systems to include inspection, cleaning, and replacement of inlet filter cartridges, cleaning of drain traps, daily inspection of lubricant levels to reduce unwanted friction, inspection of belt condition and tension, checking for system leaks and adjustment of loose connections, and overall system cleaning. Contact a qualified technician for help with setting up periodic maintenance schedule.

Plug Load Controls

There are a variety of ways to limit the energy use of plug loads including increasing occupant awareness, removing under-utilized equipment, installing hardware controls, and using software controls. Some control steps to take are to enable the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips. For additional information refer to “Plug Load Best Practices Guide” <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

Water Conservation

Installing low-flow faucets or faucet aerators, low-flow showerheads, and kitchen sink pre-rinse spray valves saves both energy and water. These devices save energy by reducing the overall amount of hot water used hence reducing the energy used to heat the water. The flow ratings for EPA WaterSense™ (<http://www3.epa.gov/watersense/products>) labeled devices are 1.5 gpm for bathroom faucets, 2.0 gpm for showerheads, and 1.28 gpm for pre-rinse spray valves.

Installing dual flush or low-flow toilets and low-flow or waterless urinals are additional ways to reduce the sites water use, however, these devices do not provide energy savings at the site level. Any reduction in water use does however ultimately reduce grid level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users. The EPA WaterSense™ ratings for urinals is 0.5 gallons per flush (gpf) and toilets that use as little as 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

Refer to Section 4.1.6 for any low-flow ECM recommendations.

6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey's Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State's electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility's electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

A preliminary screening based on the campus' electric demand and the size and location of free areas on campus was performed and is addressed in the campus level summary report.

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.

The campus has a CHP plant that uses natural gas fired turbines to generate electricity. Waste heat from the turbines is used to produce steam which is either delivered to buildings on campus or used to produce chilled water which is delivered to buildings on campus. Since the campus has a CHP that serves a significant portion of the campus further evaluation of individual building CHP applications were not done.

7 DEMAND RESPONSE

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

In our opinion this building is not a good candidate for DR.

8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 22 for a list of the eligible programs identified for each recommended ECM.

Figure 22 - ECM Incentive Program Eligibility

Energy Conservation Measure		SmartStart Prescriptive	Pay For Performance Existing Buildings
ECM 1	Install LED Fixtures	X	X
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	X	X
ECM 3	Retrofit Fixtures with LED Lamps	X	X
ECM 4	Install LED Exit Signs		X
ECM 5	Install Occupancy Sensor Lighting Controls	X	X
ECM 6	Install Daylight Dimming Controls		X
ECM 7	Install High/Low Lighting Controls		X
ECM 8	Premium Efficiency Motors		X
ECM 9	Install VFDs on Constant Volume (CV) HVAC	X	X
ECM 10	Install Pipe Insulation		X
ECM 11	Install Low-Flow Domestic Hot Water Devices		X
ECM 12	Vending Machine Control		X

SmartStart is generally well-suited for implementation of individual measures or small group of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. The Pay for Performance (P4P) program is a “whole-building” energy improvement program designed for larger facilities. It requires implementation of multiple measures meeting minimum savings thresholds, as well as use of pre-approved consultants. This facility does not meet all of the criteria for participating in the P4P program based on the measures identified in this study. However, since additional measures may be identified during the P4P evaluation and the facility is close to meeting the P4P program criteria it is worth considering the P4P program for this site.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: www.njcleanenergy.com/ci.

8.1 SmartStart

Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom Measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: www.njcleanenergy.com/SSB.

8.2 Pay for Performance - Existing Buildings

Overview

The Pay for Performance – Existing Buildings (P4P EB) program is designed for larger customers with a peak demand over 200 kW in any of the preceding 12 months. Under this program the minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings. P4P is a generally a good option for medium to large sized facilities looking to implement as many measures as possible under a single project in order to achieve deep energy savings. This program has an added benefit of evaluating a broad spectrum of measures that may not otherwise qualify under other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also utilize the P4P program.

Incentives

Incentives are calculated based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

To participate in the P4B EB program you will need to contact one of the pre-approved consultants and contractors (“Partners”). Under direct contract to you, the Partner will help further evaluate the measures identified in this report through development of the Energy Reduction Plan (ERP), assist you in implementing selected measures, and verify actual savings one year after the installation. At each of these three milestones your Partner will also facilitate securing program incentives.

Approval of the final scope of work is required by the program prior to installation completion. Although installation can be accomplished by a contractor of your choice (some P4P Partners are also contractors) or by internal personnel, the Partner must remain involved to ensure compliance with the program guidelines and requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: www.njcleanenergy.com/P4P.

8.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third party supplier, consider shopping for a reduced rate from third party electric suppliers. If your facility is purchasing electricity from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third party supplier, consider shopping for a reduced rate from third party natural gas suppliers. If your facility is purchasing natural gas from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

Appendix A: Equipment Inventory & Recommendations

Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Writing Center - 551	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	2,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,000	0.04	124	0.0	\$20.83	\$117.00	\$20.00	4.66
Writing Center - 552	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	2,000	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,000	0.07	214	0.0	\$35.94	\$175.50	\$30.00	4.05
Writing Center - 553	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	2,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,000	0.05	143	0.0	\$23.96	\$117.00	\$20.00	4.05
Writing Center - 554	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	2,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,000	0.02	71	0.0	\$11.98	\$58.50	\$10.00	4.05
Writing Center - Open Area	37	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	60	2,400	Relamp	Yes	37	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,680	1.08	4,054	0.0	\$681.10	\$2,434.50	\$405.00	2.98
Writing Center - Side Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	500	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.02	19	0.0	\$3.19	\$58.50	\$10.00	15.21
Writing Center - Men's Room	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	33	2,400	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.01	44	0.0	\$7.42	\$48.20	\$10.00	5.15
Writing Center - Women's Room	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	33	2,400	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.01	44	0.0	\$7.42	\$48.20	\$10.00	5.15
Exterior	2	Compact Fluorescent: Surface Mounted CFL	Wall Switch	52	3,000	Relamp	No	2	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	36	3,000	0.02	108	0.0	\$18.08	\$87.91	\$0.00	4.86
Canopy	15	Incandescent: Screw In	Wall Switch	75	3,000	Relamp	Yes	15	LED Screw-In Lamps: LED screw-in 1L	Daylight Dimming	11	1,500	0.77	3,590	0.0	\$603.15	\$909.30	\$750.00	0.26
Canopy	3	Incandescent: Screw In	Wall Switch	60	3,000	Relamp	No	3	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	3,000	0.11	528	0.0	\$88.68	\$131.86	\$15.00	1.32
Exterior	2	High-Pressure Sodium: (1) 150W Lamp	Wall Switch	188	3,000	Fixture Replacement	Yes	2	LED - Fixtures: Outdoor Porch Wall Mount	Daylight Dimming	56	1,500	0.24	1,103	0.0	\$185.24	\$1,749.40	\$100.00	8.90
Entry Vestibule	10	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	Yes	10	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,132	0.29	3,919	0.0	\$658.36	\$832.00	\$0.00	1.26
Entry Vestibule	8	Incandescent: Screw In	Wall Switch	60	8,760	Relamp	Yes	8	LED Screw-In Lamps: LED screw-in 1L	High/Low Control	9	6,132	0.32	4,328	0.0	\$727.07	\$551.62	\$40.00	0.70
Entry	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	Yes	15	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,132	0.43	5,878	0.0	\$987.53	\$1,348.00	\$0.00	1.37
Entry	6	Incandescent: Screw In	Wall Switch	60	8,760	Relamp	Yes	6	LED Screw-In Lamps: LED screw-in 1L	High/Low Control	9	6,132	0.24	3,246	0.0	\$545.30	\$463.72	\$30.00	0.80
Entry	2	Incandescent: Screw In	Wall Switch	75	8,760	Relamp	No	2	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	11	8,760	0.09	1,284	0.0	\$215.79	\$87.91	\$10.00	0.36
Lounge	16	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	Yes	16	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.46	6,253	0.0	\$1,050.48	\$1,281.20	\$35.00	1.19
Kitchenette	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.02	332	0.0	\$55.70	\$58.50	\$10.00	0.87
Elevators	12	LED Screw-In Lamps: MR16	None	5	8,736	None	No	12	LED Screw-In Lamps: MR16	None	5	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
1F Emergency Generator	7	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	200	Relamp & Reballast	No	7	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	200	0.30	95	0.0	\$15.96	\$819.00	\$70.00	46.93
Storage	2	Incandescent: Screw In	Wall Switch	60	200	Relamp	No	2	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	200	0.08	23	0.0	\$3.94	\$87.91	\$10.00	19.77
1F Hall	3	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	No	3	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	8,760	0.07	952	0.0	\$159.93	\$294.00	\$15.00	1.74
1F Hall	3	Compact Fluorescent: 3L CF Pin	Wall Switch	78	8,760	Relamp	No	3	LED Screw-In Lamps: LED plug-in 3L	Wall Switch	55	8,760	0.05	707	0.0	\$118.81	\$395.58	\$0.00	3.33
103/104/105	3	Compact Fluorescent: 2L CF Pin	Wall Switch	52	1,000	Relamp	No	3	LED Screw-In Lamps: LED plug-in 2L	Wall Switch	36	1,000	0.03	54	0.0	\$9.04	\$263.72	\$0.00	29.17

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mech Hall	3	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	3	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.04	499	0.0	\$83.78	\$280.50	\$15.00	3.17
2F Elevator Hall	4	Incandescent Screw In	Wall Switch	60	8,760	Relamp	No	4	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	8,760	0.15	2,055	0.0	\$345.26	\$175.81	\$0.00	0.51
2F Elevator Hall	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	33	8,760	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,760	0.01	161	0.0	\$27.08	\$48.20	\$10.00	1.41
Residence Room	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	8,736	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,115	0.22	2,950	0.0	\$495.54	\$650.53	\$115.00	1.08
Elevator Room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	500	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.05	38	0.0	\$6.38	\$117.00	\$20.00	15.21
Elevator Room	1	Incandescent Screw In	Wall Switch	60	500	Relamp	No	1	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	500	0.04	29	0.0	\$4.93	\$43.95	\$5.00	7.91
1F/2F/3F Stair	4	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,736	Relamp & Reballast	No	4	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,736	0.05	663	0.0	\$111.39	\$374.00	\$20.00	3.18
1F/2F/3F Stair	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	8,736	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	8,736	0.03	352	0.0	\$59.07	\$71.80	\$10.00	1.05
2F Hall	4	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	8,760	Relamp	No	4	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	8,760	0.05	705	0.0	\$118.47	\$143.60	\$20.00	1.04
2F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
2F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
3F Hall	7	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	7	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.18	2,528	0.0	\$424.72	\$886.00	\$35.00	2.00
3F Laundry	1	Compact Fluorescent Screw In	Wall Switch	33	8,736	Relamp	No	1	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	23	8,736	0.01	99	0.0	\$16.71	\$43.95	\$0.00	2.63
3F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
4F Hall	6	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	6	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.16	2,167	0.0	\$364.04	\$788.00	\$30.00	2.08
4F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
4F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
4F Hall	1	Linear Fluorescent - T8: 2' T8 (17W) - 4L	Wall Switch	63	8,760	Relamp	No	1	LED - Linear Tubes: (4) 2' Lamps	Wall Switch	34	8,760	0.02	292	0.0	\$49.08	\$76.53	\$20.00	1.15
4F Elevator Hall	32	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	32	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.84	11,557	0.0	\$1,941.56	\$4,136.00	\$160.00	2.05
Hall	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	8,760	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,760	0.08	1,128	0.0	\$189.55	\$190.27	\$40.00	0.79
Maintenance Area	2	LED Screw-In Lamps: Screw In	Wall Switch	9	8,736	None	No	2	LED Screw-In Lamps: Screw In	Wall Switch	9	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Maintenance Area	2	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,736	0.05	663	0.0	\$111.39	\$214.00	\$20.00	1.74
Locker Area	2	Linear Fluorescent - T12: 2' T12 (20W) - 4L	Wall Switch	100	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (4) 2' Lamps	Occupancy Sensor	34	6,115	0.11	1,531	0.0	\$257.22	\$557.67	\$75.00	1.88
444	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.04	583	0.0	\$97.89	\$126.40	\$0.00	1.29
444A	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.09	1,165	0.0	\$195.78	\$252.80	\$0.00	1.29

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
444 Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	8,736	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	0.07	995	0.0	\$167.09	\$150.40	\$30.00	0.72
4F/5F Stairs	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,760	0.04	584	0.0	\$98.16	\$126.40	\$0.00	1.29
4F/5F Stairs	12	LED Screw-In Lamps: Candelabra	Wall Switch	4	8,760	None	No	12	LED Screw-In Lamps: Candelabra	Wall Switch	4	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
4F/5F Stairs	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,760	0.09	1,169	0.0	\$196.32	\$252.80	\$0.00	1.29
Reslife Canopy	15	LED Screw-In Lamps: Screw In PAR 38	Wall Switch	18	8,760	None	No	15	LED Screw-In Lamps: Screw In PAR 38	Wall Switch	18	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Reslife Hall	10	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	Yes	10	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,132	0.29	3,919	0.0	\$658.36	\$832.00	\$0.00	1.26
Reslife Hall	1	LED Screw-In Lamps: Screw In PAR 30	Wall Switch	18	8,760	None	No	1	LED Screw-In Lamps: Screw In PAR 30	Wall Switch	18	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Men's Room	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.04	583	0.0	\$97.89	\$126.40	\$0.00	1.29
Men's Room	4	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,736	Relamp & Reballast	No	4	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	8,736	0.09	1,266	0.0	\$212.66	\$392.00	\$20.00	1.75
Women's Room	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.04	583	0.0	\$97.89	\$126.40	\$0.00	1.29
Women's Room	4	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,736	Relamp & Reballast	No	4	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	8,736	0.09	1,266	0.0	\$212.66	\$392.00	\$20.00	1.75
495	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	Yes	12	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.34	4,690	0.0	\$787.86	\$1,028.40	\$35.00	1.26
492	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	Yes	12	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.34	4,690	0.0	\$787.86	\$1,028.40	\$35.00	1.26
493	16	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	Yes	16	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.46	6,253	0.0	\$1,050.48	\$1,281.20	\$35.00	1.19
Res Life	8	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	Yes	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.23	3,126	0.0	\$525.24	\$775.60	\$35.00	1.41
436	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.09	1,165	0.0	\$195.78	\$252.80	\$0.00	1.29
Office Hall	18	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	Yes	18	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,132	0.52	7,054	0.0	\$1,185.04	\$1,737.60	\$0.00	1.47
438	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.09	1,165	0.0	\$195.78	\$252.80	\$0.00	1.29
439	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.09	1,165	0.0	\$195.78	\$252.80	\$0.00	1.29
439	4	Incandescent: Screw In	Wall Switch	60	8,736	Relamp	No	4	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	8,736	0.15	2,049	0.0	\$344.31	\$175.81	\$20.00	0.45
440	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.09	1,165	0.0	\$195.78	\$252.80	\$0.00	1.29
440	2	Incandescent: Screw In	Wall Switch	60	8,736	Relamp	No	2	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	8,736	0.08	1,025	0.0	\$172.16	\$87.91	\$10.00	0.45
435	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	Yes	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.17	2,345	0.0	\$393.93	\$649.20	\$35.00	1.56
429	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	8,736	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,736	0.02	332	0.0	\$55.70	\$107.00	\$10.00	1.74
430	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	8,736	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,736	0.02	332	0.0	\$55.70	\$107.00	\$10.00	1.74

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Hall	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	8,760	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,760	0.04	564	0.0	\$94.78	\$95.13	\$20.00	0.79
Hall	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.02	332	0.0	\$55.85	\$58.50	\$10.00	0.87
432	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	8,736	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.14	1,885	0.0	\$316.71	\$495.60	\$80.00	1.31
5F Side Office	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	33	8,736	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,736	0.02	321	0.0	\$54.01	\$96.40	\$20.00	1.41
5F Bathroom	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.04	583	0.0	\$97.89	\$126.40	\$0.00	1.29
5F Main Office Hall	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,760	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,760	0.04	584	0.0	\$98.16	\$126.40	\$0.00	1.29
501	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.05	663	0.0	\$111.39	\$117.00	\$20.00	0.87
501	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.02	291	0.0	\$48.95	\$63.20	\$0.00	1.29
501 Office Area	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	8,736	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.05	663	0.0	\$111.39	\$117.00	\$20.00	0.87
5F Hall	4	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	No	4	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	8,760	0.09	1,269	0.0	\$213.25	\$392.00	\$20.00	1.74
Storage Room	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
5F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
5F/6F Landing	2	LED Screw-In Lamps: PAR38	Wall Switch	18	8,760	None	No	2	LED Screw-In Lamps: PAR38	Wall Switch	18	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
5F/6F Landing	2	LED Screw-In Lamps: Screw In	Wall Switch	11	8,760	None	No	2	LED Screw-In Lamps: Screw In	Wall Switch	11	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
6F Hall	4	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,760	Relamp & Reballast	No	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.17	2,377	0.0	\$399.41	\$468.00	\$40.00	1.07
6F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
6F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
6F Hall	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.04	594	0.0	\$99.85	\$117.00	\$10.00	1.07
6F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
7F Hall	13	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	13	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.34	4,695	0.0	\$788.76	\$1,674.00	\$65.00	2.04
7F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
7F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
7F Bathroom	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
7F Lounge	3	U-Bend Fluorescent - T12: U T12 (34W) - 2L	Wall Switch	72	8,736	Relamp & Reballast	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.11	1,474	0.0	\$247.60	\$621.00	\$35.00	2.37
7F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
8F Hall	13	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	13	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.34	4,695	0.0	\$788.76	\$1,674.00	\$65.00	2.04
8F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
8F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
8F Bathroom	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
8F Lounge	3	U-Bend Fluorescent - T12: U T12 (34W) - 2L	Wall Switch	72	8,736	Relamp & Reballast	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.11	1,474	0.0	\$247.60	\$621.00	\$35.00	2.37
8F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
9F Hall	13	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	13	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.34	4,695	0.0	\$788.76	\$1,674.00	\$65.00	2.04
9F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
9F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
9F Bathroom	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
9F Lounge	3	U-Bend Fluorescent - T12: U T12 (34W) - 2L	Wall Switch	72	8,736	Relamp & Reballast	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.11	1,474	0.0	\$247.60	\$621.00	\$35.00	2.37
9F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
10F Hall	13	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	13	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.34	4,695	0.0	\$788.76	\$1,674.00	\$65.00	2.04
10F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
10F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
10F Bathroom	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
10F Lounge	3	U-Bend Fluorescent - T12: U T12 (34W) - 2L	Wall Switch	72	8,736	Relamp & Reballast	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.11	1,474	0.0	\$247.60	\$621.00	\$35.00	2.37
10F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
11F Hall	11	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	11	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.29	3,973	0.0	\$667.41	\$1,478.00	\$55.00	2.13
11F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
11F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
11F Res Advisor	1	Compact Fluorescent: Circline	Wall Switch	39	8,736	Relamp	No	1	LED Screw-In Lamps: LED plug-in 1L	Wall Switch	27	8,736	0.01	118	0.0	\$19.75	\$43.95	\$0.00	2.23
11F Res Advisor	3	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	176	8,736	Relamp & Reballast	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,115	0.30	4,081	0.0	\$685.58	\$755.50	\$95.00	0.96
11F Res Advisor	1	Incandescent: Screw In	Wall Switch	60	8,736	Relamp	No	1	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	8,736	0.04	512	0.0	\$86.08	\$43.95	\$5.00	0.45
11F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
11F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
12F Hall	11	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	11	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.29	3,973	0.0	\$667.41	\$1,478.00	\$55.00	2.13
12F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
12F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
12F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
12F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
13F Hall	11	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	11	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.29	3,973	0.0	\$667.41	\$1,278.00	\$55.00	1.83
13F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
13F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
13F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
13F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
14F Hall	9	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	9	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,132	0.24	3,250	0.0	\$546.06	\$1,082.00	\$45.00	1.90
14F Study	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.09	1,185	0.0	\$199.16	\$234.00	\$20.00	1.07
14F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
14F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
15F Hall	7	Linear Fluorescent - T12: 3' T12 (30W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	7	LED - Linear Tubes: (1) 3' Lamp	High/Low Control	11	6,132	0.20	2,726	0.0	\$457.89	\$868.50	\$0.00	1.90
15F Hall	1	Linear Fluorescent - T12: 2' T12 (20W) - 1L	Wall Switch	25	8,760	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	8,760	0.01	166	0.0	\$27.93	\$93.50	\$5.00	3.17
15F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
15F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
15F Lounge	4	U-Bend Fluorescent - T12: U T12 (34W) - 2L	Wall Switch	72	8,736	Relamp & Reballast	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,115	0.14	1,965	0.0	\$330.13	\$738.00	\$35.00	2.13
16F Hall	7	Linear Fluorescent - T12: 3' T12 (30W) - 1L	Wall Switch	46	8,760	Relamp & Reballast	Yes	7	LED - Linear Tubes: (1) 3' Lamp	High/Low Control	11	6,132	0.20	2,726	0.0	\$457.89	\$868.50	\$0.00	1.90
16F Laundry	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.10	1,360	0.0	\$228.53	\$504.00	\$55.00	1.96
16F Bath	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	8,736	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.30	4,081	0.0	\$685.58	\$972.00	\$95.00	1.28
Single Dorm Rooms	32	Incandescent Screw In	Wall Switch	60	4,368	Relamp	No	32	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	4,368	1.20	8,198	0.0	\$1,377.24	\$1,406.50	\$160.00	0.91
Single Dorm Room Bath Area	32	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	22	4,368	Relamp	No	32	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	4,368	0.32	2,170	0.0	\$364.56	\$1,020.80	\$160.00	2.36

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Double and Triple Rooms	564	Incandescent Screw In	Wall Switch	60	4,368	Relamp	No	564	LED Screw-In Lamps: LED screw-in 1L	Wall Switch	9	4,368	21.17	144,487	0.0	\$24,273.87	\$24,789.49	\$2,820.00	0.91
Double and Triple Bath	564	Linear Fluorescent - T8: 2 T8 (17W) - 1L	Wall Switch	22	4,368	Relamp	No	564	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	4,368	5.60	38,247	0.0	\$6,425.44	\$17,991.60	\$2,820.00	2.36
Whole building	80	Exit Signs: Fluorescent	None	12	8,760	Fixture Replacement	No	80	LED Exit Signs: 2 W Lamp	None	6	8,760	0.35	4,836	0.0	\$812.37	\$8,604.40	\$0.00	10.59

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Building Wide	1	Air Compressor	5.0	82.0%	No	4,957	No	82.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	4th Floor	1	Supply Fan	15.0	87.0%	No	6,500	Yes	91.7%	Yes	1	2.31	17,170	0.0	\$2,884.51	\$8,027.78	\$1,200.00	2.37
Mechanical Room	4th Floor	1	Return Fan	10.0	85.0%	No	6,500	Yes	91.7%	Yes	1	1.64	12,332	0.0	\$2,071.72	\$5,151.50	\$800.00	2.10
5F Roof	5th Floor	1	Supply Fan	7.5	86.5%	No	6,500	Yes	90.2%	Yes	1	1.14	8,421	0.0	\$1,414.81	\$5,321.35	\$600.00	3.34
5F Roof	5th Floor	1	Return Fan	0.8	70.0%	No	6,500	Yes	81.1%	Yes	1	0.17	1,287	0.0	\$216.24	\$3,050.93	\$60.00	13.83
Mechanical Room	Whole Building	1	Water Supply Pump	7.5	88.5%	No	6,500	No	88.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Perimeter Heating	5	Heating Hot Water Pump	7.5	91.0%	No	6,500	No	91.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Perimeter Heating	1	Heating Hot Water Pump	7.5	91.0%	No	6,500	No	91.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Elevator Room	Whole Building	2	Other	35.0	91.0%	No	4,067	No	91.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Dorm rooms	Whole Building	200	Supply Fan	0.3	65.0%	No	6,500	No	65.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Whole Building	10	Other	0.5	82.0%	No	2,745	No	82.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives
Basement	4th Floor	1	Split-System AC	35.83		No						No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Exterior	4th Floor	2	Ductless Mini-Split AC	2.00		No						No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
5th Floor Roof	5th Floor	1	Packaged AC	26.67		No						No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
2nd Floor	AC-4-1	1	Split-System AC	55.83		No						No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
5th Floor Roof	5th Floor	2	Packaged Terminal AC	1.00		No						No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions						Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mech Room	4th Floor	1	Forced Draft Steam Boiler	8,330.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Pipe Insulation Recommendations

Location	Area(s)/System(s) Affected	Recommendation Inputs		Energy Impact & Financial Analysis						
		Length of Uninsulated Pipe (ft)	Pipe Diameter (in)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Basement	Space heating	200	4.00	0.00	0	115.0	\$1,925.06	\$870.00	\$0.00	0.45

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Basement	Whole Building	1	Indirect System	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Basement	Whole Building	1	Indirect System	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Basement	Whole Building	1	Indirect System	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Low-Flow Device Recommendations

Location	Recommendation Inputs				Energy Impact & Financial Analysis						
	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Bathrooms	600	Faucet Aerator (Lavatory)	1.20	1.00	0.00	0	204.7	\$3,425.51	\$4,302.00	\$0.00	1.26
Bathrooms	600	Showerhead	2.50	2.00	0.00	0	568.5	\$9,515.31	\$53,580.00	\$0.00	5.63

Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Dorm Rooms	1	Dorm Plug Load	104,802.8	No
Lounge	10	Refrigerator	500.0	No
Laundry room	30	Washer	900.0	Yes
Laundry room	30	Dryer	1,600.0	Yes

Vending Machine Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions	Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
5th Floor	1	Glass Fronted Refrigerated	Yes	0.00	1,209	0.0	\$203.09	\$230.00	\$0.00	1.13
5th Floor	1	Refrigerated	Yes	0.00	1,612	0.0	\$270.79	\$230.00	\$0.00	0.85
5th Floor	1	Non-Refrigerated	Yes	0.00	343	0.0	\$57.54	\$230.00	\$0.00	4.00

Appendix B: ENERGY STAR® Statement of Energy Performance


ENERGY STAR® Statement of Energy Performance



N/A

Montclair State University Campus (Buildings 1-41)

Primary Property Type: College/University
Gross Floor Area (ft²): 2,925,896
Built: 1908

For Year Ending: October 31, 2016
Date Generated: October 10, 2017

ENERGY STAR® Score¹

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address	Property Owner	Primary Contact
Montclair State University Campus (Buildings 1-41) 1 Normal Avenue Montclair, New Jersey 07043	Montclair Statet University 1 Normal Avenue Montclair, NJ 07043 973-655-3244	Ana Pinto 1 Normal Avenue Montclair, NJ 07043 973-655-3244 pintoa@montclair.edu
Property ID: 6069294		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 172.3 kBtu/ft ²	Annual Energy by Fuel		National Median Comparison
	District Chilled Water - 81,507,530 (16%)		National Median Site EUI (kBtu/ft ²) 147.6
	Other (kBtu)		National Median Source EUI (kBtu/ft ²) 262.6
	District Steam (kBtu) 223,798,259 (44%)		% Diff from National Median Source EUI 17%
	Electric - Grid (kBtu) 161,334,839 (32%)		
	Natural Gas (kBtu) 37,406,141 (7%)		
Source EUI 306.4 kBtu/ft ²	Annual Emissions		
	Greenhouse Gas Emissions (Metric Tons CO2e/year)		N/A

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

 () _____



Professional Engineer Stamp (if applicable)