



Local Government Energy Audit: Energy Audit Report



Copyright ©2017 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Conrad J. Schmitt Hall

1 Normal Ave

Montclair, New Jersey 07043

Montclair State University

July 27, 2018

Final Report by:

TRC Energy Services

Disclaimer

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

Table of Contents

1	Executive Summary.....	1
1.1	Facility Summary	1
1.2	Your Cost Reduction Opportunities.....	1
	Energy Conservation Measures.....	1
	Energy Efficient Practices	3
	On-Site Generation Measures.....	3
1.3	Implementation Planning.....	4
2	Facility Information and Existing Conditions	6
2.1	Project Contacts	6
2.2	General Site Information.....	6
2.3	Building Occupancy	6
2.4	Building Envelope	7
2.5	On-Site Generation.....	7
2.6	Energy-Using Systems	8
	Lighting System	8
	Chilled Water.....	8
	Steam to Hot Water Heating System	8
	Air Distribution System	9
	Direct Expansion Air Conditioning System (DX)	9
	Building Energy Management System (BEMS).....	10
	Domestic Hot Water Heating System.....	10
	Building Plug Load	11
3	Site Energy Use and Costs.....	12
3.1	Total Cost of Energy	12
3.2	Electricity Usage	13
3.3	Natural Gas Usage	14
3.4	Steam Usage.....	15
3.5	Chilled Water Usage	16
3.6	Benchmarking.....	17
3.7	Energy End-Use Breakdown	18
4	Energy Conservation Measures	19
4.1	High Priority ECMs.....	19
4.1.1	Lighting Upgrades.....	20
	ECM 1: Install LED Fixtures	20
	ECM 2: Retrofit Fixtures with LED Lamps.....	21
4.1.2	Lighting Control Measures	22
	ECM 3: Install Occupancy Sensor Lighting Controls	22
	ECM 4: Install High/Low Lighting Controls	23
4.1.3	Variable Frequency Drive Measures	24
	ECM 5: Install VFDs on Chilled Water Pumps.....	24

4.1.4	Plug Load Equipment Control - Vending Machines.....	25
	ECM 6: Vending Machine Control	25
5	Energy Efficient Practices	26
	Reduce Air Leakage	26
	Close Doors and Windows	26
	Perform Proper Lighting Maintenance.....	26
	Develop a Lighting Maintenance Schedule	26
	Ensure Lighting Controls Are Operating Properly	26
	Turn Off Unneeded Motors.....	27
	Perform Routine Motor Maintenance	27
	Ensure Economizers are Functioning Properly.....	27
	Clean Evaporator/Condenser Coils on AC Systems	27
	Clean and/or Replace HVAC Filters	27
	Check for and Seal Duct Leakage	27
	Repair/Replace Steam Traps	28
	Perform Proper Water Heater Maintenance	28
	Plug Load Controls.....	28
	Replace Computer Monitors	28
6	On-Site Generation Measures	29
6.1	Photovoltaic.....	29
6.2	Combined Heat and Power	30
7	Demand Response	31
8	Project Funding / Incentives	32
8.1	SmartStart	33
8.2	Pay for Performance - Existing Buildings.....	34
8.3	Energy Savings Improvement Program	35
9	Energy Purchasing and Procurement Strategies	36
9.1	Retail Electric Supply Options.....	36
9.2	Retail Natural Gas Supply Options	36

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

Table of Figures

Figure 1 – Previous 12 Month Utility Costs.....	2
Figure 2 – Potential Post-Implementation Costs	2
Figure 3 – Summary of Energy Reduction Opportunities	2
Figure 4 – Project Contacts	6
Figure 5 - Building Schedule.....	6
Figure 6 – Building Façade	7
Figure 7 - Building Lighting Systems	8
Figure 8 – Air Handling Systems.....	9
Figure 9 – DX Based Air Side Systems	9
Figure 10 – Building Energy Management System (BEMS).....	10
Figure 11 – Domestic Hot Water Heater.....	10
Figure 12 - Utility Summary	12
Figure 13 - Energy Cost Breakdown	12
Figure 14 - Electric Usage & Demand.....	13
Figure 15 - Electric Usage & Demand.....	13
Figure 16 - Natural Gas Usage.....	14
Figure 17 - Natural Gas Usage.....	14
Figure 18 – Graph of 12 Months Steam Usage	15
Figure 19 – Table of 12 Months Steam Usage	15
Figure 20 – Chilled Water Usage.....	16
Figure 21 – Chilled Water Usage.....	16
Figure 22 - Energy Use Intensity Comparison – Existing Conditions.....	17
Figure 23 - Energy Use Intensity Comparison – Following Installation of Recommended Measures	17
Figure 24 - Energy Balance (% and kBtu/SF)	18
Figure 25 – Summary of High Priority ECMs	19
Figure 26 – Summary of Lighting Upgrade ECMs.....	20
Figure 27 – Summary of Lighting Control ECMs	22
Figure 28 – Summary of Variable Frequency Drive ECMs	24
Figure 29 – Summary of Plug Load Equipment Control ECMs	25
Figure 30 - ECM Incentive Program Eligibility.....	32

I EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for Conrad J. Schmitt Hall.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist New Jersey higher education facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

I.1 Facility Summary

Conrad J. Schmitt Hall is a 53,079 square foot facility consisting of various space types such as office spaces, corridors, mechanical rooms, lobbies and was constructed in 2011.

Lighting at Conrad Schmitt Hall primarily consists of a combination of 32-Watt T8, 28-Watt T5 linear fluorescent fixtures and compact fluorescent lamps (CFL). In addition to the fluorescent fixtures, all the exit light fixtures are LED based systems. Exterior lighting is provided by a combination of T8 fluorescent lamps, incandescent, and compact fluorescent lamps (CFL) based fixtures. Lighting control is provided by occupancy sensors for interior spaces and by photocell for the exterior fixtures.

Cooling is provided by chilled water (CHW) from the District Energy Plant to facility's mechanical room, where it is distributed by pumps to the building's air handling equipment. Steam is provided from the District Energy Plant to facility's mechanical room, where it is converted to heating hot water by two (2) steam to water heat exchangers.

Cooling and ventilation are provided to the zones by a combination of air handling units and split systems.

Electricity, natural gas, steam, and chilled water are supplied to the building by the campus central cogeneration plant. A thorough description of the facility and our observations are located in Section 2.

I.2 Your Cost Reduction Opportunities

Energy Conservation Measures

TRC evaluated six (6) measures that together represent an opportunity for Conrad J. Schmitt Hall to reduce annual energy costs by \$21,385.61 and annual greenhouse gas emissions by 128,183 lbs CO₂e. We estimate that if all of these high priority measures are implemented as recommended, the project will pay for itself in 3.1 years. TRC has defined high priority measures as the evaluated measures that have a simple payback less than the typical equipment life of the proposed equipment. The breakdown of existing and potential utility costs after project implementation are illustrated in Figure 1 and Figure 2, respectively. Together these measures represent an opportunity to reduce Conrad J. Schmitt Hall's annual energy use by 4%.

Figure 1 – Previous 12 Month Utility Costs


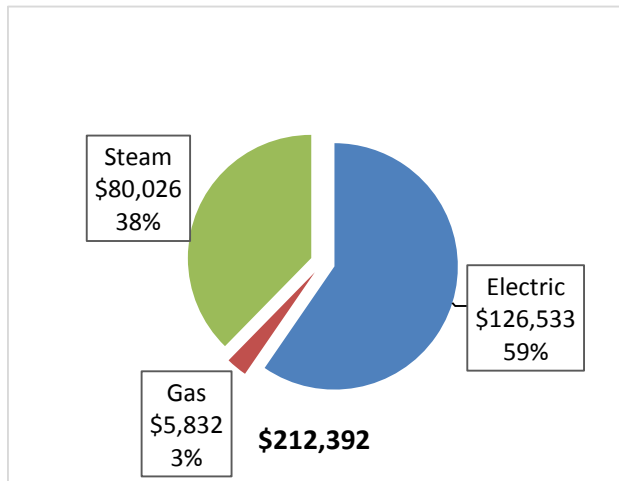


Figure 2 – Potential Post-Implementation Costs

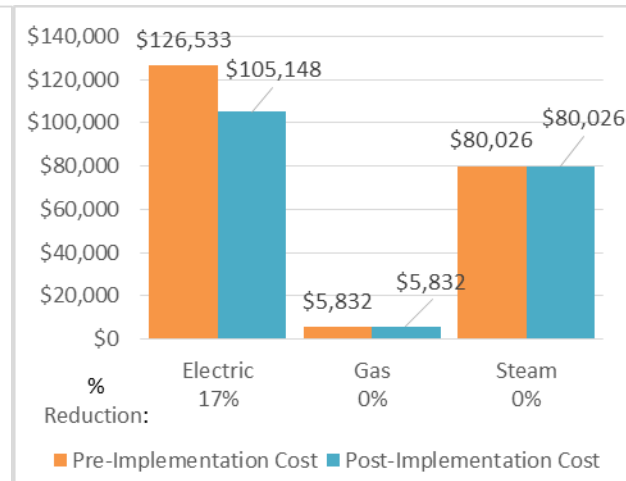

A detailed description of Conrad J. Schmitt Hall’s existing energy use can be found in Section 3.

Estimates of the total cost, energy savings, and financial incentives for the evaluated energy efficient upgrades are summarized below in Figure 3. A brief description of each category can be found below and a description of savings opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

Energy Conservation Measure	High Priority?	Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)	
Lighting Upgrades		76,295	76,295	15.3	\$12,817.62	\$59,360.01	\$7,955.00	\$51,405.01	4.0	76,829	
ECM 1	Install LED Fixtures	Yes	2,440	2,440	0.4	\$409.84	\$12,249.51	\$0.00	\$12,249.51	29.9	2,457
ECM 2	Retrofit Fixtures with LED Lamps	Yes	73,856	73,856	15.0	\$12,407.78	\$47,110.50	\$7,955.00	\$39,155.50	3.2	74,372
Lighting Control Measures		1,713	1,713	0.3	\$287.84	\$4,040.00	\$420.00	\$3,620.00	12.6	1,725	
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	1,162	1,162	0.2	\$195.27	\$3,240.00	\$420.00	\$2,820.00	14.4	1,170
ECM 4	Install High/Low Lighting Controls	Yes	551	551	0.1	\$92.57	\$800.00	\$0.00	\$800.00	8.6	555
Variable Frequency Drive (VFD) Measures		47,330	47,330	4.8	\$7,951.37	\$12,668.60	\$2,400.00	\$10,268.60	1.3	47,661	
ECM 5	Install VFDs on Chilled Water Pumps	Yes	47,330	47,330	4.8	\$7,951.37	\$12,668.60	\$2,400.00	\$10,268.60	1.3	47,661
Plug Load Equipment Control - Vending Machine		1,954	1,954	0.0	\$328.33	\$460.00	\$0.00	\$460.00	1.4	1,968	
ECM 6	Vending Machine Control	Yes	1,954	1,954	0.0	\$328.33	\$460.00	\$0.00	\$460.00	1.4	1,968
TOTALS FOR HIGH PRIORITY MEASURES		127,293	127,293	20.4	\$21,385.17	\$76,528.61	\$10,775.00	\$65,753.61	3.1	128,183	
TOTALS FOR ALL EVALUATED MEASURES		127,293	127,293	20.4	\$21,385.17	\$76,528.61	\$10,775.00	\$65,753.61	3.1	128,183	

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Lighting Upgrades generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measures save energy by reducing the power used by the lighting components due to improved electrical efficiency.

Lighting Controls measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

Variable Frequency Drives (VFDs) are motor control devices. These measures control the speed of a motor so that the motor spins at peak efficiency during partial load conditions. Sensors adapt the speed to flow, temperature, or pressure settings which is much more efficient than using a valve or damper to control flow rates, or running the motor at full speed when only partial power is needed. These measures save energy by controlling motor usage more efficiently.

Plug Load Equipment control measures generally involve installing automated devices that limit the power usage or operation of equipment that is plugged into an electric outlets when not in use.

Energy Efficient Practices

TRC also identified 15 low cost or no cost energy efficient practices. A facility's energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. Potential opportunities identified at Conrad J. Schmitt Hall include:

- Reduce Air Leakage
- Close Doors and Windows
- Perform Proper Lighting Maintenance
- Develop a Lighting Maintenance Schedule
- Ensure Lighting Controls Are Operating Properly
- Turn Off Unneeded Motors
- Perform Routine Motor Maintenance
- Ensure Economizers are Functioning Properly
- Clean Evaporator/Condenser Coils on AC Systems
- Clean and/or Replace HVAC Filters
- Check for and Seal Duct Leakage
- Repair/Replace Steam Traps
- Perform Proper Water Heater Maintenance
- Install Plug Load Controls
- Replace Computer Monitors

For details on these Energy Efficient Practices, please refer to Section 5.

On-Site Generation Measures

TRC evaluated the potential for installing on-site generation for Conrad J. Schmitt Hall. Based on the configuration of the site and its loads there is a low potential for installing any PV and combined heat and power self-generation measures.

For details on our evaluation and on-site generation potential, please refer to Section 6.

I.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Pay for Performance - Existing Building (P4P)
- Energy Savings Improvement Program (ESIP)

For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 8.

Larger facilities with an interest in a more comprehensive whole building approach to energy conservation should consider participating in the Pay for Performance (P4P) program. Projects eligible for this project program must meet minimum savings requirements. Final incentives are calculated based on actual measured performance achieved at the end of the project. The application process is more involved, and it requires working with a qualified P4P contractor, but the process may result in greater energy savings overall and more lucrative incentives, up to 50% of project's total cost.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.3 for additional information on the ESIP Program.

The Demand Response Energy Aggregator is a (non-NJCEP) program designed to reduce electric loads at commercial facilities, when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. Demand Response (DR) service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability. By enabling grid operators to call upon commercial facilities to reduce their electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and facilities receive payments whether or not they are called upon to curtail their load during times of peak demand. Refer to Section 7 for additional information on this program.

Additional information on relevant incentive programs is located in Section 8. You may also check the following website for more details: www.njcleanenergy.com/ci.

2 FACILITY INFORMATION AND EXISTING CONDITIONS

2.1 Project Contacts

Figure 4 – Project Contacts

Name	Role	E-Mail	Phone #
Customer			
Ana Pinto	Director of Energy Management	pintoa@mail.montclair.edu	973-655-3244
TRC Energy Services			
Moussa Traore	Auditor	MTraore@trcsolutions.com	(732) 855-0033

2.2 General Site Information

On July 6, 2017, TRC performed an energy audit at Conrad J. Schmitt Hall located in Montclair, New Jersey. TRC met with Ana Pinto to review the facility operations and help focus our investigation on specific energy-using systems.

Conrad J. Schmitt Hall is a 53,079 square foot facility consisting of various space types such as office spaces, corridors, mechanical rooms, lobbies, and it was constructed in 2011. Schmitt Hall has undergone a major renovation project that began in September 2010. Addition of new spaces, a new entrance tower, a new elevator on the south side of the building, and a new exterior wall system were part of the construction.

Lighting at Conrad Schmitt Hall primarily consists of a combination of 32-Watt, T8, and 28-Watt, T5 linear fluorescent fixtures and compact fluorescent lamps (CFL). In addition to the fluorescent fixtures, all the exit light fixtures are LED-based systems. Exterior lighting is provided by a combination of T8 fluorescent lamps, incandescent, and CFL-based fixtures. Lighting control is mainly provided by occupancy sensors for interior spaces and by photocell for the exterior fixtures.

Cooling is provided by chilled water (CHW) from the District Energy Plant to facility's mechanical room, where it is distributed by pumps to the building's air handling equipment. Steam is provided from the District Energy Plant to facility's mechanical room, where it is converted to heating hot water by steam to water heat exchangers.

Cooling and ventilation are provided to the zones by a combination of air handling units and split systems.

Electricity, natural gas, steam, and chilled water are supplied to the building by the campus central cogeneration plant.

2.3 Building Occupancy

The school building is open seven (7) of the week. The typical schedule is presented in the table below.

Figure 5 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
Conrad. J. Schmitt Hall	Weekday	8AM - 8PM
Conrad. J. Schmitt Hall	Weekend	8AM - 8PM

2.4 Building Envelope

Conrad Schmitt Hall is a four-story building. The construction is of concrete masonry block with finished and painted exterior and double-pane, tinted windows with fixed frames. The sloped roof is constructed of tile roofing material.

Figure 6 – Building Façade



2.5 On-Site Generation

The campus has a central cogeneration plant. The cogeneration plant uses natural gas fired turbines to produce electricity. Waste heat from the turbines is used to produce steam. The steam is delivered to some of the buildings on campus and used to produce chilled water which is delivered to some of the buildings on campus. See the campus summary report for additional information regarding the campus cogeneration plant.

Conrad J. Schmitt Hall does not have any on-site electric generation capacity.

2.6 Energy-Using Systems


Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

Lighting System

Lighting at the facility is provided mostly by 32-Watt linear fluorescent T8 lamps and 28-Watt, T5 lamps with electronic ballasts as well as CFLs. Most of the fixtures are 2-lamp or 3-lamp, 4-foot long troffers with diffusers.

Lighting control in most spaces is provided by occupancy. The occupancy sensors are either wall or ceiling mounted depending on the space layout. Stairwells areas do not contain any occupancy sensors and are controlled through manual switches.

Figure 7 - Building Lighting Systems

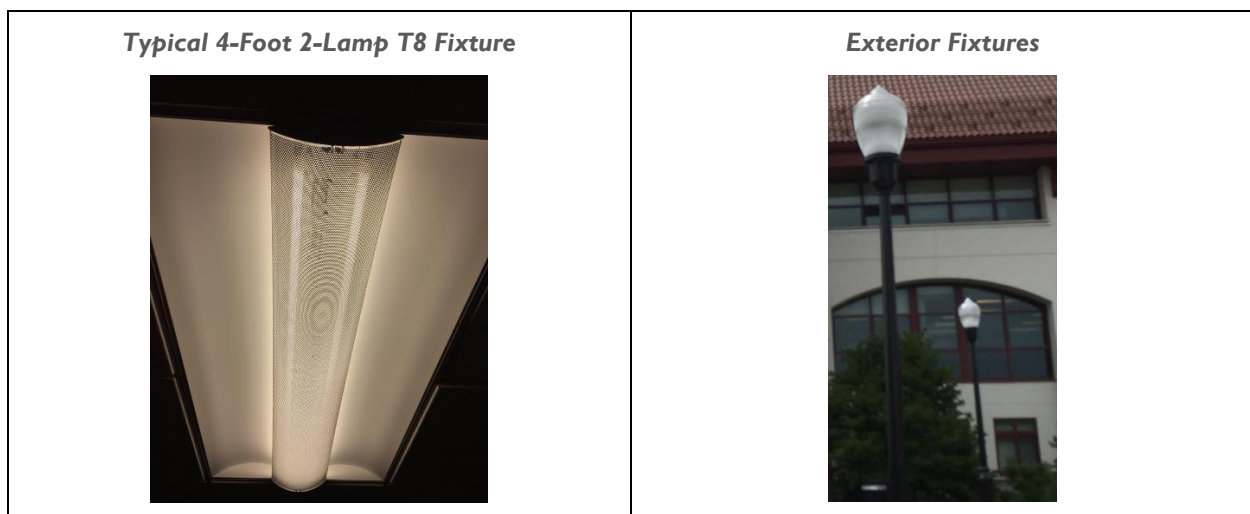

The building's exterior lighting consists primarily of incandescent 70-Watt fixtures and 25-Watt T8 fixtures. The exterior lamps that are controlled by daylight dimming controls.

Chilled Water

Chilled water (CHW) is provided from the District Energy Plant to Conrad J. Schmitt Hall's mechanical room, where it is distributed by pumps to the building's air handling equipment. The water is distributed by two (2) constant speed 20 hp pumps.

Steam to Hot Water Heating System


The heating hot water (HHW) system consists of two (2) steam to water heat exchangers in the mechanical room that receives steam from the District Energy Plant. From there, the HHW is distributed to the building's radiation system and variable air volume (VAV) reheat coils. The HHW is distributed by two (2) 15 hp hot water pumps operating at variable speed.

Air Distribution System

There are four (4) air handling units (AHU) that serve the facility. Each AHU draws air from both outside air dampers and return air dampers. Each AHU is a VAV system. Two (2) air handling units have 40 hp supply fan and 25 hp return fan each. The other two (2) air handlers have 15 hp supply fan and 15 hp return fan each. All the fans are variable speed that are controlled with VFDs. Air handling units have chilled water coils for cooling and gas furnace for heating. All the units are equipped with economizer that utilizes free cooling when the outside air temperature is less than 65°F.

Supply air temperature is set at 60°F during cooling and at 90°F during heating.

Figure 8 – Air Handling Systems

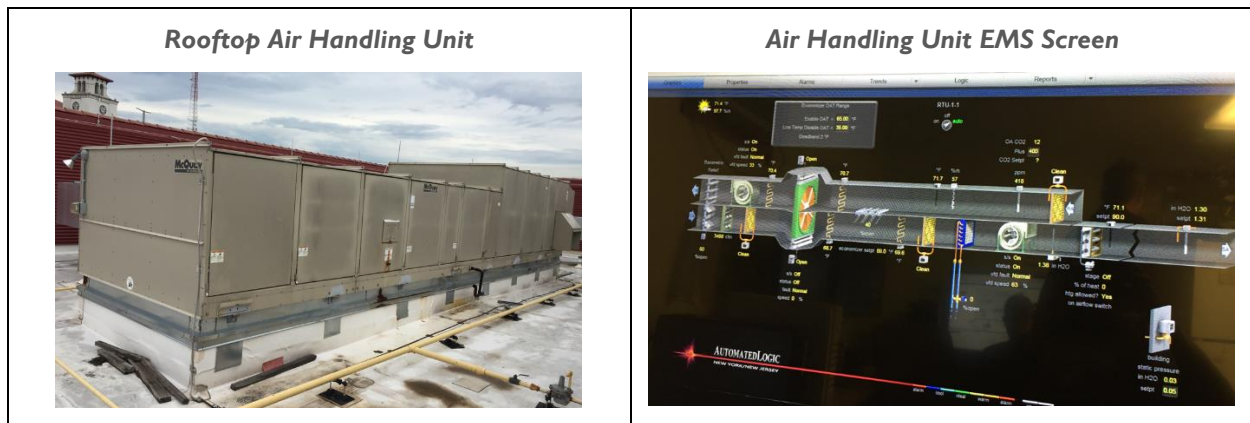

Direct Expansion Air Conditioning System (DX)

In addition to the air handling units, the facility is also served by split system heat pumps. The capacities of the systems range between 1.0 ton and 8.0 tons. The units have efficiencies between 9.68 and 12.12 EER.


Figure 9 – DX Based Air Side Systems



Building Energy Management System (BEMS)

The facility is controlled by Automated Logic Corporation's WebCTRL building energy management system (BEMS). The BEMS provides controls the air handling units, fans, pumps, and terminal units.

Figure 10 – Building Energy Management System (BEMS)

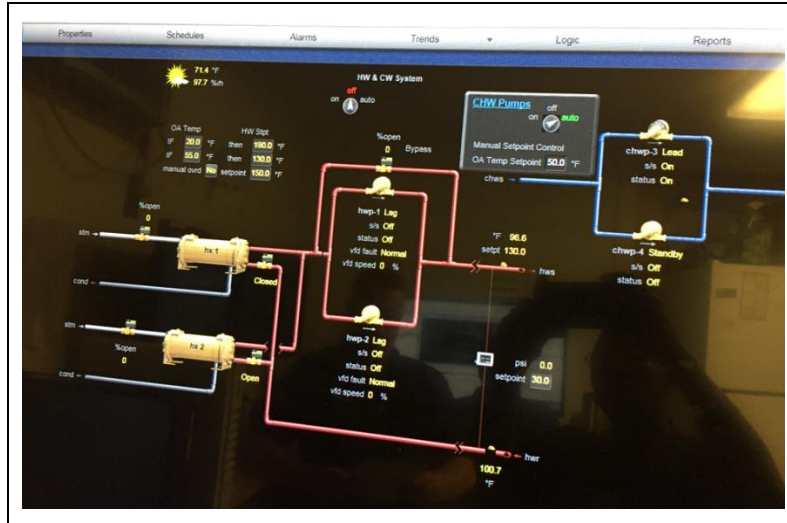

Domestic Hot Water Heating System

The domestic hot water heating system for the facility consists of one (1) A.O. Smith gas fired hot water heaters with an input rating of 150 kBtu/hr and a nominal efficiency of 87%. The water heater has a 100-gallon storage tank. Recirculation pumps distribute water to the entire site. The recirculation pumps operate continuously.

Figure 11 – Domestic Hot Water Heater



Building Plug Load

There are about 485 computer work stations throughout the facility. All the computers are desktop units with LCD monitors. There is no centralized personal computer power management software installed.

The facility contains other systems which contribute to plug load including printers, microwaves, copiers, etc. at the facility. In addition to the typical plug load equipment, the facility also has a refrigerated and a non-refrigerated vending machines.

3 SITE ENERGY USE AND COSTS

This building receives electricity and natural gas through master meters. It also receives electricity, steam and chilled water from the campus central cogeneration plant. These utilities were prorated for individual buildings based on building size and function.

Prorated and direct purchase utility data were evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 3.6 for additional information.

3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

Figure 12 - Utility Summary

Utility Summary for Conrad. J. Schmitt Hall		
Fuel	Usage	Cost
Electricity	1,541,510 kWh	\$126,533
Natural Gas	7,935 Therms	\$5,832
Steam	4,390 kLbs	\$80,026
Total		\$212,392

The current annual energy cost for this facility is \$212,392 as shown in the chart below.

Figure 13 - Energy Cost Breakdown

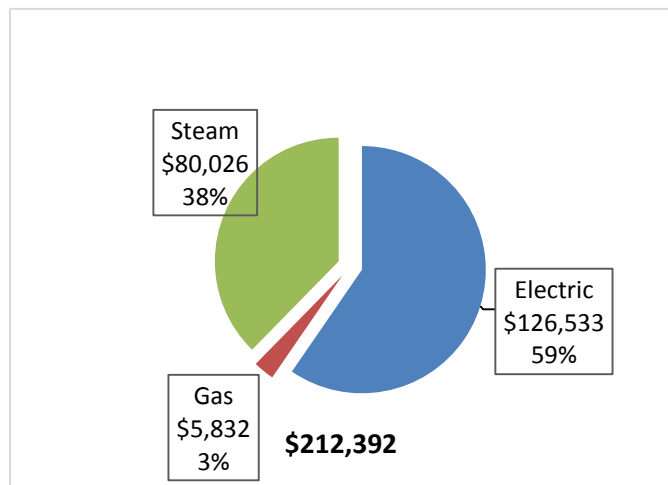

3.2 Electricity Usage

Electricity is provided by PSE&G and the campus cogeneration plant. The average electric for electricity purchased from PSE&G was \$0.168/kWh, which is the blended rate that includes energy supply, distribution, and other charges. This rate is used throughout the analyses in this report to assess energy costs and savings. The monthly electricity consumption is shown in the chart below.

Figure 14 - Electric Usage & Demand

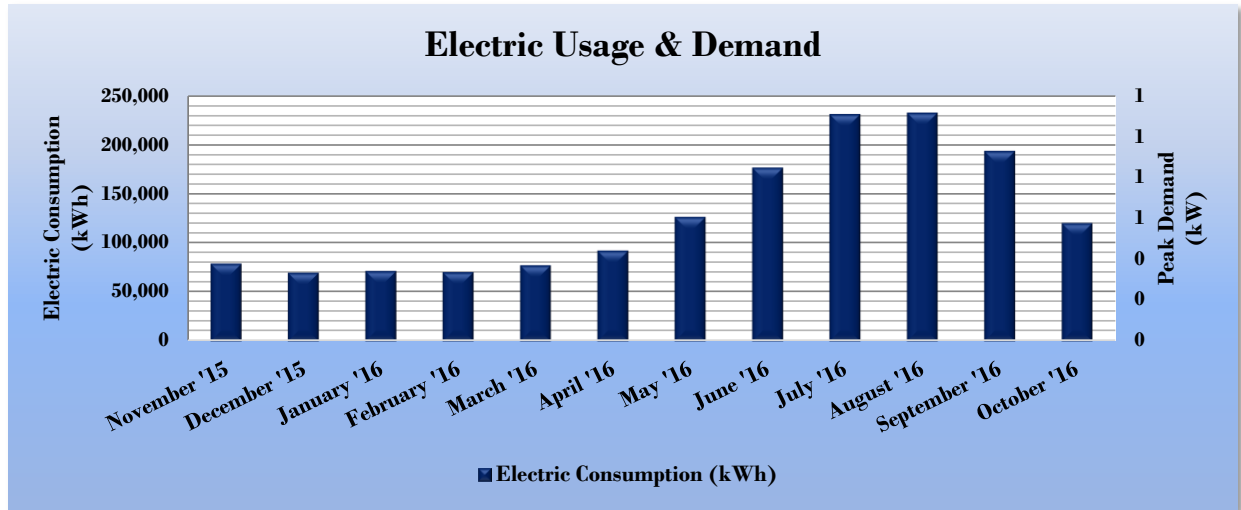


Figure 15 - Electric Usage & Demand

Electric Billing Data for Conrad. J. Schmitt Hall						
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost	TRC Estimated Usage?
11/30/15	30	79,209			\$5,429	Yes
12/31/15	31	69,836			\$5,491	Yes
1/31/16	31	71,664			\$4,721	Yes
2/28/16	28	70,479			\$9,744	Yes
3/31/16	31	77,477			\$5,068	Yes
4/30/16	30	92,305			\$6,471	Yes
5/31/16	31	126,606			\$9,888	Yes
6/30/16	30	176,677			\$14,942	Yes
7/31/16	31	230,972			\$19,689	Yes
8/31/16	31	232,420			\$19,924	Yes
9/30/16	30	193,652			\$15,979	Yes
10/31/16	31	120,213			\$9,187	Yes
Totals	365	1,541,510	0	\$0	\$126,533	12
Annual	365	1,541,510	0	\$0	\$126,533	

3.3 Natural Gas Usage

Natural Gas is provided by PSE&G. The average gas cost for the past 12 months is \$0.735/therm, which is the blended rate used throughout the analyses in this report. The monthly gas consumption is shown in the chart below.

Figure 16 - Natural Gas Usage

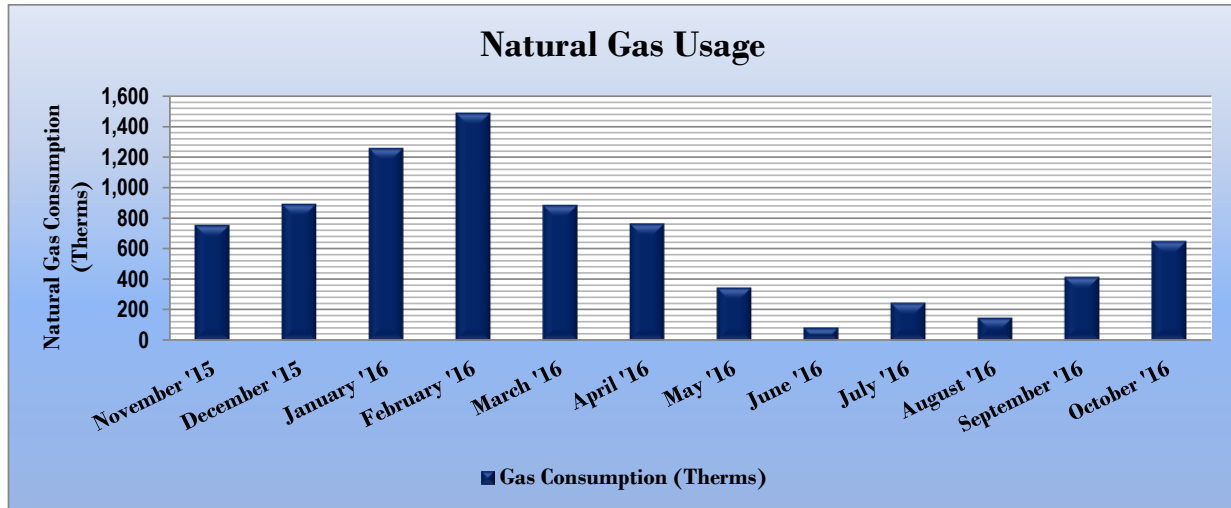


Figure 17 - Natural Gas Usage

Gas Billing Data for Conrad. J. Schmitt Hall				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
11/30/15	30	755	\$892	Yes
12/31/15	31	892	\$755	Yes
1/31/16	31	1,258	\$973	Yes
2/28/16	28	1,488	\$1,022	Yes
3/31/16	31	887	\$434	Yes
4/30/16	30	765	\$388	Yes
5/31/16	31	346	\$180	Yes
6/30/16	30	84	\$47	Yes
7/31/16	31	246	\$152	Yes
8/31/16	31	148	\$90	Yes
9/30/16	30	415	\$255	Yes
10/31/16	31	650	\$644	Yes
Totals	365	7,935	\$5,832	12
Annual	365	7,935	\$5,832	

3.4 Steam Usage

Steam is provided by campus CHP. The average steam cost for the past 12 months is \$18.227/kLb, which is the blended rate used throughout the analyses in this report. The steam consumption is shown in the table below.

Figure 18 – Graph of 12 Months Steam Usage

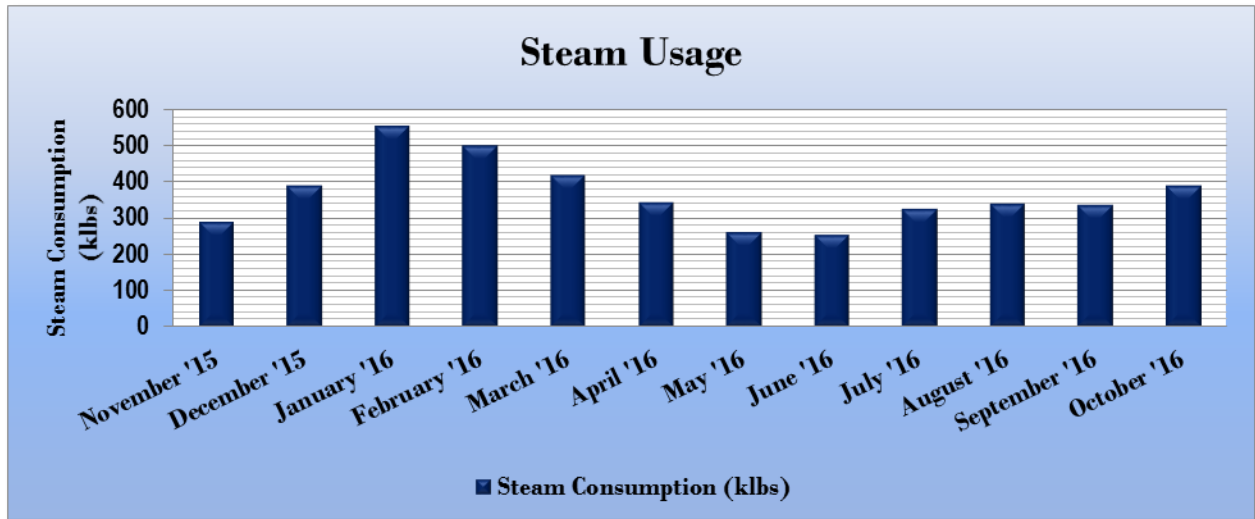


Figure 19 – Table of 12 Months Steam Usage

Steam Billing Data for Conrad. J. Schmitt Hall				
Period Ending	Days in Period	Steam Usage (kLbs)	Fuel Cost	TRC Estimated Usage?
11/30/15	30	290	\$4,427	Yes
12/31/15	31	389	\$5,982	Yes
1/31/16	31	553	\$8,640	Yes
2/28/16	28	499	\$20,698	Yes
3/31/16	31	417	\$6,337	Yes
4/30/16	30	341	\$5,130	Yes
5/31/16	31	259	\$4,045	Yes
6/30/16	30	253	\$3,839	Yes
7/31/16	31	326	\$4,905	Yes
8/31/16	31	340	\$5,126	Yes
9/30/16	30	334	\$5,015	Yes
10/31/16	31	388	\$5,883	Yes
Totals	365	4,390	\$80,026	12
Annual	365	4,390	\$80,026	

3.5 Chilled Water Usage

Chilled water is provided by the campus cogeneration plant. The average chilled water cost is \$0.327/ton-hr, which is the blended rate used throughout the analyses in this report. The chilled water consumption is shown in the table below. Chilled water is produced by steam engine chillers at the cogeneration plant, however, for ease of analysis and reporting chilled water use and cost has been combined with electricity use and cost in this report in the summary graphics.

Figure 20 – Chilled Water Usage

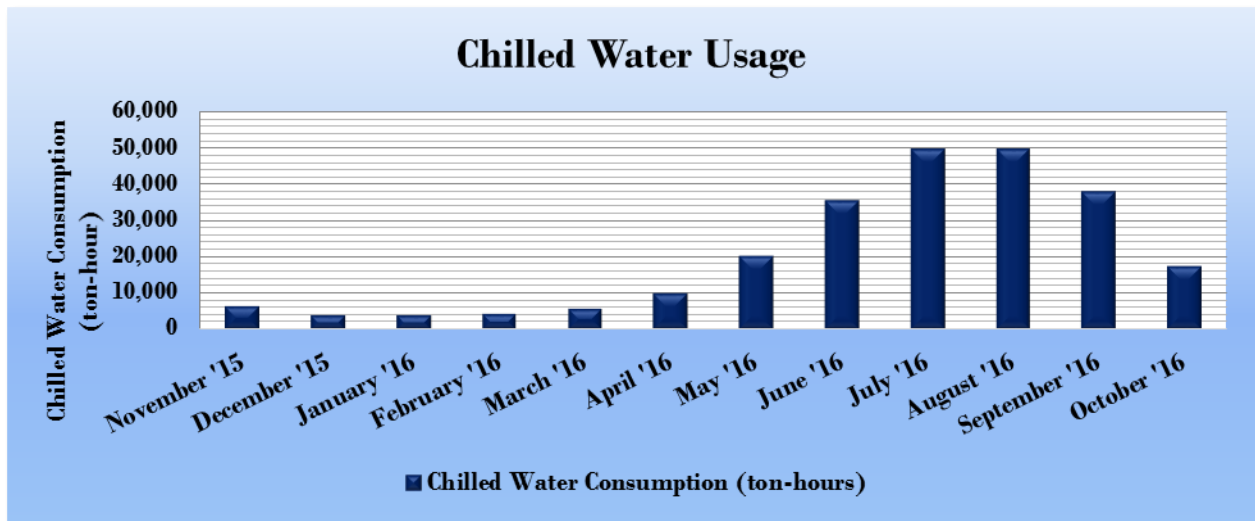


Figure 21 – Chilled Water Usage

Chilled Water Billing Data for Science Hall				
Period Ending	Days in Period	Chilled Water Usage (ton-hr)	Total Electric Cost	TRC Estimated Usage?
11/30/15	30	5,315	\$1,740	Yes
12/31/15	31	3,160	\$1,040	Yes
1/31/16	31	3,080	\$1,025	Yes
2/28/16	28	3,328	\$1,363	Yes
3/31/16	31	4,668	\$1,524	Yes
4/30/16	30	8,357	\$2,709	Yes
5/31/16	31	16,947	\$5,637	Yes
6/30/16	30	29,650	\$9,681	Yes
7/31/16	31	41,586	\$13,503	Yes
8/31/16	31	41,586	\$13,516	Yes
9/30/16	30	31,749	\$10,280	Yes
10/31/16	31	14,574	\$4,757	Yes
Totals	365	204,000	\$66,778	
Annual	365	204,000	\$66,778	

3.6 Benchmarking

This facility was benchmarked using *Portfolio Manager*, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

Figure 22 - Energy Use Intensity Comparison – Existing Conditions

Energy Use Intensity Comparison - Existing Conditions		
	Conrad. J. Schmitt Hall	National Median Building Type: Higher Education - Public
Source Energy Use Intensity (kBtu/ft ²)	445.4	262.6
Site Energy Use Intensity (kBtu/ft ²)	212.8	130.7

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

Figure 23 - Energy Use Intensity Comparison – Following Installation of Recommended Measures

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	Conrad. J. Schmitt Hall	National Median Building Type: Higher Education - Public
Source Energy Use Intensity (kBtu/ft ²)	421.5	262.6
Site Energy Use Intensity (kBtu/ft ²)	205.2	130.7

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide and may be eligible for ENERGY STAR® certification.

As the electric and gas accounts were shared between various buildings, it was not possible to benchmark these buildings and provide a score individually. A campus wide Portfolio Manager Statement of Energy Performance (SEP) was generated.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager regularly, so that you can keep track of your building’s performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager to track your building’s performance at: <https://www.energystar.gov/buildings/training>.

3.7 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 24 - Energy Balance (% and kBtu/SF)

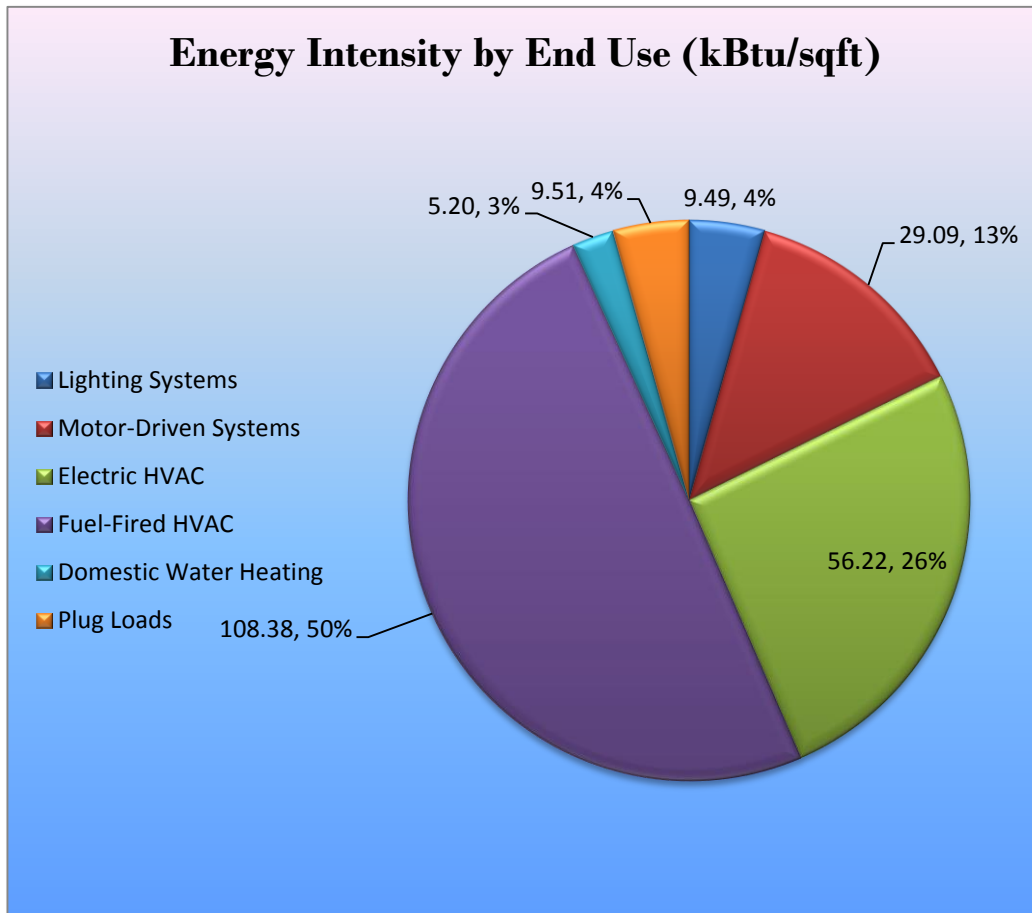

4 ENERGY CONSERVATION MEASURES

Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to the Conrad J. Schmitt Hall regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

4.1 High Priority ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 25 – Summary of High Priority ECMs

Energy Conservation Measure		High Priority?	Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			76,295	76,295	0	15.3	0.0	\$12,817.62	\$59,360.01	\$7,955.00	\$51,405.01	4.0	76,829
ECM 1	Install LED Fixtures	Yes	2,440	2,440		0.4	0.0	\$409.84	\$12,249.51	\$0.00	\$12,249.51	29.9	2,457
ECM 2	Retrofit Fixtures with LED Lamps	Yes	73,856	73,856		15.0	0.0	\$12,407.78	\$47,110.50	\$7,955.00	\$39,155.50	3.2	74,372
Lighting Control Measures			1,713	1,713	0	0.3	0.0	\$287.84	\$4,040.00	\$420.00	\$3,620.00	12.6	1,725
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	1,162	1,162		0.2	0.0	\$195.27	\$3,240.00	\$420.00	\$2,820.00	14.4	1,170
ECM 4	Install High/Low Lighting Controls	Yes	551	551		0.1	0.0	\$92.57	\$800.00	\$0.00	\$800.00	8.6	555
Variable Frequency Drive (VFD) Measures			47,330	47,330	0	4.8	0.0	\$7,951.37	\$12,668.60	\$2,400.00	\$10,268.60	1.3	47,661
ECM 5	Install VFDs on Chilled Water Pumps	Yes	47,330	47,330		4.8	0.0	\$7,951.37	\$12,668.60	\$2,400.00	\$10,268.60	1.3	47,661
Plug Load Equipment Control - Vending Machine			1,954	1,954	0	0.0	0.0	\$328.33	\$460.00	\$0.00	\$460.00	1.4	1,968
ECM 6	Vending Machine Control	Yes	1,954	1,954		0.0	0.0	\$328.33	\$460.00	\$0.00	\$460.00	1.4	1,968
TOTALS FOR HIGH PRIORITY MEASURES			127,293	127,293	0	20.4	0.0	\$21,385.17	\$76,528.61	\$10,775.00	\$65,753.61	3.1	128,183
TOTALS FOR ALL EVALUATED MEASURES			127,293	127,293	0	20.4	0.0	\$21,385.17	\$76,528.61	\$10,775.00	\$65,753.61	3.1	128,183

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

4.1.1 Lighting Upgrades

Our recommendations for upgrades to existing lighting fixtures are summarized in Figure 26 below.

Figure 26 – Summary of Lighting Upgrade ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		76,295	76,295	0	15.3	0.0	\$12,817.62	\$59,360.01	\$7,955.00	\$51,405.01	4.0	76,829
ECM 1	Install LED Fixtures	2,440	2,440		0.4	0.0	\$409.84	\$12,249.51	\$0.00	\$12,249.51	29.9	2,457
ECM 2	Retrofit Fixtures with LED Lamps	73,856	73,856		15.0	0.0	\$12,407.78	\$47,110.50	\$7,955.00	\$39,155.50	3.2	74,372

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 1: Install LED Fixtures

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	0	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0
Exterior	2,440	0	0.4	0.0	\$409.84	\$12,249.51	\$0.00	\$12,249.51	29.9	2,457

Measure Description

We recommend replacing existing fixtures containing fluorescent and incandescent lamps with new high-performance LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of fluorescent tubes and more than 10 times longer than many incandescent lamps.

ECM 2: Retrofit Fixtures with LED Lamps

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	73,207	0	14.9	0.0	\$12,298.74	\$46,767.00	\$7,955.00	\$38,812.00	3.2	73,719
Exterior	649	0	0.1	0.0	\$109.04	\$343.50	\$0.00	\$343.50	3.2	654

Measure Description

We recommend retrofitting existing fluorescent and compact fluorescent lighting technologies with LED lamps. Many LED tube lamps are direct replacements for existing fluorescent lamps and can be installed while leaving the fluorescent fixture ballast in place. LED bulbs can be used in existing fixtures as a direct replacement for most other lighting technologies. This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of fluorescent tubes.

4.1.2 Lighting Control Measures

Our recommendations for lighting control measures are summarized in Figure 27 below.

Figure 27 – Summary of Lighting Control ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures	1,713	0	0.3	0.0	\$287.84	\$4,040.00	\$420.00	\$3,620.00	12.6	1,725
ECM 3 Install Occupancy Sensor Lighting Controls	1,162	0	0.2	0.0	\$195.27	\$3,240.00	\$420.00	\$2,820.00	14.4	1,170
ECM 4 Install High/Low Lighting Controls	551	0	0.1	0.0	\$92.57	\$800.00	\$0.00	\$800.00	8.6	555

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 3: Install Occupancy Sensor Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
1,162	0	0.2	0.0	\$195.27	\$3,240.00	\$420.00	\$2,820.00	14.4	1,170

Measure Description

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in all restrooms, storage rooms, etc. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 4: Install High/Low Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
551	0	0.1	0.0	\$92.57	\$800.00	\$0.00	\$800.00	8.6	555

Measure Description

We recommend installing occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons. Typical areas for such lighting control are stairwells.

Lighting fixtures with these controls operate at default low levels when the area is not occupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. The lighting systems are switched to full lighting levels whenever an occupant is detected. Fixtures are automatically switched back to low level after an area has been vacant for a preset period of time. Energy savings results from only providing full lighting levels when it is required.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage needs to be provided to ensure that lights turn on in each area as an occupant approaches.

Additional savings from reduced lighting maintenance may also result from this measure, due to reduced lamp operation.

4.1.3 Variable Frequency Drive Measures

Our recommendations for variable frequency drive (VFD) measures are summarized in Figure 28 below.

Figure 28 – Summary of Variable Frequency Drive ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures	47,330	47,330	0	4.8	0.0	\$7,951.37	\$12,668.60	\$2,400.00	\$10,268.60	1.3	47,661
ECM 5 Install VFDs on Chilled Water Pumps	47,330	47,330		4.8	0.0	\$7,951.37	\$12,668.60	\$2,400.00	\$10,268.60	1.3	47,661

ECM 5: Install VFDs on Chilled Water Pumps

Summary of Measure Economics

Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
47,330	47,330	0	4.8	0.0	\$7,951.37	\$12,668.60	\$2,400.00	\$10,268.60	1.3	47,661

Measure Description

We recommend installing VFDs to control chilled water pumps and the existing 3-way vales be replaced with 2-way valves. This measure requires that chilled water coils be served by 2-way valves and that a differential pressure sensor be installed in the chilled water loop. As the chilled water valves close, the differential pressure increases. The VFD modulates pump speed to maintain a differential pressure setpoint. Energy savings results from reducing pump motor speed (and power) as chilled water valves close. The magnitude of energy savings is based on the estimated amount of time that the system operates at reduced loads.

The control system should be programmed to maintain the minimum flow to prevent pump cavitation.

4.1.4 Plug Load Equipment Control - Vending Machines

Our recommendations for plug load equipment controls are summarized in Figure 29 below.

Figure 29 – Summary of Plug Load Equipment Control ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Plug Load Equipment Control - Vending Machine	1,954	1,954	0	0.0	0.0	\$328.33	\$460.00	\$0.00	\$460.00	1.4	1,968
ECM 6 Vending Machine Control	1,954	1,954		0.0	0.0	\$328.33	\$460.00	\$0.00	\$460.00	1.4	1,968

ECM 6: Vending Machine Control

Summary of Measure Economics

Annual Electric Savings (kWh)	Chilled Water Savings (Ton-Hr)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
1,954	0	0.0	0.0	\$328.33	\$460.00	\$0.00	\$460.00	1.4	1,968

Measure Description

Vending machines operate continuously, even during non-business hours. It is recommended to install occupancy sensor controls to reduce the energy use. These controls power down vending machines when the vending machine area has been vacant for some time, then power up at regular intervals, as needed, to turn machine lights on or keep the product cool. Energy savings are a dependent on vending machine and activity level in the area surrounding the machines.

5 ENERGY EFFICIENT PRACTICES

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

Reduce Air Leakage

Air leakage, or infiltration, occurs when outside air enters a building uncontrollably through cracks and openings. Properly sealing such cracks and openings can significantly reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. This includes caulking or installing weather stripping around leaky doors and windows allowing for better control of indoor air quality through controlled ventilation.

Close Doors and Windows

Ensure doors and windows are closed in conditioned spaces. Leaving doors and windows open leads to a significant increase in heat transfer between conditioned spaces and the outside air. Reducing a facility's air changes per hour (ACH) can lead to increased occupant comfort as well as significant heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Perform Proper Lighting Maintenance

In order to sustain optimal lighting levels, lighting fixtures should undergo routine maintenance. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust on lamps, fixtures and reflective surfaces. Together, these factors can reduce total illumination by 20% - 60% or more, while operating fixtures continue drawing full power. To limit this reduction, lamps, reflectors and diffusers should be thoroughly cleaned of dirt, dust, oil, and smoke film buildup approximately every 6 – 12 months.

Develop a Lighting Maintenance Schedule

In addition to routine fixture cleaning, development of a maintenance schedule can both ensure maintenance is performed regularly and can reduce the overall cost of fixture re-lamping and re-ballasting. By re-lamping and re-ballasting fixtures in groups, lighting levels are better maintained and the number of site visits by a lighting technician or contractor can be minimized, decreasing the overall cost of maintenance.

Ensure Lighting Controls Are Operating Properly

Lighting controls are very cost-effective energy efficient devices, when installed and operating correctly. As part of a lighting maintenance schedule, lighting controls should be tested annually to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight sensors, maintenance involves cleaning of sensor lenses and confirming setpoints and sensitivity are appropriately configured.

Turn Off Unneeded Motors

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Reducing run hours for these motors can result in significant energy savings. Whenever possible, use automatic devices such as twist timers or occupancy sensors to ensure that motors are turned off when not needed.

Perform Routine Motor Maintenance

Motors consist of many moving parts whose collective degradation can contribute to a significant loss of motor efficiency. In order to prevent damage to motor components, routine maintenance should be performed. This maintenance consists of cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Ensure Economizers are Functioning Properly

Economizers, when properly configured, can be used to significantly reduce mechanical cooling. However, if the outdoor thermostat or enthalpy control is malfunctioning or the damper is stuck or improperly adjusted, benefits from the economizer may not be fully realized. As such, periodic inspection and maintenance is required to ensure proper operation. This maintenance should be scheduled with maintenance of the facility's air conditioning system and should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position. A malfunctioning economizer can significantly increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air.

Clean Evaporator/Condenser Coils on AC Systems

Dirty evaporators and condensers coils cause a restriction to air flow and restrict heat transfer. This results in increased evaporator and condenser fan load and a decrease in cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

Clean and/or Replace HVAC Filters

Air filters work to reduce the amount of indoor air pollution and increase occupant comfort. Over time, filters become less and less effective as particulate buildup increases. In addition to health concerns related to clogged filters, filters that have reached saturation also restrict air flow through the facility's air conditioning or heat pump system, increasing the load on the distribution fans and decreasing occupant comfort levels. Filters should be checked monthly and cleaned or replaced when appropriate.

Check for and Seal Duct Leakage

Duct leakage in commercial buildings typically accounts for 5% to 25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building, significantly increasing cooling and heating costs. By sealing sources of leakage, cooling, heating, and ventilation energy use can be reduced significantly, depending on the severity of air leakage.

Repair/Replace Steam Traps

Properly functioning steam traps ensure that all latent heat in the steam is delivered to the end use by preventing pressurized steam from leaking. Steam traps should be inspected as part of the regular steam system maintenance. Traps that are blocked, venting, or allowing steam to leak through should be repaired or replaced. Repairing or replacing existing steam traps will reduce steam losses.

Perform Proper Water Heater Maintenance

At least once a year, drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Once a year check for any leaks or heavy corrosion on the pipes and valves. For gas water heaters, check the draft hood and make sure it is placed properly, with a few inches of air space between the tank and where it connects to the vent. Look for any corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional. For electric water heaters, look for any signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank. For water heaters over three to four years old have a technician inspect the sacrificial anode annually.

Plug Load Controls

There are a variety of ways to limit the energy use of plug loads including increasing occupant awareness, removing under-utilized equipment, installing hardware controls, and using software controls. Some control steps to take are to enable the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips. For additional information refer to “Plug Load Best Practices Guide” <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

Replace Computer Monitors

Replacing old computer monitors or displays with efficient monitors will reduce energy use. ENERGY STAR® rated monitors have specific requirements for on mode power consumption as well as idle and sleep mode power. According to the ENERGY STAR® website monitors that have earned the ENERGY STAR® label are 25% more efficient than standard monitors.

6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey's Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State's electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility's electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

A preliminary screening based on the campus' electric demand and the size and location of free areas on campus was performed and is addressed in the campus level summary report.

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.

The campus has a CHP plant that uses natural gas fired turbines to generate electricity. Waste heat from the turbines is used to produce steam which is either delivered to buildings on campus or used to produce chilled water which is delivered to buildings on campus. Since the campus has a CHP that serves a significant portion of the campus further evaluation of individual building CHP applications were not done.

7 DEMAND RESPONSE

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

In our opinion this building is not is a good candidate for DR.

8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 30 for a list of the eligible programs identified for each recommended ECM.

Figure 30 - ECM Incentive Program Eligibility

Energy Conservation Measure		SmartStart Prescriptive	Pay For Performance Existing Buildings
ECM 1	Install LED Fixtures	X	X
ECM 2	Retrofit Fixtures with LED Lamps	X	X
ECM 3	Install Occupancy Sensor Lighting Controls	X	X
ECM 4	Install High/Low Lighting Controls	X	
ECM 5	Install VFDs on Chilled Water Pumps	X	X
ECM 6	Vending Machine Control		X

SmartStart is generally well-suited for implementation of individual measures or small group of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities that can bundle multiple ECMs together. This can greatly simplify participation and may lead to higher incentive amounts, but requires the use of pre-approved contractors. The Pay for Performance (P4P) program is a “whole-building” energy improvement program designed for larger facilities. It requires implementation of multiple measures meeting minimum savings thresholds, as well as use of pre-approved consultants. This facility does not meet all of the criteria for participating in the P4P program based on the measures identified in this study. However, since additional measures may be identified during the P4P evaluation and the facility is close to meeting the P4P program criteria it is worth considering the P4P program for this site. The Large Energy Users Program (LEUP) is available to New Jersey’s largest energy users giving them flexibility to install as little or as many measures, in a single facility or several facilities, with incentives capped based on the entity’s annual energy consumption. LEUP applicants can use in-house staff or a preferred contractor.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: www.njcleanenergy.com/ci.

8.1 SmartStart

Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: www.njcleanenergy.com/SSB.

8.2 Pay for Performance - Existing Buildings

Overview

The Pay for Performance – Existing Buildings (P4P EB) program is designed for larger customers with a peak demand over 200 kW in any of the preceding 12 months. Under this program the minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings. P4P is a generally a good option for medium to large sized facilities looking to implement as many measures as possible under a single project in order to achieve deep energy savings. This program has an added benefit of evaluating a broad spectrum of measures that may not otherwise qualify under other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also utilize the P4P program.

Incentives

Incentives are calculated based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

To participate in the P4B EB program you will need to contact one of the pre-approved consultants and contractors (“Partners”). Under direct contract to you, the Partner will help further evaluate the measures identified in this report through development of the Energy Reduction Plan (ERP), assist you in implementing selected measures, and verify actual savings one year after the installation. At each of these three milestones your Partner will also facilitate securing program incentives.

Approval of the final scope of work is required by the program prior to installation completion. Although installation can be accomplished by a contractor of your choice (some P4P Partners are also contractors) or by internal personnel, the Partner must remain involved to ensure compliance with the program guidelines and requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: www.njcleanenergy.com/P4P.

8.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third-party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third party electric suppliers. If your facility is purchasing electricity from a third-party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility is purchasing natural gas from a third-party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third-party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Exterior Perimeter	4	Linear Fluorescent - T8: 3' T8 (25W) - 2L	Daylight Dimming	48	4,100	Relamp	No	4	LED - Linear Tubes: (2) 3' Lamps	Daylight Dimming	21	4,100	0.07	443	0.0	\$74.39	\$213.60	\$0.00	2.87
Exterior Perimeter	10	Halogen Incandescent: Flood Light - 70W Halogen	Daylight Dimming	70	4,100	Fixture Replacement	No	10	LED - Fixtures: Architectural Flood/Spot Luminaire	Daylight Dimming	11	4,100	0.44	2,805	0.0	\$471.31	\$12,249.51	\$0.00	25.99
Exterior Perimeter	1	Compact Fluorescent: CFL - 2L - 26W - 4 Pin	Daylight Dimming	26	4,100	Relamp	No	1	LED Screw-In Lamps: LED - 4-Pin 11 Watts	Daylight Dimming	18	4,100	0.01	37	0.0	\$6.18	\$50.00	\$0.00	8.09
Exterior Perimeter	1	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Daylight Dimming	92	4,100	Relamp	No	1	LED - Linear Tubes: (3) U-Lamp	Daylight Dimming	50	4,100	0.03	200	0.0	\$33.67	\$79.90	\$0.00	2.37
Stairwell A	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	60	4,368	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,058	0.18	1,197	0.0	\$201.02	\$551.00	\$60.00	2.44
Stairwell A	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	4,368	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	3,058	0.09	628	0.0	\$105.57	\$350.40	\$30.00	3.03
Stairwell A	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Corridor 3rd Floor	63	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	63	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.79	3,766	0.0	\$632.67	\$3,036.60	\$630.00	3.80
Corridor 3rd Floor	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
329	65	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	65	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	1.58	7,542	0.0	\$1,267.11	\$3,802.50	\$650.00	2.49
329	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
352	8	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	8	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.10	478	0.0	\$80.34	\$385.60	\$80.00	3.80
368	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
Mens Restroom	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,058	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.22	1,044	0.0	\$175.45	\$451.20	\$90.00	2.06
Womens Restroom	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,058	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.22	1,044	0.0	\$175.45	\$451.20	\$90.00	2.06
371	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	4,368	Relamp	Yes	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.05	314	0.0	\$52.79	\$345.20	\$50.00	5.59
370	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
372	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
319	16	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	16	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.39	1,857	0.0	\$311.90	\$936.00	\$160.00	2.49
374	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
376	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
380	3	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	3	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.04	179	0.0	\$30.13	\$144.60	\$30.00	3.80
311	16	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	16	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.39	1,857	0.0	\$311.90	\$936.00	\$160.00	2.49
382	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
384	1	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Wall Switch	34	4,368	Relamp	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.02	111	0.0	\$18.65	\$318.20	\$45.00	14.65

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
386	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
389	4	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.05	239	0.0	\$40.17	\$192.80	\$40.00	3.80
388	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
302	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
304	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
306	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
308	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
Closet	2	Linear Fluorescent - T5: 4 T5 (28W) - 2L	Wall Switch	60	4,368	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.06	399	0.0	\$67.01	\$387.00	\$55.00	4.95
309	2	Linear Fluorescent - T5: 4 T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
310	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
312	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
314	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
318	2	Linear Fluorescent - T5: 4 T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
318	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,058	0.09	408	0.0	\$68.52	\$252.80	\$0.00	3.69
320	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
322	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
321	1	Linear Fluorescent - T5: 4 T5 (28W) - 2L	Wall Switch	60	4,368	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.03	199	0.0	\$33.50	\$328.50	\$45.00	8.46
324	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
326	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
328	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
330	2	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.03	120	0.0	\$20.08	\$96.40	\$20.00	3.80
332	3	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	3	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.04	179	0.0	\$30.13	\$144.60	\$30.00	3.80
338	4	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.05	239	0.0	\$40.17	\$192.80	\$40.00	3.80
344	4	Linear Fluorescent - T5: 2 T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.05	239	0.0	\$40.17	\$192.80	\$40.00	3.80
Closet	3	Linear Fluorescent - T8: 4 T8 (32W) - 3L	Wall Switch	93	4,368	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.14	943	0.0	\$158.36	\$495.60	\$80.00	2.62

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
353	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	60	4,368	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.03	199	0.0	\$33.50	\$328.50	\$45.00	8.46
Corridor 2nd Floor	28	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	28	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.64	3,052	0.0	\$512.75	\$1,638.00	\$280.00	2.65
242	8	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.18	872	0.0	\$146.50	\$468.00	\$80.00	2.65
233	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,058	0.02	102	0.0	\$17.13	\$63.20	\$0.00	3.69
225	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
231	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
230	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
Corridor 1st Floor	25	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	25	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.57	2,725	0.0	\$457.81	\$1,462.50	\$250.00	2.65
Corridor 1st Floor	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Corridor 1st Floor	8	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	8	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.10	478	0.0	\$80.34	\$385.60	\$80.00	3.80
340	4	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.05	239	0.0	\$40.17	\$192.80	\$40.00	3.80
344	4	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.05	239	0.0	\$40.17	\$192.80	\$40.00	3.80
Corridor 1st Floor	36	Compact Fluorescent: CFL - 2L - 26W - 4 Pin	Occupancy Sensor	26	3,058	Relamp	No	36	LED Screw-In Lamps: LED - 4-Pin 11 Watts	Occupancy Sensor	18	3,058	0.21	987	0.0	\$165.88	\$1,800.00	\$0.00	10.85
Mechanical Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,058	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.04	174	0.0	\$29.24	\$75.20	\$15.00	2.06
104	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.36	1,741	0.0	\$292.41	\$877.50	\$150.00	2.49
104	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
104A	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	232	0.0	\$38.99	\$117.00	\$20.00	2.49
104B	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	232	0.0	\$38.99	\$117.00	\$20.00	2.49
105	20	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	20	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.49	2,321	0.0	\$389.88	\$1,170.00	\$200.00	2.49
110	16	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	16	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.39	1,857	0.0	\$311.90	\$936.00	\$160.00	2.49
119	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.44	2,089	0.0	\$350.89	\$1,053.00	\$180.00	2.49
121	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	4,368	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.03	209	0.0	\$35.19	\$328.50	\$45.00	8.06
122	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.58	2,785	0.0	\$467.86	\$1,404.00	\$240.00	2.49
Mens Restroom	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	4,368	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.14	943	0.0	\$158.36	\$495.60	\$80.00	2.62
Womens Restroom	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	4,368	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.18	1,257	0.0	\$211.14	\$570.80	\$95.00	2.25

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
125	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.58	2,785	0.0	\$467.86	\$1,404.00	\$240.00	2.49
132	22	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	22	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.53	2,553	0.0	\$428.87	\$1,287.00	\$220.00	2.49
135A	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,058	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.04	174	0.0	\$29.24	\$75.20	\$15.00	2.06
135C	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	232	0.0	\$38.99	\$117.00	\$20.00	2.49
135B	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	232	0.0	\$38.99	\$117.00	\$20.00	2.49
135	20	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	20	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.49	2,321	0.0	\$389.88	\$1,170.00	\$200.00	2.49
138	7	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.16	763	0.0	\$128.19	\$409.50	\$70.00	2.65
138A	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
138B	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
138C	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	4,368	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.06	419	0.0	\$70.38	\$387.00	\$55.00	4.72
242	8	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.18	872	0.0	\$146.50	\$468.00	\$80.00	2.65
240	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.07	327	0.0	\$54.94	\$175.50	\$30.00	2.65
240	3	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	3	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.04	179	0.0	\$30.13	\$144.60	\$30.00	3.80
240A	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
240B	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
240C	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
240D	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
240E	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
240F	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
230	21	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.48	2,289	0.0	\$384.56	\$1,228.50	\$210.00	2.65
230	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
222	13	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	13	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.30	1,417	0.0	\$238.06	\$760.50	\$130.00	2.65
222	1	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.01	60	0.0	\$10.04	\$48.20	\$10.00	3.80
222B	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
222C	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
222E	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
222	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Womens Restroom	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	4,368	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,058	0.14	943	0.0	\$158.36	\$495.60	\$80.00	2.62
219	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	232	0.0	\$38.99	\$117.00	\$20.00	2.49
217	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
217 Corridor	37	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	34	3,058	Relamp	No	37	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,058	0.46	2,212	0.0	\$371.57	\$1,783.40	\$370.00	3.80
241M	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241N	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241L	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241K	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241P	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241Q	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241J	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241R	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241H	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241S	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241F	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241E	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241D	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241C	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241B	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
241A	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205M	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205L	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205K	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
205J	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205N	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205D	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205H	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205Q	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205G	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205F	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205R	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205E	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205S	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205D	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205C	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205A	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
205B	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
202	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.29	1,392	0.0	\$233.93	\$702.00	\$120.00	2.49
204	10	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.23	1,090	0.0	\$183.13	\$585.00	\$100.00	2.65
208	5	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.11	545	0.0	\$91.56	\$292.50	\$50.00	2.65
212	4	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.09	436	0.0	\$73.25	\$234.00	\$40.00	2.65
212A	4	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.09	436	0.0	\$73.25	\$234.00	\$40.00	2.65
214A	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,058	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.29	1,392	0.0	\$233.93	\$702.00	\$120.00	2.49
Corridor 2nd Floor	9	Compact Fluorescent: CFL - 2L - 26W - 4 Pin	Occupancy Sensor	26	3,058	Relamp	No	9	LED Screw-In Lamps: LED - 4-Pin 11 Watts	Occupancy Sensor	18	3,058	0.05	247	0.0	\$41.47	\$450.00	\$0.00	10.85
Corridor 2nd Floor	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
216	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
225	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.05	218	0.0	\$36.63	\$117.00	\$20.00	2.65
227	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.07	327	0.0	\$54.94	\$175.50	\$30.00	2.65

Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
229	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	60	3,058	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.07	327	0.0	\$54.94	\$175.50	\$30.00	2.65
Stairwell B	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	4,368	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,058	0.12	838	0.0	\$140.76	\$434.00	\$40.00	2.80
Stairwell B	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	4,368	Relamp	Yes	1	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	3,058	0.05	314	0.0	\$52.79	\$275.20	\$15.00	4.93
Mechanical Room	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	4,368	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,368	0.17	1,160	0.0	\$194.94	\$409.50	\$70.00	1.74
IT Room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	4,368	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,058	0.06	419	0.0	\$70.38	\$387.00	\$55.00	4.72
Mechanical Room	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Schmitt Hall	2	Heating Hot Water Pump	15.0	93.0%	Yes	2,745	No	93.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Schmitt Hall	2	Condenser Water Pump	1.5	86.5%	No	2,745	No	86.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Schmitt Hall	1	Other	2.0	88.5%	No	2,745	No	88.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Schmitt Hall	1	Other	0.5	85.5%	No	2,745	No	85.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Rooftop	Schmitt Hall	2	Supply Fan	40.0	94.1%	Yes	3,391	No	94.1%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Rooftop	Schmitt Hall	2	Return Fan	25.0	93.6%	Yes	3,391	No	93.6%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Rooftop	Schmitt Hall	2	Supply Fan	15.0	92.4%	Yes	3,391	No	92.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Rooftop	Schmitt Hall	2	Return Fan	15.0	92.4%	Yes	3,391	No	92.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Rooftop	Schmitt Hall	1	Exhaust Fan	0.8	85.5%	No	2,745	No	85.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Elevator Room	Elevator	1	Other	30.0	81.7%	No	1,040	No	81.7%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Underground	Schmitt Hall	2	Chilled Water Pump	20.0	93.0%	No	2,745	No	93.0%	Yes	2	4.84	38,313	0.0	\$6,436.60	\$17,868.60	\$2,400.00	1.60
Schmitt Hall	Schmitt Hall	5	Other	0.3	85.5%	No	2,745	No	85.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions								Energy Impact & Financial Analysis							
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Schmitt Hall	Schmitt Hall	1	Ductless Mini-Split HP	1.00	11.50	No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Schmitt Hall	Schmitt Hall	2	Ductless Mini-Split HP	8.00	103.00	No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric Chiller Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions								Energy Impact & Financial Analysis						
		Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Central Plant	Conrad Schmitt	1	Water-Cooled Centrifugal Chiller	151.75	No							0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Central Plant	Conrad Schmitt	1	Forced Draft Steam Boiler	4,002.75	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU	2	Furnace	400.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU	2	Furnace	500.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Schmitt Hall	1	Storage Tank Water Heater (> 50 Gal)	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Plug Load Inventory

Existing Conditions				
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Schmitt Hall	485	Desktop and LCD Monitor	191.0	Yes
Schmitt Hall	11	Television	120.0	Yes
Schmitt Hall	10	Copier	515.0	No
Schmitt Hall	37	Printer	20.0	Yes
Schmitt Hall	7	Microwave	300.0	No
Schmitt Hall	3	Small Freezer	180.0	No
Schmitt Hall	2	Refrigerator	180.0	Yes
Schmitt Hall	5	Coffee Machine	400.0	No
Schmitt Hall	3	Toaster	850.0	No

Vending Machine Inventory & Recommendations

Existing Conditions		Proposed Conditions	Energy Impact & Financial Analysis							
Location	Quantity	Vending Machine Type	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Main Lobby	1	Refrigerated	Yes	0.00	1,612	0.0	\$270.79	\$230.00	\$0.00	0.85
Main Lobby	1	Non-Refrigerated	Yes	0.00	343	0.0	\$57.54	\$230.00	\$0.00	4.00

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

N/A **Montclair State University Campus (Buildings 1-41)**

ENERGY STAR® Score¹

Primary Property Type: College/University
Gross Floor Area (ft²): 2,925,896
Built: 1908

For Year Ending: October 31, 2016
Date Generated: October 10, 2017

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address Montclair State University Campus (Buildings 1-41) 1 Normal Avenue Montclair, New Jersey 07043	Property Owner Montclair State University 1 Normal Avenue Montclair, NJ 07043 973-655-3244	Primary Contact Ana Pinto 1 Normal Avenue Montclair, NJ 07043 973-655-3244 pintoa@montclair.edu
Property ID: 6069294		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 172.3 kBtu/ft ²	Annual Energy by Fuel	National Median Comparison	
	District Chilled Water - 81,507,530 (16%)	National Median Site EUI (kBtu/ft ²)	147.6
	Other (kBtu)	National Median Source EUI (kBtu/ft ²)	262.6
	District Steam (kBtu) 223,798,259 (44%)	% Diff from National Median Source EUI	17%
	Electric - Grid (kBtu) 161,334,839 (32%)		
	Natural Gas (kBtu) 37,406,141 (7%)		
Source EUI 306.4 kBtu/ft ²		Annual Emissions	
		Greenhouse Gas Emissions (Metric Tons CO ₂ e/year)	N/A

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

 () _____



Professional Engineer Stamp (if applicable)