



Local Government Energy Audit: Energy Audit Report



Copyright ©2018 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Police Department

495 Demott Lane

Somerset, New Jersey 08873

Franklin, Township of Somerset

December 31, 2018

Final Report by:

TRC Energy Services

Disclaimer

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

Table of Contents

1	Executive Summary	1
1.1	Facility Summary	1
1.2	Your Cost Reduction Opportunities.....	1
	Energy Conservation Measures.....	1
	Energy Efficient Practices	3
	On-Site Generation Measures.....	3
1.3	Implementation Planning.....	4
2	Facility Information and Existing Conditions	6
2.1	Project Contacts	6
2.2	General Site Information.....	6
2.3	Building Occupancy	6
2.4	Building Envelope	7
2.5	On-Site Generation.....	7
2.6	Energy-Using Systems	8
	Lighting System	8
	Chilled Water System	9
	Hot Water Heating System.....	10
	Direct Expansion Air Conditioning System (DX)	11
	Building Energy Management System (BEMS).....	12
	Domestic Hot Water Heating System.....	13
	Building Plug Load	13
2.7	Water-Using Systems	14
3	Site Energy Use and Costs	15
3.1	Total Cost of Energy	15
3.2	Electricity Usage	16
3.3	Natural Gas Usage	17
3.4	Benchmarking.....	18
3.5	Energy End-Use Breakdown	20
4	Energy Conservation Measures	21
4.1	Recommended ECMs	21
4.1.1	Lighting Upgrades.....	22
	ECM 1: Retrofit Fixtures with LED Lamps.....	22
4.1.2	Lighting Control Measures	23
	ECM 2: Install Occupancy Sensor Lighting Controls	23
4.1.3	Domestic Hot Water Heating System Upgrades	24
	ECM 3: Install Low-Flow DHW Devices.....	24
4.1.4	Plug Load Equipment Control - Vending Machines.....	25
	ECM 4: Vending Machine Control	25

- 5 Energy Efficient Practices 26**
 - Perform Proper Lighting Maintenance..... 26
 - Develop a Lighting Maintenance Schedule 26
 - Ensure Lighting Controls Are Operating Properly 26
 - Clean Evaporator/Condenser Coils on AC Systems 26
 - Clean and/or Replace HVAC Filters 26
 - Perform Proper Boiler Maintenance..... 27
 - Water Conservation 27
- 6 On-Site Generation Measures 28**
 - 6.1 Photovoltaic..... 29
 - 6.2 Combined Heat and Power 30
- 7 Demand Response 31**
- 8 Project Funding / Incentives 32**
 - 8.1 SmartStart 33
 - 8.2 Direct Install 34
 - 8.3 SREC Registration Program..... 35
 - 8.4 Energy Savings Improvement Program 36
- 9 Energy Purchasing and Procurement Strategies 37**
 - 9.1 Retail Electric Supply Options..... 37
 - 9.2 Retail Natural Gas Supply Options 37

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

Table of Figures

Figure 1 – Previous 12 Month Utility Costs..... 2

Figure 2 – Potential Post-Implementation Costs 2

Figure 3 – Summary of Energy Reduction Opportunities 2

Figure 4 – Photovoltaic Potential..... 3

Figure 5 – Project Contacts 6

Figure 6 - Building Schedule..... 6

Figure 7 - Utility Summary 15

Figure 8 - Energy Cost Breakdown 15

Figure 9 - Electric Usage & Demand..... 16

Figure 10 - Electric Usage & Demand..... 16

Figure 11 -Natural Gas Usage 17

Figure 12 - Natural Gas Usage..... 17

Figure 13 - Energy Use Intensity Comparison – Existing Conditions..... 18

Figure 14 - Energy Use Intensity Comparison – Following Installation of Recommended Measures 18

Figure 15 - Energy Balance (% and kBtu/SF) 20

Figure 16 – Summary of Recommended ECMs..... 21

Figure 17 – Summary of Lighting Upgrade ECMs..... 22

Figure 18 – Summary of Lighting Control ECMs 23

Figure 19 - Summary of Domestic Water Heating ECMs 24

Figure 20 - Summary of Plug Load Equipment Control ECMs..... 25

Figure 21 - Photovoltaic Screening 29

Figure 22 - Combined Heat and Power Screening 30

Figure 23 - ECM Incentive Program Eligibility..... 32

I EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) Report for the Police Department.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist New Jersey townships in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

I.1 Facility Summary

The Police Department is a 32,000 square foot facility comprised of various space types within one building. The Police Department is two floors and includes offices, an armory, evidence rooms, prison cells, a court room, surveillance room, investigation department, locker rooms, gym area, kitchen and mechanical space.

Lighting at the Police Department consists of all LED fixtures which recently got retrofitted however HVAC equipment is in need of efficient controls. Heating is supplied by two boilers. A thorough description of the facility and our observations are located in Section 2.

I.2 Your Cost Reduction Opportunities

Energy Conservation Measures

TRC evaluated four measures which together represent an opportunity for the Police Department to reduce annual energy costs by roughly \$4,943 and annual greenhouse gas emissions by 41,716 lbs CO₂e. We estimate that if all measures were implemented as recommended, the project would pay for itself in 1.9 years. The breakdown of existing and potential utility costs after project implementation are illustrated in Figure 1 and Figure 2, respectively. Together these measures represent an opportunity to reduce the Police Department's annual energy use by 4%.

Figure 1 – Previous 12 Month Utility Costs


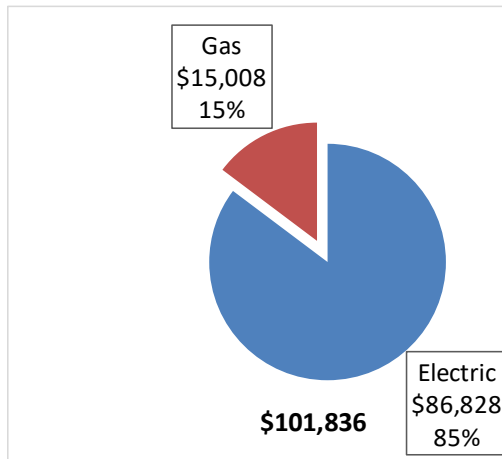


Figure 2 – Potential Post-Implementation Costs

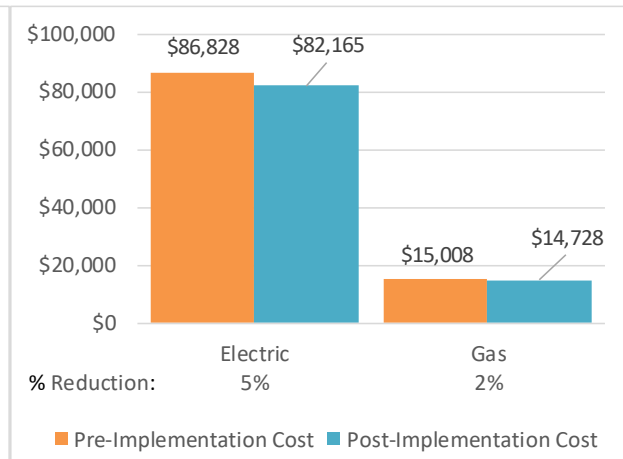

A detailed description of the Police Department’s existing energy use can be found in Section 3.

Estimates of the total cost, energy savings, and financial incentives for the proposed energy efficient upgrades are summarized below in Figure 3. A brief description of each category can be found below and a description of savings opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

Energy Conservation Measure	Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		2,606	0.2	0.0	\$323.08	\$162.90	\$20.00	\$142.90	0.4	2,624
ECM 1 Retrofit Fixtures with LED Lamps	Yes	2,606	0.2	0.0	\$323.08	\$162.90	\$20.00	\$142.90	0.4	2,624
Lighting Control Measures		33,058	2.8	0.0	\$4,098.27	\$10,038.00	\$1,415.00	\$8,623.00	2.1	33,289
ECM 2 Install Occupancy Sensor Lighting Controls	Yes	33,058	2.8	0.0	\$4,098.27	\$10,038.00	\$1,415.00	\$8,623.00	2.1	33,289
Domestic Water Heating Upgrade		0	0.0	32.7	\$279.56	\$114.72	\$0.00	\$114.72	0.4	3,834
ECM 3 Install Low-Flow Domestic Hot Water Devices	Yes	0	0.0	32.7	\$279.56	\$114.72	\$0.00	\$114.72	0.4	3,834
Plug Load Equipment Control - Vending Machine		1,954	0.0	0.0	\$242.28	\$460.00	\$0.00	\$460.00	1.9	1,968
ECM 4 Vending Machine Control	Yes	1,954	0.0	0.0	\$242.28	\$460.00	\$0.00	\$460.00	1.9	1,968
TOTALS FOR HIGH PRIORITY MEASURES		37,619	3.0	32.7	\$4,943.20	\$10,775.62	\$1,435.00	\$9,340.62	1.9	41,716
TOTALS FOR ALL EVALUATED MEASURES		37,619	3.0	32.7	\$4,943.20	\$10,775.62	\$1,435.00	\$9,340.62	1.9	41,716

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Lighting Upgrades generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measures save energy by reducing the power used by the lighting components due to improved electrical efficiency.

Lighting Controls measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

Domestic Hot Water upgrade measures generally involve replacing older inefficient domestic water heating systems with modern energy efficient systems. New domestic hot water heating systems can provide equivalent, or greater, water heating capacity compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel used for domestic hot water heating due to improved heating efficiency or reducing standby losses.

Plug Load Equipment control measures generally involve installing automated devices that limit the power usage or operation of equipment that is plugged into an electric outlet when not in use.

Energy Efficient Practices

TRC also identified seven low cost (or no cost) energy efficient practices. A facility’s energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. Potential opportunities identified at the Police Department include:

- Perform Proper Lighting Maintenance
- Develop a Lighting Maintenance Schedule
- Ensure Lighting Controls Are Operating Properly
- Clean Evaporator/Condenser Coils on AC Systems
- Clean and/or Replace HVAC Filters
- Perform Proper Boiler Maintenance
- Water Conservation

For details on these energy efficient practices, please refer to Section 5.

On-Site Generation Measures

TRC evaluated the potential for installing on-site generation for the Police Department. Based on the configuration of the site and its loads there is a high potential for installing a photovoltaic (PV) array.

Figure 4 – Photovoltaic Potential

Potential	High	
System Potential	86	kW DC STC
Electric Generation	102,458	kWh/yr
Displaced Cost	\$8,910	/yr
Installed Cost	\$223,600	

For details on our evaluation and on-site generation potential, please refer to Section 6.

I.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Direct Install
- SREC (Solar Renewable Energy Certificate) Registration Program (SRP)
- Energy Savings Improvement Program (ESIP)

For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 8.

This facility may also qualify for the Direct Install program which can provide turnkey installation of multiple measures, through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures, although measure eligibility will have to be assessed and be verified by the designated Direct Install contractor and, in most cases, they will perform the installation work.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.4 for additional information on the ESIP Program.

The Demand Response Energy Aggregator is a (non-NJCEP) program designed to reduce electric loads at commercial facilities, when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. Demand Response (DR) service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability. By enabling grid operators to call upon commercial facilities to reduce their electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and facilities receive payments whether or not they are called upon to curtail their load during times of peak demand. Refer to Section 7 for additional information on this program.

Additional information on relevant incentive programs is located in Section 8 or: www.njcleanenergy.com/ci.

2 FACILITY INFORMATION AND EXISTING CONDITIONS

2.1 Project Contacts

Figure 5 – Project Contacts

Name	Role	E-Mail	Phone #
Customer			
Carl Hauck	Public Works Manager	carl.hauck@fanklinnj.gov	(732) 249-7800
Designated Representative			
John Beigen	Facility Representative	john.beigen@franklinnj.gov	(732) 841-5544
TRC Energy Services			
Yagna Otia	Auditor	Yotia@trcsolutions.com	(732) 855-0033

2.2 General Site Information

On August 16, 2018, TRC performed an energy audit at the Police Department located in Somerset, New Jersey. TRC’s team met with John Beigen to review the facility operations and help focus our investigation on specific energy-using systems.

The Police Department is a 32,000 square foot facility comprised of various space types within one building. The Police Department is two floors and includes offices, an armory, evidence rooms, prison cells, court room, surveillance room, investigation department, locker rooms, gym area, kitchen and mechanical space.

The building was constructed in 1991. Over the last five years the facility has replaced all of its existing T12 & T8 fluorescent fixtures with LED fixtures. The site is controlled by a building energy management system (BEMS) by Carrier.

2.3 Building Occupancy

The Police Department is open daily 24 hours a day and 7 days a week. The typical schedule is presented in the table below. During a typical day, the facility is occupied by approximately 120 staff people.

Figure 6 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
Police Department	Weekday	12AM - 12AM
Police Department	Weekend	12AM - 12AM

2.4 Building Envelope

The building is constructed of concrete block, and structural steel with a stone facade. The building has flat roofs covered with white membrane that is in good condition. The building has double pane windows which are in good condition. The exterior doors are constructed of aluminum and in good condition.



Image 1 Building Roof and Exterior

2.5 On-Site Generation

The Police Department does not have any on-site electric generation capacity.

2.6 Energy-Using Systems

Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

Lighting System

Lighting at the facility is provided mostly by linear LED lamps as well as some LED screw-in lamps. Most of the fixtures are 2-lamp or 3-lamp, 4-foot long. Mr. Brian, the facility's maintenance technician, indicated that the building had a comprehensive LED retrofit one year ago.

A small area of the building and the majority of the office spaces are primarily lit with 17-Watt CFL and 10.5-Watt LED lamps in recessed can ceiling fixtures.

Lighting control in most spaces is provided by wall switches with occupancy sensors in large areas. The occupancy sensors are either wall or ceiling mounted depending on the space layout. Stairwells, elevator lobbies and main lobby areas do not contain any occupancy sensors and are on 24 hours per day throughout the year.

The building's exterior lighting is minimal and consists primarily of efficient LED fixtures that are controlled by photocells, though the lights were seen on during a sunny day.



Image 2 LED Fixtures

Chilled Water System

The facility is served by a single chilled water plant. The chiller plant consists of one 102-ton, Carrier, R-22, air-cooled screw chiller (CH1). The chiller is configured in a primary- secondary distribution loop with three constant flow primary pumps (P3 & P4). The chiller is supplied by eight 1.8 hp pumps with a rated flow of 440 gallons per minute (gpm). Chilled water is distributed to the facility based on a reset schedule. Chilled water is distributed at 44°F when the outside air temperature is above 60°F and the setpoint is reset to 48°F when the outside air is below 55°F. The chiller plant is locked out when the outside air temperature is below 45°F and turned off from mid-December through February.



Image 3 Chiller Plant

The chiller plant supplies chilled water to air handlers 1,2 and 3 units. The facility engineers manually stage on chillers to meet the load, operating the least number of chillers required.

The chiller plant is 12 years old but has been well maintained.

Hot Water Heating System

The hot water system consists of two Well-McClain 724 kBtu/hr output, non-condensing hot water boilers (B1 & 2). The boilers have a nominal combustion efficiency of 85.10%. The boilers are configured in a constant flow primary distribution with two hot water pumps (P1 & 2). Hot water is supplied at 180°F when the outside air temperature is below 50°F and the setpoint is reset to 155°F when the outside air is above 65°F. The boilers provide hot water to air handlers 1,2 and 3.

The boilers operate in a lead/lag configuration. Both boilers may be required during cold weather. The lead boiler is rotated weekly.



Image 4 Hot Water Boiler system

The boilers are in good condition and well maintained.

Direct Expansion Air Conditioning System (DX)

Four 3-ton Mitsubishi cooling only split systems (14.40 EER) are used to condition the offices. The compressor and condensing unit are located on the roof. One 5-ton Carrier ceiling-suspended duct free split AC with 12 EER also used to condition the Police Department along with one 3-ton Liebert Ductless mini-split AC with 10.30 EER in the surveillance room. The Police Department has dedicated three AHUs which serves first floor, second floor and court room respectively.

The unit is manually controlled by the Carrier BEMS. The unit operates on demand to maintain a space temperature setpoint around 75°F (adjustable by staff).



Image 5 AHU & DX Systems on Roof

Building Energy Management System (BEMS)

The majority of the facility is controlled with a Carrier building energy management system (BEMS). The BEMS aggregates the DDC points from throughout the building. Roughly 90% of the building zones are DDC and the remainder have pneumatic controls which are not tied into the BEMS. The system is capable of providing trends for individual DDC points for up to one-year of historical data.

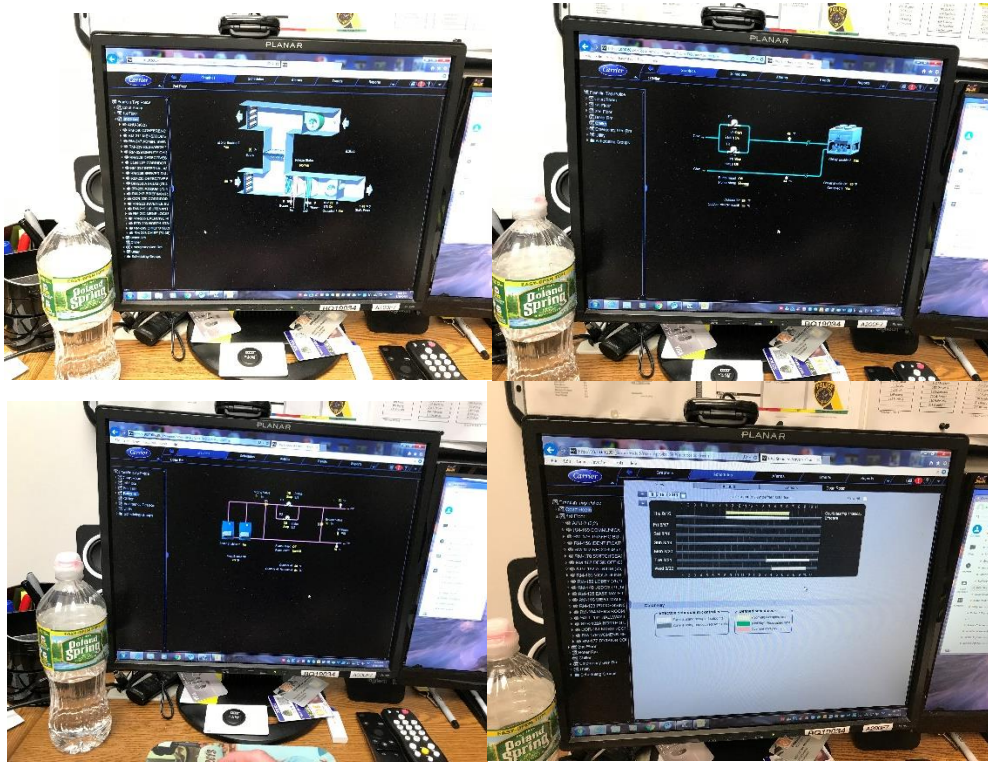


Image 6 BEMS

The chiller & boiler plants are also controlled by the same Carrier BEMS. The entire central plant is DDC. The BEMS can provide trends for individual DDC points for up to one-year of historical data.

Domestic Hot Water Heating System

The Police Department has a 72-gallon gas fired domestic water heater with an input rating of 72.10 kbtu/hr and a nominal efficiency of 80%. A 50-Watt recirculation pump distributes 120°F hot water throughout the building continuously.



Image 7 DHW Heater with Storage Tank

Building Plug Load

There are roughly 90 computer work stations throughout the facility. Roughly 90% of the computers are desktop units with LCD monitors. There is a centralized PC power management software installed.

There are five total telephone and server closets scattered throughout the facility. Half of them have cooling provided by dedicated split systems. The remaining use air provided by the main AHUs.

The facility has one refrigerated beverage and one non-refrigerated vending machine.



Image 8 Vending Machines

2.7 Water-Using Systems

There are four restrooms at this facility. A sampling of restrooms found that all of the faucets are rated for 2.2 gallon per minute (gpm) or higher, the toilets are rated at 2.5 gallons per flush (gpf) and the urinals are rated at 2 gpf.

3 SITE ENERGY USE AND COSTS

Utility data for electricity and natural gas was analyzed to identify opportunities for savings. In addition, data for electricity and natural gas was evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 3.4 for additional information.

3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

Figure 7 - Utility Summary

Utility Summary for Police Department		
Fuel	Usage	Cost
Electricity	700,391 kWh	\$86,828
Natural Gas	17,579 Therms	\$15,008
Total		\$101,836

The current annual energy cost for this facility is \$101,836 as shown in the chart below.

Figure 8 - Energy Cost Breakdown

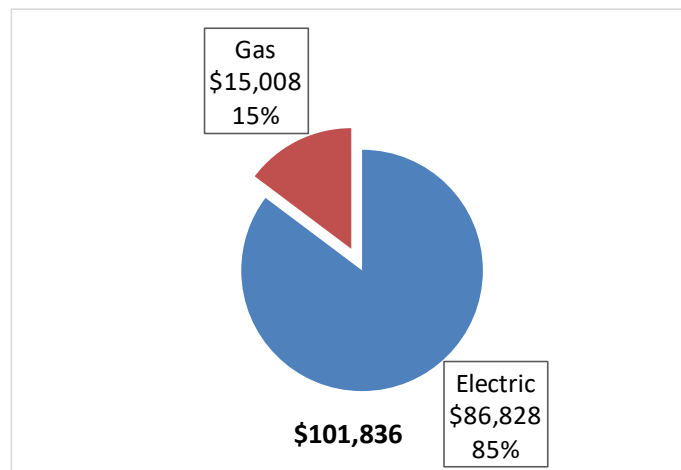

3.2 Electricity Usage

Electricity is provided by PSE&G. The average electric cost over the past 12 months was \$0.124/kWh, which is the blended rate that includes energy supply, distribution, and other charges. This rate is used throughout the analyses in this report to assess energy costs and savings. The monthly electricity consumption and peak demand are shown in the chart below.

Figure 9 - Electric Usage & Demand

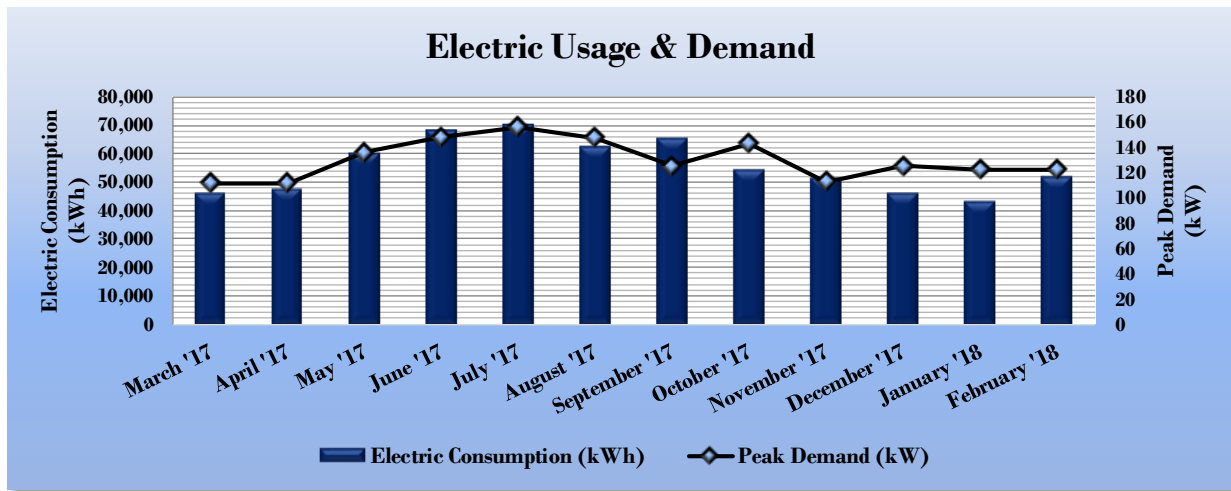


Figure 10 - Electric Usage & Demand

Electric Billing Data for Police Department					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
4/3/17	27	46,137	111		\$4,148
5/4/17	30	47,597	111		\$5,644
6/5/17	30	60,472	136		\$8,263
7/5/17	29	68,511	148		\$9,230
8/2/17	26	70,406	156		\$9,529
9/1/17	28	62,874	147		\$8,649
10/3/17	31	65,453	125		\$6,396
11/1/17	27	54,491	143		\$6,342
12/4/17	32	51,781	113		\$6,204
1/8/18	33	46,442	125		\$6,206
2/1/18	22	43,295	123		\$6,167
3/6/18	34	52,230	123		\$6,243
Totals	349	669,689	156.4	\$0	\$83,022
Annual	365	700,391	156.4	\$0	\$86,828

3.3 Natural Gas Usage

Natural gas is provided by PSE&G. The average gas cost for the past 12 months is \$0.854/therm, which is the blended rate used throughout the analyses in this report. The monthly gas consumption is shown in the chart below.

Figure 11 - Natural Gas Usage

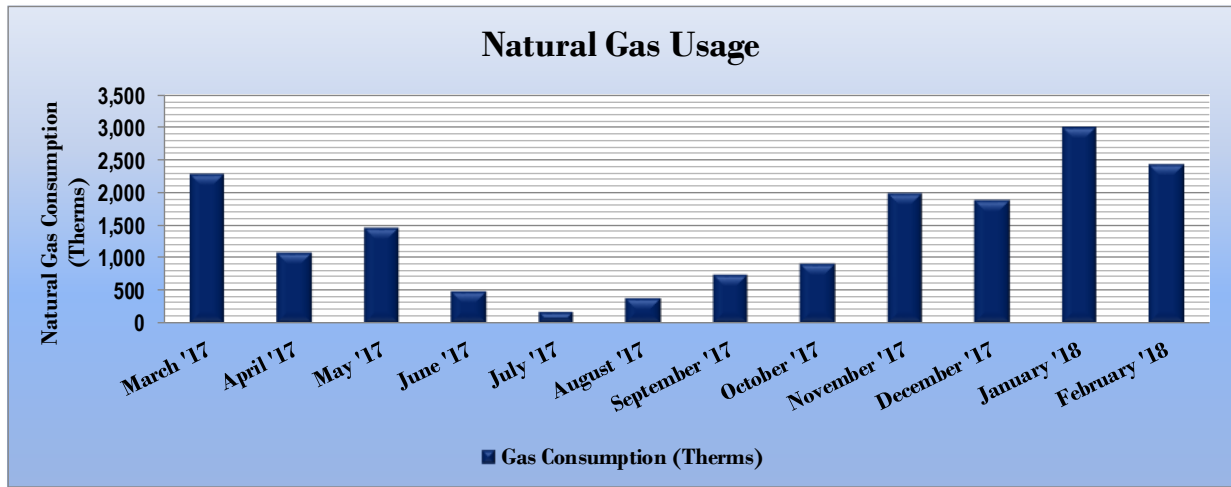


Figure 12 - Natural Gas Usage

Gas Billing Data for Police Department				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
4/3/17	27	2,276	\$1,746	No
5/4/17	30	1,077	\$885	No
6/5/17	30	1,454	\$1,155	No
7/5/17	29	494	\$489	No
8/2/17	26	168	\$237	No
9/1/17	28	391	\$410	No
10/3/17	31	735	\$677	Yes
11/1/17	27	917	\$1,160	Yes
12/4/17	32	1,976	\$1,984	Yes
1/8/18	33	1,884	\$1,476	No
2/1/18	22	2,998	\$2,206	No
3/6/18	34	2,439	\$1,925	No
Totals	349	16,809	\$14,350	
Annual	365	17,579	\$15,008	

3.4 Benchmarking

This facility was benchmarked using Portfolio Manager®, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager® analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

Figure 13 - Energy Use Intensity Comparison – Existing Conditions

Energy Use Intensity Comparison - Existing Conditions		
	Police Department	National Median Building Type: Municipal
Source Energy Use Intensity (kBtu/ft ²)	292.2	148.1
Site Energy Use Intensity (kBtu/ft ²)	129.6	67.3

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

Figure 14 - Energy Use Intensity Comparison – Following Installation of Recommended Measures

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	Police Department	National Median Building Type: Municipal
Source Energy Use Intensity (kBtu/ft ²)	278.5	148.1
Site Energy Use Intensity (kBtu/ft ²)	124.6	67.3

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide and may be eligible for ENERGY STAR® certification. Your building is not being one of the building categories that are eligible to receive a score.

A Portfolio Manager® Statement of Energy Performance (SEP) was generated for this facility, see Appendix B: ENERGY STAR® Statement of Energy Performance.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager® account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>

3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 15 - Energy Balance (% and kBtu/SF)

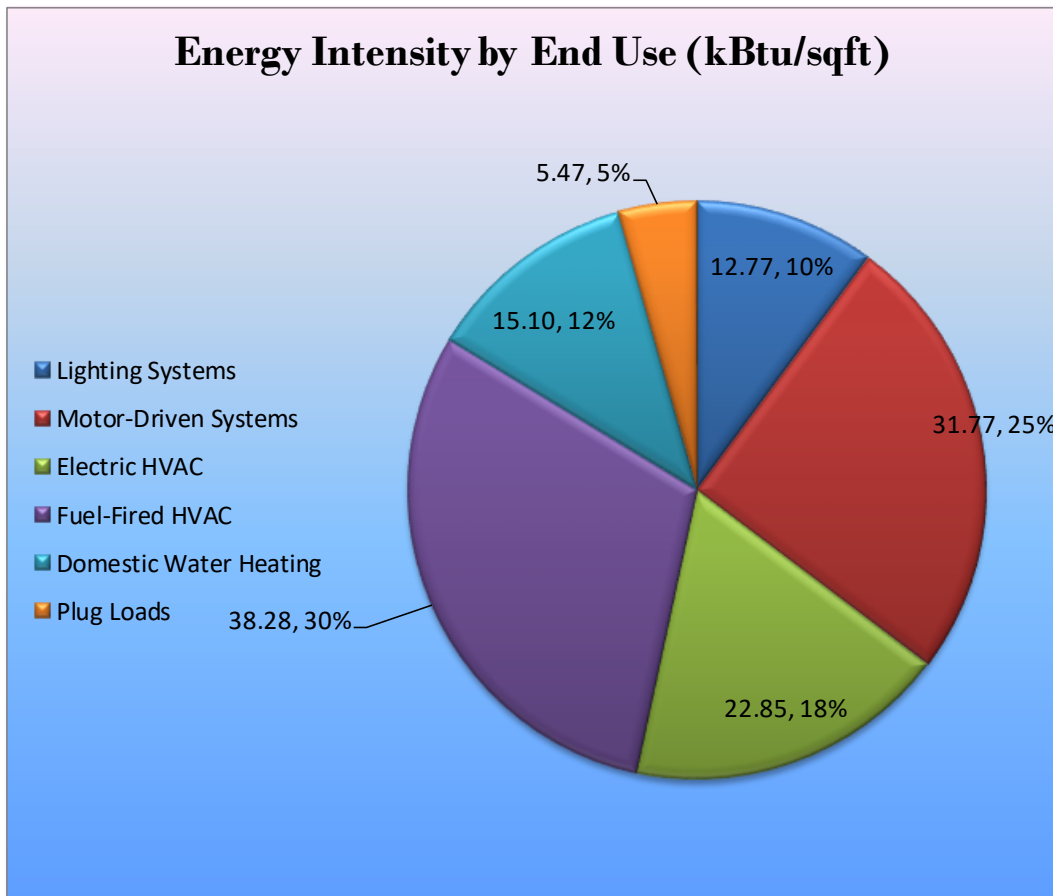

4 ENERGY CONSERVATION MEASURES

Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to the Police Department regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

4.1 Recommended ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 16 – Summary of Recommended ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		2,606	0.2	0.0	\$323.08	\$162.90	\$20.00	\$142.90	0.4	2,624
ECM 1	Retrofit Fixtures with LED Lamps	2,606	0.2	0.0	\$323.08	\$162.90	\$20.00	\$142.90	0.4	2,624
Lighting Control Measures		33,058	2.8	0.0	\$4,098.27	\$10,038.00	\$1,415.00	\$8,623.00	2.1	33,289
ECM 2	Install Occupancy Sensor Lighting Controls	33,058	2.8	0.0	\$4,098.27	\$10,038.00	\$1,415.00	\$8,623.00	2.1	33,289
Domestic Water Heating Upgrade		0	0.0	32.7	\$279.56	\$114.72	\$0.00	\$114.72	0.4	3,834
ECM 3	Install Low-Flow Domestic Hot Water Devices	0	0.0	32.7	\$279.56	\$114.72	\$0.00	\$114.72	0.4	3,834
Plug Load Equipment Control - Vending Machine		1,954	0.0	0.0	\$242.28	\$460.00	\$0.00	\$460.00	1.9	1,968
ECM 4	Vending Machine Control	1,954	0.0	0.0	\$242.28	\$460.00	\$0.00	\$460.00	1.9	1,968
TOTALS		37,619	3.0	32.7	\$4,943.20	\$10,775.62	\$1,435.00	\$9,340.62	1.9	41,716

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

4.1.1 Lighting Upgrades

Our recommendations for upgrades to existing lighting fixtures are summarized in Figure 17 below.

Figure 17 – Summary of Lighting Upgrade ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		2,606	0.2	0.0	\$323.08	\$162.90	\$20.00	\$142.90	0.4	2,624
ECM 1	Retrofit Fixtures with LED Lamps	2,606	0.2	0.0	\$323.08	\$162.90	\$20.00	\$142.90	0.4	2,624

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 1: Retrofit Fixtures with LED Lamps

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	2,527	0.2	0.0	\$313.29	\$152.90	\$20.00	\$132.90	0.4	2,545
Exterior	79	0.0	0.0	\$9.79	\$10.00	\$0.00	\$10.00	1.0	80

Measure Description

We recommend retrofitting existing incandescent lighting technologies with LED lamps. LED bulbs can be used in existing fixtures as a direct replacement for most other lighting technologies. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tube and more than ten times longer than many incandescent lamps.

4.1.2 Lighting Control Measures

Our recommendations for lighting control measures are summarized in Figure 18 below.

Figure 18 – Summary of Lighting Control ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures	33,058	2.8	0.0	\$4,098.27	\$10,038.00	\$1,415.00	\$8,623.00	2.1	33,289
ECM 2 Install Occupancy Sensor Lighting Controls	33,058	2.8	0.0	\$4,098.27	\$10,038.00	\$1,415.00	\$8,623.00	2.1	33,289

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 2: Install Occupancy Sensor Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
33,058	2.8	0.0	\$4,098.27	\$10,038.00	\$1,415.00	\$8,623.00	2.1	33,289

Measure Description

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in all restrooms, offices, storage areas and meeting rooms. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

4.1.3 Domestic Hot Water Heating System Upgrades

Our recommendations for domestic water heating system improvements are summarized in Figure 19 below.

Figure 19 - Summary of Domestic Water Heating ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	32.7	\$279.56	\$114.72	\$0.00	\$114.72	0.4	3,834
ECM 3	Install Low-Flow Domestic Hot Water Devices	0	0.0	32.7	\$279.56	\$114.72	\$0.00	\$114.72	0.4	3,834

ECM 3: Install Low-Flow DHW Devices

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	32.7	\$279.56	\$114.72	\$0.00	\$114.72	0.4	3,834

Measure Description

We recommend installing low-flow domestic hot water devices to reduce overall hot water demand. Energy demand from domestic hot water heating systems can be reduced by reducing water usage in general. Faucet aerators can reduce hot water usage, relative to standard aerators, which saves energy.

Low-flow devices reduce the overall water flow from the fixture, while still adequate pressure for washing. This reduces the amount of water used per day resulting in energy and water savings.

4.1.4 Plug Load Equipment Control - Vending Machines

Our recommendations for plug load equipment controls are summarized in Figure 20 below.

Figure 20 - Summary of Plug Load Equipment Control ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Plug Load Equipment Control - Vending Machine		1,954	0.0	0.0	\$242.28	\$460.00	\$0.00	\$460.00	1.9	1,968
ECM 4	Vending Machine Control	1,954	0.0	0.0	\$242.28	\$460.00	\$0.00	\$460.00	1.9	1,968

ECM 4: Vending Machine Control

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
1,954	0.0	0.0	\$242.28	\$460.00	\$0.00	\$460.00	1.9	1,968

Measure Description

Vending machines operate continuously, even during non-business hours. It is recommended to install occupancy sensor controls to reduce the energy use. These controls power down vending machines when the vending machine area has been vacant for some time, then power up at regular intervals, as needed, to turn machine lights on or keep the product cool. Energy savings are a dependent on vending machine and activity level in the area surrounding the machines.

5 ENERGY EFFICIENT PRACTICES

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

Perform Proper Lighting Maintenance

In order to sustain optimal lighting levels, lighting fixtures should undergo routine maintenance. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust on lamps, fixtures and reflective surfaces. Together, these factors can reduce total illumination by 20% - 60% or more, while operating fixtures continue drawing full power. To limit this reduction, lamps, reflectors and diffusers should be thoroughly cleaned of dirt, dust, oil, and smoke film buildup approximately every 6 – 12 months.

Develop a Lighting Maintenance Schedule

In addition to routine fixture cleaning, development of a maintenance schedule can both ensure maintenance is performed regularly and can reduce the overall cost of fixture re-lamping and re-ballasting. By re-lamping and re-ballasting fixtures in groups, lighting levels are better maintained and the number of site visits by a lighting technician or contractor can be minimized, decreasing the overall cost of maintenance.

Ensure Lighting Controls Are Operating Properly

Lighting controls are very cost effective energy efficient devices, when installed and operating correctly. As part of a lighting maintenance schedule, lighting controls should be tested annually to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight sensors, maintenance involves cleaning of sensor lenses and confirming setpoints and sensitivity are appropriately configured.

Clean Evaporator/Condenser Coils on AC Systems

Dirty evaporators and condensers coils cause a restriction to air flow and restrict heat transfer. This results in increased evaporator and condenser fan load and a decrease in cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

Clean and/or Replace HVAC Filters

Air filters work to reduce the amount of indoor air pollution and increase occupant comfort. Over time, filters become less and less effective as particulate buildup increases. In addition to health concerns related to clogged filters, filters that have reached saturation also restrict air flow through the facility's air conditioning or heat pump system, increasing the load on the distribution fans and decreasing occupant comfort levels. Filters should be checked monthly and cleaned or replaced when appropriate.

Perform Proper Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to retain proper functionality and efficiency of the heating system. Fuel burning equipment should undergo yearly tune-ups to ensure they are operating as safely and efficiently as possible from a combustion standpoint. A tune-up should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely. Buildup of dirt, dust, or deposits on the internal surfaces of a boiler can greatly affect its heat transfer efficiency. These deposits can accumulate on the water side or fire side of the boiler. Boilers should be cleaned regularly according to the manufacturer's instructions to remove this build up in order to sustain efficiency and equipment life.

Water Conservation

Installing low-flow faucets or faucet aerators, low-flow showerheads, and kitchen sink pre-rinse spray valves saves both energy and water. These devices save energy by reducing the overall amount of hot water used hence reducing the energy used to heat the water. The flow ratings for EPA WaterSense™ (<http://www3.epa.gov/watersense/products>) labeled devices are 1.5 gpm for bathroom faucets, 2.0 gpm for showerheads, and 1.28 gpm for pre-rinse spray valves.

Installing dual flush or low-flow toilets and low-flow or waterless urinals are additional ways to reduce the sites water use, however, these devices do not provide energy savings at the site level. Any reduction in water use does however ultimately reduce grid level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users. The EPA WaterSense™ ratings for urinals is 0.5 gpf and toilets that use as little as 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

Refer to Section 4.1.3 for any low-flow ECM recommendations.

6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey's Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State's electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility’s electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has a **high** potential for installing a PV array.

The amount of 8,000 square feet of free area, ease of installation on roof and parking Lot, and the lack of shading elements contribute to the high potential for PV at the site. A PV array located on the roof may be feasible. If the Police Department is interested in pursuing the installation of PV, we recommended a full feasibility study be conducted.

Figure 21 - Photovoltaic Screening

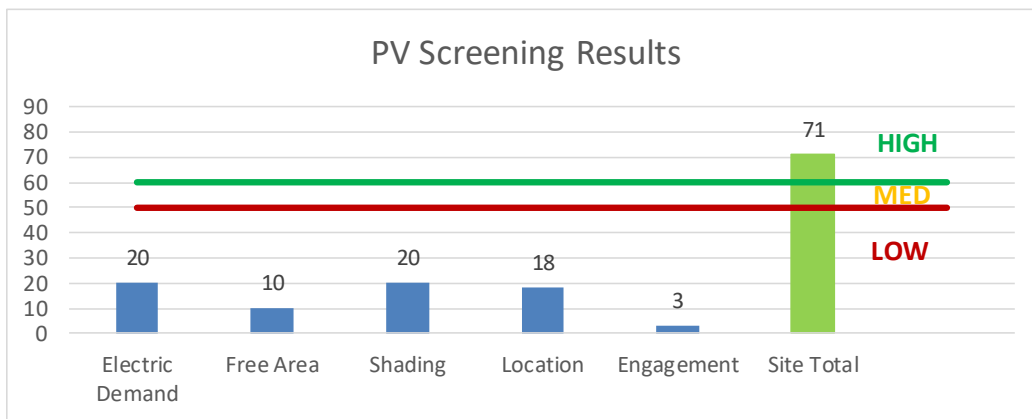

Potential	High	
System Potential	86	kWDC STC
Electric Generation	102,458	kWh/yr
Displaced Cost	\$8,910	/yr
Installed Cost	\$223,600	

Solar projects must register their projects in the SREC (Solar Renewable Energy Certificate) Registration Program (SRP) prior to the start of construction in order to establish the project’s eligibility to earn SRECs. Registration of the intent to participate in New Jersey’s solar marketplace provides market participants with information about developed new solar projects and insight into future SREC pricing. Refer to Section 8.3 for additional information.

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.

CHP systems are typically used to produce a portion of the electric power used onsite by a facility, with the balance of electric power needs supplied by grid purchases. The heat is used to supplement (or supplant) existing boilers for the purpose of space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for the purpose of space cooling. The key criteria used for screening, however, is the amount of time the system operates at full load and the facility's ability to use the recovered heat. Facilities with continuous use for large quantities of waste heat are the best candidates for CHP.


A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has a **low** potential for installing a cost-effective CHP system.

The magnitude, type, and duration of the thermal demand, the coincident electric load, and the ease of interconnection contribute to the potential for CHP at the site. Based on the amount of hot water used throughout the year and the concurrent electric demand a gas turbine/fuel cell may be feasible.

If the Police Department is interested in pursuing the installation of CHP, we recommended a more detailed feasibility study be conducted.

For a list of qualified firms in New Jersey specializing in commercial CHP cost assessment and installation, go to: http://www.njcleanenergy.com/commercial-industrial/programs/ni-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/.

Figure 22 - Combined Heat and Power Screening

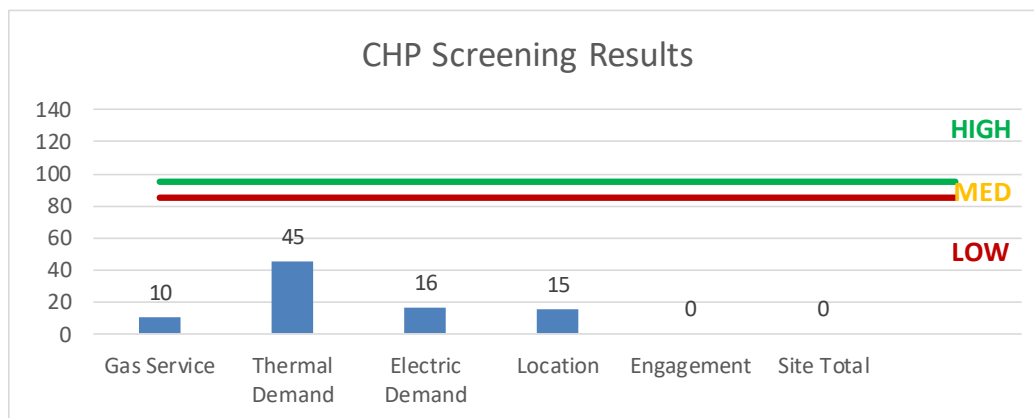

7 DEMAND RESPONSE

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

This facility is not a good candidate for DR curtailment.

8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 23 for a list of the eligible programs identified for each recommended ECM.

Figure 23 - ECM Incentive Program Eligibility

Energy Conservation Measure		SmartStart Prescriptive	SmartStart Custom	Direct Install	Pay For Performance Existing Buildings	Large Energy Users Program	Combined Heat & Power and Fuel Cell
ECM 1	Retrofit Fixtures with LED Lamps	X		X			
ECM 2	Install Occupancy Sensor Lighting Controls	X		X			
ECM 3	Install Low-Flow Domestic Hot Water Devices			X			
ECM 4	Vending Machine Control			X			

SmartStart is generally well-suited for implementation of individual measures or small group of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities that can bundle multiple ECMs together. This can greatly simplify participation and may lead to higher incentive amounts, but requires the use of pre-approved contractors. The Pay for Performance (P4P) program is a “whole-building” energy improvement program designed for larger facilities. It requires implementation of multiple measures meeting minimum savings thresholds, as well as use of pre-approved consultants. The Large Energy Users Program (LEUP) is available to New Jersey’s largest energy users giving them flexibility to install as little or as many measures, in a single facility or several facilities, with incentives capped based on the entity’s annual energy consumption. LEUP applicants can use in-house staff or a preferred contractor.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: www.njcleanenergy.com/ci.

8.1 SmartStart

Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: www.njcleanenergy.com/SSB.

8.2 Direct Install

Overview

Direct Install is a turnkey program available to existing small to medium-sized facilities with a peak electric demand that does not exceed 200 kW for a recent 12-month period. You will work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Direct Install participants will also be held to a fiscal year cap of \$250,000 per entity.

How to Participate

To participate in the Direct Install program you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Since Direct Install offers a free assessment of eligible measures, Direct Install is also available to small businesses and other commercial facilities too that may not be eligible for the more detailed facility audits provided by LGEA.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

8.3 SREC Registration Program

The SREC (Solar Renewable Energy Certificate) Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SRP prior to the start of construction in order to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number which enables it to generate New Jersey SRECs. SREC's are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SREC's to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar RPS. One way they can meet the RPS requirements is by purchasing SRECs. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period can and will fluctuate depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.

8.4 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third-party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility is purchasing electricity from a third-party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third-party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility is purchasing natural gas from a third-party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third-party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

Appendix A: Equipment Inventory & Recommendations

Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Stairs 1	2	LED Screw-In Lamps: Bulb (17W) - 1L	Wall Switch	17	8,736	None	Yes	2	LED Screw-In Lamps: Bulb (17W) - 1L	Occupancy Sensor	17	6,115	0.01	101	0.0	\$12.48	\$116.00	\$20.00	7.69
Stairs 1	6	LED Screw-In Lamps: Bulb (17W) - 1L	Wall Switch	17	8,736	None	No	6	LED Screw-In Lamps: Bulb (17W) - 1L	Wall Switch	17	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Exterior	1	LED Screw-In Lamps: Bulb (17W) - 1L	Wall Switch	17	8,736	None	Yes	1	LED Screw-In Lamps: Bulb (17W) - 1L	Occupancy Sensor	17	6,115	0.00	50	0.0	\$6.24	\$30.00	\$0.00	4.81
Court Room	20	LED Screw-In Lamps: Bulb (17W) - 1L	Wall Switch	17	8,736	None	No	20	LED Screw-In Lamps: Bulb (17W) - 1L	Wall Switch	17	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Women	1	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	1	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.00	33	0.0	\$4.04	\$30.00	\$0.00	7.43
Women	3	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	No	3	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Vestibule	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.01	62	0.0	\$7.71	\$30.00	\$0.00	3.89
Vestibule	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	No	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairs 2	7	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	7	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.02	218	0.0	\$26.98	\$116.00	\$20.00	3.56
Men's Room	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	High/Low Control	11	6,115	None	Yes	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	4,281	0.01	46	0.0	\$5.65	\$116.00	\$20.00	16.98
Men	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.01	65	0.0	\$8.08	\$116.00	\$20.00	11.89
Meeting Room	5	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	No	5	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Maintenance	1	LED Screw-In Lamps: Bulb (10.5W) - 1L	High/Low Control	11	6,115	None	Yes	1	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	4,281	0.00	23	0.0	\$2.83	\$30.00	\$0.00	10.61
Lobby Hall	38	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	38	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.10	1,182	0.0	\$146.49	\$30.00	\$0.00	0.20
Lobby	10	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	10	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.03	326	0.0	\$40.39	\$30.00	\$0.00	0.74
Identification Bureau	3	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	3	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.01	98	0.0	\$12.12	\$30.00	\$0.00	2.48
Hallway	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	2	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.01	62	0.0	\$7.71	\$30.00	\$0.00	3.89
Hallway	9	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	9	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.02	280	0.0	\$34.69	\$30.00	\$0.00	0.86
Electric Closet 2	1	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	No	1	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Court Room	6	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	6	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.02	195	0.0	\$24.23	\$116.00	\$20.00	3.96
Communication Center	4	LED Screw-In Lamps: Bulb (10.5W) - 1L	Wall Switch	11	8,736	None	Yes	4	LED Screw-In Lamps: Bulb (10.5W) - 1L	Occupancy Sensor	11	6,115	0.01	124	0.0	\$15.42	\$116.00	\$20.00	6.23
Traffic Office	9	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	9	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.10	1,159	0.0	\$143.74	\$116.00	\$20.00	0.67
Telephone closet	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$30.00	\$0.00	0.94
Supply	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Sergeant's Office	4	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	6,115	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	4,281	0.04	361	0.0	\$44.72	\$116.00	\$20.00	2.15

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Prosecutor	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Prof. Services	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.04	515	0.0	\$63.88	\$116.00	\$20.00	1.50
Prof. Services	8	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.08	1,031	0.0	\$127.77	\$270.00	\$35.00	1.84
Office 2	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Office	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Office	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$30.00	\$0.00	0.94
Office	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.04	515	0.0	\$63.88	\$270.00	\$35.00	3.68
Lieutenants Office	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.03	386	0.0	\$47.91	\$116.00	\$20.00	2.00
Judge	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$270.00	\$35.00	7.36
Investigate Division	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.01	129	0.0	\$15.97	\$30.00	\$0.00	1.88
Investigate Division	15	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	15	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.16	1,932	0.0	\$239.56	\$232.00	\$40.00	0.80
Interview 2	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$270.00	\$35.00	7.36
Interview 1	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$30.00	\$0.00	0.94
Identification Bureau	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.04	515	0.0	\$63.88	\$116.00	\$20.00	1.50
Identification Bureau	11	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	11	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.12	1,417	0.0	\$175.68	\$232.00	\$40.00	1.09
Hallway	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.01	129	0.0	\$15.97	\$30.00	\$0.00	1.88
Greg's Office	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.03	386	0.0	\$47.91	\$116.00	\$20.00	2.00
Divison Commander Office	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	No	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Copy room	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Copy room	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$270.00	\$35.00	7.36
Computer Room	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	None	Yes	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	4,281	0.01	90	0.0	\$11.18	\$30.00	\$0.00	2.68
Communication Center	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Communication Center	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.04	515	0.0	\$63.88	\$116.00	\$20.00	1.50
Communication Center	5	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.05	644	0.0	\$79.85	\$116.00	\$20.00	1.20
Commander's Office	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.04	515	0.0	\$63.88	\$270.00	\$35.00	3.68

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Chief's Office	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Chief's Office	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.03	386	0.0	\$47.91	\$116.00	\$20.00	2.00
Break Room	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
2nd FI Supply	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,736	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Office	6	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	26	8,736	None	No	6	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	26	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Meeting Room	15	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	26	8,736	None	Yes	15	LED - Linear Tubes: (3) 2' Lamps	Occupancy Sensor	26	6,115	0.09	1,133	0.0	\$140.43	\$540.00	\$70.00	3.35
Evidence Room	1	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	26	8,736	None	Yes	1	LED - Linear Tubes: (3) 2' Lamps	Occupancy Sensor	26	6,115	0.01	76	0.0	\$9.36	\$30.00	\$0.00	3.20
Conference Room	8	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	26	8,736	None	Yes	8	LED - Linear Tubes: (3) 2' Lamps	Occupancy Sensor	26	6,115	0.05	604	0.0	\$74.90	\$270.00	\$35.00	3.14
Computer Room	1	LED - Linear Tubes: (3) 2' Lamps	Occupancy Sensor	26	6,115	None	Yes	1	LED - Linear Tubes: (3) 2' Lamps	Occupancy Sensor	26	4,281	0.01	53	0.0	\$6.55	\$30.00	\$0.00	4.58
Women's Office	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Women	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.01	172	0.0	\$21.29	\$30.00	\$0.00	1.41
Women	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.03	344	0.0	\$42.59	\$116.00	\$20.00	2.25
Women	6	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.04	515	0.0	\$63.88	\$116.00	\$20.00	1.50
Telephone closet	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.01	172	0.0	\$21.29	\$30.00	\$0.00	1.41
Storage	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.02	258	0.0	\$31.94	\$30.00	\$0.00	0.94
Sally Port 2	11	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	11	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.08	945	0.0	\$117.12	\$116.00	\$20.00	0.82
Room 179	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Restroom	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.01	86	0.0	\$10.65	\$30.00	\$0.00	2.82
Office	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Office	10	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.07	859	0.0	\$106.47	\$270.00	\$35.00	2.21
Men's Locker	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,115	None	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,281	0.04	361	0.0	\$44.72	\$30.00	\$0.00	0.67
Men	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.01	172	0.0	\$21.29	\$270.00	\$35.00	11.04
Men	6	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.04	515	0.0	\$63.88	\$116.00	\$20.00	1.50
Janitor Closet	1	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,115	None	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,281	0.01	60	0.0	\$7.45	\$30.00	\$0.00	4.03
Identification Bureau	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.01	172	0.0	\$21.29	\$116.00	\$20.00	4.51

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Hallway	18	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.13	1,546	0.0	\$191.65	\$30.00	\$0.00	0.16
Hallway	19	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	19	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.13	1,632	0.0	\$202.29	\$30.00	\$0.00	0.15
Gym	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,115	None	No	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,115	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Girl's Locker	4	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,115	None	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,281	0.03	240	0.0	\$29.81	\$116.00	\$20.00	3.22
Garage	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	No	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Evidence Room	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.01	172	0.0	\$21.29	\$116.00	\$20.00	4.51
Evidence Locker	6	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.04	515	0.0	\$63.88	\$30.00	\$0.00	0.47
Elevator	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Electric Closet	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Electric 3	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Communication Department	9	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.06	773	0.0	\$95.82	\$116.00	\$20.00	1.00
Communication Center	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.03	344	0.0	\$42.59	\$116.00	\$20.00	2.25
Cell Blocks 1-4	7	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.05	601	0.0	\$74.53	\$116.00	\$20.00	1.29
Cell Blocks 1-2F	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	0.02	258	0.0	\$31.94	\$116.00	\$20.00	3.01
Cell Blocks	12	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	None	No	12	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Boiler Room	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,115	None	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,281	0.04	301	0.0	\$37.26	\$116.00	\$20.00	2.58
Armory	3	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,115	None	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,281	0.02	180	0.0	\$22.36	\$270.00	\$35.00	10.51
Supply	1	LED - Linear Tubes: (2) 3' Lamps	Wall Switch	21	8,736	None	Yes	1	LED - Linear Tubes: (2) 3' Lamps	Occupancy Sensor	21	6,115	0.01	62	0.0	\$7.71	\$30.00	\$0.00	3.89
Men's Room	6	LED - Linear Tubes: (2) 3' Lamps	High/Low Control	21	6,115	None	Yes	6	LED - Linear Tubes: (2) 3' Lamps	Occupancy Sensor	21	4,281	0.03	261	0.0	\$32.38	\$270.00	\$35.00	7.26
Air Controls	1	LED - Linear Tubes: (2) 3' Lamps	Wall Switch	21	8,736	None	Yes	1	LED - Linear Tubes: (2) 3' Lamps	Occupancy Sensor	21	6,115	0.01	62	0.0	\$7.71	\$30.00	\$0.00	3.89
Shower	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,736	None	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	6,115	0.00	50	0.0	\$6.24	\$30.00	\$0.00	4.81
Court Room	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,736	None	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	8,736	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Men's Room	3	LED - Linear Tubes: (1) 3' Lamp	High/Low Control	11	6,115	None	Yes	3	LED - Linear Tubes: (1) 3' Lamp	Occupancy Sensor	11	4,281	0.01	65	0.0	\$8.10	\$116.00	\$20.00	11.86
Lobby	2	LED - Fixtures: Wall Sconces	Wall Switch	32	8,736	None	Yes	2	LED - Fixtures: Wall Sconces	Occupancy Sensor	32	6,115	0.02	190	0.0	\$23.50	\$30.00	\$0.00	1.28
Lobby	8	LED - Fixtures: Wall Sconces	Wall Switch	32	8,736	None	Yes	8	LED - Fixtures: Wall Sconces	Occupancy Sensor	32	6,115	0.06	758	0.0	\$93.99	\$30.00	\$0.00	0.32

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Hallway	12	LED - Fixtures: Wall Sconces	Occupancy Sensor	32	6,115	None	No	12	LED - Fixtures: Wall Sconces	Occupancy Sensor	32	6,115	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Court Hallway	2	LED - Fixtures: Wall Sconces	Wall Switch	32	8,736	None	Yes	2	LED - Fixtures: Wall Sconces	Occupancy Sensor	32	6,115	0.02	190	0.0	\$23.50	\$116.00	\$20.00	4.09
Exterior	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Daylight Dimming	75	4,368	None	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Daylight Dimming	75	4,368	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Exterior	3	LED - Fixtures: Ceiling Mount	Daylight Dimming	19	4,368	None	No	3	LED - Fixtures: Ceiling Mount	Daylight Dimming	19	4,368	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Supply	1	Incandescent Bulb (60W) - 1L	Wall Switch	60	8,736	Relamp	Yes	1	LED Screw-In Lamps: LED Bulb (9W) - 1L	Occupancy Sensor	9	6,115	0.04	530	0.0	\$65.72	\$47.23	\$5.00	0.64
Pipe Room	3	Incandescent Bulb (60W) - 1L	Wall Switch	60	8,736	Relamp	Yes	3	LED Screw-In Lamps: LED Bulb (9W) - 1L	Occupancy Sensor	9	6,115	0.13	1,590	0.0	\$197.15	\$167.68	\$35.00	0.67
Vestibule	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairs 2	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Lobby	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Hallway	14	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	14	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Hallway	14	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	14	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Court Room	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Cell Blocks	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Court Office	2	Compact Fluorescent: Srial Bulb (17W) - 1L	Wall Switch	17	8,736	Relamp	Yes	2	LED - Fixtures: Other	Occupancy Sensor	11	6,115	0.02	184	0.0	\$22.76	\$150.00	\$20.00	5.71
Exterior	2	Compact Fluorescent: Srial Bulb (13W) - 1L	Wall Switch	13	8,736	Relamp	Yes	2	LED - Fixtures: Other	Occupancy Sensor	9	6,115	0.01	132	0.0	\$16.40	\$126.00	\$20.00	6.46
Court Room	10	Compact Fluorescent: Srial Bulb (13W) - 1L	Wall Switch	13	8,736	Relamp	Yes	10	LED - Fixtures: Other	Occupancy Sensor	9	6,115	0.05	661	0.0	\$81.99	\$166.00	\$20.00	1.78

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	AHU-1	1	Other	0.2	68.5%	No	2,745	No	68.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-1	1	Supply Fan	15.0	89.5%	Yes	3,391	No	89.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-1	1	Return Fan	15.0	89.5%	Yes	3,391	No	89.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-2	1	Other	0.2	68.5%	No	2,745	No	68.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-2	1	Supply Fan	25.0	93.0%	Yes	4,067	No	93.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-2	1	Return Fan	15.0	91.0%	Yes	3,391	No	91.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-3	1	Other	0.2	68.5%	No	2,745	No	68.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-3	1	Supply Fan	25.0	93.0%	Yes	4,067	No	93.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	AHU-3	1	Return Fan	15.0	91.7%	Yes	3,391	No	91.7%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	P1	1	Other	0.1	68.5%	No	2,745	No	68.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	P2	1	Other	0.3	73.4%	Yes	2,745	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Outdoor	Chillar Fan	8	Other	1.8	86.5%	No	2,745	No	86.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Exhaust Fan -5,12	2	Exhaust Fan	0.3	73.4%	No	2,745	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	P3	1	Heating Hot Water Pump	7.5	91.0%	Yes	3,391	No	91.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	P4	1	Heating Hot Water Pump	7.5	91.0%	Yes	0	No	91.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Fan Coil Unit	0.3	73.4%	No	2,745	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Ventilation Fan	0.5	76.2%	No	2,745	No	76.2%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Exhaust Fan	0.3	73.4%	No	2,745	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Exhaust Fan	0.8	81.1%	No	2,745	No	81.1%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Exhaust Fan	0.1	67.5%	No	2,745	No	67.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

		Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Police Department	1	Exhaust Fan	0.3	71.4%	No	2,745	No	71.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Exhaust Fan	0.3	73.4%	No	2,745	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Exhaust Fan	0.3	73.4%	No	2,745	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric HVAC Inventory & Recommendations

		Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis							
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Police Department	4	Split-System AC	3.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Split-System AC	5.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Police Department	1	Ductless Mini-Split AC	3.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric Chiller Inventory & Recommendations

		Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Outdoor	Police Department	1	Air-Cooled Screw Chiller	102.40	No							0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00	

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Building	1	Non-Condensing Hot Water Boiler	724.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Building	1	Non-Condensing Hot Water Boiler	724.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Building	1	Storage Tank Water Heater (> 50 Gal)	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Low-Flow Device Recommendations

Location	Recommendation Inputs				Energy Impact & Financial Analysis						
	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restrooms	16	Faucet Aerator (Lavatory)	2.20	1.00	0.00	0	32.7	\$279.56	\$114.72	\$0.00	0.41

Plug Load Inventory

Existing Conditions				
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Offices	90	Computers	100.0	No
Offices	11	Small Printer	45.0	No
Offices	10	Medium Printer	80.0	Yes
Mail Room	4	Big Printer	1,100.0	Yes
Mail Room	7	Paper Shredder	80.0	Yes
Court	1	Projector	300.0	No
Lunch Room	8	Microwave	800.0	No
Offices	4	Small Refrigerator	54.0	No
Break Room	2	Medium Refrigerator	80.0	Yes
Kitchen	5	Large Refrigerator	300.0	Yes
Pantry	3	Coffee Machine	800.0	Yes
Pantry	2	Toaster Oven	1,200.0	Yes
Lobby	6	CRT TV	250.0	Yes
Surveillance Room	2	Plasma 42" TV	200.0	No
Surveillance Room	4	LCD 42" TV	200.0	No
Court Room/Offices	3	LCD 50" TV	150.0	Yes
Offices	3	LED 50" TV	100.0	Yes

Vending Machine Inventory & Recommendations

Existing Conditions			Proposed Conditions	Energy Impact & Financial Analysis						
Location	Quantity	Vending Machine Type	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Lobby	1	Non-Refrigerated	Yes	0.00	343	0.0	\$42.46	\$230.00	\$0.00	5.42
Lobby	1	Refrigerated	Yes	0.00	1,612	0.0	\$199.82	\$230.00	\$0.00	1.15

Appendix B: ENERGY STAR® Statement of Energy Performance

ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

N/A

Franklin Township Police Department

Primary Property Type: Police Station
 Gross Floor Area (ft²): 32,000
 Built: 1991

For Year Ending: February 28, 2018
 Date Generated: September 10, 2018

ENERGY STAR®
Score¹

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address Franklin Township Police Department 495 DeMott Lane Somerset, New Jersey 08873	Property Owner Township of Franklin 475 DeMott Lane Somerset, NJ 08873 732-249-7800	Primary Contact Carl Hauck 475 DeMott Lane Somerset, NJ 08873 732-249-7800 carl.hauck@twp.franklin.nj.us
Property ID: 6449811		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 123.9 kBtu/ft ²	Annual Energy by Fuel		National Median Comparison
	Electric - Grid (kBtu)	2,284,080 (58%)	National Median Site EUI (kBtu/ft ²)
	Natural Gas (kBtu)	1,681,731 (42%)	National Median Source EUI (kBtu/ft ²)
			% Diff from National Median Source EUI
			104%
Source EUI 255 kBtu/ft ²			Annual Emissions
			Greenhouse Gas Emissions (Metric Tons CO2e/year)
			321

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

() _____



Professional Engineer Stamp
(if applicable)