



# Local Government Energy Audit: Energy Audit Report



Copyright ©2017 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

## **Municipal Building**

131 Perrineville Road

Jamesburg, NJ 08831

Borough of Jamesburg

July 23, 2018

Final Report by:

**TRC Energy Services**

## Disclaimer

---

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

# Table of Contents

---

<b>1</b>	<b>Executive Summary.....</b>	<b>1</b>
1.1	Facility Summary .....	1
1.2	Your Cost Reduction Opportunities.....	1
	Energy Conservation Measures.....	1
	Energy Efficient Practices .....	3
	On-Site Generation Measures.....	3
1.3	Implementation Planning.....	4
<b>2</b>	<b>Facility Information and Existing Conditions .....</b>	<b>5</b>
2.1	Project Contacts .....	5
2.2	General Site Information.....	5
2.3	Building Occupancy .....	5
2.4	Building Envelope .....	6
2.5	On-Site Generation.....	6
2.6	Energy-Using Systems .....	6
	Lighting System .....	6
	Hot Water (or Steam) Heating System.....	7
	Direct Expansion Air Conditioning System (DX) .....	7
	Domestic Hot Water Heating System.....	8
	Building Plug Load .....	8
2.7	Water-Using Systems .....	8
<b>3</b>	<b>Site Energy Use and Costs.....</b>	<b>9</b>
3.1	Total Cost of Energy .....	9
3.2	Electricity Usage .....	10
3.3	Natural Gas Usage .....	11
3.4	Benchmarking.....	12
3.5	Energy End-Use Breakdown .....	13
<b>4</b>	<b>Energy Conservation Measures .....</b>	<b>14</b>
4.1	Recommended ECMs .....	14
4.1.1	Lighting Upgrades.....	15
	ECM 1: Install LED Fixtures.....	15
	ECM 2: Retrofit Fixtures with LED Lamps.....	16
4.1.2	Lighting Control Measures .....	17
	ECM 3: Install Occupancy Sensor Lighting Controls .....	17
	ECM 4: Install High/Low Lighting Controls .....	18
4.1.3	HVAC System Upgrades.....	19
	ECM 5: Install Dual-Enthalpy Economizers.....	19
4.1.4	Domestic Hot Water Heating System Upgrades .....	20
	ECM 6: Install Tankless Hot Water Heater .....	20

4.2	ECMs Evaluated But Not Recommended .....	21
	Install High Efficiency Air Conditioning Units .....	21
	Install High Efficiency Furnaces .....	22
<b>5</b>	<b>Energy Efficient Practices .....</b>	<b>23</b>
	Use Window Treatments/Coverings .....	23
	Ensure Lighting Controls Are Operating Properly .....	23
	Practice Proper Use of Thermostat Schedules and Temperature Resets .....	23
	Plug Load Controls.....	23
	Water Conservation .....	24
<b>6</b>	<b>On-Site Generation Measures .....</b>	<b>25</b>
6.1	Photovoltaic.....	25
6.2	Combined Heat and Power .....	26
<b>7</b>	<b>Demand Response .....</b>	<b>27</b>
<b>8</b>	<b>Project Funding / Incentives .....</b>	<b>28</b>
8.1	SmartStart .....	29
8.2	Direct Install .....	30
8.3	Energy Savings Improvement Program .....	31
<b>9</b>	<b>Energy Purchasing and Procurement Strategies .....</b>	<b>32</b>
9.1	Retail Electric Supply Options.....	32
9.2	Retail Natural Gas Supply Options .....	32

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

# Table of Figures

---

Figure 1 – Previous 12 Month Utility Costs..... 2

Figure 2 – Potential Post-Implementation Costs ..... 2

Figure 3 – Summary of Energy Reduction Opportunities ..... 2

Figure 4 – Project Contacts ..... 5

Figure 5 - Building Schedule..... 5

Figure 6 - Utility Summary ..... 9

Figure 7 - Energy Cost Breakdown ..... 9

Figure 8 - Electric Usage & Demand..... 10

Figure 9 - Electric Usage & Demand..... 10

Figure 10 - Natural Gas Usage..... 11

Figure 11 - Natural Gas Usage..... 11

Figure 12 - Energy Use Intensity Comparison – Existing Conditions..... 12

Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures ..... 12

Figure 14 - Energy Balance (% and kBtu/SF) ..... 13

Figure 15 – Summary of Recommended ECMs..... 14

Figure 16 – Summary of Lighting Upgrade ECMs..... 15

Figure 17 – Summary of Lighting Control ECMs ..... 17

Figure 18 - Summary of HVAC System Improvement ECMs ..... 19

Figure 19 - Summary of Domestic Water Heating ECMs ..... 20

Figure 20 – Summary of Measures Evaluated, But Not Recommended ..... 21

Figure 21 - Photovoltaic Screening ..... 25

Figure 22 - Combined Heat and Power Screening ..... 26

Figure 23 - ECM Incentive Program Eligibility..... 28

# I EXECUTIVE SUMMARY

---

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for the Borough of Jamesburg Municipal Building.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist New Jersey municipalities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

## I.1 Facility Summary

The Borough of Jamesburg Municipal Building is a 10,204 square foot facility comprised of a police station, municipal offices, restrooms, Court Hall, locker rooms and a mechanical space. This is a two story facility with the police station occupying the lower level. The police station is occupied for 24 hours per day all year. The upper level houses the municipal offices and the Court Hall. These areas are occupied from 8:30 AM to 4:00 PM during most weekdays and from 8:00 AM to 5:00 PM from Monday to Thursday in July & August. The offices are closed on the weekends.

Space heating is provided by a gas fired furnace and two gas fired packaged units located on the roof. Cooling is provided by split AC units and rooftop packaged units with direct expansion coils. Lighting at the facility consists of T8 tubes and compact fluorescent lamps (CFL).


A thorough description of the facility and our observations are located in Section 2.

## I.2 Your Cost Reduction Opportunities


### Energy Conservation Measures

TRC evaluated eight measures and recommends six measures which together represent an opportunity for the Borough of Jamesburg Municipal Building to reduce annual energy costs by \$5,793 and annual greenhouse gas emissions by 48,491 lbs CO<sub>2</sub>e. We estimate that if all measures were implemented as recommended, the project would pay for itself in 5.4 years. The breakdown of existing and potential utility costs after project implementation are illustrated in Figure 1 and Figure 2, respectively. Together these measures represent an opportunity to reduce the Borough of Jamesburg Municipal Building's annual energy use by 29%.

**Figure 1 – Previous 12 Month Utility Costs**

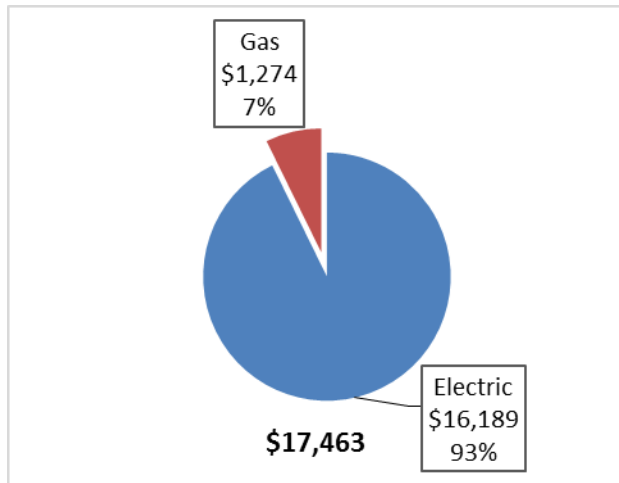

**Figure 2 – Potential Post-Implementation Costs**

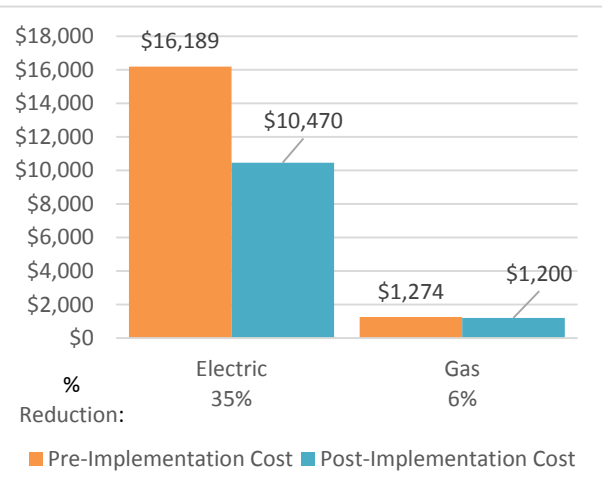

A detailed description of the Borough of Jamesburg Municipal Building’s existing energy use can be found in Section 3.

Estimates of the total cost, energy savings, and financial incentives for the proposed energy efficient upgrades are summarized below in Figure 3. A brief description of each category can be found below and a description of savings opportunities can be found in Section 4.

**Figure 3 – Summary of Energy Reduction Opportunities**

Energy Conservation Measure	Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>41,834</b>	<b>6.6</b>	<b>0.0</b>	<b>\$5,053.62</b>	<b>\$29,504.22</b>	<b>\$1,155.00</b>	<b>\$28,349.22</b>	<b>5.6</b>	<b>42,127</b>
ECM 1   Install LED Fixtures	Yes	13,878	2.3	0.0	\$1,676.50	\$13,280.67	\$1,000.00	\$12,280.67	7.3	13,975
ECM 2   Retrofit Fixtures with LED Lamps	Yes	27,956	4.3	0.0	\$3,377.12	\$16,223.55	\$155.00	\$16,068.55	4.8	28,151
<b>Lighting Control Measures</b>		<b>3,343</b>	<b>0.4</b>	<b>0.0</b>	<b>\$403.81</b>	<b>\$2,446.00</b>	<b>\$215.00</b>	<b>\$2,231.00</b>	<b>5.5</b>	<b>3,366</b>
ECM 3   Install Occupancy Sensor Lighting Controls	Yes	2,672	0.3	0.0	\$322.72	\$2,046.00	\$215.00	\$1,831.00	5.7	2,690
ECM 4   Install High/Low Lighting Controls	Yes	671	0.1	0.0	\$81.08	\$400.00	\$0.00	\$400.00	4.9	676
<b>Electric Unitary HVAC Measures</b>		<b>3,424</b>	<b>2.0</b>	<b>0.0</b>	<b>\$413.59</b>	<b>\$28,327.99</b>	<b>\$1,467.50</b>	<b>\$26,860.49</b>	<b>64.9</b>	<b>3,448</b>
Install High Efficiency Electric AC	No	3,424	2.0	0.0	\$413.59	\$28,327.99	\$1,467.50	\$26,860.49	64.9	3,448
<b>Gas Heating (HVAC/Process) Replacement</b>		<b>0</b>	<b>0.0</b>	<b>0.4</b>	<b>\$4.70</b>	<b>\$2,718.88</b>	<b>\$400.00</b>	<b>\$2,318.88</b>	<b>493.2</b>	<b>53</b>
Install High Efficiency Furnaces	No	0	0.0	0.4	\$4.70	\$2,718.88	\$400.00	\$2,318.88	493.2	53
<b>HVAC System Improvements</b>		<b>2,164</b>	<b>0.5</b>	<b>0.0</b>	<b>\$261.40</b>	<b>\$750.00</b>	<b>\$250.00</b>	<b>\$500.00</b>	<b>1.9</b>	<b>2,179</b>
ECM 5   Install Dual Enthalpy Outside Economizer Control	Yes	2,164	0.5	0.0	\$261.40	\$750.00	\$250.00	\$500.00	1.9	2,179
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>7.0</b>	<b>\$73.26</b>	<b>\$522.80</b>	<b>\$300.00</b>	<b>\$222.80</b>	<b>3.0</b>	<b>819</b>
ECM 6   Install Tankless Water Heater	Yes	0	0.0	7.0	\$73.26	\$522.80	\$300.00	\$222.80	3.0	819
<b>TOTAL OF ALL EVALUATED ECMS</b>		<b>50,764</b>	<b>9.5</b>	<b>7.4</b>	<b>\$6,210.38</b>	<b>\$64,269.89</b>	<b>\$3,787.50</b>	<b>\$60,482.39</b>	<b>9.7</b>	<b>51,991</b>
<b>TOTAL OF ALL RECOMMENDED ECMS</b>		<b>47,341</b>	<b>8</b>	<b>7</b>	<b>\$ 5,792.08</b>	<b>\$ 33,223.02</b>	<b>\$ 1,920.00</b>	<b>\$ 31,303.02</b>	<b>5.4</b>	<b>48,491</b>
<b>TOTAL OF ALL NON-RECOMMENDED ECMS</b>		<b>3,424</b>	<b>2</b>	<b>0</b>	<b>\$ 418.29</b>	<b>\$ 31,046.87</b>	<b>\$ 1,867.50</b>	<b>\$ 29,179.37</b>	<b>69.8</b>	<b>3,500</b>

\* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

**Lighting Upgrades** generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measure save energy by reducing the power used by the lighting components due to improved electrical efficiency.

**Lighting Controls** measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

**Electric Unitary HVAC** measures generally involve replacing older inefficient air conditioning systems with modern energy efficient systems. New air conditioning systems can provide equivalent cooling to older air condition systems at a reduced energy cost. These measures save energy by reducing the power used by the air conditioning systems, due to improved electrical efficiency.

**Gas Heating** (HVAC/Process) measures generally involve replacing older inefficient hydronic heating systems with modern energy efficient systems. Gas heating systems can provide equivalent heating compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel demands for heating, due to improved combustion and heat transfer efficiency.

**HVAC System Improvements** generally involve the installation of automated controls to reduce heating and cooling demand during periods of reduced demand. These measures could encompass changing temperature setpoints, using outside air for free cooling, or limiting excessive outside air during extreme outdoor air temperature conditions. These measures save energy by reducing the demand on HVAC systems and the amount of time systems operate.

**Domestic Hot Water** upgrade measures generally involve replacing older inefficient domestic water heating systems with modern energy efficient systems. New domestic hot water heating systems can provide equivalent, or greater, water heating capacity compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel used for domestic hot water heating due to improved heating efficiency or reducing standby losses.

### **Energy Efficient Practices**

TRC also identified five low cost (or no cost) energy efficient practices. A facility's energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. Potential opportunities identified at Borough of Jamesburg Municipal Building include:

- Use Window Treatments/Coverings
- Ensure Lighting Controls Are Operating Properly
- Practice Proper Use of Thermostat Schedules and Temperature Resets
- Install Plug Load Controls
- Water Conservation

For details on these energy efficient practices, please refer to Section 5.

### **On-Site Generation Measures**

TRC evaluated the potential for installing on-site generation for the Borough of Jamesburg Municipal Building. Based on the configuration of the site and its loads there is a low potential for installing any PV and combined heat and power self-generation measures.

For details on our evaluation and on-site generation potential, please refer to Section 6.



### I.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Direct Install
- Energy Savings Improvement Program (ESIP)

For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 8.

This facility may also qualify for the Direct Install program which can provide turnkey installation of multiple measures, through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures, although measure eligibility will have to be assessed and be verified by the designated Direct Install contractor and, in most cases, they will perform the installation work.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.3 for additional information on the ESIP Program.

The Demand Response Energy Aggregator is a (non-NJCEP) program designed to reduce electric loads at commercial facilities, when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. Demand Response (DR) service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability. By enabling grid operators to call upon commercial facilities to reduce their electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and facilities receive payments whether or not they are called upon to curtail their load during times of peak demand. Refer to Section 7 for additional information on this program.

Additional information on relevant incentive programs is located in Section 8 or: [www.njcleanenergy.com/ci](http://www.njcleanenergy.com/ci).

## 2 FACILITY INFORMATION AND EXISTING CONDITIONS

### 2.1 Project Contacts

Figure 4 – Project Contacts

Name	Role	E-Mail	Phone #
<b>Customer</b>			
Scott M. Frueh	Business Administrator/CFO	sfrueh@jamesburgborough.org	732-521-2222 Ext 110
Paul Intravartola	DPW Manager	jintravartola@jamesburgborough.org	732-521-3335
<b>TRC Energy Services</b>			
Smruti Srinivasan	Auditor	ssrinivasan@trcsolutions.com	(732) 855-0033

### 2.2 General Site Information

On February 22, 2018, TRC performed an energy audit at the Borough of Jamesburg Municipal Building located in Jamesburg, New Jersey. TRC's team met with Paul Intravartola to review the facility operations and help focus our investigation on specific energy-using systems.

The Borough of Jamesburg Municipal Building is a 10,204 square foot facility comprised of a police station, municipal offices, restrooms, Court Hall, locker rooms and a mechanical space. This is a two story facility with the police station occupying the lower level.

The original building was constructed in 1959. Space heating is provided by a gas fired furnace and two gas fired packaged units located on the roof. Cooling is provided by split AC units and rooftop packaged units with direct expansion coils. Lighting at the facility consists of T8 tubes and compact fluorescent lamps (CFL).

### 2.3 Building Occupancy

The typical schedule is presented in the table below. The police station is occupied for 24 hours per day all year. The upper level has the municipal offices and the Court Hall. These areas are occupied from 8:30 AM to 4:00 PM during most weekdays and from 8:00 AM to 5:00 PM from Monday to Thursday in July & August. The offices are closed on the weekends. During a typical day, the facility is occupied by approximately 30 staff.

Figure 5 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
Borough of Jamesburg	Weekday	Offices: 8:30AM - 4PM (Monday to Friday) 8AM - 5PM (Monday to Thursday, July & August) Police Station: 12AM - 12AM
Borough of Jamesburg	Weekend	Offices: No operation Police Station: 12AM - 12AM

## 2.4 Building Envelope

The building is constructed of concrete block with a concrete and brick facade. The roof is flat with a rubber coat EPDM membrane. The windows are double pane with blinds and in good condition. The exterior doors are constructed of aluminum framed glass and in good condition.



## 2.5 On-Site Generation

The Borough of Jamesburg Municipal Building does not have any on-site electric generation systems currently installed.

## 2.6 Energy-Using Systems

Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

### Lighting System

Lighting is provided mostly by 4-foot 2-lamp 32-Watt linear fluorescent T8 lamps and 2-foot U-bent, 2-lamp fixtures with electronic ballasts as well as some compact fluorescent lamps (CFL).

Lighting control in most spaces is provided by occupancy sensors while manual wall switches are used in other locations. The occupancy sensors are either wall or ceiling mounted depending on the space layout. The Borough of Jamesburg Municipal Building participated in the Direct Install program in 2011 to get occupancy sensors installed in the building. All exit signs in the facility are LED fixtures.

The building's exterior lighting consists of wall pack fixtures with 250-Watt high pressure sodium lamps and some LED wall pack fixtures (~50-Watt) by the police station side entrances. The pole fixtures in the parking lot have 400-Watt high pressure sodium lamps.



## Hot Water (or Steam) Heating System

The upper level (municipal offices) and the lower level (police station) are heated using two rooftop packaged units (York) equipped with gas fired furnaces. The onsite auditor did not have roof access. Hence the output capacities of these units have been reasonably assumed for analytical purposes using information available to us. One of these units was replaced in 2017 and the other unit is approximately 20 years old.

The Court Hall in the upper level is heated separately using a York gas fired furnace with an output capacity of 120 MBh. The furnace was installed in 2000 and has been evaluated for replacement.

The space temperatures are controlled using programmable thermostats in the respective zones.



## Direct Expansion Air Conditioning System (DX)

Upper and lower levels are cooled using two rooftop packaged units with direct expansion coils. One of the units which was replaced in 2017 was described by the site contact to be a 10-ton cooling capacity. The cooling capacity of the other unit has been assumed for analytical purposes. This unit is more than 20 years old and has been evaluated for replacement. The space temperatures in these areas are being controlled using programmable thermostats in the respective zones.

The Court Hall in the upper level is cooled using two 5-ton split AC units from York. These units were installed in 2003 and have been evaluated for replacement. The Court House has its own programmable thermostat to control space temperature.



## **Domestic Hot Water Heating System**



The domestic hot water heating system for the facility consists of one gas fired water heater (Bradford White) of input capacity 40 MBh and an energy factor of 63%, serving the restrooms. The tank capacity of the unit is 40 gallons. The unit was installed in 2009 and in good condition.

## **Building Plug Load**

There are 19 computer work stations throughout the facility, a few printers and televisions. The kitchenette equipment includes refrigerators, toasters, a coffee machine, a toaster oven, hot water dispensers and an induction cooking range. Most of these equipment are ENERGY STAR® qualified. There is no centralized PC power management software installed.

## **2.7 Water-Using Systems**

The restrooms faucets are rated for 2.2 gallons per minute (gpm) or lower, the toilets are rated at 1.6 gallons per flush (gpf) and the urinals are rated at 1 gpf.

### 3 SITE ENERGY USE AND COSTS

Utility data for electricity and natural gas was analyzed to identify opportunities for savings. In addition, data for electricity and natural gas was evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 3.4 for additional information.

#### 3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

*Figure 6 - Utility Summary*

Utility Summary for Municipal Building		
Fuel	Usage	Cost
Electricity	134,014 kWh	\$16,189
Natural Gas	1,217 Therms	\$1,274
<b>Total</b>		<b>\$17,463</b>

The current annual energy cost for this facility is \$17,463 as shown in the chart below.

*Figure 7 - Energy Cost Breakdown*

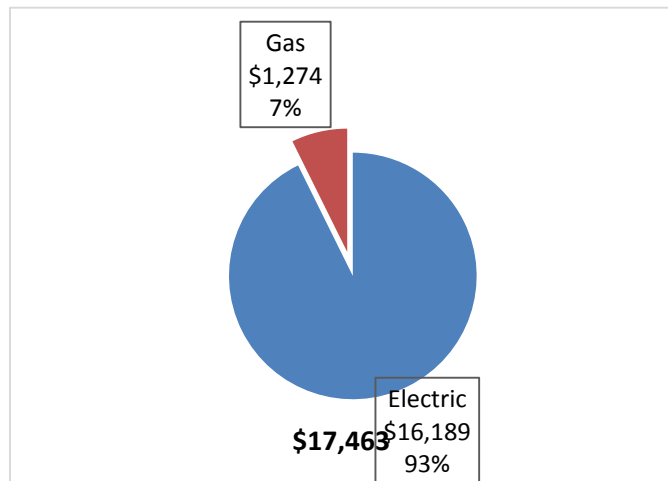

### 3.2 Electricity Usage

Electricity is provided by JCP&L. The average electric cost over the past 12 months was \$0.121/kWh, which is the blended rate that includes energy supply, distribution, and other charges. This rate is used throughout the analyses in this report to assess energy costs and savings. The monthly electricity consumption and peak demand are shown in the chart below.

Figure 8 - Electric Usage & Demand

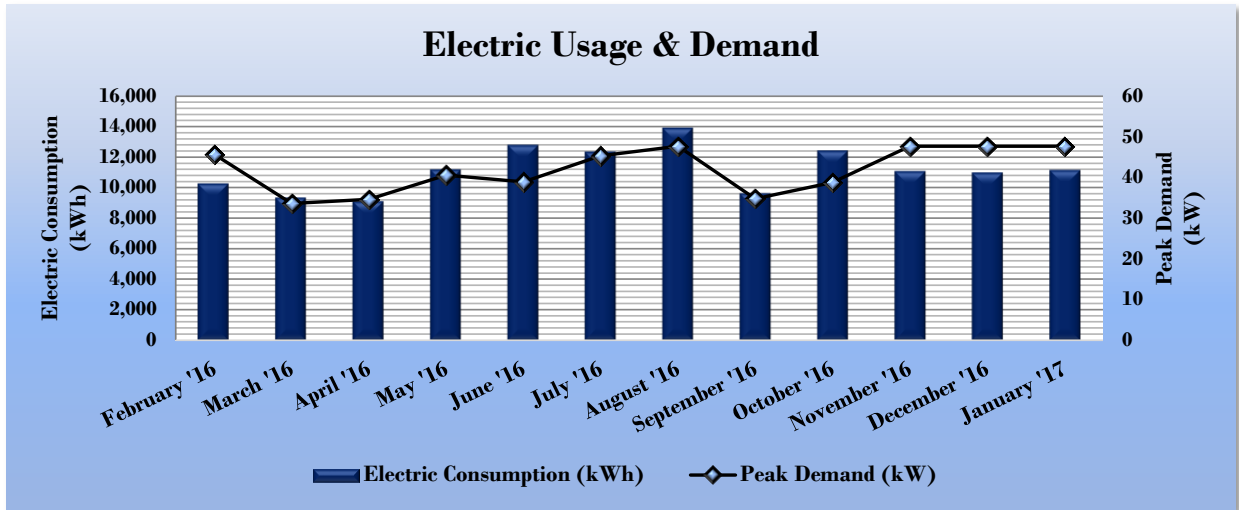


Figure 9 - Electric Usage & Demand

Electric Billing Data for Municipal Building					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
3/3/16	30	10,252	46		\$1,190
4/1/16	29	9,332	34		\$1,133
5/2/16	31	9,092	35		\$1,115
6/1/16	30	11,172	41		\$1,371
6/30/16	29	12,772	39		\$1,519
8/1/16	32	12,332	45		\$1,513
8/31/16	30	13,892	48		\$1,699
10/10/16	40	9,612	35		\$1,192
11/1/16	22	12,402	39		\$1,506
12/12/16	41	11,052	48		\$1,302
1/3/17	22	10,972	48		\$1,304
2/1/17	29	11,132	48		\$1,348
<b>Totals</b>	<b>365</b>	<b>134,014</b>	<b>47.7</b>	<b>\$0</b>	<b>\$16,189</b>
<b>Annual</b>	<b>365</b>	<b>134,014</b>	<b>47.7</b>	<b>\$0</b>	<b>\$16,189</b>

### 3.3 Natural Gas Usage

Natural gas is provided by PSE&G. The average gas cost for the past 12 months is \$1.047/therm, which is the blended rate used throughout the analyses in this report. The third party gas supply is provided by Direct Energy. **The total gas use for the building is lower than expected for a facility of this type.** The monthly gas consumption is shown in the chart below.

Figure 10 - Natural Gas Usage

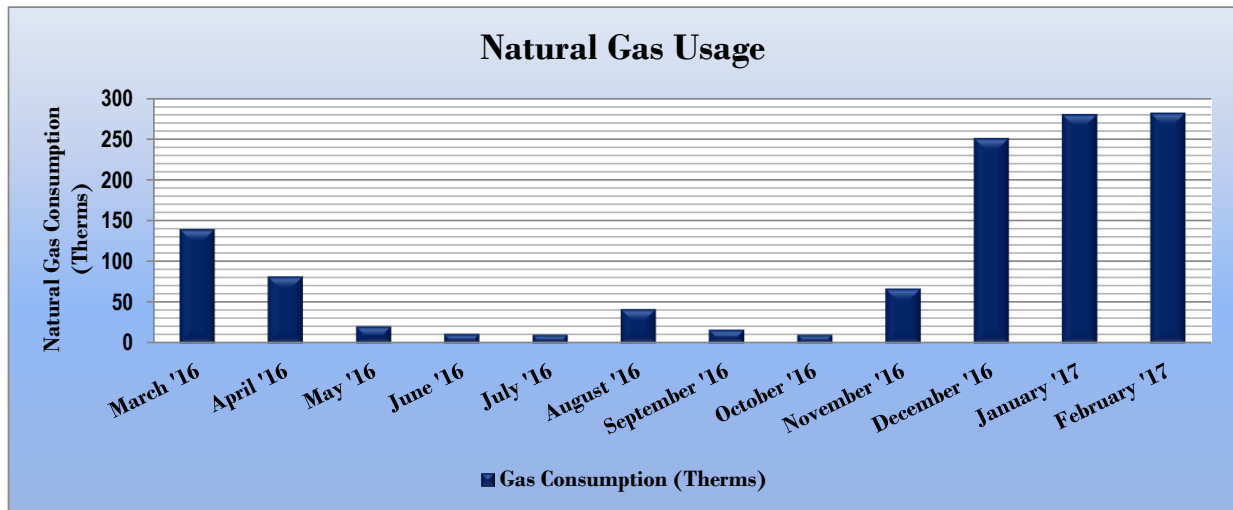


Figure 11 - Natural Gas Usage

Gas Billing Data for Municipal Building			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
3/23/16	30	140	\$138
4/21/16	29	82	\$80
5/20/16	29	21	\$29
6/21/16	32	12	\$21
7/21/16	30	11	\$19
8/19/16	29	42	\$47
9/20/16	32	17	\$26
10/19/16	29	11	\$21
11/17/16	29	67	\$75
12/20/16	33	251	\$252
1/21/17	32	281	\$281
2/21/17	31	283	\$283
<b>Totals</b>	<b>365</b>	<b>1,217</b>	<b>\$1,274</b>
<b>Annual</b>	<b>365</b>	<b>1,217</b>	<b>\$1,274</b>



### 3.4 Benchmarking

This facility was benchmarked using Portfolio Manager, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

**Figure 12 - Energy Use Intensity Comparison – Existing Conditions**

Energy Use Intensity Comparison - Existing Conditions		
	Municipal Building	National Median Building Type: Center/Meeting Hall
Source Energy Use Intensity (kBtu/ft <sup>2</sup> )	153.2	69.8
Site Energy Use Intensity (kBtu/ft <sup>2</sup> )	56.7	45.3

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

**Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures**

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	Municipal Building	National Median Building Type: Center/Meeting Hall
Source Energy Use Intensity (kBtu/ft <sup>2</sup> )	102.8	69.8
Site Energy Use Intensity (kBtu/ft <sup>2</sup> )	40.2	45.3

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide and may be eligible for ENERGY STAR® certification. Your building is not is one of the building categories that are eligible to receive a score.

A Portfolio Manager Statement of Energy Performance (SEP) was generated for this facility, see Appendix B: ENERGY STAR® Statement of Energy Performance.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager regularly, so that you can keep track of your building’s performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager to track your building’s performance at: <https://www.energystar.gov/buildings/training>.

### 3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 14 - Energy Balance (% and kBtu/SF)

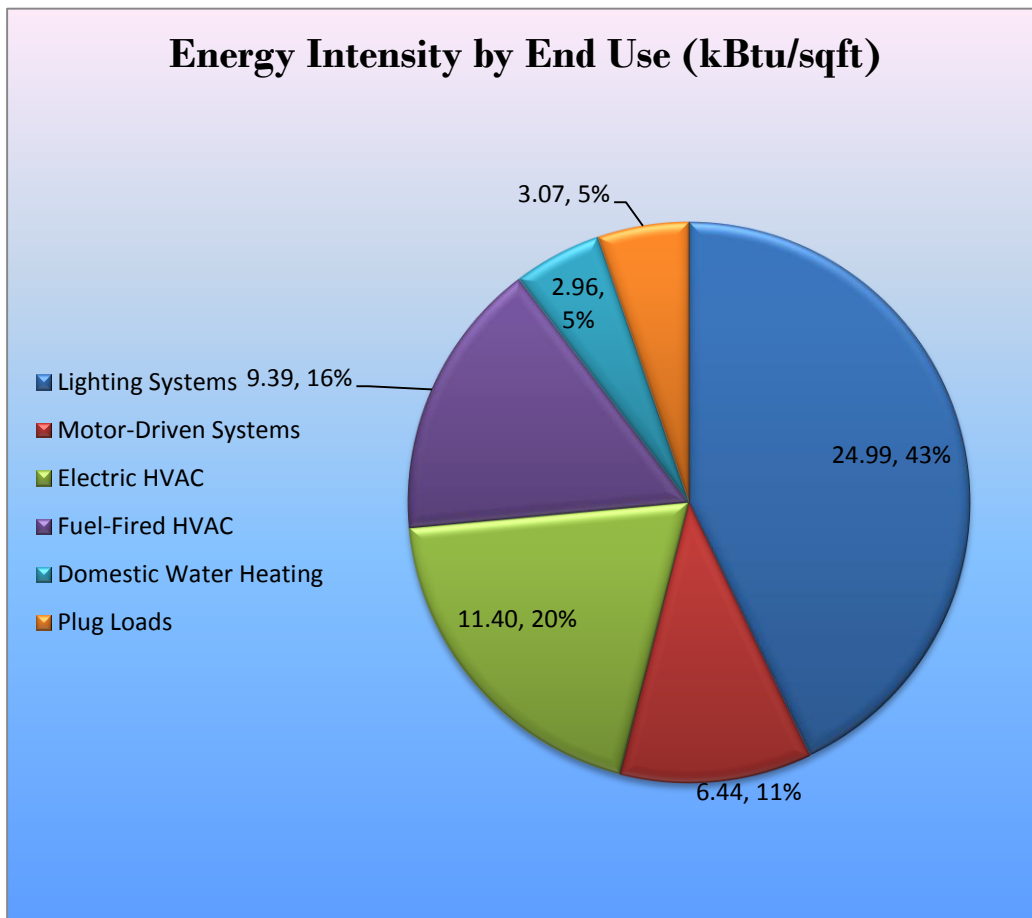

## 4 ENERGY CONSERVATION MEASURES

### Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to the Borough of Jamesburg Municipal Building regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

### 4.1 Recommended ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

*Figure 15 – Summary of Recommended ECMs*

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>41,834</b>	<b>6.6</b>	<b>0.0</b>	<b>\$5,053.62</b>	<b>\$29,504.22</b>	<b>\$1,155.00</b>	<b>\$28,349.22</b>	<b>5.6</b>	<b>42,127</b>
ECM 1	Install LED Fixtures	13,878	2.3	0.0	\$1,676.50	\$13,280.67	\$1,000.00	\$12,280.67	7.3	13,975
ECM 2	Retrofit Fixtures with LED Lamps	27,956	4.3	0.0	\$3,377.12	\$16,223.55	\$155.00	\$16,068.55	4.8	28,151
<b>Lighting Control Measures</b>		<b>3,343</b>	<b>0.4</b>	<b>0.0</b>	<b>\$403.81</b>	<b>\$2,446.00</b>	<b>\$215.00</b>	<b>\$2,231.00</b>	<b>5.5</b>	<b>3,366</b>
ECM 3	Install Occupancy Sensor Lighting Controls	2,672	0.3	0.0	\$322.72	\$2,046.00	\$215.00	\$1,831.00	5.7	2,690
ECM 4	Install High/Low Lighting Controls	671	0.1	0.0	\$81.08	\$400.00	\$0.00	\$400.00	4.9	676
<b>HVAC System Improvements</b>		<b>2,164</b>	<b>0.5</b>	<b>0.0</b>	<b>\$261.40</b>	<b>\$750.00</b>	<b>\$250.00</b>	<b>\$500.00</b>	<b>1.9</b>	<b>2,179</b>
ECM 5	Install Dual Enthalpy Outside Economizer Control	2,164	0.5	0.0	\$261.40	\$750.00	\$250.00	\$500.00	1.9	2,179
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>7.0</b>	<b>\$73.26</b>	<b>\$522.80</b>	<b>\$300.00</b>	<b>\$222.80</b>	<b>3.0</b>	<b>819</b>
ECM 6	Install Tankless Water Heater	0	0.0	7.0	\$73.26	\$522.80	\$300.00	\$222.80	3.0	819
<b>TOTALS</b>		<b>47,341</b>	<b>7.5</b>	<b>7.0</b>	<b>\$5,792.08</b>	<b>\$33,223.02</b>	<b>\$1,920.00</b>	<b>\$31,303.02</b>	<b>5.4</b>	<b>48,491</b>

\* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

## 4.1.1 Lighting Upgrades

Our recommendations for upgrades to existing lighting fixtures are summarized in Figure 16 below.

*Figure 16 – Summary of Lighting Upgrade ECMs*

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>41,834</b>	<b>6.6</b>	<b>0.0</b>	<b>\$5,053.62</b>	<b>\$29,504.22</b>	<b>\$1,155.00</b>	<b>\$28,349.22</b>	<b>5.6</b>	<b>42,127</b>
ECM 1	Install LED Fixtures	13,878	2.3	0.0	\$1,676.50	\$13,280.67	\$1,000.00	\$12,280.67	7.3	13,975
ECM 2	Retrofit Fixtures with LED Lamps	27,956	4.3	0.0	\$3,377.12	\$16,223.55	\$155.00	\$16,068.55	4.8	28,151

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

### **ECM 1: Install LED Fixtures**

#### *Summary of Measure Economics*

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
Interior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0
Exterior	13,878	2.3	0.0	\$1,676.50	\$13,280.67	\$1,000.00	\$12,280.67	7.3	13,975

#### *Measure Description*

We recommend replacing existing fixtures containing HID lamps with new high performance LED light fixtures. Exterior fixtures targeted for replacement include high pressure sodium (HPS) wall packs and pole mounted fixtures as well as a metal halide fixture at the entrance. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of typical HID sources such as HPS and metal halide.

## **ECM 2: Retrofit Fixtures with LED Lamps**

### *Summary of Measure Economics*

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
Interior	27,956	4.3	0.0	\$3,377.12	\$16,223.55	\$155.00	\$16,068.55	4.8	28,151
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

### *Measure Description*

We recommend retrofitting existing halogen and linear T8 tubes (U-bend and 4-foot) with LED lamps. Many LED tube lamps are direct replacements for existing fluorescent lamps and can be installed while leaving the fluorescent fixture ballast in place. LED bulbs can be used in existing fixtures as a direct replacement for most other lighting technologies. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tubes and more than 10 times longer than many incandescent lamps.

## 4.1.2 Lighting Control Measures

Our recommendations for lighting control measures are summarized in Figure 17 below.

*Figure 17 – Summary of Lighting Control ECMs*

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>3,343</b>	<b>0.4</b>	<b>0.0</b>	<b>\$403.81</b>	<b>\$2,446.00</b>	<b>\$215.00</b>	<b>\$2,231.00</b>	<b>5.5</b>	<b>3,366</b>
ECM 3	Install Occupancy Sensor Lighting Controls	2,672	0.3	0.0	\$322.72	\$2,046.00	\$215.00	\$1,831.00	5.7	2,690
ECM 4	Install High/Low Lighting Controls	671	0.1	0.0	\$81.08	\$400.00	\$0.00	\$400.00	4.9	676

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

### **ECM 3: Install Occupancy Sensor Lighting Controls**

#### *Summary of Measure Economics*

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
2,672	0.3	0.0	\$322.72	\$2,046.00	\$215.00	\$1,831.00	5.7	2,690

#### *Measure Description*

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in some areas that are applicable for automated control and are not already controlled by occupancy sensors. Potential areas include restrooms, locker rooms, and small offices. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

## **ECM 4: Install High/Low Lighting Controls**

### *Summary of Measure Economics*

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
671	0.1	0.0	\$81.08	\$400.00	\$0.00	\$400.00	4.9	676

### *Measure Description*

We recommend installing occupancy sensors to provide dual level lighting control for lighting fixtures in spaces such as the hallways that are infrequently occupied but may require some level of continuous lighting for safety or security reasons. Typical areas for such lighting control are stairwells, interior corridors, parking lots, and parking garages.

Lighting fixtures with these controls operate at default low levels when the area is not occupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. The lighting systems are switched to full lighting levels whenever an occupant is detected. Fixtures are automatically switched back to low level after an area has been vacant for a preset period of time. In parking lots and parking garages with significant ambient lighting this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylighting. Energy savings results from only providing full lighting levels when it is required.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage needs to be provided to ensure that lights turn on in each area as an occupant approaches.

Additional savings from reduced lighting maintenance may also result from this measure, due to reduced lamp operation.

### 4.1.3 HVAC System Upgrades

Our recommendation for HVAC system improvement are summarized in Figure 18 below.

*Figure 18 - Summary of HVAC System Improvement ECMs*

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>HVAC System Improvements</b>		<b>2,164</b>	<b>0.5</b>	<b>0.0</b>	<b>\$261.40</b>	<b>\$750.00</b>	<b>\$250.00</b>	<b>\$500.00</b>	<b>1.9</b>	<b>2,179</b>
ECM 5	Install Dual Enthalpy Outside Economizer Control	2,164	0.5	0.0	\$261.40	\$750.00	\$250.00	\$500.00	1.9	2,179

#### ECM 5: Install Dual-Enthalpy Economizers

*Summary of Measure Economics*

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
2,164	0.5	0.0	\$261.40	\$750.00	\$250.00	\$500.00	1.9	2,179

#### *Measure Description*

Dual enthalpy economizers are used to control a ventilation system’s outside air intake in order to reduce a facility’s total cooling load. A dual-enthalpy economizer monitors the air temperature and humidity of both the outside and return air. The control supplies the lowest energy (temperature and humidity) air to the air handling system. When outside air conditions allow, outside air can be used for cooling instead of running the air handling system’s compressor. We recommend that the economizer be installed in the older HVAC unit at the building if this unit is not being replaced. If this unit is going to be replaced, then we suggest that the new one comes equipped with the enthalpy economizer feature. This measure reduces the demand on the cooling system, lowering its usage hours and saving energy.

Savings result from using outside air instead of mechanical cooling when outside air conditions permit.



## 4.1.4 Domestic Hot Water Heating System Upgrades

Our recommendations for domestic water heating system improvements are summarized in Figure 19 below.

*Figure 19 - Summary of Domestic Water Heating ECMs*

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>7.0</b>	<b>\$73.26</b>	<b>\$522.80</b>	<b>\$300.00</b>	<b>\$222.80</b>	<b>3.0</b>	<b>819</b>
ECM 6	Install Tankless Water Heater	0	0.0	7.0	\$73.26	\$522.80	\$300.00	\$222.80	3.0	819

### ECM 6: Install Tankless Hot Water Heater

#### *Summary of Measure Economics*

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
0	0.0	7.0	\$73.26	\$522.80	\$300.00	\$222.80	3.0	819

#### *Measure Description*

We recommend replacing the existing tank water heater with a tankless water heating system. Tankless water heaters (a.k.a. “on-demand water heaters”) only heat water when hot water is needed. Water is heated as it flows through the pipe to the hot water tap. Energy savings from a tankless water heater is based from eliminating heat losses associated with maintaining unnecessary standby hot water capacity.

## 4.2 ECMs Evaluated But Not Recommended

The measures below have been evaluated by the auditor but are not recommended for implementation at the facility. Reasons for exclusion can be found in each measure description section.

**Figure 20 – Summary of Measures Evaluated, But Not Recommended**

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Electric Unitary HVAC Measures</b>	<b>3,424</b>	<b>2.0</b>	<b>0.0</b>	<b>\$413.59</b>	<b>\$28,327.99</b>	<b>\$1,467.50</b>	<b>\$26,860.49</b>	<b>64.9</b>	<b>3,448</b>
Install High Efficiency Electric AC	3,424	2.0	0.0	\$413.59	\$28,327.99	\$1,467.50	\$26,860.49	64.9	3,448
<b>Gas Heating (HVAC/Process) Replacement</b>	<b>0</b>	<b>0.0</b>	<b>0.4</b>	<b>\$4.70</b>	<b>\$2,718.88</b>	<b>\$400.00</b>	<b>\$2,318.88</b>	<b>493.2</b>	<b>53</b>
Install High Efficiency Furnaces	0	0.0	0.4	\$4.70	\$2,718.88	\$400.00	\$2,318.88	493.2	53
<b>TOTALS</b>	<b>3,424</b>	<b>2.0</b>	<b>0.4</b>	<b>\$418.29</b>	<b>\$31,046.87</b>	<b>\$1,867.50</b>	<b>\$29,179.37</b>	<b>69.8</b>	<b>3,500</b>

\* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

### Install High Efficiency Air Conditioning Units

#### *Summary of Measure Economics*

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
3,424	2.0	0.0	\$413.59	\$28,327.99	\$1,467.50	\$26,860.49	64.9	3,448

#### *Measure Description*

We recommend replacing standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. There have been significant improvements in both compressor and fan motor efficiencies over the past several years. Therefore, electricity savings can be achieved by replacing older units with new high efficiency units. A higher EER or SEER rating indicates a more efficient cooling system. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling load, and the estimated annual operating hours.

#### *Reasons for not Recommending*

Although the split system and older package units are approaching the end of useful life, the payback period on this investment is higher than the useful life of the equipment itself. When the equipment is scheduled for replacement we suggest that the units be replaced with high efficiency equipment.

## Install High Efficiency Furnaces

### *Summary of Measure Economics*

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
0	0.0	0.4	\$4.70	\$2,718.88	\$400.00	\$2,318.88	493.2	53

### *Measure Description*

We often recommend replacing existing standard efficiency furnaces with condensing furnaces. Improved combustion technology and heat exchanger design optimize heat recovery from the combustion gases which can significantly improve furnace efficiency. Savings result from improved system efficiency.

### *Reasons for not Recommending*

Although the court room furnace is approaching the end of useful life, the payback period on this investment is higher than the useful life of the equipment itself. When the equipment is scheduled for replacement we suggest that the unit be replaced with a high efficiency unit, such as a condensing furnace.

## 5 ENERGY EFFICIENT PRACTICES

---

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Use Window Treatments/Coverings**

A substantial amount of heat gain can occur through uncovered or untreated windows, especially older single pane windows and east or west-facing windows. Treatments such as high-reflectivity films or covering windows with shades or shutters can reduce solar heat gain and, consequently, cooling load and can reduce internal heat loss and the associated heating load.

### **Ensure Lighting Controls Are Operating Properly**

Lighting controls are very cost effective energy efficient devices, when installed and operating correctly. As part of a lighting maintenance schedule, lighting controls should be tested annually to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight sensors, maintenance involves cleaning of sensor lenses and confirming setpoints and sensitivity are appropriately configured.

### **Practice Proper Use of Thermostat Schedules and Temperature Resets**

Ensure thermostats are correctly set back. By employing proper set back temperatures and schedules, facility heating and cooling costs can be reduced dramatically during periods of low or no occupancy. As such, thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced further by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

### **Plug Load Controls**

There are a variety of ways to limit the energy use of plug loads including increasing occupant awareness, removing under-utilized equipment, installing hardware controls, and using software controls. Some control steps to take are to enable the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips. For additional information refer to "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

## **Water Conservation**

Installing low-flow faucets or faucet aerators, low-flow showerheads, and kitchen sink pre-rinse spray valves saves both energy and water. These devices save energy by reducing the overall amount of hot water used hence reducing the energy used to heat the water. The flow ratings for EPA WaterSense™ (<http://www3.epa.gov/watersense/products>) labeled devices are 1.5 gpm for bathroom faucets, 2.0 gpm for showerheads, and 1.28 gpm for pre-rinse spray valves.

Installing dual flush or low-flow toilets and low-flow or waterless urinals are additional ways to reduce the sites water use, however, these devices do not provide energy savings at the site level. Any reduction in water use does however ultimately reduce grid level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users. The EPA WaterSense™ ratings for urinals is 0.5 gpf and toilets that use as little as 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

## 6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey’s Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State’s electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


### 6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility’s electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has a **Low** potential for installing a PV array.

In order to be cost-effective, a solar PV array needs certain minimum criteria, such as flat or south-facing rooftop or other unshaded space on which to place the PV panels. In our opinion, the facility does appear not meet these minimum criteria for cost-effective PV installation.

*Figure 21 - Photovoltaic Screening*

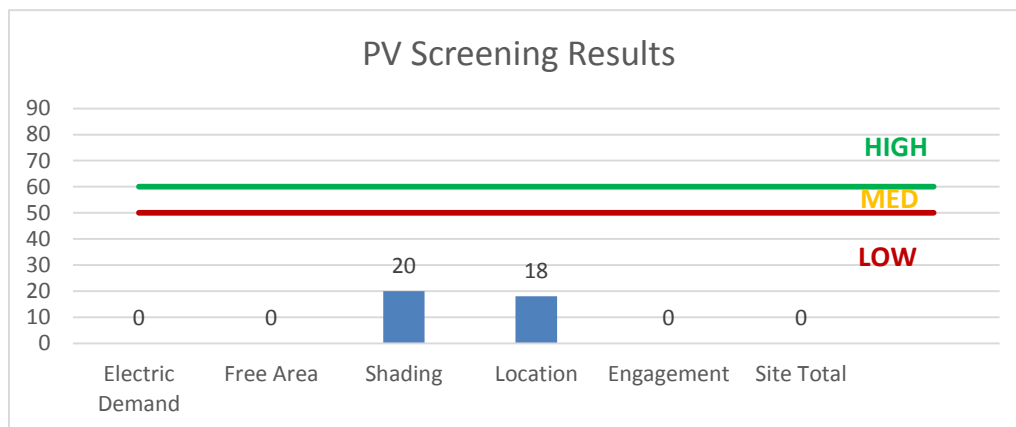

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-fags>
- **Approved Solar Installers in the NJ Market:** [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.


CHP systems are typically used to produce a portion of the electric power used onsite by a facility, with the balance of electric power needs supplied by grid purchases. The heat is used to supplement (or supplant) existing boilers for the purpose of space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for the purpose of space cooling. The key criteria used for screening, however, is the amount of time the system operates at full load and the facility’s ability to use the recovered heat. Facilities with continuous use for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has a **Low** potential for installing a cost-effective CHP system.

Low or infrequent thermal load, are the most significant factors contributing to the potential for CHP at the site. In our opinion, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation.

For a list of qualified firms in New Jersey specializing in commercial CHP cost assessment and installation, go to: [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/)

**Figure 22 - Combined Heat and Power Screening**

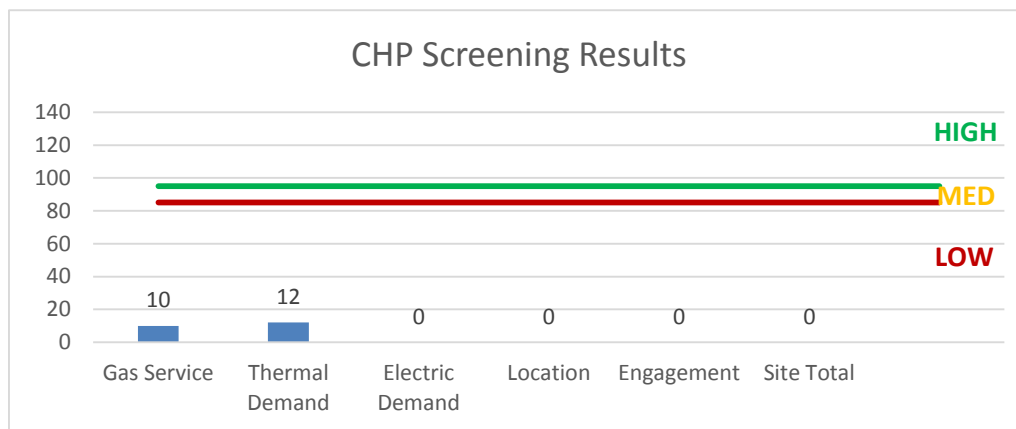

## 7 DEMAND RESPONSE

---

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

**In our opinion this building is not a good candidate for the demand response program.**



## 8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 23 for a list of the eligible programs identified for each recommended ECM.

*Figure 23 - ECM Incentive Program Eligibility*

Energy Conservation Measure		SmartStart Prescriptive	Direct Install
ECM 1	Install LED Fixtures	x	x
ECM 2	Retrofit Fixtures with LED Lamps	x	x
ECM 3	Install Occupancy Sensor Lighting Controls	x	x
ECM 4	Install High/Low Lighting Controls		x
ECM 5	Install Dual Enthalpy Outside Economizer Control	x	x
ECM 6	Install Tankless Water Heater	x	x

SmartStart is generally well-suited for implementation of individual measures or small group of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities that can bundle multiple ECMs together. This can greatly simplify participation and may lead to higher incentive amounts, but requires the use of pre-approved contractors.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: [www.njcleanenergy.com/ci](http://www.njcleanenergy.com/ci).

## 8.1 SmartStart

### Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

### **Equipment with Prescriptive Incentives Currently Available:**

*Electric Chillers*

*Electric Unitary HVAC*

*Gas Cooling*

*Gas Heating*

*Gas Water Heating*

*Ground Source Heat Pumps*

*Lighting*

*Lighting Controls*

*Refrigeration Doors*

*Refrigeration Controls*

*Refrigerator/Freezer Motors*

*Food Service Equipment*

*Variable Frequency Drives*

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

### Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

### How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: [www.njcleanenergy.com/SSB](http://www.njcleanenergy.com/SSB).

## 8.2 Direct Install

### Overview

Direct Install is a turnkey program available to existing small to medium-sized facilities with a peak electric demand that does not exceed 200 kW for any recent 12-month period. You will work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

### Incentives

The program pays up to **70%** of the total installed cost of eligible measures, up to \$125,000 per project. Direct Install participants will also be held to a fiscal year cap of \$250,000 per entity.

### How to Participate

To participate in the Direct Install program you will need to contact the participating contractor who the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Since Direct Install offers a free assessment of eligible measures, Direct Install is also available to small businesses and other commercial facilities too that may not be eligible for the more detailed facility audits provided by LGEA.

Detailed program descriptions and applications can be found at: [www.njcleanenergy.com/DI](http://www.njcleanenergy.com/DI).

### 8.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program descriptions and application can be found at: [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## 9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third party supplier, consider shopping for a reduced rate from third party electric suppliers. If your facility is purchasing electricity from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

### 9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third party supplier, consider shopping for a reduced rate from third party natural gas suppliers. If your facility is purchasing natural gas from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

# Appendix A: Equipment Inventory & Recommendations

## Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Stairwell to Basement	2	Compact Fluorescent: 2 Lamps	Wall Switch	52	6,000	Relamp	No	2	LED Screw-In Lamps: 2 Lamps	Wall Switch	36	6,000	0.03	212	0.0	\$25.55	\$215.01	\$0.00	8.41
Basement hall	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,200	0.09	791	0.0	\$95.58	\$389.60	\$0.00	4.08
Archives	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,200	0.14	1,131	0.0	\$136.61	\$350.00	\$60.00	2.12
Closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,200	0.03	283	0.0	\$34.15	\$174.50	\$10.00	4.82
Police room inside archives	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	6,000	0.02	197	0.0	\$23.75	\$63.20	\$0.00	2.66
Private	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	6,000	0.02	197	0.0	\$23.75	\$63.20	\$0.00	2.66
Custidia closet	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	4,200	0.03	264	0.0	\$31.86	\$179.20	\$0.00	5.62
Locker room	8	Compact Fluorescent: 2 Lamps	Wall Switch	52	6,000	Relamp	No	8	LED Screw-In Lamps: 2 Lamps	Wall Switch	36	6,000	0.10	846	0.0	\$102.22	\$860.05	\$0.00	8.41
Locker room	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	4,200	0.19	1,582	0.0	\$191.16	\$649.20	\$35.00	3.21
Police Station hall	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.14	673	0.0	\$81.27	\$379.20	\$0.00	4.67
Police station entrance	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	6,000	0.05	393	0.0	\$47.50	\$126.40	\$0.00	2.66
Electric room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	6,000	0.05	447	0.0	\$54.06	\$117.00	\$20.00	1.79
Conference room	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.09	449	0.0	\$54.18	\$252.80	\$0.00	4.67
Conference room	1	Compact Fluorescent: 2 Lamps	Occupancy Sensor	52	3,422	Relamp	No	1	LED Screw-In Lamps: 2 Lamps	Occupancy Sensor	36	3,422	0.01	60	0.0	\$7.29	\$107.51	\$0.00	14.75
Private	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	No	3	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	6,000	0.07	590	0.0	\$71.26	\$189.60	\$0.00	2.66
Men's restroom	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.05	224	0.0	\$27.09	\$126.40	\$0.00	4.67
Men's restroom	2	Compact Fluorescent: 2 Lamps	Occupancy Sensor	52	3,422	Relamp	No	2	LED Screw-In Lamps: 2 Lamps	Occupancy Sensor	36	3,422	0.03	121	0.0	\$14.57	\$215.01	\$0.00	14.75
Staff restroom	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	52	3,422	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.03	147	0.0	\$17.75	\$126.40	\$0.00	7.12
Women's restroom	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.05	224	0.0	\$27.09	\$126.40	\$0.00	4.67
Women's restroom	2	Compact Fluorescent: 2 Lamps	Occupancy Sensor	52	3,422	Relamp	No	2	LED Screw-In Lamps: 2 Lamps	Occupancy Sensor	36	3,422	0.03	121	0.0	\$14.57	\$215.01	\$0.00	14.75
Secretary office hallway	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.07	336	0.0	\$40.63	\$189.60	\$0.00	4.67
Secretary office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.09	449	0.0	\$54.18	\$252.80	\$0.00	4.67
Police Chief	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.09	449	0.0	\$54.18	\$252.80	\$0.00	4.67
Process area	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	4,200	0.13	1,055	0.0	\$127.44	\$252.80	\$35.00	1.71
Cell	1	Halogen Incandescent: 1 Lamp	Wall Switch	90	6,000	Relamp	No	1	LED Screw-In Lamps: 1 Lamp	Wall Switch	14	6,000	0.06	519	0.0	\$62.66	\$97.85	\$5.00	1.48

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Process area	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	4,200	0.19	1,582	0.0	\$191.16	\$649.20	\$35.00	3.21
Kitchenette	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,422	0.05	255	0.0	\$30.83	\$117.00	\$20.00	3.15
Detective office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,200	0.03	283	0.0	\$34.15	\$174.50	\$30.00	4.23
Water dispenser area	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	6,000	0.05	447	0.0	\$54.06	\$117.00	\$20.00	1.79
Dispatch	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	4,200	0.19	1,582	0.0	\$191.16	\$649.20	\$35.00	3.21
Low overhead closet	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	6,000	0.08	671	0.0	\$81.08	\$175.50	\$30.00	1.79
First floor - Offices area hallway	7	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	7	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,200	0.22	1,846	0.0	\$223.02	\$642.40	\$0.00	2.88
First floor - Women's restroom	5	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	5	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	4,200	0.16	1,319	0.0	\$159.30	\$586.00	\$35.00	3.46
First floor - Men's restroom	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	6,000	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	4,200	0.13	1,055	0.0	\$127.44	\$522.80	\$35.00	3.83
Top floor - Kitchen closet	1	Compact Fluorescent: 2 Lamps	Occupancy Sensor	52	3,422	Relamp	No	1	LED Screw-In Lamps: 2 Lamps	Occupancy Sensor	36	3,422	0.01	60	0.0	\$7.29	\$107.51	\$0.00	14.75
Kitchen closet	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.07	336	0.0	\$40.63	\$189.60	\$0.00	4.67
Construction	5	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	5	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.12	561	0.0	\$67.72	\$316.00	\$0.00	4.67
Municipal Court - Council Chambers	24	Compact Fluorescent: 2 Lamps	Wall Switch	52	4,888	Relamp	No	24	LED Screw-In Lamps: 2 Lamps	Wall Switch	36	4,888	0.30	2,068	0.0	\$249.81	\$2,580.14	\$0.00	10.33
Municipal Court - Council Chambers	16	Compact Fluorescent: 2 Lamps	Wall Switch	52	4,888	Relamp	No	16	LED Screw-In Lamps: 2 Lamps	Wall Switch	36	4,888	0.20	1,379	0.0	\$166.54	\$1,720.10	\$0.00	10.33
Municipal closet	1	Compact Fluorescent: 2 Lamps	Wall Switch	52	4,888	Relamp	Yes	1	LED Screw-In Lamps: 2 Lamps	Occupancy Sensor	36	3,422	0.02	146	0.0	\$17.70	\$223.51	\$0.00	12.63
Tech closet	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	62	4,888	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.06	430	0.0	\$51.91	\$242.40	\$0.00	4.67
Stairwell	6	Compact Fluorescent: 2 Lamps	Wall Switch	52	4,888	Relamp	No	6	LED Screw-In Lamps: 2 Lamps	Wall Switch	36	4,888	0.08	517	0.0	\$62.45	\$645.04	\$0.00	10.33
Fire prevention zoning	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.14	673	0.0	\$81.27	\$379.20	\$0.00	4.67
CFO Business Admin	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.09	449	0.0	\$54.18	\$252.80	\$0.00	4.67
Tax assessor may or	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.14	673	0.0	\$81.27	\$379.20	\$0.00	4.67
Copy machine area	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.14	673	0.0	\$81.27	\$379.20	\$0.00	4.67
Copy machine area	3	Compact Fluorescent: 2 Lamps	Occupancy Sensor	52	3,422	Relamp	No	3	LED Screw-In Lamps: 2 Lamps	Occupancy Sensor	36	3,422	0.04	181	0.0	\$21.86	\$322.52	\$0.00	14.75
Tax Collector - server	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.09	449	0.0	\$54.18	\$252.80	\$0.00	4.67
Municipal Court register desk	5	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	5	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.12	561	0.0	\$67.72	\$316.00	\$0.00	4.67
Municipal court admin	7	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	7	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.17	785	0.0	\$94.81	\$442.40	\$0.00	4.67

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Municipal court admin	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.09	449	0.0	\$54.18	\$252.80	\$0.00	4.67
Municipal court clerk hall	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	62	3,422	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,422	0.02	112	0.0	\$13.54	\$63.20	\$0.00	4.67
Canopy fixture entrance	1	Metal Halide: (1) 70W Lamp	Wall Switch	95	4,380	Fixture Replacement	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	21	4,380	0.06	366	0.0	\$44.24	\$390.68	\$100.00	6.57
Wall packs	3	High-Pressure Sodium: (1) 250W Lamp	Wall Switch	295	4,380	Fixture Replacement	No	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	75	4,380	0.54	3,267	0.0	\$394.61	\$1,172.03	\$300.00	2.21
Police department - side entrance and front entrance	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	50	4,380	None	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	50	4,380	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Single pole	6	High-Pressure Sodium: (1) 400W Lamp	Wall Switch	465	4,380	Fixture Replacement	No	6	LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture	Wall Switch	120	4,380	1.68	10,245	0.0	\$1,237.64	\$11,717.96	\$600.00	8.98

### Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Police station	1	Supply Fan	5.0	89.5%	No	2,745	No	89.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Municipal offices	1	Supply Fan	3.0	89.5%	No	2,745	No	89.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Police station furnace room	Court room	2	Supply Fan	0.3	60.0%	No	2,745	No	60.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	Municipal building and Police station	2	Exhaust Fan	0.5	60.0%	No	2,745	No	60.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	All building	2	Exhaust Fan	0.3	60.0%	No	2,745	No	60.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

### Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis							
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Building	1	Packaged AC	10.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Grounds	Court room	2	Split-System AC	5.00		Yes	2	Split-System AC	5.00		14.00		No	0.82	1,388	0.0	\$167.72	\$14,962.20	\$920.00	83.72
Roof	Building	1	Packaged AC	7.50		Yes	1	Packaged AC	7.50		11.50		Yes	1.69	4,199	0.0	\$507.27	\$14,115.79	\$797.50	26.25



### Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Police station	Court room	1	Furnace	120.00	Yes	1	Furnace	120.00	95.00%	AFUE	0.00	0	0.4	\$4.70	\$2,718.88	\$400.00	493.18
Roof	All building	1	Furnace	240.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof	All building	1	Furnace	180.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00


### DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions						Energy Impact & Financial Analysis					
		System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Low overhead room	All building	1	Storage Tank Water Heater (> 50 Gal)	Yes	1	Tankless Water Heater	Natural Gas	82.00%	EF	0.00	0	7.0	\$73.26	\$522.80	\$300.00	3.04

### Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Municipal building	19	Computer	145.0	Yes
Municipal building	4	Printer - Small	20.0	Yes
Municipal building	9	Printer - medium	60.0	Yes
Municipal building	1	Printer - Large	200.0	Yes
Municipal building	1	Microwave	1,000.0	Yes
Municipal building	1	Refrigerator - Small	20.0	Yes
Municipal building	1	Refrigerator - Large	60.0	Yes
Municipal building	1	Refrigerator - Double door	218.0	Yes
Municipal building	1	Coffee machine	400.0	Yes
Municipal building	1	Toaster oven	1,200.0	Yes
Municipal building	3	Television - LCD	100.0	Yes
Municipal building	1	Hot and cold water dispenser	500.0	Yes
Municipal building	1	Cooking range	1,500.0	Yes

## Appendix B: ENERGY STAR® Statement of Energy Performance



**ENERGY STAR® Statement of Energy Performance**

LEARN MORE AT [energystar.gov](http://energystar.gov)

**N/A**

**Jamesburg Municipal Complex**

Primary Property Type: Mixed Use Property  
 Gross Floor Area (ft<sup>2</sup>): 10,204  
 Built: 1959

For Year Ending: February 28, 2017  
 Date Generated: April 06, 2018

ENERGY STAR®  
 Score<sup>1</sup>

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

### Property & Contact Information

Property Address	Property Owner	Primary Contact
Jamesburg Municipal Complex 131 Perrineville Road Jamesburg, New Jersey 08831	Borough of Jamesburg 131 Perrineville Road Jamesburg, NJ 08831 732-521-2222	Scott Frueh 131 Perrineville Road Jamesburg, NJ 08831 732-521-2222 Ext 110 sfrueh@jamesburgborough.org
Property ID: 6222691		

### Energy Consumption and Energy Use Intensity (EUI)

Site EUI	Annual Energy by Fuel	National Median Comparison	
57.1 kBtu/ft <sup>2</sup>	Natural Gas (kBtu)	National Median Site EUI (kBtu/ft <sup>2</sup> )	45.6
	Electric - Grid (kBtu)	National Median Source EUI (kBtu/ft <sup>2</sup> )	123.1
		% Diff from National Median Source EUI	25%
Source EUI	Annual Emissions		
154.2 kBtu/ft <sup>2</sup>	Greenhouse Gas Emissions (Metric Tons CO <sub>2</sub> /year)		58

### Signature & Stamp of Verifying Professional

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Licensed Professional

\_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_



Professional Engineer Stamp  
(if applicable)