



# Local Government Energy Audit Report

Emma L. Arleth Elementary School

February 8, 2019

*Prepared for:*

Sayreville Public Schools  
3198 Washington Rd  
Parlin, NJ 08859

*Prepared by:*

TRC Energy Services  
900 Route 9 North  
Woodbridge, NJ 07095

# Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC Energy Services (TRC) reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. We encourage the owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

The New Jersey Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2019 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

# Table of Contents

---

<b>1</b>	<b>Executive Summary .....</b>	<b>4</b>
1.1	<b>Planning Your Project .....</b>	<b>7</b>
	Pick Your Installation Approach .....	7
	More Options from Around the State .....	9
<b>2</b>	<b>Existing Conditions .....</b>	<b>11</b>
2.1	Site Overview.....	11
2.2	Building Occupancy .....	12
2.3	Building Envelope .....	13
2.4	Lighting Systems .....	13
2.5	Air Handling Systems .....	18
	Unit Ventilators .....	18
	Air Handling Units (AHUs) .....	18
	Split Air Conditioning (AC) Systems.....	19
	Air Conditioners .....	20
2.6	Heating Hot Water Systems .....	21
2.7	Building Energy Management Systems (EMS) .....	22
2.8	Domestic Hot Water .....	23
2.9	Food Service Equipment.....	24
2.10	Refrigeration.....	24
2.11	Plug Load & Vending Machines.....	25
2.12	Water-Using Systems .....	25
<b>3</b>	<b>Energy Use and Costs.....</b>	<b>26</b>
3.1	Electricity .....	27
3.2	Natural Gas.....	28
3.3	Benchmarking.....	29
	Tracking Your Energy Performance.....	30
<b>4</b>	<b>Energy Conservation Measures .....</b>	<b>31</b>
4.1	Lighting .....	34
	ECM 1: Install LED Fixtures.....	34
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	34
	ECM 3: Retrofit Fixtures with LED Lamps.....	35
4.2	Lighting Controls.....	36
	ECM 4: Install Occupancy Sensor Lighting Controls .....	36
	ECM 5: Install Daylight Dimming Controls .....	36
	ECM 6: Install High/Low Lighting Controls .....	36
4.3	Motors .....	38
	ECM 7: Premium Efficiency Motors .....	38
4.4	Variable Frequency Drives (VFD).....	39

ECM 8: Install VFDs on Constant Volume (CV) Fans .....	39
ECM 9: Install VFDs on Heating Water Pumps .....	40
4.5 Electric Unitary HVAC .....	41
Install High Efficiency Air Conditioning Units .....	41
4.6 Gas-Fired Heating .....	42
ECM 10: Install High Efficiency Hot Water Boilers .....	42
4.7 HVAC.....	43
ECM 11: Install Pipe Insulation.....	43
4.8 Domestic Water Heating .....	43
ECM 12: Install Low-Flow DHW Devices.....	43
4.9 Food Service & Refrigeration Measures.....	44
Replace Refrigeration Equipment .....	44
ECM 13: Vending Machine Control .....	44
<b>5 Energy Efficient Best Practices .....</b>	<b>45</b>
Energy Tracking with ENERGY STAR® Portfolio Manager®.....	45
Weatherization.....	45
Doors and Windows .....	45
Window Treatments/Coverings .....	45
Lighting Controls .....	45
Motor Controls.....	46
Motor Maintenance .....	46
Fans to Reduce Cooling Load .....	46
Destratification Fans .....	46
AC System Evaporator/Condenser Coil Cleaning .....	46
HVAC Filter Cleaning and Replacement .....	46
Duct Sealing.....	46
Boiler Maintenance .....	47
Water Heater Maintenance .....	47
Plug Load Controls.....	47
Computer Power Management Software .....	47
Water Conservation .....	48
Procurement Strategies .....	48
<b>6 On-site Generation .....</b>	<b>49</b>
6.1 Solar Photovoltaic .....	50
6.2 Combined Heat and Power .....	51
<b>7 Project Funding and Incentives .....</b>	<b>52</b>
7.1 SmartStart .....	53
7.2 Direct Install .....	54
7.3 Energy Savings Improvement Program .....	55
7.4 SREC Registration Program.....	56
<b>8 Energy Purchasing and Procurement Strategies .....</b>	<b>57</b>
8.1 Retail Electric Supply Options.....	57
8.2 Retail Natural Gas Supply Options .....	57




**Appendix A: Equipment Inventory & Recommendations ..... 1**  
**Appendix B: ENERGY STAR® Statement of Energy Performance ..... 1**  
**Appendix C: Glossary ..... 1**

# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Emma L. Arleth Elementary School. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC Energy Services (TRC) conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

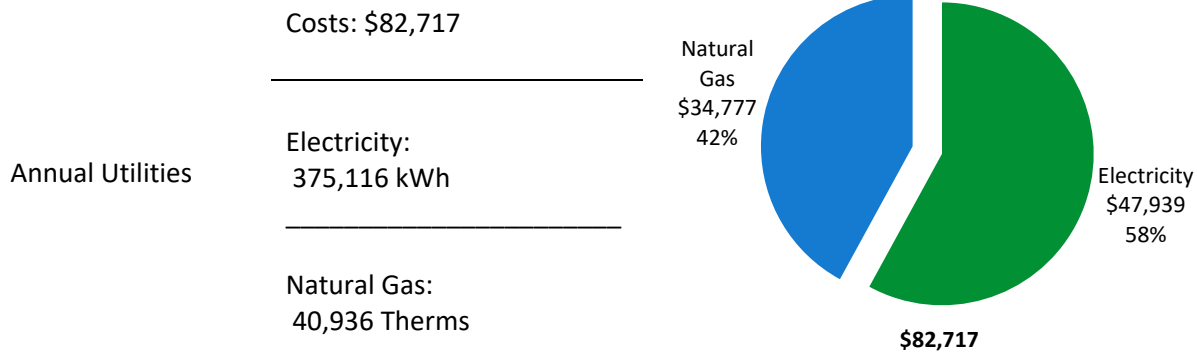

ENERGY STAR® Benchmarking Score	44 <i>(1-100 scale)</i>	This building performs at or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.
------------------------------------	----------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------

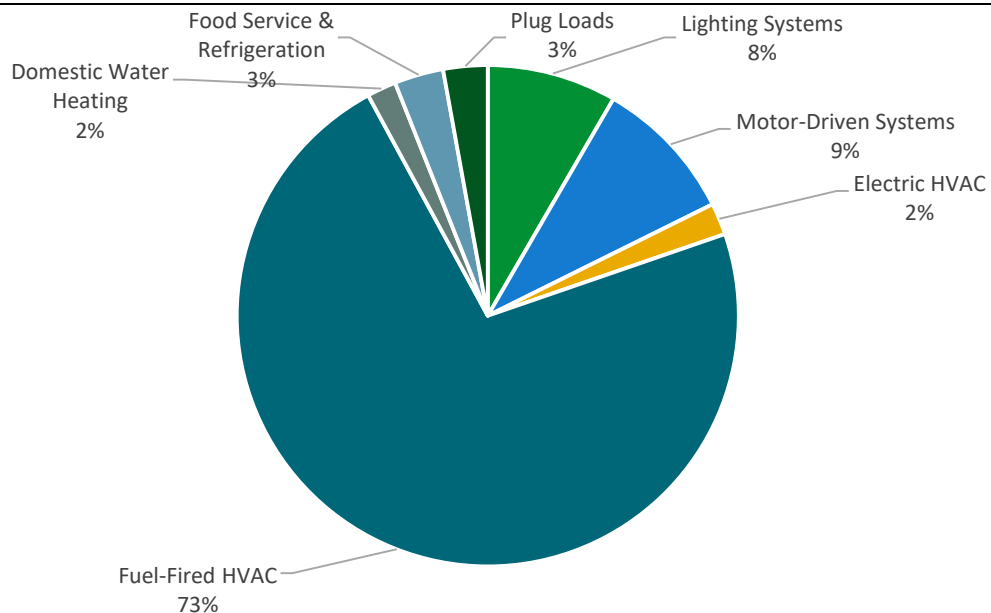


Figure 1 - Energy Use by System


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$239,387
Potential Rebates & Incentives <sup>1</sup>	\$25,630
Annual Cost Savings	\$22,996
Annual Energy Savings	Electricity: 111,054 kWh Natural Gas: 10,363 Therms
Greenhouse Gas Emission Savings	117 Tons
Simple Payback	9.3 Years
Site Energy Savings (all utilities)	26%

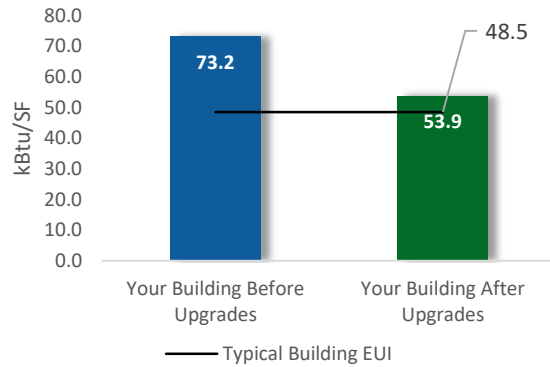

### Scenario 2: Cost Effective Package<sup>2</sup>

Installation Cost	\$198,835
Potential Rebates & Incentives	\$24,374
Annual Cost Savings	\$21,682
Annual Energy Savings	Electricity: 100,768 kWh Natural Gas: 10,363 Therms
Greenhouse Gas Emission Savings	111 Tons
Simple Payback	8.0 Years
Site Energy Savings (all utilities)	26%

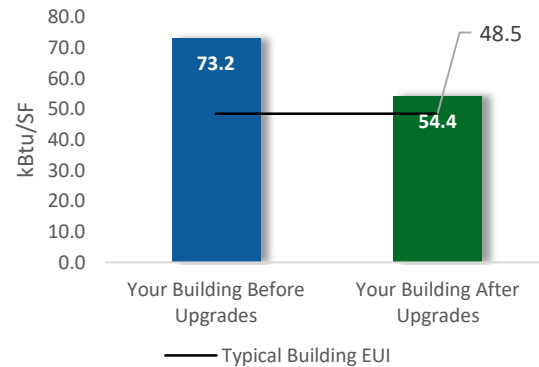

### On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

<sup>1</sup> Incentives are based on current SmartStart Prescriptive incentives. Other program incentives may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>56,266</b>	<b>17.5</b>	<b>-15</b>	<b>\$7,063</b>	<b>\$105,946</b>	<b>\$45,506</b>	<b>\$8,090</b>	<b>\$37,416</b>	<b>5.3</b>	<b>54,901</b>
ECM 1	Install LED Fixtures	Yes	13,409	2.2	-1	\$1,704	\$25,556	\$13,644	\$965	\$12,679	7.4	13,366
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps	Yes	3,421	1.5	-1	\$428	\$6,417	\$3,301	\$480	\$2,821	6.6	3,315
ECM 3	Retrofit Fixtures with LED Lamps	Yes	39,435	13.7	-13	\$4,932	\$73,973	\$28,561	\$6,645	\$21,916	4.4	38,219
<b>Lighting Control Measures</b>			<b>3,981</b>	<b>1.0</b>	<b>-1</b>	<b>\$498</b>	<b>\$3,982</b>	<b>\$8,922</b>	<b>\$1,370</b>	<b>\$7,552</b>	<b>15.2</b>	<b>3,858</b>
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	2,688	0.7	-1	\$336	\$2,689	\$6,622	\$985	\$5,637	16.8	2,605
ECM 5	Install Daylight Dimming Controls	Yes	356	0.1	0	\$45	\$356	\$500	\$385	\$115	2.6	345
ECM 6	Install High/Low Lighting Controls	Yes	937	0.2	0	\$117	\$937	\$1,800	\$0	\$1,800	15.4	908
<b>Motor Upgrades</b>			<b>2,411</b>	<b>0.6</b>	<b>0</b>	<b>\$308</b>	<b>\$4,622</b>	<b>\$10,294</b>	<b>\$0</b>	<b>\$10,294</b>	<b>33.4</b>	<b>2,428</b>
ECM 7	Premium Efficiency Motors	Yes	2,411	0.6	0	\$308	\$4,622	\$10,294	\$0	\$10,294	33.4	2,428
<b>Variable Frequency Drive (VFD) Measures</b>			<b>36,498</b>	<b>9.5</b>	<b>0</b>	<b>\$4,664</b>	<b>\$69,966</b>	<b>\$33,671</b>	<b>\$3,360</b>	<b>\$30,311</b>	<b>6.5</b>	<b>36,753</b>
ECM 8	Install VFDs on Constant Volume (CV) Fans	Yes	28,459	8.1	0	\$3,637	\$54,555	\$26,458	\$3,360	\$23,098	6.4	28,658
ECM 9	Install VFDs on Heating Water Pumps	Yes	8,039	1.4	0	\$1,027	\$15,411	\$7,214	\$0	\$7,214	7.0	8,095
<b>Electric Unitary HVAC Measures</b>			<b>7,266</b>	<b>4.5</b>	<b>0</b>	<b>\$929</b>	<b>\$13,928</b>	<b>\$34,202</b>	<b>\$1,306</b>	<b>\$32,896</b>	<b>35.4</b>	<b>7,317</b>
	Install High Efficiency Air Conditioning Units	No	7,266	4.5	0	\$929	\$13,928	\$34,202	\$1,306	\$32,896	35.4	7,317
<b>Gas Heating (HVAC/Process) Replacement</b>			<b>0</b>	<b>0.0</b>	<b>995</b>	<b>\$8,455</b>	<b>\$169,097</b>	<b>\$99,870</b>	<b>\$11,504</b>	<b>\$88,367</b>	<b>10.5</b>	<b>116,527</b>
ECM 10	Install High Efficiency Hot Water Boilers	Yes	0	0.0	995	\$8,455	\$169,097	\$99,870	\$11,504	\$88,367	10.5	116,527
<b>HVAC System Improvements</b>			<b>0</b>	<b>0.0</b>	<b>12</b>	<b>\$99</b>	<b>\$1,088</b>	<b>\$220</b>	<b>\$0</b>	<b>\$220</b>	<b>2.2</b>	<b>1,363</b>
ECM 11	Install Pipe Insulation	Yes	0	0.0	12	\$99	\$1,088	\$220	\$0	\$220	2.2	1,363
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>46</b>	<b>\$388</b>	<b>\$3,884</b>	<b>\$122</b>	<b>\$0</b>	<b>\$122</b>	<b>0.3</b>	<b>5,353</b>
ECM 12	Install Low-Flow DHW Devices	Yes	0	0.0	46	\$388	\$3,884	\$122	\$0	\$122	0.3	5,353
<b>Food Service &amp; Refrigeration Measures</b>			<b>4,632</b>	<b>0.5</b>	<b>0</b>	<b>\$592</b>	<b>\$5,661</b>	<b>\$6,579</b>	<b>\$0</b>	<b>\$6,579</b>	<b>11.1</b>	<b>4,664</b>
	Replace Refrigeration Equipment	No	3,020	0.3	0	\$386	\$4,631	\$6,349	\$0	\$6,349	16.5	3,041
ECM 13	Vending Machine Control	Yes	1,612	0.2	0	\$206	\$1,030	\$230	\$50	\$180	0.9	1,623
<b>TOTALS</b>			<b>111,054</b>	<b>33.7</b>	<b>1,036</b>	<b>\$22,996</b>	<b>\$378,176</b>	<b>\$239,387</b>	<b>\$25,630</b>	<b>\$213,757</b>	<b>9.3</b>	<b>233,164</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements



## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

New Jersey Clean Energy Programs gives you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures	x	x	
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	x	x	
ECM 3	Retrofit Fixtures with LED Lamps	x	x	
ECM 4	Install Occupancy Sensor Lighting Controls	x	x	
ECM 5	Install Daylight Dimming Controls		x	
ECM 6	Install High/Low Lighting Controls	x	x	
ECM 7	Premium Efficiency Motors		x	
ECM 8	Install VFDs on Constant Volume (CV) HVAC	x	x	
ECM 9	Install VFDs on Hot Water Pumps		x	
ECM 10	Install High Efficiency Hot Water Boilers	x		
ECM 11	Install Pipe Insulation		x	
ECM 12	Install Low-Flow Domestic Hot Water Devices		x	
ECM 13	Vending Machine Control	x	x	

Figure 3 – Funding Options



## New Jersey Clean Energy Programs At-A-Glance

	<b>SmartStart</b> Flexibility to install at your own pace	<b>Direct Install</b> Turnkey installation	<b>Pay for Performance</b> Whole building upgrades
<b>Who should use it?</b>	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together.  Peak demand should be below 200 kW.  Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time.  Peak demand should be over 200 kW.
<b>How does it work?</b>	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
<b>What are the Incentives?</b>	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project.  You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
<b>How do I participate?</b>	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified partner to develop your energy reduction plan and set your energy savings targets.

Take the next step by visiting [www.njcleanenergy.com](http://www.njcleanenergy.com) for program details, applications, and to contact a qualified contractor.

### *Individual Measures with SmartStart*

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

### *Turnkey Installation with Direct Install*

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

### *Whole Building Approach with Pay for Performance*

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

## **More Options from Around the State**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat & Power (CHP)*

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce their electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

## 2 EXISTING CONDITIONS

---

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for Emma L. Arleth Elementary School. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On August 28, 2018, TRC performed an energy audit at Emma L. Arleth Elementary School located in Parlin, NJ. TRC met with Kenny to review the facility operations and help focus our investigation on specific energy-using systems.

Emma L. Arleth Elementary School is a one-story, 73,426 square foot building built in 1959. Spaces include: classrooms, gymnasium, offices, cafeteria, kitchen, media center, corridors, stairwells and mechanical space. The building is 100% heated and approximately 15% cooled. The heating system is served by hot water boilers. The office, media center, lounge, server rooms and a few classrooms are cooled. This includes air handling units (AHUs) and split air-conditioning (AC) systems. The HVAC equipment and systems are controlled by a pneumatic control system and an energy management system (EMS). The EMS includes three hallways and the gym but does not control anything in the front of the building. The front parking lot lighting is on the main meter and are HID lamp fixtures which are controlled by a timeclock.

Recent improvements include: Over the last five years the facility has replaced the gymnasium high bay lighting with new T5 high output lamp fixtures and replaced exterior light fixtures with new LED fixtures.

Facility concerns include: Per discussions with facility personnel the main operational and maintenance concerns include the original unit ventilators (~25% of the building) and the original pneumatic controls which are said to no longer be working. The heating system fan motors operate 24 hours a day, seven days a week due to freeze protection. Another main concern are the old inefficient boilers which were installed in 2000.

## 2.2 Building Occupancy

The facility is occupied from September through June and for occasional board of education meetings in the summer. Typical peak building occupancy includes about 500 students and 85 staff members.

Summer occupancy includes continuing maintenance and custodial activities. There were weekend activities which included a program where the building was occupied on Saturdays, however this program is no longer in operation since June of 2018.

Building Name	Weekday/Weekend	Operating Schedule
Normal School Day (Whole Building)	Weekday	7:00AM-3:20PM
	Weekend	No Use
Separate Entity Use of Building (Saturday Program)	Weekday	No Use
	Weekend	6:00AM-4:00PM
After Hours Cleaning	Weekday	3:00PM-11:00PM
	Weekend	No Use

Figure 4 - Building Occupancy Schedule

## 2.3 Building Envelope

Building walls are concrete block with a brick facade. The roof is flat and appears to be in fair condition. The walls are made of concrete masonry units (CMUs) with a brick veneer. Windows are single or double pane, operable with metal frames. The window frames are showing evidence of excessive wear. Exterior doors are metal with metal frames which are in fair condition. They have worn or missing weather-stripping materials. Degraded window and door seals increase drafts and outside air infiltration.



*Building Facade*



*Building Facade*



*Building Envelope Deficiencies*



*Exterior Doors with Worn Weather-Stripping*

## 2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. Fixture types include 2- 3- or 4-lamp, 2- or 4-foot long recessed troffer and surface mounted wrap fixtures. There are also several compact fluorescent fixtures with either plug in lamps, biax lamps or high output screw in lamps. There are incandescent general purpose lamps. The cafeteria is lit by linear fluorescent T5 lamp fixtures and the gymnasium is lit by linear fluorescent T5 high output lamp fixtures which were installed within the past five years. Most fixtures are in fair to good condition. All of the classroom light fixtures are controlled by occupancy sensors and the remaining areas are controlled manually via wall switches. Exit signs are LED.

Interior lighting levels were generally sufficient with the exception of some classrooms and the media center which were over lit. These classrooms are lit by 2-lamp or 3-lamp fixtures and have inboard/outboard bi-level switching. During the energy audit, the following light levels, in footcandles (FC), were taken:

- Classroom with 6 fixtures, 3 Lamp – 60 FC
- Classroom with 12 fixtures, 2 Lamp – 45 FC
- Media Center, CFL fixtures – 95-100 FC

The minimum light levels required for classroom space by IES standards is 30 FC. However, additional considerations must be investigated during design to determine the cost effectiveness of reducing the number of lamps. With bi-level switching, it is uncertain as to how often these fixtures operate at each level of switching (number of lamps). Reducing the light output would require a level of design, beyond the scope of this energy audit, to determine the feasibility. Options may include upgrading to 1-LED lamp fixtures, 2x4 LED retrofit kits, changing the number of fixtures, etc. The options range too much to provide an analysis and cost would vary drastically on the proposed approach. We recommend that this be investigated further by an electrical contractor if lighting upgrades move forward to implementation.



*Surface Mounted Wrap Fixtures*



*Classroom Lighting*




*Hallway Lighting*



*Hallway Lighting*




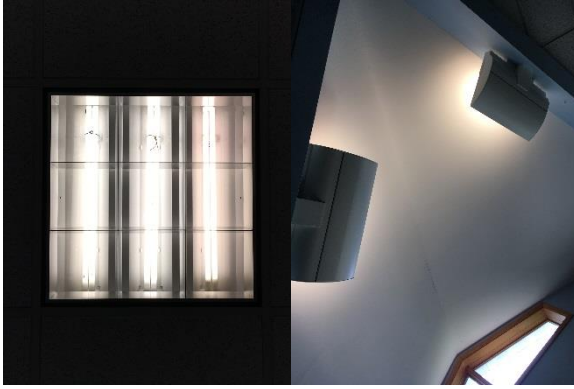

*Compact Fluorescent Biax Lamp Recessed Troffer and Wall Mounted Up Light Fixtures*




*Media Center Lighting*

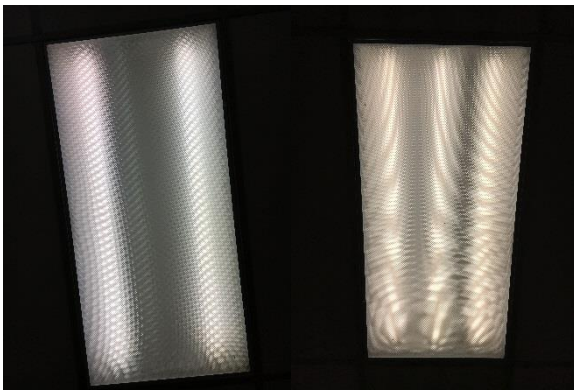

*Recessed Troffer Fixtures*



*Classroom Lighting*

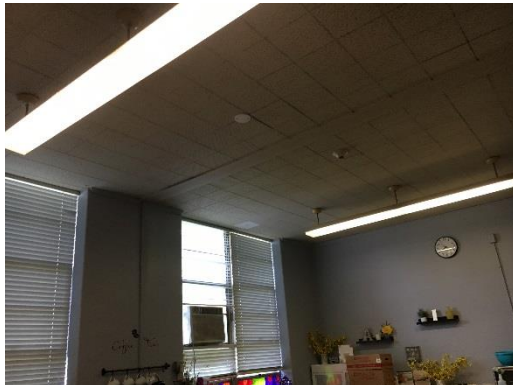

*Continuous Row Pendant Mounted Wrap Fixtures*



*Cafeteria Lighting*



*Wall Switch and Key Switch*



*Ceiling Mounted Occupancy Sensor*

Exterior fixtures include wall packs, flood fixtures, under canopy fixtures and pole mounted shoe box fixtures with high pressure sodium lamp that range between 70-Watt and 250-Watt. There are also LED wall pack fixtures which were installed within the past five years. There are recessed can fixtures with compact fluorescent plug in lamps. Exterior light fixtures are controlled by timeclocks set from 7:00 PM to 7:00 AM, every day.



*LED Wall Pack Fixture*



*HID Wall Pack Fixture*



*HID Wall Mounted Flood Fixtures*



*HID Pole Mounted Shoe Box Fixture*



*Timeclocks*



*Timeclock*

## 2.5 Air Handling Systems

### Unit Ventilators

The original unit ventilators have fractional horsepower supply fan motors, pneumatically controlled outside air dampers and zone valves that operate with a pneumatic control system. This system is original to the building and appears to be in poor operating condition. The newer unit ventilators have fractional horsepower supply fan motors, electronically controlled outside air dampers and valves that operate with the energy management system (EMS). The classroom wing schedule is Monday through Friday, 5:00 AM to 3:00 PM.



*Original Unit Ventilator*



*New Unit Ventilator*

### Air Handling Units (AHUs)

The gymnasium and media center are conditioned by AHUs which were installed in 2000. These AHUs have a supply fan motor, exhaust fan motor, heating hot water coil served by the boilers and refrigerant coil served by outdoor condensing units. The media center schedule is Monday through Friday, 7:00 AM to 5:00 PM.



*AHU*



*AHU*

## Split Air Conditioning (AC) Systems

The offices are conditioned by split AC systems with outdoor units that are up to one ton in cooling capacity. These are beyond their useful life and operate at an estimated efficiency of 9 EER (energy efficiency ratio). There was a new split AC system installed for an office that is in good condition and 11 EER. These systems are remote controlled by occupants. The outdoor condensing units that serve the aforementioned AHUs are beyond their useful life and operate at an estimated efficiency of 9 EER. They are a 6-ton and 10-ton unit. The efficiencies for this equipment were de-rated based on the age and condition of the equipment. These systems are controlled by the EMS.



*Split AC Systems – Outdoor Condensing Unit*



*Split AC System - Remote*



*AHU Systems – Outdoor Condensing Unit*



*AHU Systems – Outdoor Condensing Unit*

## Air Conditioners

Classrooms and some smaller rooms are cooled by window AC units which vary in condition and efficiency. Most are beyond their useful life, up to 2-ton units with efficiencies between 8.5 EER and 10.7 EER. They are manually turned on and off by occupants, when needed in the summer months.



*Window AC Unit*



*Window AC Unit*




## 2.7 Building Energy Management Systems (EMS)

A United Technologies Automated Logic energy management system controls the HVAC equipment, the boilers, the air handlers and new unit ventilators. The EMS provides equipment scheduling control and monitors space temperatures, supply air temperatures and heating water loop temperatures. The site staff expressed an interest in expanding the level of control provided by the EMS.




*Original UV Controls*

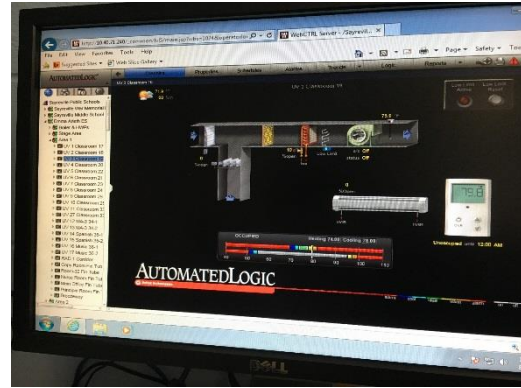

*New UV Controls*




*Temperature Sensor*

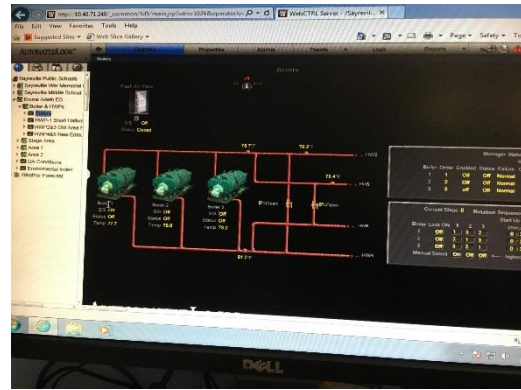

*Heating System Graphic*



*Radiator Graphic*

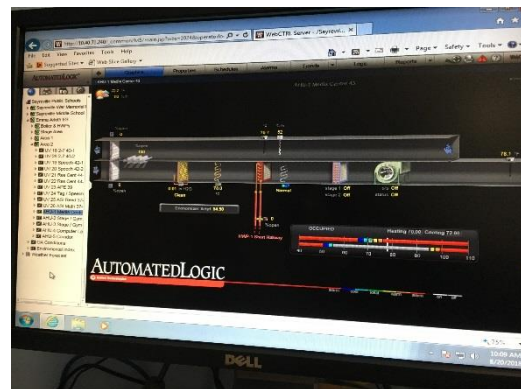

*AHU Graphic*




## 2.8 Domestic Hot Water

Hot water is produced by a 71-gallon A.O. Smith (Model: BT 80 300) 75 MBH gas-fired storage tank water heater with an 80% efficiency. This water heater is in good condition and serves the hand washing sinks throughout majority of the building. The hot water supply piping was uninsulated in the boiler room. A fractional horsepower circulation pump distributes water to end uses. The hand washing sinks are fit with high flow aerators rated for 2.0 gallons per minute (gpm) or higher.



*Storage Tank Water Heater and Uninsulated Piping*

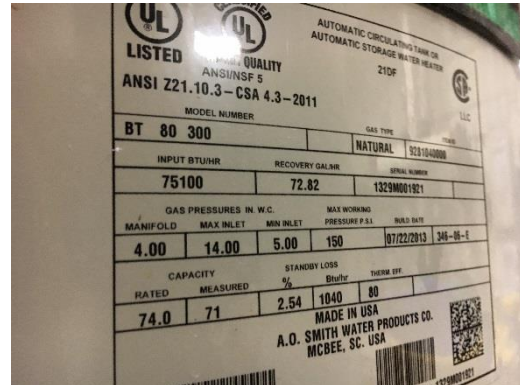

*Water Heater Nameplate*

There is a 49-gallon Rheem Ruud (Model: ES50-6-G-1) 3.5 kW electric storage tank water heater that serves the domestic hot water needs of the new wing. This water heater is in good condition and pipes were properly insulated. At the time of the site visit, the domestic water heater was set at 110°F. A fractional horsepower circulation pump distributes water to end uses. The hand washing sinks in the newer wing are already fit with low flow aerators rated for 0.5 gpm.



*Storage Tank Water Heater*



*High Flow Aerator and Low Flow Sinks*

## 2.9 Food Service Equipment

The kitchen has mixed gas and electric equipment that is used to prepare lunches for students. Most cooking is done using a convection and conventional gas-fired ovens. Bulk prepared foods are held in several electric holding cabinets. Equipment is high efficiency and is in fair condition.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Food Service Equipment*

## 2.10 Refrigeration

The kitchen has several refrigerator chests, a stand-up freezer and a few stand-up refrigerators with either solid or glass doors. Stand up equipment is generally high efficiency equipment while the refrigerator chests are not. However, the stand up equipment was noted to be on and empty during the energy audit which was conducted during the unoccupied summer. The refrigerator chests were cleaned out, off and empty. There is no walk-in refrigeration equipment at the building.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Refrigeration Chests*



*Stand up Refrigerators*

## 2.11 Plug Load & Vending Machines

The utility bill analysis indicates that plug loads consume approximately 2.86% percent of total building energy use. This is lower than a typical building. You seem to already be doing a great job managing your electrical plug loads. This report makes additional suggestions for ECMs in this area as well as Energy Efficient Best Practices.

There are approximately 97 computer work stations throughout the facility as well as laptop charging carts. Plug loads throughout the building include general café and office equipment. There are classroom typical loads such as smart boards, projectors, speakers and fans. There are several residential style refrigerators throughout the building. These vary in condition and efficiency. There is a refrigerated beverage vending machine in the lounge which is not equipped with occupancy-based controls.



*Vending Machine*



*Desktop Computers & Laptop Cart*


## 2.12 Water-Using Systems

There are restrooms with toilets, urinals, and sinks. Faucet flow rates are either high flow rated for 2.0 gpm or higher or low flow rated for 0.5 gpm.

### 3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	375,116 kWh	\$47,939
Natural Gas	40,936 Therms	\$34,777
<b>Total</b>		<b>\$82,717</b>

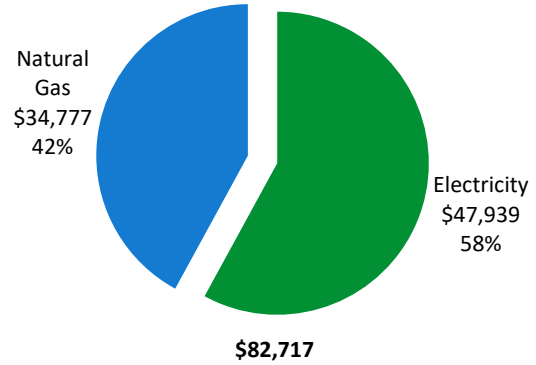

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


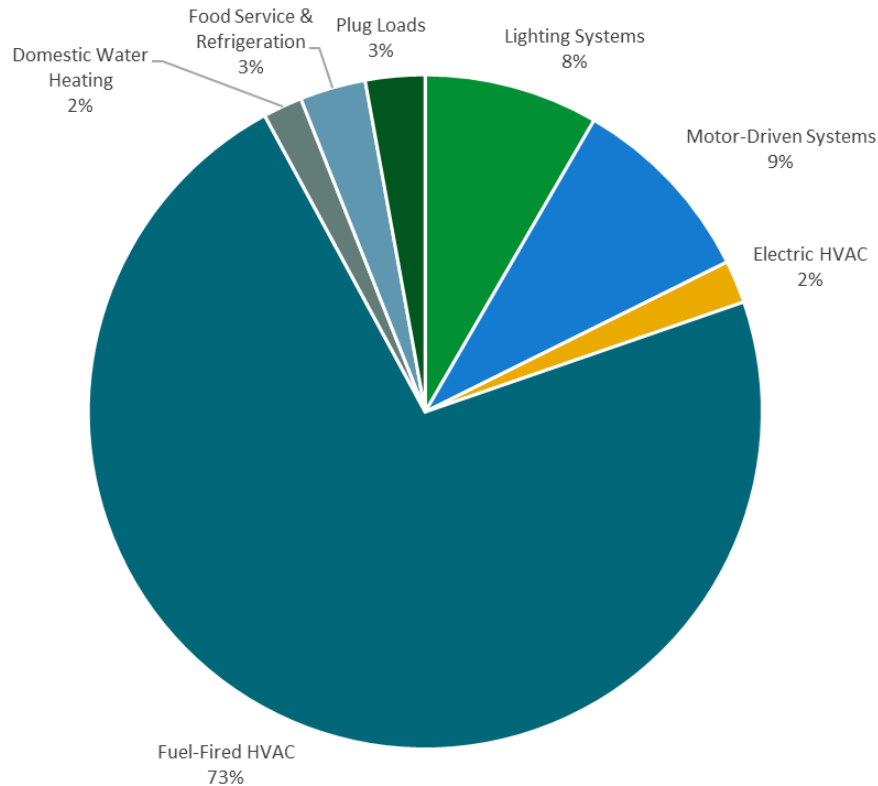


Figure 5 - Energy Balance

### 3.1 Electricity

JCP&L supplies and delivers electricity under rate class General Service Secondary 3 Phase.

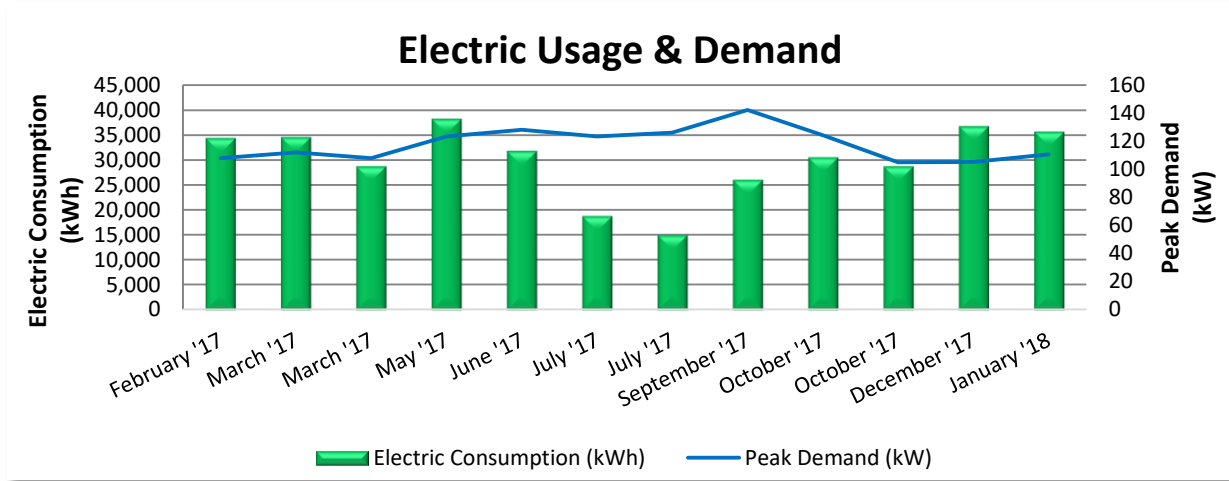


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
2/16/17	28	34,400	108	\$649	\$4,252
3/17/17	28	34,580	112	\$575	\$4,310
4/14/17	27	28,800	108	\$847	\$3,688
5/18/17	33	38,240	124	\$751	\$4,765
6/19/17	31	31,840	128	\$825	\$4,150
7/19/17	29	18,880	123	\$805	\$2,817
8/15/17	26	15,040	126	\$625	\$2,456
9/19/17	31	26,080	142	\$808	\$3,544
10/18/17	28	30,560	124	\$757	\$3,914
11/15/17	27	28,800	105	\$629	\$3,601
12/19/17	33	36,800	105	\$631	\$4,400
1/18/18	29	35,680	111	\$665	\$4,074
<b>Totals</b>	<b>350</b>	<b>359,700</b>	<b>142</b>	<b>\$8,567</b>	<b>\$45,969</b>
<b>Annual</b>	<b>365</b>	<b>375,116</b>	<b>142</b>	<b>\$8,934</b>	<b>\$47,939</b>

Notes:

- Peak demand of 142 kW occurred in May 2017.
- The average electric cost over the past 12 months was \$0.128/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

### 3.2 Natural Gas

PSE&G delivers natural gas under rate class LVG, with natural gas supply provided by Direct Energy, a third-party supplier.

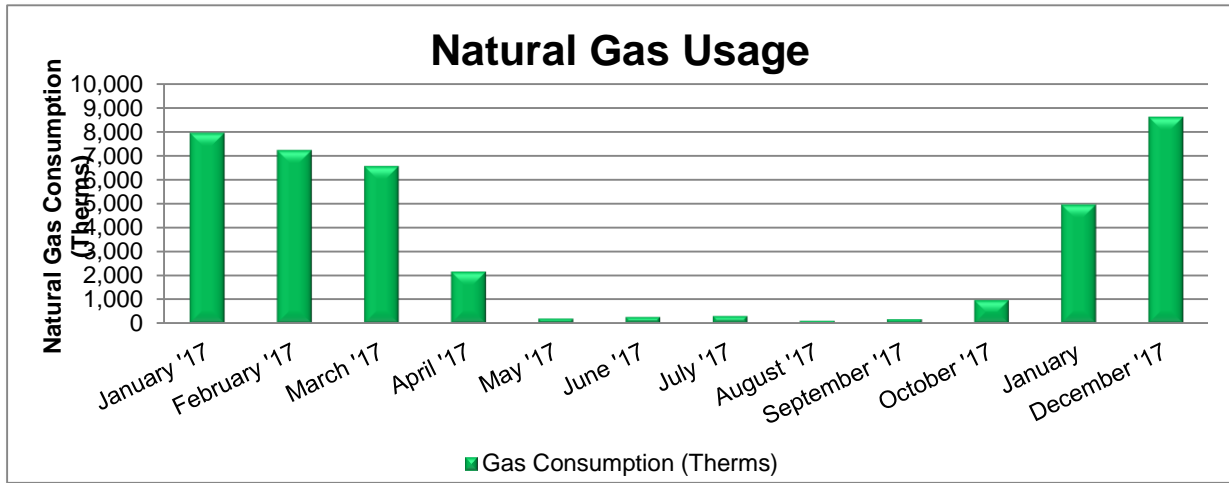

Gas Billing Data				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
2/1/17	28	7,963	\$7,100	No
3/6/17	32	7,238	\$6,448	No
4/4/17	28	6,575	\$4,219	No
5/3/17	28	2,165	\$1,464	No
6/2/17	29	203	\$235	No
7/5/17	32	278	\$263	No
8/3/17	28	316	\$370	No
8/31/17	27	108	\$124	Yes
10/5/17	34	173	\$200	Yes
10/31/17	25	977	\$1,128	Yes
11/31/17	30	4,968	\$4,455	No
1/3/18	32	8,626	\$7,628	No
<b>Totals</b>	<b>353</b>	<b>39,590</b>	<b>\$33,634</b>	
<b>Annual</b>	<b>365</b>	<b>40,936</b>	<b>\$34,777</b>	

Notes:

- The average gas cost for the past 12 months is \$0.850/therm, which is the blended rate used throughout the analysis.

### 3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's Portfolio Manager® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

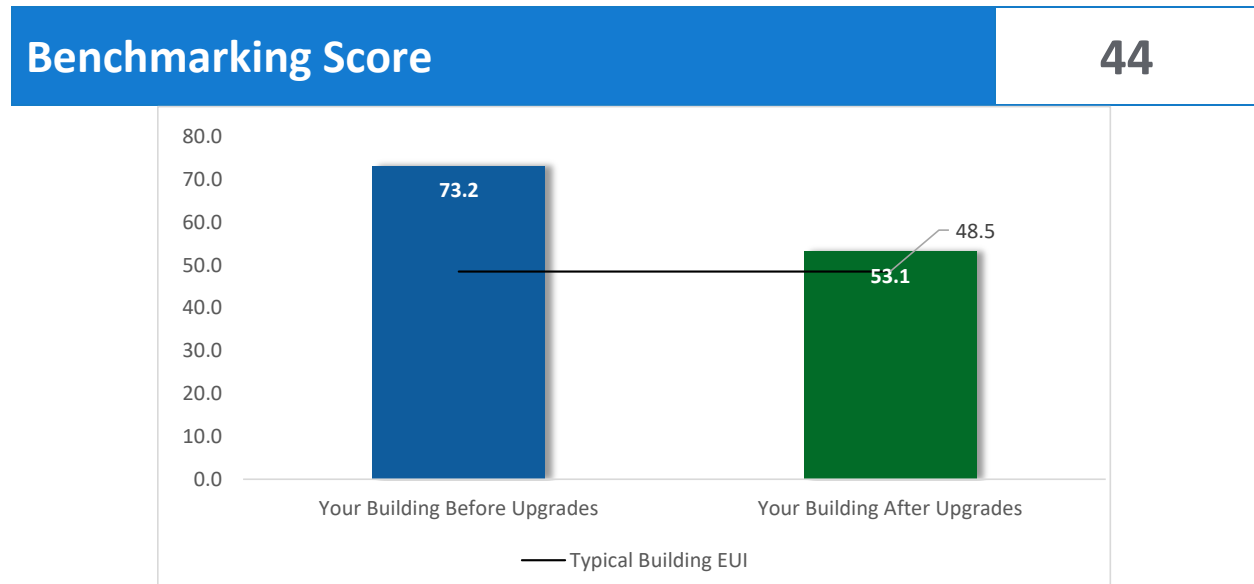


Figure 6 - Energy Use Intensity Comparison

This building performs at, or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

## **Tracking Your Energy Performance**

Keeping track of your energy use monthly is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>. For more information on ENERGY STAR® and Portfolio Manager®, visit their website<sup>3</sup>.

---

<sup>3</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.



## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

**Appendix A: Equipment Inventory & Recommendations** provides a detailed list of the locations and recommended upgrades for each energy conservation measure.

#	Energy Conservation Measure	Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>56,266</b>	<b>17.5</b>	<b>-15</b>	<b>\$7,063</b>	<b>\$105,946</b>	<b>\$45,506</b>	<b>\$8,090</b>	<b>\$37,416</b>	<b>5.3</b>	<b>54,901</b>
ECM 1	Install LED Fixtures	Yes	13,409	2.2	-1	\$1,704	\$25,556	\$13,644	\$965	\$12,679	7.4	13,366
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps	Yes	3,421	1.5	-1	\$428	\$6,417	\$3,301	\$480	\$2,821	6.6	3,315
ECM 3	Retrofit Fixtures with LED Lamps	Yes	39,435	13.7	-13	\$4,932	\$73,973	\$28,561	\$6,645	\$21,916	4.4	38,219
<b>Lighting Control Measures</b>			<b>3,981</b>	<b>1.0</b>	<b>-1</b>	<b>\$498</b>	<b>\$3,982</b>	<b>\$8,922</b>	<b>\$1,370</b>	<b>\$7,552</b>	<b>15.2</b>	<b>3,858</b>
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	2,688	0.7	-1	\$336	\$2,689	\$6,622	\$985	\$5,637	16.8	2,605
ECM 5	Install Daylight Dimming Controls	Yes	356	0.1	0	\$45	\$356	\$500	\$385	\$115	2.6	345
ECM 6	Install High/Low Lighting Controls	Yes	937	0.2	0	\$117	\$937	\$1,800	\$0	\$1,800	15.4	908
<b>Motor Upgrades</b>			<b>2,411</b>	<b>0.6</b>	<b>0</b>	<b>\$308</b>	<b>\$4,622</b>	<b>\$10,294</b>	<b>\$0</b>	<b>\$10,294</b>	<b>33.4</b>	<b>2,428</b>
ECM 7	Premium Efficiency Motors	Yes	2,411	0.6	0	\$308	\$4,622	\$10,294	\$0	\$10,294	33.4	2,428
<b>Variable Frequency Drive (VFD) Measures</b>			<b>36,498</b>	<b>9.5</b>	<b>0</b>	<b>\$4,664</b>	<b>\$69,966</b>	<b>\$33,671</b>	<b>\$3,360</b>	<b>\$30,311</b>	<b>6.5</b>	<b>36,753</b>
ECM 8	Install VFDs on Constant Volume (CV) Fans	Yes	28,459	8.1	0	\$3,637	\$54,555	\$26,458	\$3,360	\$23,098	6.4	28,658
ECM 9	Install VFDs on Heating Water Pumps	Yes	8,039	1.4	0	\$1,027	\$15,411	\$7,214	\$0	\$7,214	7.0	8,095
<b>Electric Unitary HVAC Measures</b>			<b>7,266</b>	<b>4.5</b>	<b>0</b>	<b>\$929</b>	<b>\$13,928</b>	<b>\$34,202</b>	<b>\$1,306</b>	<b>\$32,896</b>	<b>35.4</b>	<b>7,317</b>
	Install High Efficiency Air Conditioning Units	No	7,266	4.5	0	\$929	\$13,928	\$34,202	\$1,306	\$32,896	35.4	7,317
<b>Gas Heating (HVAC/Process) Replacement</b>			<b>0</b>	<b>0.0</b>	<b>995</b>	<b>\$8,455</b>	<b>\$169,097</b>	<b>\$99,870</b>	<b>\$11,504</b>	<b>\$88,367</b>	<b>10.5</b>	<b>116,527</b>
ECM 10	Install High Efficiency Hot Water Boilers	Yes	0	0.0	995	\$8,455	\$169,097	\$99,870	\$11,504	\$88,367	10.5	116,527
<b>HVAC System Improvements</b>			<b>0</b>	<b>0.0</b>	<b>12</b>	<b>\$99</b>	<b>\$1,088</b>	<b>\$220</b>	<b>\$0</b>	<b>\$220</b>	<b>2.2</b>	<b>1,363</b>
ECM 11	Install Pipe Insulation	Yes	0	0.0	12	\$99	\$1,088	\$220	\$0	\$220	2.2	1,363
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>46</b>	<b>\$388</b>	<b>\$3,884</b>	<b>\$122</b>	<b>\$0</b>	<b>\$122</b>	<b>0.3</b>	<b>5,353</b>
ECM 12	Install Low-Flow DHW Devices	Yes	0	0.0	46	\$388	\$3,884	\$122	\$0	\$122	0.3	5,353
<b>Food Service &amp; Refrigeration Measures</b>			<b>4,632</b>	<b>0.5</b>	<b>0</b>	<b>\$592</b>	<b>\$5,661</b>	<b>\$6,579</b>	<b>\$0</b>	<b>\$6,579</b>	<b>11.1</b>	<b>4,664</b>
	Replace Refrigeration Equipment	No	3,020	0.3	0	\$386	\$4,631	\$6,349	\$0	\$6,349	16.5	3,041
ECM 13	Vending Machine Control	Yes	1,612	0.2	0	\$206	\$1,030	\$230	\$50	\$180	0.9	1,623
<b>TOTALS</b>			<b>111,054</b>	<b>33.7</b>	<b>1,036</b>	<b>\$22,996</b>	<b>\$378,176</b>	<b>\$239,387</b>	<b>\$25,630</b>	<b>\$213,757</b>	<b>9.3</b>	<b>233,164</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>56,266</b>	<b>17.5</b>	<b>-15</b>	<b>\$7,063</b>	<b>\$45,506</b>	<b>\$8,090</b>	<b>\$37,416</b>	<b>5.3</b>	<b>54,901</b>
ECM 1	Install LED Fixtures	13,409	2.2	-1	\$1,704	\$13,644	\$965	\$12,679	7.4	13,366
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps	3,421	1.5	-1	\$428	\$3,301	\$480	\$2,821	6.6	3,315
ECM 3	Retrofit Fixtures with LED Lamps	39,435	13.7	-13	\$4,932	\$28,561	\$6,645	\$21,916	4.4	38,219
<b>Lighting Control Measures</b>		<b>3,981</b>	<b>1.0</b>	<b>-1</b>	<b>\$498</b>	<b>\$8,922</b>	<b>\$1,370</b>	<b>\$7,552</b>	<b>15.2</b>	<b>3,858</b>
ECM 4	Install Occupancy Sensor Lighting Controls	2,688	0.7	-1	\$336	\$6,622	\$985	\$5,637	16.8	2,605
ECM 5	Install Daylight Dimming Controls	356	0.1	0	\$45	\$500	\$385	\$115	2.6	345
ECM 6	Install High/Low Lighting Controls	937	0.2	0	\$117	\$1,800	\$0	\$1,800	15.4	908
<b>Motor Upgrades</b>		<b>2,411</b>	<b>0.6</b>	<b>0</b>	<b>\$308</b>	<b>\$10,294</b>	<b>\$0</b>	<b>\$10,294</b>	<b>33.4</b>	<b>2,428</b>
ECM 7	Premium Efficiency Motors	2,411	0.6	0	\$308	\$10,294	\$0	\$10,294	33.4	2,428
<b>Variable Frequency Drive (VFD) Measures</b>		<b>36,498</b>	<b>9.5</b>	<b>0</b>	<b>\$4,664</b>	<b>\$33,671</b>	<b>\$3,360</b>	<b>\$30,311</b>	<b>6.5</b>	<b>36,753</b>
ECM 8	Install VFDs on Constant Volume (CV) Fans	28,459	8.1	0	\$3,637	\$26,458	\$3,360	\$23,098	6.4	28,658
ECM 9	Install VFDs on Heating Water Pumps	8,039	1.4	0	\$1,027	\$7,214	\$0	\$7,214	7.0	8,095
<b>Gas Heating (HVAC/Process) Replacement</b>		<b>0</b>	<b>0.0</b>	<b>995</b>	<b>\$8,455</b>	<b>\$99,870</b>	<b>\$11,504</b>	<b>\$88,367</b>	<b>10.5</b>	<b>116,527</b>
ECM 10	Install High Efficiency Hot Water Boilers	0	0.0	995	\$8,455	\$99,870	\$11,504	\$88,367	10.5	116,527
<b>HVAC System Improvements</b>		<b>0</b>	<b>0.0</b>	<b>12</b>	<b>\$99</b>	<b>\$220</b>	<b>\$0</b>	<b>\$220</b>	<b>2.2</b>	<b>1,363</b>
ECM 11	Install Pipe Insulation	0	0.0	12	\$99	\$220	\$0	\$220	2.2	1,363
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>46</b>	<b>\$388</b>	<b>\$122</b>	<b>\$0</b>	<b>\$122</b>	<b>0.3</b>	<b>5,353</b>
ECM 12	Install Low-Flow DHW Devices	0	0.0	46	\$388	\$122	\$0	\$122	0.3	5,353
<b>Food Service &amp; Refrigeration Measures</b>		<b>1,612</b>	<b>0.2</b>	<b>0</b>	<b>\$206</b>	<b>\$230</b>	<b>\$50</b>	<b>\$180</b>	<b>0.9</b>	<b>1,623</b>
ECM 13	Vending Machine Control	1,612	0.2	0	\$206	\$230	\$50	\$180	0.9	1,623
<b>TOTALS</b>		<b>100,768</b>	<b>28.9</b>	<b>1,036</b>	<b>\$21,682</b>	<b>\$198,835</b>	<b>\$24,374</b>	<b>\$174,462</b>	<b>8.0</b>	<b>222,806</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

## 4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>56,266</b>	<b>17.5</b>	<b>-15</b>	<b>\$7,063</b>	<b>\$45,506</b>	<b>\$8,090</b>	<b>\$37,416</b>	<b>5.3</b>	<b>54,901</b>
ECM 1	Install LED Fixtures	13,409	2.2	-1	\$1,704	\$13,644	\$965	\$12,679	7.4	13,366
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	3,421	1.5	-1	\$428	\$3,301	\$480	\$2,821	6.6	3,315
ECM 3	Retrofit Fixtures with LED Lamps	39,435	13.7	-13	\$4,932	\$28,561	\$6,645	\$21,916	4.4	38,219

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Install LED Fixtures**

Replace existing exterior fixtures containing high pressure sodium lamps and interior fixtures in the media room using CFL biax lamps with new LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixture(s).

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

**Affected building areas:** media center, exterior fixtures

### **ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers**

Retrofit fluorescent 3-lamp fixtures by removing the fluorescent tubes and ballasts and replacing them with a 2-LED tubes, an LED driver and retrofit kit (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and therefore do not need to be replaced as often.

**Affected building areas:** classrooms #33-#36 with fluorescent fixtures with T8 lamps that are over lit

### **ECM 3: Retrofit Fixtures with LED Lamps**

Replace fluorescent (T8, T5 and T5HO), compact fluorescent and incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected building areas:** all areas with fluorescent fixtures and general purpose lamps

**Considerations/Sensitivities:** Light levels were over lit in some classrooms. Over lit classrooms that were not recommended for retrofit within ECM 2 may still have an opportunity for greater savings than replacing the lamps one-for-one. The classroom light levels were on average 45 FC and these have 2-lamp fixtures. The minimum light levels required for classroom space by IES standards is 30 FC. However, additional considerations must be investigated during design to determine the cost effectiveness of reducing the number of lamps. Reducing the light output would require a level of design, beyond the scope of this energy audit, to determine the feasibility. Options may include upgrading to 1-LED lamp fixtures, 2x4 LED retrofit kits, changing the number of fixtures, etc. The options range too much to provide an analysis and cost would vary drastically on the proposed approach. We recommend that this be investigated further by an electrical contractor if lighting upgrades move forward to implementation.

## 4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>3,981</b>	<b>1.0</b>	<b>-1</b>	<b>\$498</b>	<b>\$8,922</b>	<b>\$1,370</b>	<b>\$7,552</b>	<b>15.2</b>	<b>3,858</b>
ECM 4	Install Occupancy Sensor Lighting Controls	2,688	0.7	-1	\$336	\$6,622	\$985	\$5,637	16.8	2,605
ECM 5	Install Daylight Dimming Controls	356	0.1	0	\$45	\$500	\$385	\$115	2.6	345
ECM 6	Install High/Low Lighting Controls	937	0.2	0	\$117	\$1,800	\$0	\$1,800	15.4	908

Lighting controls reduce energy use by turning off or lowering, lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

### **ECM 4: Install Occupancy Sensor Lighting Controls**

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

**Affected building areas:** offices, gym, media center and restrooms

### **ECM 5: Install Daylight Dimming Controls**

Install daylight dimming controls that use photosensors to reduce electric lighting in areas when ample daylight lighting is present. Use photosensor controls for fixtures serving areas that are lit by sunlight. As sunlight levels increase in the room, artificial lighting decreases or turns off.

This measure reduces energy use in spaces where ambient daylight provides sufficient lighting levels. Optimum light levels and the method of dimming should be determined during lighting design.

**Affected building areas:** hallway and walkway

### **ECM 6: Install High/Low Lighting Controls**

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. This measure

provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

**Affected building areas:** hallways

**Considerations/Sensitivities:** For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as an occupant approaches.

## 4.3 Motors

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Motor Upgrades</b>		<b>2,411</b>	<b>0.6</b>	<b>0</b>	<b>\$308</b>	<b>\$10,294</b>	<b>\$0</b>	<b>\$10,294</b>	<b>33.4</b>	<b>2,428</b>
ECM 7	Premium Efficiency Motors	2,411	0.6	0	\$308	\$10,294	\$0	\$10,294	33.4	2,428

### **ECM 7: Premium Efficiency Motors**

Replace standard efficiency motors with IHP 2014 efficiency motors. This evaluation assumes that existing motors will be replaced with motors of equivalent size and type. In some cases, additional savings may be possible by downsizing motors to better meet the motor's current load requirements.

Affected motors:

Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor
Boiler Room	HWP-4	1	Heating Hot Water Pump	7.5
Boiler Room	HWP-5	1	Heating Hot Water Pump	7.5
AHU	Gym	2	Supply Fan	7.5
AHU	Gym	2	Exhaust Fan	3.0
AHU	Library/Media Center	2	Supply Fan	7.5
AHU	Library/Media Center	2	Exhaust Fan	3.0

Savings are based on the difference between baseline and proposed efficiencies and the assumed annual operating hours. The base case motor energy consumption is estimated using the efficiencies found on nameplates or estimated based on the age of the motor and our best estimates of motor run hours. Efficiencies of proposed motor upgrades are obtained from the current *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*.



## 4.4 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Variable Frequency Drive (VFD) Measures</b>		<b>36,498</b>	<b>9.5</b>	<b>0</b>	<b>\$4,664</b>	<b>\$33,671</b>	<b>\$3,360</b>	<b>\$30,311</b>	<b>6.5</b>	<b>36,753</b>
ECM 8	Install VFDs on Constant Volume (CV) Fans	28,459	8.1	0	\$3,637	\$26,458	\$3,360	\$23,098	6.4	28,658
ECM 9	Install VFDs on Heating Water Pumps	8,039	1.4	0	\$1,027	\$7,214	\$0	\$7,214	7.0	8,095

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new motor —unless the existing motor meets or exceeds IHP 2014 standards—to conservatively account for the cost of an inverter duty rated motor. The savings and cost associated with the new motor are presented with the Premium Efficiency Motor measures. If the proposed VFD measure is not selected for implementation the motor replacement should be reevaluated.

### **ECM 8: Install VFDs on Constant Volume (CV) Fans**

Install VFDs to control constant volume supply and exhaust fan motor speeds in the AHUs that serve the gymnasium and media center. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor, if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature. Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

This measure is part of a measure to replace motors and as such must be considered in combination with ECM 7: Premium Efficiency Motors.

### **ECM 9: Install VFDs on Heating Water Pumps**

Install variable frequency drives (VFD) to control heating water pumps. Two-way valves must serve the hot water coils and the hot water loop must have a differential pressure sensor installed. If three-way valves or a bypass leg are used in the hot water distribution they will need to be modified when this measure is implemented. As the hot water valves close, the differential pressure increases and the VFD modulates the pump speed to maintain a differential pressure setpoint.

Energy savings result from reducing pump motor speed (and power) as hot water valves close. The magnitude of energy savings is based on the estimated amount of time that the system will operate at reduced load.

This measure is part of a measure to replace motors and as such must be considered in combination with ECM 7: Premium Efficiency Motors.

**Considerations/Sensitives:** The hot water pump distributes water to the unit ventilators and the AHUs in the building. There may be a significant number of 3-way valves that need to be converted as part of this measure. There are additional considerations which must be investigated to determine the cost effectiveness of converting from constant flow to variable flow. This depth of analysis is beyond the scope of this audit. We recommend that this be investigated further by an electrical contractor if variable frequency drive installations move forward to implementation.

## 4.5 Electric Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Electric Unitary HVAC Measures</b>		<b>7,266</b>	<b>4.5</b>	<b>0</b>	<b>\$929</b>	<b>\$34,202</b>	<b>\$1,306</b>	<b>\$32,896</b>	<b>35.4</b>	<b>7,317</b>
	Install High Efficiency Air Conditioning Units	7,266	4.5	0	\$929	\$34,202	\$1,306	\$32,896	35.4	7,317

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units at this facility are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the equipment is eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

### **Install High Efficiency Air Conditioning Units**

Replace standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling load, and the estimated annual operating hours.

**Reasons for not Recommending as a High Priority Measure:** The projected payback period for this measure based on the energy savings exceeds the expected useful life of the replacement equipment. The upgrade to high efficiency is not justified by energy savings alone.

**Considerations:** If the school district moves forward toward implementation of a comprehensive project under the ESIP, we would recommend including this measure.

## 4.6 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Gas Heating (HVAC/Process) Replacement</b>		<b>0</b>	<b>0.0</b>	<b>995</b>	<b>\$8,455</b>	<b>\$99,870</b>	<b>\$11,504</b>	<b>\$88,367</b>	<b>10.5</b>	<b>116,527</b>
ECM 10	Install High Efficiency Hot Water Boilers	0	0.0	995	\$8,455	\$99,870	\$11,504	\$88,367	10.5	116,527

### **ECM 10: Install High Efficiency Hot Water Boilers**

Replace older inefficient hot water boilers with high efficiency hot water boilers. Energy savings result from improved combustion efficiency and reduced standby losses at low loads.

The most notable efficiency improvement is condensing hydronic boilers which can achieve over 90% efficiency under the proper conditions. Condensing hydronic boilers typically operate at efficiencies between 85% and 87% (comparable to other high efficiency boilers) when the return water temperature is above 130°F. The boiler efficiency increases as the return water temperature drops below 130°F. Therefore, condensing hydronic boilers are evaluated when the return water temperature is less than 130°F during most of the operating hours.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load at this facility. In many cases installing multiple modular boilers rather than one or two large boilers will result in higher overall plant efficiency while providing additional system redundancy.

## 4.7 HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>HVAC System Improvements</b>		<b>0</b>	<b>0.0</b>	<b>12</b>	<b>\$99</b>	<b>\$220</b>	<b>\$0</b>	<b>\$220</b>	<b>2.2</b>	<b>1,363</b>
ECM 11	Install Pipe Insulation	0	0.0	12	\$99	\$220	\$0	\$220	2.2	1,363

### **ECM 11: Install Pipe Insulation**

Install insulation on heating water system piping. Distribution system losses are dependent on water system temperature, the size of the distribution system, and the level of insulation of the piping. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is exposed to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

**Affected building areas:** all exposed piping

## 4.8 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>46</b>	<b>\$388</b>	<b>\$122</b>	<b>\$0</b>	<b>\$122</b>	<b>0.3</b>	<b>5,353</b>
ECM 12	Install Low-Flow DHW Devices	0	0.0	46	\$388	\$122	\$0	\$122	0.3	5,353

### **ECM 12: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. Low flow faucet aerators are rated for 0.5 gpm. Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

**Affected building areas:** all faucets within facility

## 4.9 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Food Service &amp; Refrigeration Measures</b>		<b>4,632</b>	<b>0.5</b>	<b>0</b>	<b>\$592</b>	<b>\$6,579</b>	<b>\$0</b>	<b>\$6,579</b>	<b>11.1</b>	<b>4,664</b>
	Replace Refrigeration Equipment	3,020	0.3	0	\$386	\$6,349	\$0	\$6,349	16.5	3,041
ECM 13	Vending Machine Control	1,612	0.2	0	\$206	\$230	\$50	\$180	0.9	1,623

### **Replace Refrigeration Equipment**

Replace existing refrigerator chests with new ENERGY STAR® rated equipment. The energy savings associated with this measure come from reduced energy usage due to more efficient technology, and reduced run times.

**Reasons for not Recommending as a High Priority Measure:** The projected payback period for this measure based on the energy savings exceeds the expected useful life of the replacement equipment. The upgrade to high efficiency is not justified by energy savings alone.

**Considerations:** If the school district moves forward toward implementation of a comprehensive project under the ESIP, we would recommend including this measure.

### **ECM 13: Vending Machine Control**

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and, they power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

## 5 ENERGY EFFICIENT BEST PRACTICES

---

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR® Portfolio Manager®**



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions.<sup>4</sup> Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Weatherization**

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment.

### **Doors and Windows**

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour (ACH) can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

### **Window Treatments/Coverings**

Use high-reflectivity films or cover windows with shades or shutters to reduce solar heat gain and reduce the load on cooling and heating systems. Older, single pane windows and east or west-facing windows are especially prone to solar heat gain. In addition, use shades or shutters at night during cold weather to reduce heat loss.

### **Lighting Controls**

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly.

---

<sup>4</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

## **Motor Controls**

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Whenever possible, use automatic devices such as twist timers or occupancy sensors to turn off motors when they are not needed.

## **Motor Maintenance**

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

## **Fans to Reduce Cooling Load**

Install ceiling fans to supplement your cooling system. Thermostat settings can typically be increased by 4°F with no change in overall occupant comfort due to the wind chill effect of moving air.

## **Destratification Fans**

For areas with high ceilings, destratification fans f air balance the air temperature from floor to ceiling. They help reduce the recovery time needed to warm the space after nightly temperature setbacks and will increase occupants' the comfort level.

Areas with high ceilings require the heating system to heat a larger volume of space than that which is occupied. As the warm air rises, the warmest space is at the ceiling level, rather than floor level. Higher temperatures at the ceiling accelerate heat loss through the roof, which requires additional energy consumption by the heating equipment to compensate for this accelerated heat transfer.

## **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan, and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

## **HVAC Filter Cleaning and Replacement**

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

## **Duct Sealing**

Duct leakage in commercial buildings can account for five to twenty-five percent of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.



## **Boiler Maintenance**


Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the water side or fire side of the boiler.

## **Water Heater Maintenance**

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

## **Plug Load Controls**



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips<sup>5</sup>. Your local utility may offer incentives or rebates for this equipment.

## **Computer Power Management Software**

Many computers consume power during nights, weekends, and holidays. Screen savers are commonly confused as a power management strategy. This contributes to avoidable, excessive electrical energy consumption. There are innovative power management software packages available that are designed to deliver significant energy saving and provide ongoing tracking measurements. A central power management platform helps enforce energy savings policies as well as identify and eliminate underutilized devices

---

<sup>5</sup> For additional information refer to "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

## **Water Conservation**



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense™ ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense™ website<sup>6</sup> or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>7</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

## **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense™ products where available.

---

<sup>6</sup> <https://www.epa.gov/watersense>.

<sup>7</sup> <https://www.epa.gov/watersense/watersense-work-0>.

## 6 ON-SITE GENERATION

---

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases reduction, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

## 6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC is converted to alternating current (AC) through an inverter. The inverter is then connected to the building’s electrical distribution system.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has a **high** potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the high potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

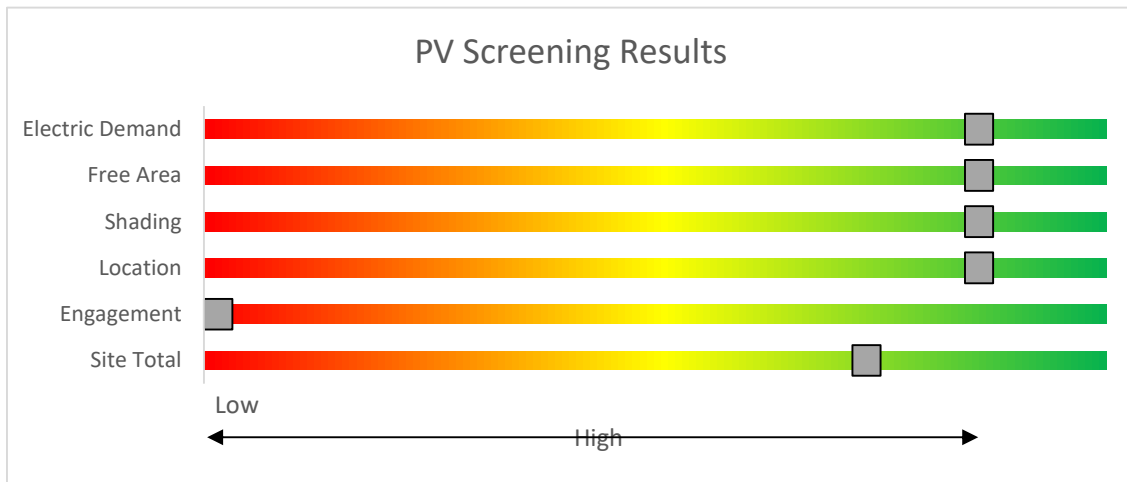


Figure 9 - Photovoltaic Screening

### Solar Renewable Energy Certificate (SREC) Registration Program (SRP)

Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SREC Registration Program (SRP) before starting construction. Once your PV system is up and running, you periodically earn credits, which can then be sold on the open market for up to 15 years.

If you are considering installing solar photovoltaics on your building, visit [www.njcleanenergy.com/srec](http://www.njcleanenergy.com/srec) for more information about the SREC Registration Program.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- **Basic Info on Solar PV in NJ:** [www.njcleanenergy.com/whysolar](http://www.njcleanenergy.com/whysolar)
- **NJ Solar Market FAQs:** [www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs](http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs)
- **Approved Solar Installers in the NJ Market:** [www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has **no** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

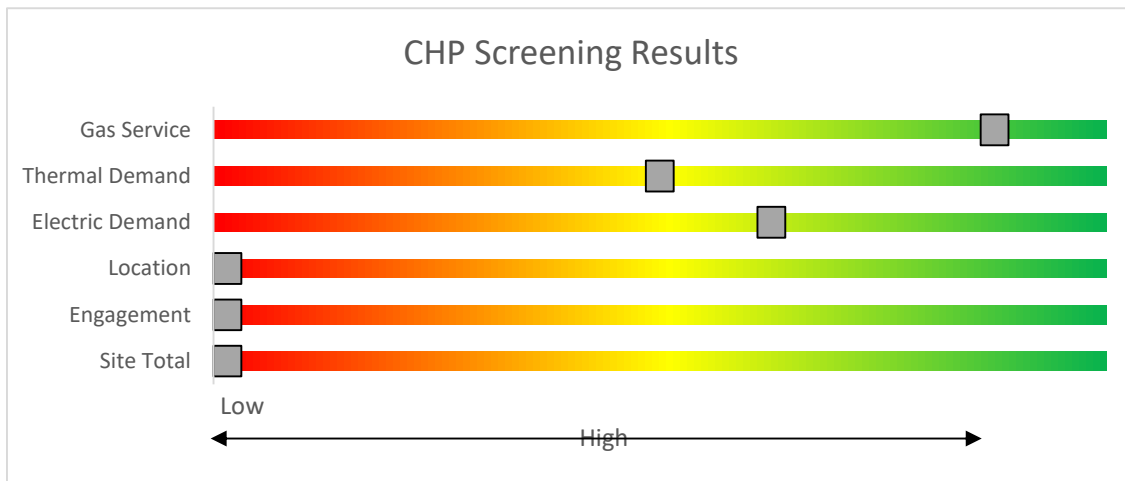


Figure 10 - Combined Heat and Power Screening

## 7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? NJ Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available in NJ Clean Energy Programs.

	<b>SmartStart</b> <i>Flexibility to install at your own pace</i>	<b>Direct Install</b> <i>Turnkey installation</i>	<b>Pay for Performance</b> <i>Whole building upgrades</i>
<b>Who should use it?</b>	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together.  Average peak demand should be below 200 kW.  Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time.  Peak demand should be over 200 kW.
<b>How does it work?</b>	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
<b>What are the Incentives?</b>	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project.  You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
<b>How do I participate?</b>	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting <a href="http://www.njcleanenergy.com">www.njcleanenergy.com</a> for program details, applications, and to contact a qualified contractor.			

## 7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficiency equipment based on market trends and new technologies.

### **Equipment with Prescriptive Incentives Currently Available:**

*Electric Chillers*  
*Electric Unitary HVAC*  
*Gas Cooling*  
*Gas Heating*  
*Gas Water Heating*  
*Ground Source Heat Pumps*  
*Lighting*

*Lighting Controls*  
*Refrigeration Doors*  
*Refrigeration Controls*  
*Refrigerator/Freezer Motors*  
*Food Service Equipment*  
*Variable Frequency Drives*

### **Incentives**

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

### **How to Participate**

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit [www.njcleanenergy.com/SSB](http://www.njcleanenergy.com/SSB) for a detailed program description, instructions for applying, and applications.

## 7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

### Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

### How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the DI website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: [www.njcleanenergy.com/DI](http://www.njcleanenergy.com/DI)



## 7.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at: [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## 7.4 SREC Registration Program

The SREC (Solar Renewable Energy Certificate) Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey SRECs. SREC's are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SREC's to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar Renewable Portfolio Standard. Purchasing SRECs can help them meet those requirements. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period fluctuates depending on supply and demand.

Information about the SRP can be found at: [www.njcleanenergy.com/srec](http://www.njcleanenergy.com/srec).

## 8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>8</sup>.

### 8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>9</sup>.

---

<sup>8</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

<sup>9</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

# APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

## Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.1	373	0	\$47	\$256	\$70	4.0
Cafeteria	8	Linear Fluorescent - T5: 4' T5 (28W) - 4L	Occupancy Sensor	S	120	1,569	3	Relamp	No	8	LED - Linear Tubes: (4) 4' T5HO (25W) Lamps	Occupancy Sensor	102	1,569	0.1	160	0	\$20	\$845	\$0	42.1
Kitchen	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.1	213	0	\$27	\$146	\$40	4.0
Stage	1	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	2,273	3	Relamp	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	2,273	0.0	22	0	\$3	\$16	\$3	4.9
Stage	3	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	3	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	85	0	\$11	\$55	\$15	3.8
Vestibules	3	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	3	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	85	0	\$11	\$55	\$15	3.8
Long Hallway	18	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,088	3, 6	Relamp	Yes	18	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	2,131	0.2	868	0	\$109	\$929	\$90	7.7
Hallway	2	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	3,088	3	Relamp	No	2	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	3,088	0.0	59	0	\$7	\$33	\$6	3.6
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	2,273	3	Relamp	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	2,273	0.0	22	0	\$3	\$16	\$3	4.9
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	2,273	3	Relamp	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	2,273	0.0	22	0	\$3	\$16	\$3	4.9
Lounge	4	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	4	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	113	0	\$14	\$73	\$20	3.8
Supply Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.0	53	0	\$7	\$37	\$10	4.0
Server Room - Locked	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.0	53	0	\$7	\$37	\$10	4.0
Classroom #16	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #15	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #14	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #13	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #12	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #11	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #10	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #9	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #8	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #7	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #6	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #5	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Classroom #4	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Classroom #3	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	441	0	\$55	\$438	\$120	5.8
Office	33	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	33	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.5	1,758	-1	\$220	\$1,205	\$330	4.0
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	2,273	3	Relamp	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	2,273	0.0	22	0	\$3	\$16	\$3	4.9
Closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	28	0	\$4	\$18	\$5	3.8
Restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	56	0	\$7	\$37	\$10	3.8
Restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	56	0	\$7	\$37	\$10	3.8
Art Classroom #1	17	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	17	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.3	625	0	\$78	\$621	\$170	5.8
Closet	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	26	0	\$3	\$33	\$6	8.2
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	26	0	\$3	\$33	\$6	8.2
Music Room #2	17	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	17	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.3	625	0	\$78	\$621	\$170	5.8
Closet	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	26	0	\$3	\$33	\$6	8.2
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	26	0	\$3	\$33	\$6	8.2
Hallway	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,088	3	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	3,088	0.0	77	0	\$10	\$37	\$10	2.8
Hallway	6	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,088	3,6	Relamp	Yes	6	LED - Linear Tubes: (2) 2' Lamps	High/Low Control	17	2,131	0.1	280	0	\$35	\$395	\$36	10.3
Hallway	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,088	3,6	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,131	0.2	737	0	\$92	\$492	\$80	4.5
Closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	28	0	\$4	\$18	\$5	3.8
Restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	56	0	\$7	\$37	\$10	3.8
Restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,273	3	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	2,273	0.0	56	0	\$7	\$37	\$10	3.8
Machine Room #31	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	221	0	\$28	\$219	\$60	5.8
Main Office	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,088	3,4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,131	0.1	552	0	\$69	\$489	\$95	5.7
Office	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3,4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.1	271	0	\$34	\$262	\$60	6.0
Closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.0	53	0	\$7	\$37	\$10	4.0
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	2,273	3	Relamp	No	1	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	2,273	0.0	22	0	\$3	\$16	\$3	4.9
Nurse's Office	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.0	160	0	\$20	\$110	\$30	4.0

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restroom	3	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	2,273	3	Relamp	No	3	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	2,273	0.0	65	0	\$8	\$49	\$9	4.9
Child's Study Room #32	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.1	271	0	\$34	\$262	\$60	6.0
Classroom #17	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.3	662	0	\$83	\$657	\$180	5.8
Classroom #18	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #19	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #20	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #21	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #22	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #23	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #24	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #25	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Classroom #26	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	551	0	\$69	\$548	\$150	5.8
Hallway	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,088	3, 6	Relamp	Yes	15	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,131	0.3	1,381	0	\$173	\$948	\$150	4.6
Classroom Cubbies	6	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,569	0.1	206	0	\$26	\$465	\$71	15.3
Classroom Closets	6	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	6	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	155	0	\$19	\$195	\$36	8.2
Classroom Restrooms	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	52	0	\$6	\$65	\$12	8.2
Hallway "New Wing"	11	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,088	3, 5	Relamp	Yes	11	LED - Linear Tubes: (2) 4' Lamps	Daylight Dimming	29	1,853	0.2	1,076	0	\$135	\$652	\$360	2.2
Classroom #33	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6
Classroom #33	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6
Classroom #34	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6
Classroom #34	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6
Classroom #35	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6
Classroom #35	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6
Classroom #36	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6
Classroom #36	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	O	93	1,569	2	Relamp & Reballast	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.2	428	0	\$53	\$413	\$60	6.6

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Electric Room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.0	107	0	\$13	\$73	\$20	4.0
Lobby	13	Compact Fluorescent: Plug in Lamps	Wall Switch	S	14	3,088	3	Relamp	No	13	LED Screw-In Lamps: Plug in Lamps	Wall Switch	10	3,088	0.0	114	0	\$14	\$448	\$0	31.4
Lobby	4	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,088	3	Relamp	No	4	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	3,088	0.0	153	0	\$19	\$73	\$20	2.8
Hallway	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,088	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,088	0.0	145	0	\$18	\$73	\$20	2.9
Hallway	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,088	3,6	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,131	0.3	1,105	0	\$138	\$838	\$120	5.2
Gym	18	Linear Fluorescent - T5HO: 4' T5HO (54W) - 4L	Wall Switch	S	234	3,088	3,4	Relamp	Yes	18	LED - Linear Tubes: (4) 4' T5HO (25W) Lamps	Occupancy Sensor	102	2,131	1.5	6,458	-2	\$808	\$5,861	\$630	6.5
Stage	10	Incandescent: Cylindrical Fixtures	Wall Switch	S	200	2,273	3	Relamp	No	10	LED Screw-In Lamps: Plug in Lamps	Wall Switch	30	2,273	0.9	2,744	-1	\$343	\$172	\$10	0.5
Stage	9	Halogen Incandescent: Spot Light Fixtures	Wall Switch	S	150	2,273	3	Relamp	No	9	LED Screw-In Lamps: Plug in Lamps	Wall Switch	23	2,273	0.6	1,852	-1	\$232	\$155	\$9	0.6
Stairwell	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,273	3	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,273	0.1	320	0	\$40	\$219	\$60	4.0
Gym Storage	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	O	93	2,273	3	Relamp	No	8	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,273	0.2	639	0	\$80	\$438	\$120	4.0
Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,273	3	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,273	0.0	80	0	\$10	\$55	\$15	4.0
Closet/DHW Room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.0	107	0	\$13	\$73	\$20	4.0
Hallway	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,273	0.0	53	0	\$7	\$37	\$10	4.0
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	26	0	\$3	\$33	\$6	8.2
Restroom	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3,4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.1	203	0	\$25	\$380	\$65	12.4
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,273	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,273	0.0	26	0	\$3	\$33	\$6	8.2
Restroom	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,273	3,4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.1	203	0	\$25	\$380	\$65	12.4
Classroom #37	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Classroom #37	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,569	3	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,569	0.1	221	0	\$28	\$219	\$60	5.8
Teacher's Room #38	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,273	3,4	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	305	0	\$38	\$434	\$80	9.3
Classroom #39	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Classroom #39	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Classroom #40	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Classroom #40	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Computer Room #41	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.3	662	0	\$83	\$657	\$180	5.8

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Library/Media Center Room #43	32	Compact Fluorescent: Biax Lamps	Wall Switch	O	120	2,273	1, 4	Fixture Replacement	Yes	32	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	50	1,569	1.4	4,416	-1	\$552	\$6,942	\$550	11.6
Library/Media Center Room #43	18	Compact Fluorescent: High Output Screw in Lamps	Wall Switch	O	32	2,273	3, 4	Relamp	Yes	18	LED Screw-In Lamps: Screw in Lamps	Occupancy Sensor	22	1,569	0.1	481	0	\$60	\$850	\$70	13.0
Storage	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,273	3	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,273	0.1	320	0	\$40	\$219	\$60	4.0
Classroom #42	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Classroom #42	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Classroom #44	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Classroom #44	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,569	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,569	0.1	331	0	\$41	\$329	\$90	5.8
Walkway	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,088	3, 5	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Daylight Dimming	29	1,853	0.1	293	0	\$37	\$360	\$165	5.3
Transitional Spaces	20	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	20	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Exterior	18	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Timeclock	S	21	4,380		None	No	18	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Timeclock	21	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior	2	High-Pressure Sodium: (1) 70W Lamp	Timeclock	S	95	4,380	1	Fixture Replacement	No	2	LED - Fixtures: Other	Timeclock	29	4,380	0.1	578	0	\$74	\$397	\$10	5.2
Exterior	8	High-Pressure Sodium: (1) 70W Lamp	Timeclock	S	95	4,380	1	Fixture Replacement	No	8	LED - Fixtures: Other	Timeclock	29	4,380	0.3	2,313	0	\$296	\$1,590	\$40	5.2
Exterior	2	High-Pressure Sodium: (1) 50W Lamp	Timeclock	S	66	4,380	1	Fixture Replacement	No	2	LED - Fixtures: Other	Timeclock	20	4,380	0.0	403	0	\$51	\$397	\$10	7.5
Exterior	4	High-Pressure Sodium: (1) 250W Lamp	Timeclock	S	295	4,380	1	Fixture Replacement	No	4	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Timeclock	89	4,380	0.4	3,609	0	\$461	\$3,864	\$400	7.5
Exterior	5	High-Pressure Sodium: (1) 150W Lamp	Timeclock	S	188	4,380	1	Fixture Replacement	No	5	LED - Fixtures: Other	Timeclock	56	4,380	0.3	2,891	0	\$369	\$994	\$25	2.6
Exterior	6	Compact Fluorescent: Plug in Lamps	Timeclock	S	14	4,380	3	Relamp	No	6	LED Screw-In Lamps: Plug in Lamps	Timeclock	10	4,380	0.0	105	0	\$13	\$207	\$0	15.4



### Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	HWP-4	1	Heating Hot Water Pump	7.5	88.5%	No	B	1,696	7, 9	Yes	91.0%	Yes	1	0.8	4,218	0	\$539	\$4,738	\$0	8.8
Boiler Room	HWP-5	1	Heating Hot Water Pump	7.5	88.5%	No	B	1,696	7, 9	Yes	91.0%	Yes	1	0.8	4,218	0	\$539	\$4,738	\$0	8.8
Boiler Room	Boiler Circ Pumps	3	Boiler Feed Water Pump	0.8	74.0%	No	W	1,696		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	HWP-2&3	2	Heating Hot Water Pump	0.8	74.0%	No	W	1,696		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	HWP-1	1	Heating Hot Water Pump	1.0	85.5%	Yes	W	1,696		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	DHW Circulators	2	Water Supply Pump	0.8	74.0%	No	W	2,745		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	Boiler Exhaust	3	Exhaust Fan	0.3	74.0%	No	W	1,696		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Cafeteria	Exhaust	2	Exhaust Fan	0.3	74.0%	No	W	2,745		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
AHU	Gym	2	Supply Fan	7.5	88.5%	No	B	3,391	7, 8	Yes	91.0%	Yes	2	3.0	11,514	0	\$1,471	\$9,476	\$1,200	5.6
AHU	Gym	2	Exhaust Fan	3.0	87.5%	No	B	2,745	7, 8	Yes	89.5%	Yes	2	1.2	3,722	0	\$476	\$7,768	\$480	15.3
AHU	Library/Media Center	2	Supply Fan	7.5	88.5%	No	B	3,391	7, 8	Yes	91.0%	Yes	2	3.0	11,514	0	\$1,471	\$9,476	\$1,200	5.6
AHU	Library/Media Center	2	Exhaust Fan	3.0	87.5%	No	B	2,745	7, 8	Yes	89.5%	Yes	2	1.2	3,722	0	\$476	\$7,768	\$480	15.3
Unit Ventilators	Old Unit Ventilators	32	Supply Fan	0.2	74.0%	No	B	2,745		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Unit Ventilators	New Unit Ventilators	12	Supply Fan	0.3	74.0%	No	W	2,745		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
General Building Exhaust	General Building Exhaust	44	Exhaust Fan	0.3	87.5%	No	B	2,745		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0

### Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions					Proposed Conditions								Energy Impact & Financial Analysis						
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Classrooms	Classrooms	2	Window AC	2.00		B	NR	Yes	2	Window AC	2.00		12.00		0.7	1,221	0	\$156	\$4,355	\$0	27.9
Server Room	Server Room	1	Window AC	2.00		B	NR	Yes	1	Window AC	2.00		12.00		0.4	671	0	\$86	\$2,178	\$0	25.4
Machine Room	Machine Room	1	Window AC	1.00		B	NR	Yes	1	Window AC	1.00		12.00		0.2	336	0	\$43	\$1,089	\$0	25.4
Main Office	Main Office	2	Split-System AC	0.75		B	NR	Yes	2	Split-System AC	0.75		14.00		0.4	582	0	\$74	\$2,244	\$138	28.3
Child's Study	Child's Study	1	Window AC	0.83		W	NR	Yes	1	Window AC	0.83		12.00		0.1	83	0	\$11	\$907	\$0	86.0
Classrooms	Classrooms	2	Window AC	2.00		W	NR	Yes	2	Window AC	2.00		12.00		0.3	466	0	\$60	\$4,355	\$0	73.2
Classrooms	Classrooms	1	Window AC	0.42		B	NR	Yes	1	Window AC	0.42		12.00		0.1	127	0	\$16	\$454	\$0	27.9
Office	Office	1	Split-System AC	1.00		N		No						0.0	0	0	\$0	\$0	\$0	0.0	
Exterior	Outdoor Condensing Unit for Split AC System	1	Split-System AC	10.00		B	NR	Yes	1	Split-System AC	10.00		11.50		1.4	2,363	0	\$302	\$11,638	\$730	36.1
Exterior	Outdoor Condensing Unit for Split AC System	1	Split-System AC	6.00		B	NR	Yes	1	Split-System AC	6.00		11.50		0.9	1,418	0	\$181	\$6,983	\$438	36.1

### Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions								Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	Hydronic Heating	1	Non-Condensing Hot Water Boiler	#####	B	10	Yes	1	Condensing Hot Water Boiler	#####	91.00%	Et	0.0	0	498	\$4,227	\$33,290	\$3,835	7.0
Boiler Room	Hydronic Heating	1	Non-Condensing Hot Water Boiler	#####	B	10	Yes	1	Condensing Hot Water Boiler	#####	91.00%	Et	0.0	0	332	\$2,818	\$33,290	\$3,835	10.5
Boiler Room	Hydronic Heating	1	Non-Condensing Hot Water Boiler	#####	B	10	Yes	1	Condensing Hot Water Boiler	#####	91.00%	Et	0.0	0	166	\$1,409	\$33,290	\$3,835	20.9

**Pipe Insulation Recommendations**

		Recommendation Inputs			Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Affected	ECM #	Length of Uninsulated Pipe (ft)	Pipe Diameter (in)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	Domestic Hot Water	11	25	1.00	0.0	0	12	\$99	\$220	\$0	2.2

### DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	Domestic Hot Water	1	Storage Tank Water Heater (> 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Closet	Domestic Hot Water - New Wing	1	Storage Tank Water Heater (≤ 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0

**Low-Flow Device Recommendations**

Location	Recommendation Inputs					Energy Impact & Financial Analysis						
	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restrooms	12	8	Faucet Aerator (Lavatory)	2.00	0.50	0.0	0	20	\$171	\$57	\$0	0.3
Restrooms	12	9	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	26	\$218	\$65	\$0	0.3

**Commercial Refrigerator/Freezer Inventory & Recommendations**

Location	Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Refrigerator/ Freezer Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Cafeteria	3	Refrigerator Chest	No	NR	Yes	0.3	3,020	0	\$386	\$6,349	\$0	16.5
Kitchen	1	Stand-Up Freezer, Solid Door (16 - 30 cu. ft.)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Stand-Up Refrigerator, Glass Door (16 - 30 cu. ft.)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Stand-Up Refrigerator, Glass Door (≤15 cu. ft.)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

### Cooking Equipment Inventory & Recommendations

Location	Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Equipment Type	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Gas Combination Oven/Steam Cooker (<15 Pans)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Gas Convection Oven (Half Size)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Insulated Food Holding Cabinet (1/2 Size)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0



### Plug Load Inventory


Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?
Emma L. Arleth School	97	Desktop Computer	120.0	
Emma L. Arleth School	2	Laptop Cart	2,160.0	
Emma L. Arleth School	53	Fan	100.0	
Emma L. Arleth School	51	TV	150.0	
Emma L. Arleth School	46	Smart Board / Projector	300.0	
Emma L. Arleth School	7	Small Office Printers	50.0	
Emma L. Arleth School	2	Large Xerox- Type Printers	515.0	
Emma L. Arleth School	2	Coffee Maker	400.0	
Emma L. Arleth School	10	Microwave	1,100.0	
Emma L. Arleth School	4	Residential Refrigerator	690.0	
Emma L. Arleth School	5	Mini Fridge	260.0	
Emma L. Arleth School	2	Water Dispenser	300.0	
Emma L. Arleth School	6	Large Floor Fans	185.0	
Emma L. Arleth School	1	Kiln	11,000.0	
Emma L. Arleth School	44	Speakers	50.0	
Emma L. Arleth School	8	Large Speakers	400.0	
Emma L. Arleth School	1	Misc. Sound Equipment	3,500.0	
Emma L. Arleth School	1	Misc. IT Equipment	4,500.0	


**Vending Machine Inventory & Recommendations**

Location	Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Lounge	1	Refrigerated	13	Yes	0.2	1,612	0	\$206	\$230	\$50	0.9

## APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.


ENERGY STAR® Statement of Energy Performance



**ENERGY STAR®  
Score<sup>1</sup>**

**Emma L Arleth School**

**Primary Property Type:** K-12 School  
**Gross Floor Area (ft<sup>2</sup>):** 73,426  
**Built:** 1959

**For Year Ending:** February 28, 2018  
**Date Generated:** October 02, 2018

<sup>1</sup> The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
<b>Property Address</b> Emma L Arleth School 3198 Washington Rd Parlin, New Jersey 08859	<b>Property Owner</b> Sayreville Board of Education 3198 Washington Rd Sayreville, NJ 08871 ( ) -	<b>Primary Contact</b> Erin Hill 3198 Washington Rd Sayreville, NJ 08871 732-525-5204 Erin.Hill@sayrevillek12.net
<b>Property ID:</b> 6563191		

Energy Consumption and Energy Use Intensity (EUI)				
<b>Site EUI</b> 72.5 kBtu/ft <sup>2</sup>	<b>Annual Energy by Fuel</b>		<b>National Median Comparison</b>	
	Electric - Grid (kBtu)	1,124,507 (21%)	National Median Site EUI (kBtu/ft <sup>2</sup> )	68.6
	Natural Gas (kBtu)	4,202,039 (79%)	National Median Source EUI (kBtu/ft <sup>2</sup> )	97.4
			% Diff from National Median Source EUI	6%
<b>Source EUI</b> 103 kBtu/ft <sup>2</sup>			<b>Annual Emissions</b>	
			Greenhouse Gas Emissions (Metric Tons CO <sub>2</sub> e/year)	337

**Signature & Stamp of Verifying Professional**

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**Licensed Professional**

\_\_\_\_\_

( ) -

\_\_\_\_\_

Professional Engineer Stamp  
(if applicable)

## APPENDIX C: GLOSSARY

TERM	DEFINITION
<b>Blended Rate</b>	Used to calculate financial savings. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
<b>BTU</b>	A British thermal unit is the amount of heat required to increase the temperature of one pound water by one-degree Fahrenheit. Commonly used to measure natural gas consumption.
<b>Demand Response</b>	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
<b>Energy Efficiency</b>	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing energy management systems.
<b>Generation</b>	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
<b>HVAC</b>	Heating, ventilation, and air conditioning.
<b>kW</b>	Kilowatt. Equal to 1,000 Watts.
<b>Load</b>	The total amount of power used by a building system at any given time.
<b>Measure</b>	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
<b>MMBtu</b>	One million British thermal units.
<b>psig</b>	Pounds per square inch.
<b>Plug Load</b>	Refers to the amount of energy used in a space by products that are powered by means of an ordinary AC plug.
<b>Simple Payback</b>	The amount of time needed to recoup the funds expended in an investment, or to reach the break-even point.
<b>Temperature Setpoint</b>	The temperature at which a temperature regulating device (thermostat, for example) has been set.
<b>Turnkey</b>	Provision of a complete product or service that is ready for immediate use
<b>Watt (W)</b>	Unit of power commonly used to measure electricity use.