



Local Government Energy Audit Report

Bodman Park and Maintenance, McMahan Park, Nick Trezza Field and MYAA Field

March 1, 2019

Prepared for:

Middletown Township
Red Bank and Middletown, NJ 07701

Prepared by:

TRC Energy Services
900 Route 9 North
Woodbridge, NJ 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC Energy Services (TRC) reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBP) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. We encourage the owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBP do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

The New Jersey Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBP reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2019 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents

1	Executive Summary	5
1.1	Planning Your Project	8
	Pick Your Installation Approach	8
	More Options from Around the State	10
2	Existing Conditions	12
2.1	Site Overview.....	12
2.2	Building Occupancy	12
2.3	Building Envelope	13
2.4	Lighting Systems	14
2.5	Air Handling Systems	16
	Air Conditioners	16
2.6	Domestic Hot Water	17
2.7	Plug Load & Vending Machines	18
3	Energy Use and Costs	19
3.1	Electricity	21
3.2	Natural Gas	22
3.3	Benchmarking.....	23
	Tracking Your Energy Performance	24
4	Energy Conservation Measures	25
4.1	Lighting	28
	ECM 1: Install LED Fixtures	28
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers	28
	ECM 3: Retrofit Fixtures with LED Lamps.....	29
4.2	Lighting Controls.....	29
	ECM 4: Install Occupancy Sensor Lighting Controls	29
4.3	Food Service & Refrigeration Measures.....	30
	ECM 5: Vending Machine Control	30
5	Energy Efficient Best Practices	31
	Energy Tracking with ENERGY STAR® Portfolio Manager®	31
	Weatherization.....	31
	Doors and Windows	31
	Lighting Maintenance.....	31
	Lighting Controls	32
	Fans to Reduce Cooling Load	32
	AC System Evaporator/Condenser Coil Cleaning	32
	HVAC Filter Cleaning and Replacement	32
	Duct Sealing.....	32
	Furnace Maintenance	32
	Water Heater Maintenance	33

Water Conservation	33
Procurement Strategies	34
6 On-site Generation	35
6.1 Solar Photovoltaic	36
6.2 Combined Heat and Power	37
7 Project Funding and Incentives	38
7.1 SmartStart	39
7.2 Direct Install	40
7.3 Energy Savings Improvement Program	41
8 Energy Purchasing and Procurement Strategies	42
8.1 Retail Electric Supply Options.....	42
8.2 Retail Natural Gas Supply Options	42
Appendix A: Equipment Inventory & Recommendations	1
Appendix B: ENERGY STAR® Statement of Energy Performance	1
Appendix C: Glossary	4

1 EXECUTIVE SUMMARY


The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Bodman Park and Maintenance, McMahan Park, Nick Trezza Field and MYAA Field. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC Energy Services (TRC) conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

Costs: \$33,673

Annual Utilities Electricity: 176,975 kWh

Natural Gas: 3,430 Therms

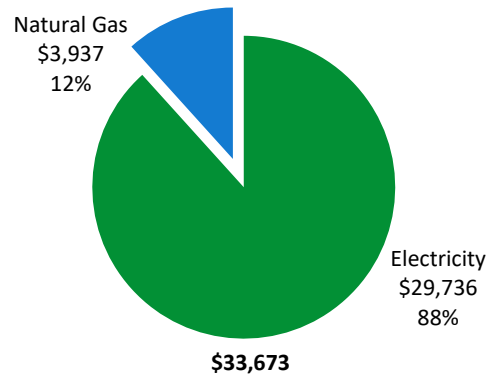

ENERGY STAR®
Benchmarking Score

N/A
(1-100 scale)

A standard energy use benchmark is not available for these facility types. This report contains suggestions about how to improve building performance and reduce energy costs.

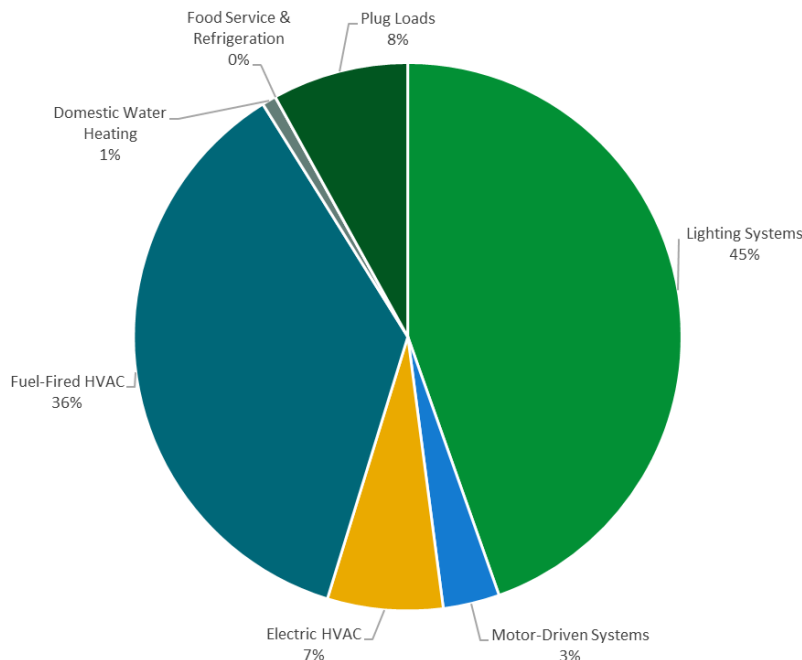


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$125,571
Potential Rebates & Incentives ¹	\$14,188
Annual Cost Savings	\$14,932
Annual Energy Savings	Electricity: 89,027 kWh
Greenhouse Gas Emission Savings	45 Tons
Simple Payback	7.5 Years
Site Energy Savings (all utilities)	32%

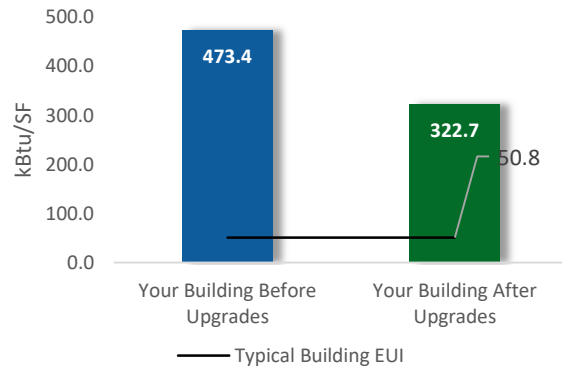

Scenario 2: Cost Effective Package²

Installation Cost	\$125,571
Potential Rebates & Incentives	\$14,188
Annual Cost Savings	\$14,932
Annual Energy Savings	Electricity: 89,027 kWh
Greenhouse Gas Emission Savings	45 Tons
Simple Payback	7.5 Years
Site Energy Savings (all utilities)	32%

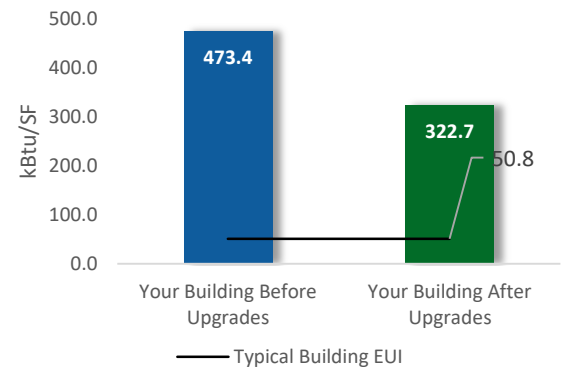

On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		81,205	63.5	-2	\$13,622	\$204,323	\$120,601	\$13,733	\$106,868	7.8	81,540
ECM 1	Install LED Fixtures	69,473	57.3	0	\$11,673	\$175,097	\$111,668	\$12,000	\$99,668	8.5	69,959
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	5,961	3.4	-1	\$987	\$14,809	\$4,794	\$760	\$4,034	4.1	5,857
ECM 3	Retrofit Fixtures with LED Lamps	5,771	2.8	-1	\$961	\$14,417	\$4,139	\$973	\$3,166	3.3	5,724
Lighting Control Measures		1,375	0.9	0	\$228	\$1,821	\$4,050	\$455	\$3,595	15.8	1,350
ECM 4	Install Occupancy Sensor Lighting Controls	1,375	0.9	0	\$228	\$1,821	\$4,050	\$455	\$3,595	15.8	1,350
Food Service & Refrigeration Measures		6,447	0.7	0	\$1,083	\$5,417	\$920	\$0	\$920	0.8	6,492
ECM 5	Vending Machine Control	6,447	0.7	0	\$1,083	\$5,417	\$920	\$0	\$920	0.8	6,492
TOTALS		89,027	65.1	-2	\$14,932	\$211,560	\$125,571	\$14,188	\$111,383	7.5	89,382

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures	x	x	
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	x	x	
ECM 3	Retrofit Fixtures with LED Lamps	x	x	
ECM 4	Install Occupancy Sensor Lighting Controls	x	x	
ECM 5	Vending Machine Control		x	

Figure 3 – Funding Options



New Jersey Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your energy reduction plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.

Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce their electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for Bodman Park and Maintenance, McMahan Park, Nick Trezza Field and MYAA Field. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey’s Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On July 11, 2018, TRC performed an energy audit at Bodman Park and Maintenance, McMahan Park, Nick Trezza Field and MYAA Field located in Red Bank and Middletown, NJ. TRC met with Anthony Mercantante to review the facility operations and help focus our investigation on specific energy-using systems.

Bodman Park and Maintenance, McMahan Park, Nick Trezza Field and MYAA Field are multi-use facilities consisting of recreational parks as well as activities, concessions and maintenance buildings. The recreational parks include baseball and football fields as well as tennis and basketball courts. Lighting for the courts and fields is provided by metal halide (MH) fixtures.

2.2 Building Occupancy

The facilities are used year-round. The use of the parks and activities are dependent on the season. The summer has the most use in the year.

Building Name	Weekday/Weekend	Operating Schedule
Bodman Park and Maintenance, McMahan Park, Nick Trezza Field and MYAA Field	Weekday	8:00 AM - 10:00 PM
	Weekend	8:00 AM - 10:00 PM

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

There are maintenance and activities (MYAA club) buildings at Bodman Park and a concession building at McMahon Park.

The building envelopes at Bodman Park are a mix of corrugated steel walls and concrete block walls, and the roof sections are flat or pitched. The flat roof sections have an asphalt membrane covering and the pitched sections have asphalt shingles. At McMahon Park, the building walls are concrete block with a textured stone facade. The roof is pitched with asphalt shingles.

Most of the windows are double glazed. Exterior doors have steel frames and are in fair condition.



Bodman Park Maintenance Building



Bodman Park MYAA Building



McMahon Park Concessions Building



Nick Trezza Field Cottages

2.4 Lighting Systems

The primary interior lighting systems use 32-Watt linear fluorescent T8 lamps. There are also several 40-Watt T12 fixtures. Additionally, there are some compact fluorescent lamps (CFL), incandescent and LED general purpose lamps. Typically, T8 fluorescent lamps use electronic ballasts and T12 fluorescent lamps use magnetic ballasts. The majority of the interior lighting fixtures are controlled by wall switches.



Nick Trezza Field Cottages – Equipment Room



Bodman Park Maintenance Shop



McMahon Park Building



Bodman Park MYAA

The athletic field and courts are illuminated with pole mounted lights with high intensity discharge (HID) lamps and are manually controlled. There are also CFL and LED lights mounted on the walls of various buildings at Nick Trezza and Bodman Park.



McMahon Park MH Fixtures



Nick Trezza Field MH Fixtures

2.5 Air Handling Systems

Air Conditioners

The Bodman Park Maintenance offices have a few Frigidaire window air conditioning (AC) units in the maintenance shops and an Arcoaire 3-ton split-system AC serving the workshop offices. The split-system AC has an estimated efficiency of 14 EER. The two window ACs have estimated efficiencies of 10 EER. The units appear to be in fair condition and within their effective useful life.

There are two mini-split heat pump (HP) units (2 and 3-ton cooling capacity; 24 and 36 MBh heating capacity) serving the MYAA offices at Bodman Park.

The two Nick Trezza Field cottages have a total of three 3-ton split-system AC serving the spaces. There is a kitchen/concessions space as well as meeting rooms and equipment storage spaces in the cottages. The split-system AC has an estimated efficiency of 14 EER. There is also one window AC serving one of the rooms in a cottage. The window ACs has an estimated efficiency of 10 EER. The units appear to be in fair condition within their effective useful life.

There are two unit heaters (UH) used to heat the shop areas in the Bodman Park Maintenance building. There is also a 71 MBh natural gas furnace in the McMahon Park concession building and another integrated 50 MBh natural gas furnace on the split system AC serving the workshop offices.



Bodman Park MYAA Building – Mini-Split HP



Bodman Park Maintenance Shop UH



Nick Trezza Field Cottage - Split System AC



McMahon Park Bldg– NG Gas Furnace

2.6 Domestic Hot Water

Hot water for the Bodman Park buildings and the Nick Trezza Field cottages are electric storage water heaters. There is one natural gas-fired storage water heater serving the concession kitchen in the Nick Trezza Field cottages. The storage capacities for the water heaters range from 20-40 gallons. The electric water heaters have an input capacities ranging from 2-4.5 kW, and the gas water heater has an input capacity of 40 Mbh.



Nick Trezza Bldg.- Water Heater



McMahon Park – Water Heater


2.7 Plug Load & Vending Machines

The utility bill analysis indicates that plug loads consume approximately 8% of total building energy use. This is higher than a typical building although the buildings where the plug loads are used are not typical. The buildings at McMahon Park and Nick Trezza are concessions/kitchens which have high energy and demand intensity per floor area (square footage). There are several electric griddles, appliances, freezers and refrigerators as well as office equipment included in the plug-loads.

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	176,975 kWh	\$29,736
Natural Gas	3,430 Therms	\$3,937
Total		\$33,673

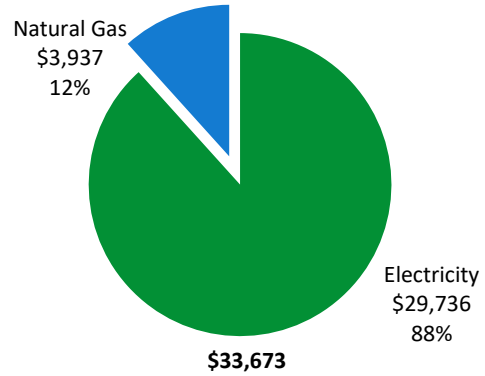

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


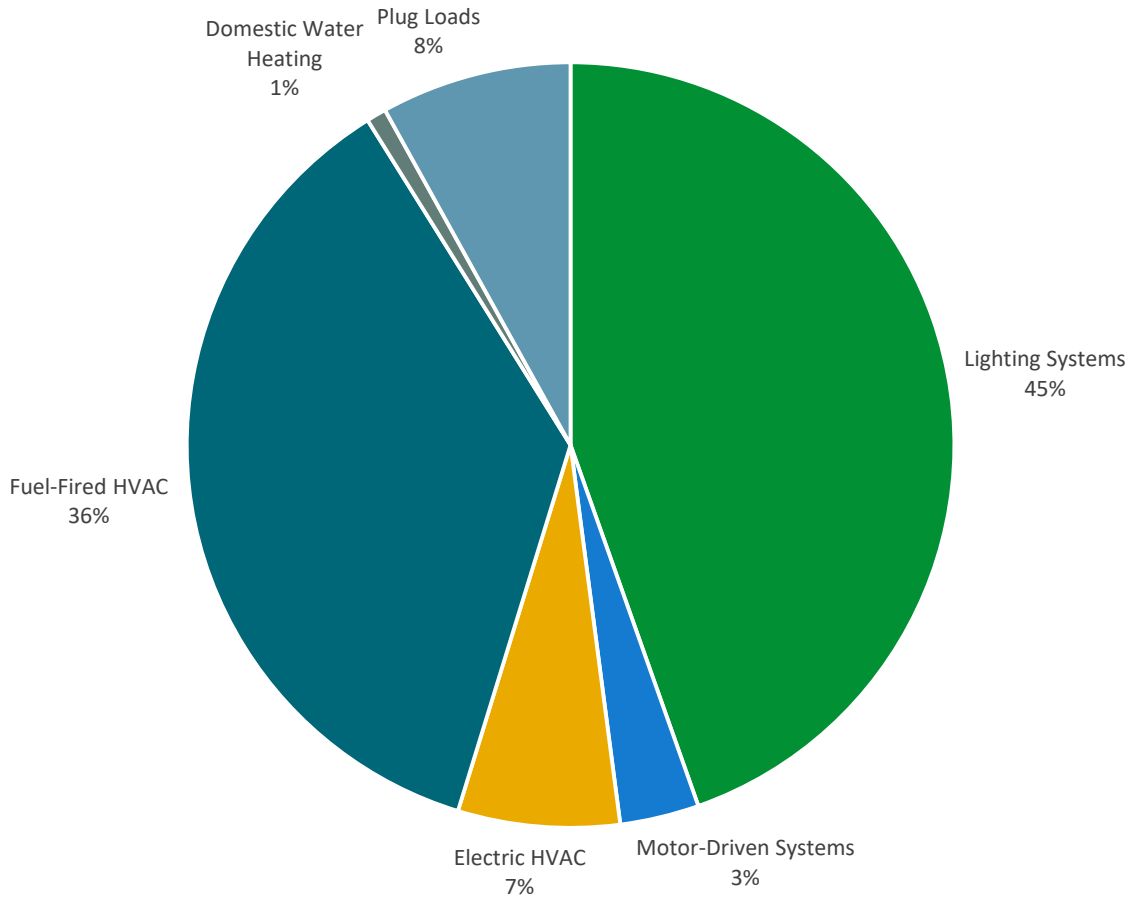


Figure 5 - Energy Balance

3.1 Electricity

JCP&L delivers electricity under rate class General Service Secondary. The usage and demand are combined for all the facilities in this report.

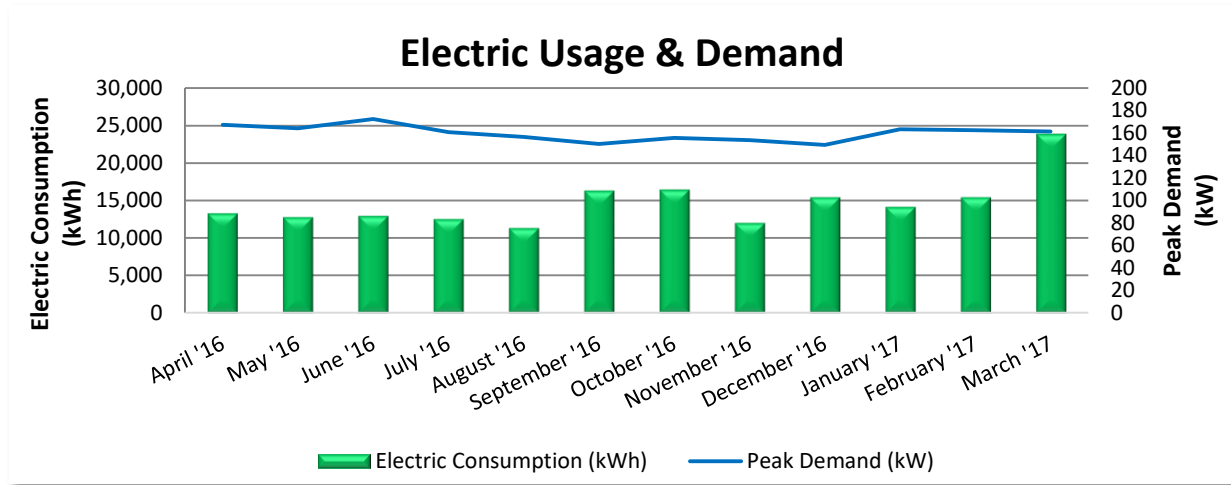


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
5/4/16	27	13,353	168		\$2,223
6/3/16	30	12,822	164		\$2,193
7/7/16	34	12,975	172		\$3,190
8/4/16	28	12,573	161		\$2,364
9/6/16	33	11,360	157		\$1,941
10/5/16	29	16,356	150		\$2,480
11/3/16	29	16,471	156		\$2,508
12/7/16	34	12,033	154		\$2,058
1/9/17	33	15,475	150		\$2,296
2/7/17	29	14,203	163		\$2,374
3/8/17	29	15,446	163		\$2,804
4/7/17	30	23,908	161		\$3,304
Totals	365	176,975	172	\$0	\$29,736
Annual	365	176,975	172	\$0	\$29,736

Notes:

- Peak demand of 172 kW occurred in June 2016.
- The average electric cost over the past 12 months was \$0.168/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- The equipment survey did not account for the overall electrical load as reflected in the metered data. However, TRC’s analysis assumes that the field lighting is never operated during the peak period. Field lighting is a major component of the overall load. If the field lighting were ever operated during the peak period, it would contribute to the peak power usage as reflected at the meter, resulting in unnecessary demand charges. We recommend an operational review of field lighting practices.

3.2 Natural Gas

NJ Natural Gas delivers natural gas under rate class Basic Gas Service (BGS), with natural gas supply. The natural gas usage and costs are combined for all the facilities in this report.

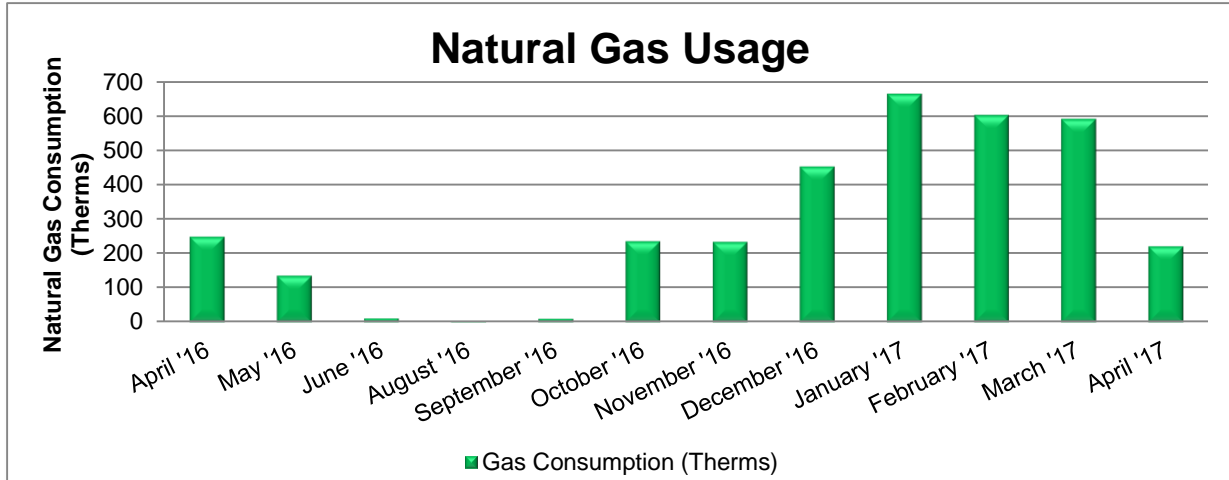

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
4/28/16	27	249	\$293
5/27/16	29	136	\$194
6/29/16	33	12	\$85
8/26/16	28	3	\$83
9/26/16	31	11	\$84
10/26/16	30	236	\$268
11/29/16	34	234	\$271
12/28/16	28	453	\$452
1/27/17	30	663	\$699
2/27/17	31	602	\$570
3/30/17	30	591	\$619
5/1/17	32	221	\$297
Totals	363	3,411	\$3,915
Annual	365	3,430	\$3,937

Notes:

- The average gas cost for the past 12 months is \$1.148/therm, which is the blended rate used throughout the analysis.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency’s (EPA) Portfolio Manager® software. Benchmarking compares your building’s energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building’s energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building’s energy performance. It assesses the building’s physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score	N/A
---------------------------	------------

Due to its unique characteristics, these building types are not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

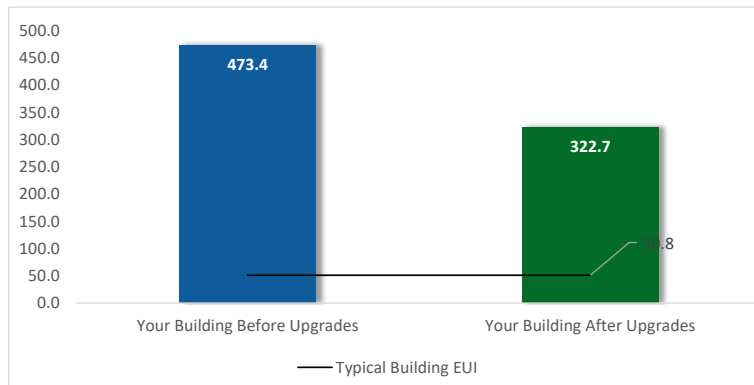


Figure 6 - Energy Use Intensity Comparison

Energy use intensity (EUI) measures energy consumption per square foot is the standard metric for comparing buildings’ energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause as building to vary from the “typical” energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building’s energy use and the benchmarking score.

Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website.³

³ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

Appendix A: Equipment Inventory & Recommendations provides a detailed list of the locations and recommended upgrades for each energy conservation measure.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		81,205	63.5	-2	\$13,622	\$204,323	\$120,601	\$13,733	\$106,868	7.8	81,540
ECM 1	Install LED Fixtures	69,473	57.3	0	\$11,673	\$175,097	\$111,668	\$12,000	\$99,668	8.5	69,959
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	5,961	3.4	-1	\$987	\$14,809	\$4,794	\$760	\$4,034	4.1	5,857
ECM 3	Retrofit Fixtures with LED Lamps	5,771	2.8	-1	\$961	\$14,417	\$4,139	\$973	\$3,166	3.3	5,724
Lighting Control Measures		1,375	0.9	0	\$228	\$1,821	\$4,050	\$455	\$3,595	15.8	1,350
ECM 4	Install Occupancy Sensor Lighting Controls	1,375	0.9	0	\$228	\$1,821	\$4,050	\$455	\$3,595	15.8	1,350
Food Service & Refrigeration Measures		6,447	0.7	0	\$1,083	\$5,417	\$920	\$0	\$920	0.8	6,492
ECM 5	Vending Machine Control	6,447	0.7	0	\$1,083	\$5,417	\$920	\$0	\$920	0.8	6,492
TOTALS		89,027	65.1	-2	\$14,932	\$211,560	\$125,571	\$14,188	\$111,383	7.5	89,382

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		81,205	63.5	-2	\$13,622	\$120,601	\$13,733	\$106,868	7.8	81,540
ECM 1	Install LED Fixtures	69,473	57.3	0	\$11,673	\$111,668	\$12,000	\$99,668	8.5	69,959
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	5,961	3.4	-1	\$987	\$4,794	\$760	\$4,034	4.1	5,857
ECM 3	Retrofit Fixtures with LED Lamps	5,771	2.8	-1	\$961	\$4,139	\$973	\$3,166	3.3	5,724
Lighting Control Measures		1,375	0.9	0	\$228	\$4,050	\$455	\$3,595	15.8	1,350
ECM 4	Install Occupancy Sensor Lighting Controls	1,375	0.9	0	\$228	\$4,050	\$455	\$3,595	15.8	1,350
Food Service & Refrigeration Measures		6,447	0.7	0	\$1,083	\$920	\$0	\$920	0.8	6,492
ECM 5	Vending Machine Control	6,447	0.7	0	\$1,083	\$920	\$0	\$920	0.8	6,492
TOTALS		89,027	65.1	-2	\$14,932	\$125,571	\$14,188	\$111,383	7.5	89,382

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		81,205	63.5	-2	\$13,622	\$120,601	\$13,733	\$106,868	7.8	81,540
ECM 1	Install LED Fixtures	69,473	57.3	0	\$11,673	\$111,668	\$12,000	\$99,668	8.5	69,959
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	5,961	3.4	-1	\$987	\$4,794	\$760	\$4,034	4.1	5,857
ECM 3	Retrofit Fixtures with LED Lamps	5,771	2.8	-1	\$961	\$4,139	\$973	\$3,166	3.3	5,724

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace existing fixtures containing HID lamps with new LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixture(s).

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected building areas: exterior fixtures

ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Retrofit T12 fluorescent fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and therefore do not need to be replaced as often.

Affected building areas: all areas with fluorescent fixtures with T12 tubes

ECM 3: Retrofit Fixtures with LED Lamps

Replace fluorescent, CFL, and incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected building areas: all areas with fluorescent fixtures with T8 tubes, CFLs and incandescent lamps

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		1,375	0.9	0	\$228	\$4,050	\$455	\$3,595	15.8	1,350
ECM 4	Install Occupancy Sensor Lighting Controls	1,375	0.9	0	\$228	\$4,050	\$455	\$3,595	15.8	1,350

Lighting controls reduce energy use by turning off or lowering, lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 4: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected building areas: conference rooms, restrooms, and storage rooms

4.3 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		6,447	0.7	0	\$1,083	\$920	\$0	\$920	0.8	6,492
ECM 5	Vending Machine Control	6,447	0.7	0	\$1,083	\$920	\$0	\$920	0.8	6,492

ECM 5: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and, they power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions.⁴ Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Weatherization

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment.

Doors and Windows

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour (ACH) can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Lighting Maintenance



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

Lighting Controls

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly.

Fans to Reduce Cooling Load

Install ceiling fans to supplement your cooling system. Thermostat settings can typically be increased by 4°F with no change in overall occupant comfort due to the wind chill effect of moving air.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Duct Sealing

Duct leakage in commercial buildings can account for five to twenty-five percent of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Furnace Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should include the following: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

Water Heater Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense™ ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense™ website⁵ or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"⁶ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

⁵ <https://www.epa.gov/watersense>.

⁶ <https://www.epa.gov/watersense/watersense-work-0>.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense™ products where available.

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases reduction, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC is converted to alternating current (AC) through an inverter. The inverter is then connected to the building’s electrical distribution system.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has **no** potential for installing a PV array.

This facility does appear to not meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

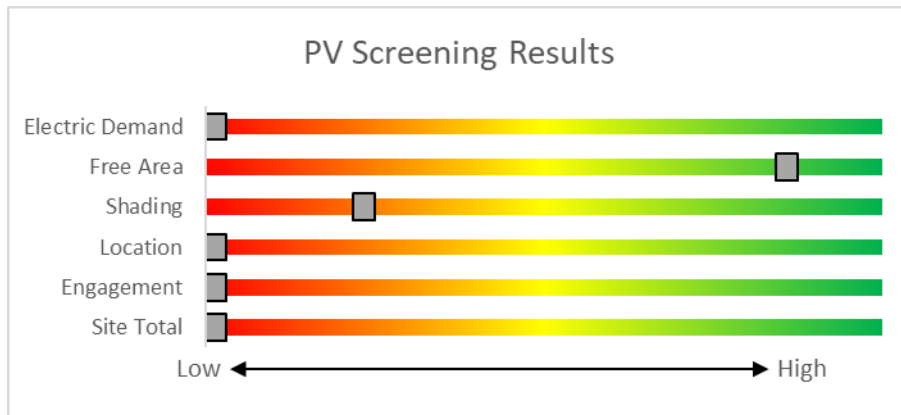


Figure 9 - Photovoltaic Screening

Solar Renewable Energy Certificate (SREC) Registration Program (SRP)

Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SREC Registration Program before starting construction. Once your PV system is up and running, you periodically earn credits, which can then be sold on the open market for up to 15 years.

If you are considering installing solar photovoltaics on your building, visit www.njcleanenergy.com/srec for more information about the SREC Registration Program.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- **Basic Info on Solar PV in NJ:** www.njcleanenergy.com/whysolar
- **NJ Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs
- **Approved Solar Installers in the NJ Market:** www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has **no** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

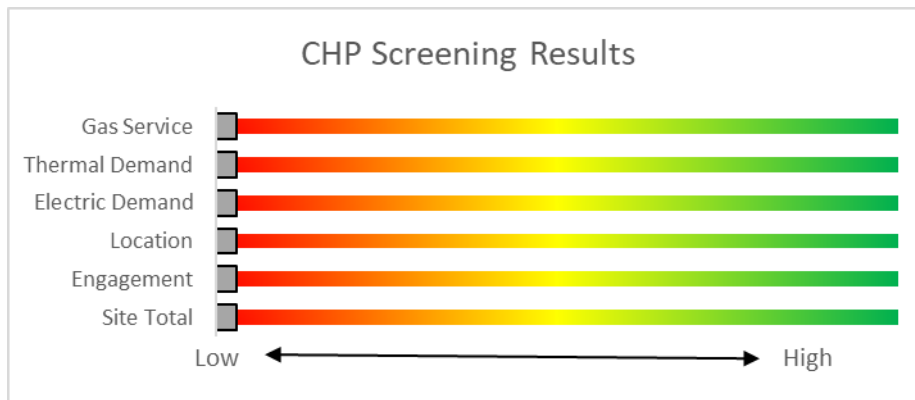


Figure 10 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/.

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? New Jersey Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available in New Jersey Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			

7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers
Electric Unitary HVAC
Gas Cooling
Gas Heating
Gas Water Heating
Ground Source Heat Pumps
Lighting

Lighting Controls
Refrigeration Doors
Refrigeration Controls
Refrigerator/Freezer Motors
Food Service Equipment
Variable Frequency Drives

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.

7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website.⁷

8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website.⁸

⁷ www.state.nj.us/bpu/commercial/shopping.html.

⁸ www.state.nj.us/bpu/commercial/shopping.html.

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BodmanParkMaintenanceBldg_MaintenanceHQ	7	Linear Fluorescent - T12: 8' T12 (75W) - 2L	Wall Switch	S	158	1,420	2, 4	Relamp & Reballast	Yes	7	LED - Linear Tubes: (2) 8' Lamps	Occupancy Sensor	72	980	0.7	1,163	0	\$192	\$1,171	\$175	5.2
BodmanParkMaintenanceBldg_MaintenanceHQ-RR	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.0	51	0	\$8	\$37	\$10	3.2
BodmanParkMaintenanceBldg_MaintenanceHQ-Office	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	980	0.1	258	0	\$43	\$416	\$75	8.0
BodmanParkMaintenanceBldg_CarpenterShop	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.2	405	0	\$67	\$292	\$80	3.2
BodmanParkMaintenanceBldg_CarpenterShop	5	Linear Fluorescent - T12: 8' T12 (75W) - 2L	Wall Switch	S	158	1,420	2	Relamp & Reballast	No	5	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	1,420	0.4	659	0	\$109	\$643	\$100	5.0
BodmanParkMaintenanceBldg_CarpenterShop	1	Linear Fluorescent - T8: 3' T8 (25W) - 2L	Wall Switch	S	48	1,420	3	Relamp	No	1	LED - Linear Tubes: (2) 3' Lamps	Wall Switch	21	1,420	0.0	41	0	\$7	\$37	\$10	3.9
BodmanParkMaintenanceBldg_CarpenterShop-RR	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.0	51	0	\$8	\$37	\$10	3.2
BodmanParkMaintenanceBldg_CarpenterShop-RR	1	Compact Fluorescent: CFL Screw In	Wall Switch	S	13	1,420	3	Relamp	No	1	LED Screw-In Lamps: A19 Bulb	Wall Switch	9	1,420	0.0	6	0	\$1	\$17	\$1	16.4
BodmanParkMaintenanceBldg_FrontEntryOffice	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.1	101	0	\$17	\$73	\$20	3.2
BodmanParkMaintenanceBldg_FrontEntryOffice	2	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
BodmanParkMaintenanceBldg_Trailer-w/Power	1	Linear Fluorescent - T12: 8' T12 (75W) - 1L	Wall Switch	S	92	1,420	2	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 8' Lamp	Wall Switch	36	1,420	0.0	86	0	\$14	\$84	\$10	5.2
BodmanPark_DarkMaintenanceBldg_EntryLockerArea	1	Incandescent: 60 W Bulb	Wall Switch	S	60	1,420	3	Relamp	No	1	LED Screw-In Lamps: A19 bulb	Wall Switch	9	1,420	0.0	78	0	\$13	\$17	\$0	1.3
BodmanPark_DarkMaintenanceBldg_EntryLockerArea-RR	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.1	101	0	\$17	\$73	\$20	3.2
BodmanPark_DarkMaintenanceBldg_BreakRoom	2	Linear Fluorescent - T8: 8' T8 (59W) - 2L	Wall Switch	S	110	1,420	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 8' Lamps	Occupancy Sensor	72	980	0.1	185	0	\$31	\$447	\$75	12.1
BodmanPark_DarkMaintenanceBldg_BreakRoom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.0	51	0	\$8	\$37	\$10	3.2
BodmanPark_DarkMaintenanceBldg_Copy/FileRoom	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	980	0.1	193	0	\$32	\$380	\$65	9.8
BodmanPark_DarkMaintenanceBldg_Office1	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.1	101	0	\$17	\$73	\$20	3.2
BodmanPark_DarkMaintenanceBldg_Office2	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,420	0.1	101	0	\$17	\$73	\$20	3.2
BodmanPark_DarkMaintenanceBldg_Bay1	2	Linear Fluorescent - T8: 8' T8 (59W) - 2L	Wall Switch	S	110	1,420	3	Relamp	No	2	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	1,420	0.1	117	0	\$19	\$177	\$40	7.1
BodmanPark_DarkMaintenanceBldg_SmallIToolRoom	1	Linear Fluorescent - T12: 8' T12 (75W) - 1L	Wall Switch	S	92	1,420	2	Relamp & Reballast	No	1	LED - Linear Tubes: (1) 8' Lamp	Wall Switch	36	1,420	0.0	86	0	\$14	\$84	\$10	5.2
BodmanPark_DarkMaintenanceBldg_Bay2	1	Linear Fluorescent - T8: 8' T8 (59W) - 2L	Wall Switch	S	110	1,420	3	Relamp	No	1	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	1,420	0.0	58	0	\$10	\$89	\$20	7.1
BodmanPark_DarkMaintenanceBldg_ToolRoom	3	Linear Fluorescent - T8: 8' T8 (59W) - 2L	Wall Switch	S	110	1,420	3	Relamp	No	3	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	1,420	0.1	175	0	\$29	\$266	\$60	7.1
BodmanPark_DarkMaintenanceBldg_WorkShop	5	Linear Fluorescent - T8: 8' T8 (59W) - 2L	Wall Switch	S	110	1,420	3	Relamp	No	5	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	1,420	0.2	291	0	\$48	\$443	\$100	7.1
BodmanPark_DarkMaintenanceBldg_WorkShop	2	Compact Fluorescent: PAR38	Wall Switch	S	13	1,420	3	Relamp	No	2	LED Screw-In Lamps: Par38	Wall Switch	9	1,420	0.0	12	0	\$2	\$60	\$2	29.5
BodmanPark_DarkMaintenanceBldg_AtticStorage	4	Linear Fluorescent - T8: 8' T8 (59W) - 2L	Wall Switch	S	110	400	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 8' Lamps	Occupancy Sensor	72	276	0.2	104	0	\$17	\$624	\$80	31.5

Location	Existing Conditions													Proposed Conditions										Energy Impact & Financial Analysis					
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years								
BodmanPark_Dark MaintBldg_StorageRm	3	Compact Fluorescent: CFL Screw In	Wall Switch	S	18	400	3	Relamp	No	3	LED Screw-In Lamps: A19 Bulb	Wall Switch	13	400	0.0	7	0	\$1	\$52	\$3	42.0								
BodmanParkMaintenanceBldg_RestroomBldg_WomensRR	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	980	0.1	193	0	\$32	\$380	\$65	9.8								
BodmanParkMaintenanceBldg_RestroomBldg_MensRR	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	980	0.1	193	0	\$32	\$380	\$65	9.8								
BodmanParkMaintenanceBldg_RestroomBldg	1	Compact Fluorescent: Screw In	Timedock	S	18	4,380	3	Relamp	No	1	LED Screw-In Lamps: A19 Bulb	Timedock	13	4,380	0.0	24	0	\$4	\$17	\$1	4.1								
BodmanParkMaintenanceBldg_RestroomBldg	2	Compact Fluorescent: Screw In	Timedock	S	13	4,380	3	Relamp	No	2	LED Screw-In Lamps: A19 Bulb	Timedock	9	4,380	0.0	34	0	\$6	\$34	\$2	5.7								
BodmanPark_Field Lights	24	Metal Halide: (1) 1000W Lamp	Timedock	S	1,080	800	1	LED Retrofit	No	24	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Timedock	324	800	12.0	14,515	0	\$2,439	\$22,334	\$2,400	8.2								
BodmanPark_Club House	1	Compact Fluorescent: 2 lamps (9 watts each)	PhotoCell	S	18	4,380	3	Relamp	No	1	LED Screw-In Lamps: A19 Bulb	PhotoCell	13	4,380	0.0	24	0	\$4	\$34	\$2	8.2								
BodmanPark_Club House_BayCorridor	2	Linear Fluorescent - T12: 4' T12 (40W) - 3L	Wall Switch	S	127	1,420	2	Relamp & Reballast	No	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,420	0.1	256	0	\$42	\$195	\$30	3.9								
BodmanPark_Club House_BayCorridor	2	Compact Fluorescent: CFL SI(18W)	Wall Switch	S	18	1,420	3	Relamp	No	2	LED Screw-In Lamps: A19 Bulb	Wall Switch	13	1,420	0.0	17	0	\$3	\$34	\$2	11.8								
BodmanPark_Club House_MensRR	2	Linear Fluorescent - T12: 4' T12 (40W) - 3L	Wall Switch	S	127	1,420	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	980	0.2	297	0	\$49	\$465	\$65	8.1								
BodmanPark_Club House_WomensRR	3	Linear Fluorescent - T12: 4' T12 (40W) - 3L	Wall Switch	S	127	1,420	2, 4	Relamp & Reballast	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	980	0.3	446	0	\$74	\$563	\$80	6.5								
BodmanPark_Club House_MeetingRoom	14	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,420	2, 4	Relamp & Reballast	Yes	14	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	980	1.7	2,919	-1	\$483	\$1,927	\$315	3.3								
BodmanPark_Club House_Storage1	2	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	S	58	400		None	No	2	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	400	0.0	0	0	\$0	\$0	\$0	0.0								
BodmanPark_Club House_Storage2	2	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	S	58	400		None	No	2	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	400	0.0	0	0	\$0	\$0	\$0	0.0								
McMahon Park_ConcessionArea	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,420	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,420	0.2	422	0	\$71	\$329	\$90	3.4								
McMahon Park_M/W RR	1	Linear Fluorescent - T12: 4' T12 (40W) - 3L	Wall Switch	S	127	1,420	2	Relamp & Reballast	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,420	0.1	119	0	\$20	\$98	\$15	4.1								
McMahon Park_ConcessionArea	4	Metal Halide: (1) 400W Lamp	Time Switch	S	458	800	1	LED Retrofit	No	4	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Time Switch	137	800	0.8	1,026	0	\$172	\$3,722	\$400	19.3								
McMahon Park_ParkingLot	4	Metal Halide: (1) 400W Lamp	Timedock	S	458	800	1	LED Retrofit	No	4	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Timedock	137	800	0.8	1,026	0	\$172	\$3,722	\$400	19.3								
McMahon Park_FieldLights	29	Metal Halide: (1) 1000W Lamp	Time Switch	S	1,080	800	1	LED Retrofit	No	29	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Time Switch	324	800	14.5	17,539	0	\$2,947	\$26,986	\$2,900	8.2								
McMahon Park_FieldLights	16	Metal Halide: (1) 1000W Lamp	Time Switch	S	1,080	800	1	LED Retrofit	No	16	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Time Switch	324	800	8.0	9,677	0	\$1,626	\$14,889	\$1,600	8.2								
NickTrezaField_FieldLights	24	Metal Halide: (1) 1500W Lamp	Wall Switch	S	1,610	800	1	LED Retrofit	No	24	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Wall Switch	483	800	17.9	21,638	0	\$3,636	\$22,334	\$2,400	5.5								
NickTrezaField_SmallFieldLight	10	Metal Halide: (1) 400W Lamp	Wall Switch	S	458	800	1	LED Retrofit	No	10	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Wall Switch	137	800	2.1	2,565	0	\$431	\$9,306	\$1,000	19.3								
NickTrezaField_SmallField_SquareLight	9	Metal Halide: (1) 250W Lamp	Wall Switch	S	295	800	1	LED Retrofit	No	9	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Wall Switch	89	800	1.2	1,487	0	\$250	\$8,375	\$900	29.9								
NickTrezaField_Bldg1	5	Linear Fluorescent - T12: 8' T12 (75W) - 2L	Wall Switch	S	158	1,420	2, 4	Relamp & Reballast	Yes	5	LED - Linear Tubes: (2) 8' Lamps	Occupancy Sensor	72	980	0.5	830	0	\$137	\$913	\$135	5.7								
NickTrezaField_Bldg1_VentHood	2	Incandescent: 60W bulb	Wall Switch	S	60	1,420	3	Relamp	No	2	LED Screw-In Lamps: A19 bulb	Wall Switch	9	1,420	0.1	156	0	\$26	\$34	\$0	1.3								

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
NickTrezaField_Bldg1_WomenRR	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	980	0.1	258	0	\$43	\$416	\$75	8.0
NickTrezaField_Bldg2_equipment storage	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	400	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	276	0.2	109	0	\$18	\$489	\$60	23.8
NickTrezaField_Bldg2_entryWay	1	LED Screw-In Lamps: 2 Lamp (9W)	Wall Switch	S	9	1,420		None	No	1	LED Screw-In Lamps: 2 Lamp (9W)	Wall Switch	9	1,420	0.0	0	0	\$0	\$0	\$0	0.0
NickTrezaField_Bldg1_2nd Floor	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	980	0.1	258	0	\$43	\$416	\$75	8.0
NickTrezaField_Bldg1_2nd Floor_StorageRm	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	400	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	400	0.1	29	0	\$5	\$73	\$20	11.2
NickTrezaField_Bldg1_MensRR	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,420	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	980	0.1	258	0	\$43	\$416	\$75	8.0
NickTrezaField_Bldg2_Exterior	3	Incandescent: 60W -2 lamp fixt	Photocell	S	120	4,380	3	Relamp	No	3	LED Screw-In Lamps: A19 bulb	Photocell	18	4,380	0.2	1,340	0	\$225	\$52	\$0	0.2
NickTrezaField_Bldg2_Exterior	2	LED Screw-In Lamps: 16W -2 lamp fixt	Photocell	S	32	4,380		None	No	2	LED Screw-In Lamps: 16W -2 lamp fixt	Photocell	32	4,380	0.0	0	0	\$0	\$0	\$0	0.0
NickTrezaField_Bldg1_Exterior	1	LED Screw-In Lamps: 20W -1 lamp fixt	Photocell	S	20	4,380		None	No	1	LED Screw-In Lamps: 20W -1 lamp fixt	Photocell	20	4,380	0.0	0	0	\$0	\$0	\$0	0.0
NickTrezaField_Bldg1_Exterior	1	Incandescent: 60W -2 lamp fixt	Photocell	S	120	4,380	3	Relamp	No	1	LED Screw-In Lamps: A19 bulb	Photocell	18	4,380	0.1	447	0	\$75	\$17	\$0	0.2

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BodmanPark_Main maintenanceHQ	Maintenance shop	1	Supply Fan	1.0	85.5%	No		2,745		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_Carpentershop	Carpentershop	1	Supply Fan	1.0	85.5%	No		2,745		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_Workshop	Carpentershop	1	Air Compressor	1.0	85.5%	No		6,978		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_Main maintenanceHQ	Workshop-Offices	1	Supply Fan	0.8	85.5%	No		2,745		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives
BodmanPark_Main maintenanceHQ	Maintenance shop	1	Window AC	2.00		W		No						0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_Main maintenanceHQ	Maintenance shop	1	Window AC	1.25		W		No						0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_Main maintenanceHQ	Workshop-Offices	1	Split-System AC	3.00		W		No						0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark	MYAA-Offices	1	Ductless Mini-Split HP	2.00	24.00	W		No						0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark	MYAA-Offices	1	Ductless Mini-Split HP	3.00	36.00	W		No						0.0	0	0	\$0	\$0	\$0	0.0
NickTrezzaField_Cottages	Cottage	1	Split-System AC	3.00		W		No						0.0	0	0	\$0	\$0	\$0	0.0
NickTrezzaField_Cottages	Cottage	2	Split-System AC	3.00		W		No						0.0	0	0	\$0	\$0	\$0	0.0
NickTrezzaField_Cottages	Cottage	1	Window AC	0.75		W		No						0.0	0	0	\$0	\$0	\$0	0.0

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BodmanPark_Main maintenanceHQ	Maintenance shop	1	Furnace	50.00	W		No						0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_Carpentershop	Carpentershop	1	Furnace	50.00	W		No						0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_Main maintenanceHQ	Workshop-Offices	1	Furnace	50.00	W		No						0.0	0	0	\$0	\$0	\$0	0.0
McMahonPark-ConcessionArea	Concession	1	Furnace	71.00	W		No						0.0	0	0	\$0	\$0	\$0	0.0

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BodmanPark_Carpentershop	Carpentershop	1	Storage Tank Water Heater (≤ 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0
BodmanPark_RestroomBldg	Restroom	1	Storage Tank Water Heater (≤ 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0
McMahonPark-ConcessionArea	Concession	1	Storage Tank Water Heater (≤ 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0
NickTrezzaField	Concession	1	Storage Tank Water Heater (≤ 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Plug Load Inventory


Location	Existing Conditions			ENERGY STAR Qualified ?
	Quantity	Equipment Description	Energy Rate (W)	
BodmanPark_Main tenanceHQ	2	Refrigerator	500.0	
BodmanPark_Main tenanceHQ	2	microwave	1,200.0	
BodmanPark_Main tenanceHQ	2	ceiling fan	100.0	
BodmanPark_Main tenanceHQ	2	water cooler	100.0	
BodmanPark_Main tenanceHQ	7	desktop computer	150.0	
BodmanPark_Main tenanceHQ	4	desk printer	50.0	
BodmanPark_Carpe ntershop	1	electric heater	1,000.0	
BodmanPark_Carpe ntershop	10	misc shop equipment	500.0	
BodmanPark_Carpe ntershop	1	photocopier	500.0	
McMahonPark- ConcessionArea	1	Refrigerator	500.0	
McMahonPark- ConcessionArea	1	Deep Freezer	800.0	
McMahonPark- ConcessionArea	2	Tube TV	300.0	
NickTrezzaField	3	Deep Freezer	800.0	
NickTrezzaField	4	Appliances	200.0	
NickTrezzaField	1	Heavy Duty Fan	300.0	
NickTrezzaField	1	Ice Maker	800.0	
NickTrezzaField	4	Refridgerator	500.0	
NickTrezzaField	1	Electric Fryer	3,000.0	
NickTrezzaField	1	Electric Griddle	4,000.0	
NickTrezzaField	1	Electric Stove	4,000.0	
NickTrezzaField	2	Small Oven	2,000.0	
NickTrezzaField	1	microwave	1,500.0	
NickTrezzaField	1	coffee maker'	2,000.0	
NickTrezzaField	2	Coca Cola Fridge	1,000.0	
NickTrezzaField_Co ttages	1	Projecttion TV	500.0	

Vending Machine Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BodmanPark_Maintenance_Bay2	1	Refrigerated	5	Yes	0.2	1,612	0	\$271	\$230	\$0	0.8
McMahonPark-ConcessionArea	1	Refrigerated	5	Yes	0.2	1,612	0	\$271	\$230	\$0	0.8
NickTrezzaField	2	Refrigerated	5	Yes	0.4	3,224	0	\$542	\$460	\$0	0.8

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

N/A

Bodman Park Maintenance Building

Primary Property Type: Repair Services (Vehicle, Shoe, Locksmith, etc.)
Gross Floor Area (ft²): 1,000
Built: 1980

For Year Ending: March 31, 2017
Date Generated: November 09, 2018

ENERGY STAR®
Score¹

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address Bodman Park Maintenance Building Patterson and Bodman Park Red Bank, New Jersey 07701	Property Owner Middletown Township 1 King's Highway Middletown, NJ 07748 732-615-2000	Primary Contact Anthony Mercantante 1 King's Highway Middletown, NJ 07748 732-615-2000 x 2013 amercant@middletownnj.org
Property ID: 6414818		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI	Annual Energy by Fuel		National Median Comparison
93.3 kBtu/ft ²	Electric - Grid (kBtu)	93,346 (100%)	National Median Site EUI (kBtu/ft ²) 34.6
			National Median Source EUI (kBtu/ft ²) 96.9
			% Diff from National Median Source EUI 170%
Source EUI			Annual Emissions
261.4 kBtu/ft ²			Greenhouse Gas Emissions (Metric Tons CO ₂ e/year) 10

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

Anthony Mercantante
 1 King's Highway
 Middletown, NJ 07748
 732-615-2000 x 2013
 amercant@middletownnj.org



Professional Engineer Stamp
(if applicable)



ENERGY STAR® Statement of Energy Performance

N/A

Nick Trezza & Charger Field

Primary Property Type: Other - Recreation
Gross Floor Area (ft²): 2,300
Built: 1997

ENERGY STAR®
Score¹

For Year Ending: May 31, 2017
Date Generated: November 09, 2018

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information

Property Address
Nick Trezza & Charger Field
Gordon Street
Red Bank, New Jersey 07701

Property Owner
Middletown Township
1 King's Highway
Middletown, NJ 07748
732-615-2000

Primary Contact
Anthony Mercantante
1 King's Highway
Middletown, NJ 07748
732-615-2000 x 2013
amercant@middletownnj.org

Property ID: 6424677

Energy Consumption and Energy Use Intensity (EUI)

Site EUI	Annual Energy by Fuel	National Median Comparison	
81.2 kBtu/ft ²	Electric - Grid (kBtu) 186,841 (100%)	National Median Site EUI (kBtu/ft ²)	40
		National Median Source EUI (kBtu/ft ²)	112
		% Diff from National Median Source EUI	103%
Source EUI	Annual Emissions		
227.5 kBtu/ft ²	Greenhouse Gas Emissions (Metric Tons CO ₂ e/year)	19	

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

Anthony Mercantante
1 King's Highway
Middletown, NJ 07748
732-615-2000 x 2013
amercant@middletownnj.org



Professional Engineer Stamp
(if applicable)

EPA's Portfolio Manager currently does not have a comparable building type for the MYAA Field, Bodman Park, and Normandy Park. Therefore, there is no Statement of Energy Performance (SEP) for this property. The NJCEP LGEA program has set up a profile within Portfolio Manager®, but its intent is solely to provide the Township of Winslow with a method to track monthly utility bills.

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate financial savings. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
BTU	A British thermal unit is the amount of heat required to increase the temperature of one pound water by one-degree Fahrenheit. Commonly used to measure natural gas consumption.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing energy management systems.
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
HVAC	Heating, ventilation, and air conditioning.
kW	Kilowatt. Equal to 1,000 Watts.
Load	The total amount of power used by a building system at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MMBtu	One million British thermal units.
psig	Pounds per square inch.
Plug Load	Refers to the amount of energy used in a space by products that are powered by means of an ordinary AC plug.
Simple Payback	The amount of time needed to recoup the funds expended in an investment, or to reach the break-even point.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
Turnkey	Provision of a complete product or service that is ready for immediate use
Watt (W)	Unit of power commonly used to measure electricity use.