



Local Government Energy Audit: Energy Audit Report



Copyright ©2019 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Littlebrook Elementary School

39 Magnolia Lane

Princeton, New Jersey 08540

Princeton Public Schools

January 24, 2019

Final Report by:

TRC Energy Services

Disclaimer

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

Table of Contents

1	Executive Summary	1
1.1	Facility Summary	1
1.2	Your Cost Reduction Opportunities.....	1
	Energy Conservation Measures.....	1
	Energy Efficient Practices	3
	On-Site Generation Measures.....	4
1.3	Implementation Planning.....	4
2	Facility Information and Existing Conditions	6
2.1	Project Contacts	6
2.2	General Site Information.....	6
2.3	Building Occupancy	6
2.4	Building Envelope	7
2.5	On-Site Generation.....	7
2.6	Energy-Using Systems	7
	Lighting System	8
	Hot Water Heating System.....	9
	Direct Expansion Air Conditioning System (DX)	9
	Domestic Hot Water Heating System.....	10
	Food Service Equipment	10
	Refrigeration	11
	Building Plug Load	11
2.7	Water-Using Systems	11
3	Site Energy Use and Costs	12
3.1	Total Cost of Energy	12
3.2	Electricity Usage	13
3.3	Natural Gas Usage	14
3.4	Benchmarking.....	15
3.5	Energy End-Use Breakdown	16
4	Energy Conservation Measures	17
4.1	Recommended ECMs	17
4.1.1	Lighting Upgrades.....	18
	ECM 1: Install LED Fixtures.....	18
	ECM 2: Retrofit Fixtures with LED Lamps.....	19
4.1.2	Lighting Control Measures	20
	ECM 3: Install Occupancy Sensor Lighting Controls	20
4.1.3	Variable Frequency Drive Measures	21
	ECM 4: Install VFD on Variable Air Volume (VAV) HVAC.....	21
4.1.4	Domestic Hot Water Heating System Upgrades	22

ECM 5: Install Low-Flow DHW Devices.....	22
4.1.5 Plug Load Equipment Control - Vending Machines.....	23
ECM 6: Vending Machine Control	23
4.2 ECMs Evaluated But Not Recommended	24
Retrofit Fluorescent Fixtures with LED Lamps and Drivers	24
Install VFDs on Hot Water Pumps	25
Install High Efficiency Steam Boilers	25
Replace Refrigeration Equipment	26
5 Energy Efficient Practices	27
Close Doors and Windows	27
Perform Proper Lighting Maintenance.....	27
Develop a Lighting Maintenance Schedule	27
Perform Routine Motor Maintenance	27
Use Fans to Reduce Cooling Load	27
Clean Evaporator/Condenser Coils on AC Systems	28
Clean and/or Replace HVAC Filters	28
Water Conservation	28
6 On-Site Generation Measures	29
6.1 Photovoltaic.....	30
6.2 Combined Heat and Power	31
7 Demand Response	32
8 Project Funding / Incentives	33
8.1 SmartStart	34
8.2 Direct Install	35
8.3 SREC Registration Program.....	36
8.4 Energy Savings Improvement Program	37
9 Energy Purchasing and Procurement Strategies	38
9.1 Retail Electric Supply Options.....	38
9.2 Retail Natural Gas Supply Options	38

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

Table of Figures

Figure 1 – Previous 12 Month Utility Costs..... 2

Figure 2 – Potential Post-Implementation Costs 2

Figure 3 – Summary of Energy Reduction Opportunities 2

Figure 4 – Photovoltaic Potential..... 4

Figure 5 – Project Contacts 6

Figure 6 - Building Schedule..... 6

Figure 7 - Utility Summary 12

Figure 8 - Energy Cost Breakdown 12

Figure 9 - Electric Usage & Demand..... 13

Figure 10 - Electric Usage & Demand..... 13

Figure 11 - Natural Gas Usage..... 14

Figure 12 - Natural Gas Usage..... 14

Figure 13 - Energy Use Intensity Comparison – Existing Conditions..... 15

Figure 14 - Energy Use Intensity Comparison – Following Installation of Recommended Measures 15

Figure 15 - Energy Balance (% and kBtu/SF) 16

Figure 16 – Summary of Recommended ECMs..... 17

Figure 17 – Summary of Lighting Upgrade ECMs..... 18

Figure 18 – Summary of Lighting Control ECMs 20

Figure 19 – Summary of Variable Frequency Drive ECMs 21

Figure 20 - Summary of Domestic Water Heating ECMs 22

Figure 21-Summary of Plug Load Equipment ECMs 23

Figure 22 – Summary of Measures Evaluated, But Not Recommended 24

Figure 23 - Photovoltaic Screening 30

Figure 24 - Combined Heat and Power Screening 31

Figure 25 - ECM Incentive Program Eligibility 33

I EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for Littlebrook Elementary School.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist New Jersey school districts in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

I.1 Facility Summary

Littlebrook Elementary School is a 54,629 square foot facility comprised of various space types within one single-story building which includes the main office, staff rooms, a cafeteria with kitchen, classrooms, offices, gym, and locker rooms, with a sub-basement mechanical space.

Littlebrook Elementary School consists of aging in need of replacement with new LED lighting fixtures and inefficient fixtures and HVAC equipment in need of replacement with high efficiency HVAC systems. Heating is supplied by a natural gas boiler. A thorough description of the facility and our observations are in Section 2.

I.2 Your Cost Reduction Opportunities

Energy Conservation Measures

TRC evaluated ten measures and recommends six measures which together represent an opportunity for Littlebrook Elementary School to reduce annual energy costs by roughly \$19,709 and annual greenhouse gas emissions by 142,231 lbs. CO₂e. We estimate that if all measures were implemented as recommended, the project would pay for itself in 3 years. The breakdown of existing and potential utility costs after project implementation are illustrated in Figure 1 and Figure 2, respectively. Together these measures represent an opportunity to reduce Littlebrook Elementary School's annual energy use by 10%.

Figure 1 – Previous 12 Month Utility Costs


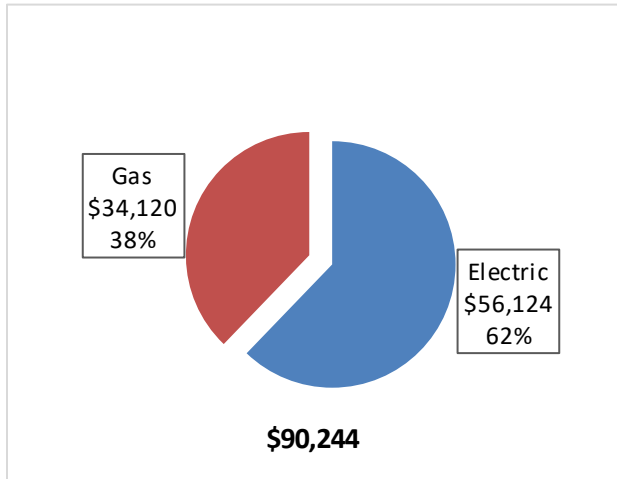


Figure 2 – Potential Post-Implementation Costs

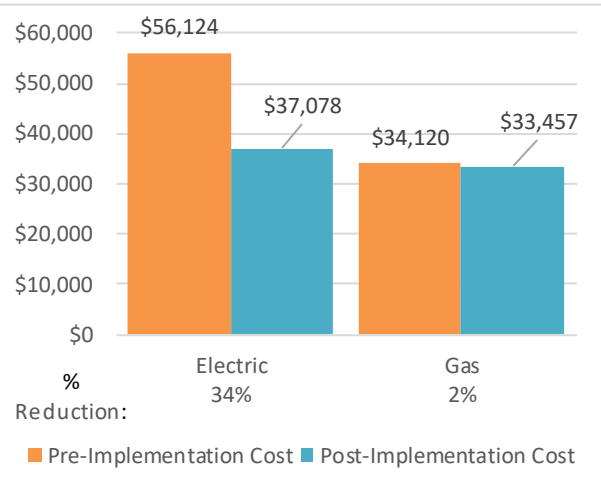

A detailed description of Littlebrook Elementary School’s existing energy use can be found in Section 3.

Estimates of the total cost, energy savings, and financial incentives for the proposed energy efficient upgrades are summarized below in Figure 3. A brief description of each category can be found below and a description of savings opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

Energy Conservation Measure		Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			100,473	21.5	0.0	\$14,423.25	\$40,142.43	\$10,425.00	\$29,717.43	2.1	101,176
ECM 1	Install LED Fixtures	Yes	2,440	0.7	0.0	\$350.33	\$3,752.83	\$900.00	\$2,852.83	8.1	2,458
	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	No	96	0.2	0.0	\$13.73	\$453.41	\$70.00	\$383.41	27.9	96
ECM 2	Retrofit Fixtures with LED Lamps	Yes	97,937	20.7	0.0	\$14,059.18	\$35,936.20	\$9,455.00	\$26,481.20	1.9	98,622
Lighting Control Measures			24,270	5.0	0.0	\$3,484.04	\$25,458.00	\$3,155.00	\$22,303.00	6.4	24,440
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	24,270	5.0	0.0	\$3,484.04	\$25,458.00	\$3,155.00	\$22,303.00	6.4	24,440
Variable Frequency Drive (VFD) Measures			10,436	7.8	0.0	\$1,498.11	\$23,894.01	\$3,487.50	\$20,406.51	13.6	10,509
ECM 4	Install VFD on Variable Air Volume (VAV) HVAC	Yes	6,414	6.3	0.0	\$920.74	\$10,820.40	\$3,487.50	\$7,332.90	8.0	6,459
	Install VFDs on Hot Water Pumps	No	4,022	1.5	0.0	\$577.36	\$13,073.61	\$0.00	\$13,073.61	22.6	4,050
Gas Heating (HVAC/Process) Replacement			0	0.0	88.9	\$800.34	\$75,760.26	\$4,500.00	\$71,260.26	89.0	10,408
	Install High Efficiency Steam Boilers	No	0	0.0	88.9	\$800.34	\$75,760.26	\$4,500.00	\$71,260.26	89.0	10,408
Domestic Water Heating Upgrade			0	0.0	73.7	\$663.63	\$229.44	\$0.00	\$229.44	0.3	8,630
ECM 5	Install Low-Flow Domestic Hot Water Devices	Yes	0	0.0	73.7	\$663.63	\$229.44	\$0.00	\$229.44	0.3	8,630
Food Service Equipment & Refrigeration Measures			601	0.1	0.0	\$86.30	\$4,263.70	\$100.00	\$4,163.70	48.2	605
	Replace Refrigeration Equipment	No	601	0.1	0.0	\$86.30	\$4,263.70	\$100.00	\$4,163.70	48.2	605
Plug Load Equipment Control - Vending Machine			1,612	0.0	0.0	\$231.39	\$230.00	\$0.00	\$230.00	1.0	1,623
ECM 6	Vending Machine Control	Yes	1,612	0.0	0.0	\$231.39	\$230.00	\$0.00	\$230.00	1.0	1,623
TOTALS FOR HIGH PRIORITY MEASURES			132,673	32.7	73.7	\$19,709.31	\$76,426.87	\$16,997.50	\$59,429.37	3.0	142,231
TOTALS FOR ALL EVALUATED MEASURES			137,392	34.4	162.6	\$21,187.05	\$169,977.85	\$21,667.50	\$148,310.35	7.0	157,390

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Lighting Upgrades generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measure save energy by reducing the power used by the lighting components due to improved electrical efficiency.

Lighting Controls measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

Variable Frequency Drives (VFDs) are motor control devices. These measures control the speed of a motor so that the motor spins at peak efficiency during partial load conditions. Sensors adapt the speed to flow, temperature, or pressure settings which is much more efficient than usage of a valve or damper to control flow rates, or running the motor at full speed when only partial power is needed. These measures save energy by controlling motor usage more efficiently.

Gas Heating (HVAC/Process) measures generally involve replacing older inefficient hydronic heating systems with modern energy efficient systems. Gas heating systems can provide equivalent heating compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel demands for heating, due to improved combustion and heat transfer efficiency.

Domestic Hot Water upgrade measures generally involve replacing older inefficient domestic water heating systems with modern energy efficient systems. New domestic hot water heating systems can provide equivalent, or greater, water heating capacity compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel used for domestic hot water heating due to improved heating efficiency or reducing standby losses.

Food Service Equipment & Refrigeration measures generally involve improvements in the efficiency of cooking, food service, dishwashing, and food storage equipment. These measures may include more efficient convection ovens, steamers, ice machines, or refrigeration. These measures save energy by reducing the energy usage with more energy efficient equipment.

Plug Load Equipment control measures generally involve installing automated devices that limit the power usage or operation of equipment that is plugged into an electric outlet when not in use.

Energy Efficient Practices

TRC also identified eight low cost (or no cost) energy efficient practices. A facility's energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. Potential opportunities identified at Littlebrook Elementary School include:

- Close Doors and Windows
- Perform Proper Lighting Maintenance
- Develop a Lighting Maintenance Schedule
- Perform Routine Motor Maintenance
- Use Fans to Reduce Cooling Load
- Clean Evaporator/Condenser Coils on AC Systems
- Clean and/or Replace HVAC Filters
- Water Conservation

For details on these energy efficient practices, please refer to Section 5.

On-Site Generation Measures

TRC evaluated the potential for installing on-site generation for Littlebrook Elementary School. Based on the configuration of the site and its loads there is a high potential for installing a photovoltaic (PV) array.

Figure 4 – Photovoltaic Potential

Potential	High	
System Potential	106	kW DC STC
Electric Generation	126,285	kWh/yr
Displaced Cost	\$10,990	/yr
Installed Cost	\$303,200	

For details on our evaluation and on-site generation potential, please refer to Section 6.

I.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Direct Install
- SREC (Solar Renewable Energy Certificate) Registration Program (SRP)
- Energy Savings Improvement Program (ESIP)

For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 8.

This facility may also qualify for the Direct Install program which can provide turnkey installation of multiple measures, through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures, although measure eligibility will have to be assessed and be verified by the designated Direct Install contractor and, in most cases, they will perform the installation work.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.4 for additional information on the ESIP Program.

The Demand Response Energy Aggregator is a (non-NJCEP) program designed to reduce electric loads at commercial facilities, when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. Demand Response (DR) service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability. By enabling grid operators to call upon commercial facilities to reduce their electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and facilities receive payments whether or not they are called upon to curtail their load during times of peak demand. Refer to Section 7 for additional information on this program.

Additional information on relevant incentive programs is located in Section 8. You may also check the following website for more details: www.njcleanenergy.com/ci.

2 FACILITY INFORMATION AND EXISTING CONDITIONS

2.1 Project Contacts

Figure 5 – Project Contacts

Name	Role	E-Mail	Phone #
Customer			
Gary Weisman	Director of Plant Operations	GaryWeisman@princetonk12.org	(609) 203-4534
Peter Vazquez	Operations Manager	PeterVazquez@princetonk12.org	(609) 751-3916
Stephanie Kennedy	Business Administrator	stephaniekennedy@princetonk12.org	(609) 806-4204
TRC Energy Services			
Yagna Otia	Auditor	Yotia@trcsolutions.com	(732) 855-0033

2.2 General Site Information

On July 25, 2018, TRC performed an energy audit at Littlebrook Elementary School located in Princeton, New Jersey. TRC’s team met with the facility’s technician to review the facility operations and help focus our investigation on specific energy-using systems.

Littlebrook Elementary School is a 54,629 square foot facility comprised of various space types within one single story building. The school building has only one floor which includes a main office, staff rooms, a cafeteria with kitchen, classrooms, offices, gym, and locker rooms, with a sub-basement mechanical space.

The building was constructed in 1957. Over the last several years the facility has replaced most of the existing T12 fluorescent fixtures with T8 fluorescent fixtures.

2.3 Building Occupancy

The school building is open Monday through Friday and occasionally for weekend operations for school organized events. The typical schedule is presented in the table below. The entire facility is used year-round by the school community and camps are run throughout the summer. During a typical day, the facility is occupied by 65 staff and 250 students.

Figure 6 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
LittleBrook Elementary School	Weekday	7AM-6PM

2.4 Building Envelope

The school building is constructed of concrete blocks and structural steel with a stone facade. The building has a flat roof covered with black and white membranes that are in good condition. The building has double-pane windows which are in good condition and show little sign of excessive infiltration. The exterior doors are constructed of aluminum and in good condition except that the door seals have worn out which increases the level of outside air infiltration.



Image 1 Building Roof and Exterior

2.5 On-Site Generation

Littlebrook Elementary School does not have any on-site electric generation capacity.

2.6 Energy-Using Systems

Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

Lighting System

Lighting at the facility is provided mostly by 32-Watt linear fluorescent T8 lamps with electronic ballasts as well as some compact fluorescent lamps (CFL). Most of the fixtures are 2-lamp or 3-lamp, 4-foot long troffers with diffusers. The facility's maintenance technician indicated that the building had a comprehensive T8 retrofit eight years ago, although a few 2-foot T12 fixtures remain, mainly in the lavatories.

A small area of the building and most of the office spaces are primarily lit with 13-Watt, 26-Watt and 42-Watt CFL lamps in recessed can ceiling fixtures.

Lighting control in most spaces is provided by wall switches, however, a few occupancy sensors are present. The occupancy sensors are either wall or ceiling mounted depending on the space layout. Stairwells, elevator lobbies and main lobby areas do not contain any occupancy sensors and operate 24 hours per day throughout the year.

The building's exterior lighting is minimal and consists primarily of moderately efficient metal halide and very inefficient mercury vapor fixtures that are controlled by photocells, though the lights were seen on during a sunny day.



Image 2 School T8 & T12 Lamp Sample

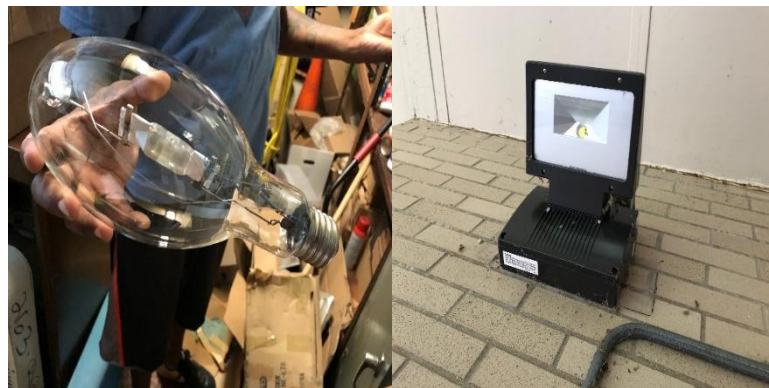


Image 3 Exterior MH and LED Lamp

Hot Water Heating System

The steam system consists of two Smith cast iron 1875 kBtu/hr output, natural draft boilers (B1 & 2). The boilers have a nominal combustion efficiency of 78%. The boilers are configured in a constant flow primary distribution with two heating hot water pumps (HHWP1 & 2) along with secondary loop with two heating hot water pumps (HHWP3 & 4). Each boiler is supplied by a dedicated 1 hp burner motor and 1/2 hp ID Fan motor. Steam is supplied to the facility at 20 psig.

The boilers operate in a lead/lag configuration. Only a single boiler is required to meet the facility heating demand. Boiler operation is rotated weekly. Steam is supplied directly to air handler for radiators in the lobby and classrooms.



Image 4 School Boiler System

Direct Expansion Air Conditioning System (DX)

Six 1.5-ton Trane roof top packaged units (RTU 1, 2,3,4,5 & 6) with outside air economizers are used to condition the building. Four units are located on the roof of the south half of the building and the other two units are located on the north half of the building. The units are constant air volume, each with a single 0.8 hp supply fan and 0.2 hp return fan. The units utilize a scroll compressor and a direct-expansion (DX) coil. The units have outside air economizers to utilize free cooling when the outside air temperature is lower than the return air temperature.

The units are controlled by individual thermostats located in the zones. The packaged units operate continuously to maintain the building space temperature setpoint around 72°F. All six units are reportedly required to maintain the space temperature set point during the summer months.



Image 5 AHU & Roof Top Unit

Domestic Hot Water Heating System

The domestic hot water heating system for the facility consists of one A.O. Smith gas-fired storage tank hot water heater with an input rating of 199 kBtu/hr each and a nominal efficiency of 80%. The water heater has a 100-gallon storage tank. One 500-Watt recirculation pump distributes 120°F water to the entire site except the kitchen in the west wing. The recirculation pump operates continuously.



Image 6 DHW Heater

Food Service Equipment

The school has an all-electric kitchen that is used to prepare 200 lunches per day for the students. The kitchen is also used to prepare hot snacks for three fund raising events each year. Most of the cooking is done using the two convection ovens and a single large griddle. There is also a large electric kettle that is used to prepare pasta and soup.



Image 7 School Kitchen

Refrigeration

The kitchen has one chest freezer for cold beverages, one stand-up freezer for meat storage, and two stand-up refrigerators that are used to store food prepared for school lunches. The kitchen also has a free standing commercial size freezer.



Image 8 Refrigeration Equipment

Building Plug Load

There are 37 computer work stations throughout the facility. Sixty percent of the computers are desktop units with LCD monitors and other 40% are notebooks with a moving charging cart. There is no centralized PC power management software installed.

We noted two server closets in the facility. One has cooling provided by dedicated split systems while the other is cooled by the main AHU.

The facility has only one refrigerated beverage vending machine.

2.7 Water-Using Systems

There are 15 restrooms at this facility. A sampling of restrooms found that 15 of the faucets are rated for 2.2 gallons per minute (gpm) or higher and 17 of faucets are rated for 3.5 gpm, the toilets are rated at 2.5 gallons per flush (gpf) and the urinals are rated at 2 gpf.

3 SITE ENERGY USE AND COSTS

Utility data for electricity and natural gas was analyzed to identify opportunities for savings. In addition, data for electricity and natural gas was evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 3.4 for additional information.

3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

Figure 7 - Utility Summary

Utility Summary for Littlebrook Elementary School		
Fuel	Usage	Cost
Electricity	390,960 kWh	\$56,124
Natural Gas	37,895 Therms	\$34,120
Total		\$90,244

The current annual energy cost for this facility is \$90,244 as shown in the chart below.

Figure 8 - Energy Cost Breakdown

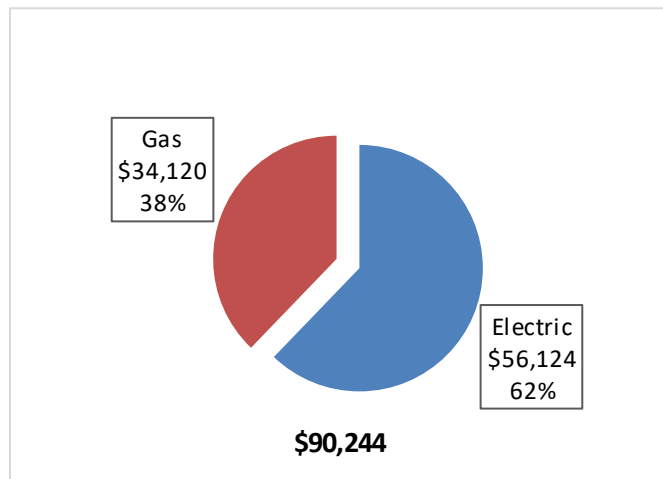

3.2 Electricity Usage

Electricity is provided by PSE&G. The average electric cost over the past 12 months was \$0.144/kWh, which is the blended rate that includes energy supply, distribution, and other charges. This rate is used throughout the analyses in this report to assess energy costs and savings. The monthly electricity consumption and peak demand are shown in the chart below.

Figure 9 - Electric Usage & Demand

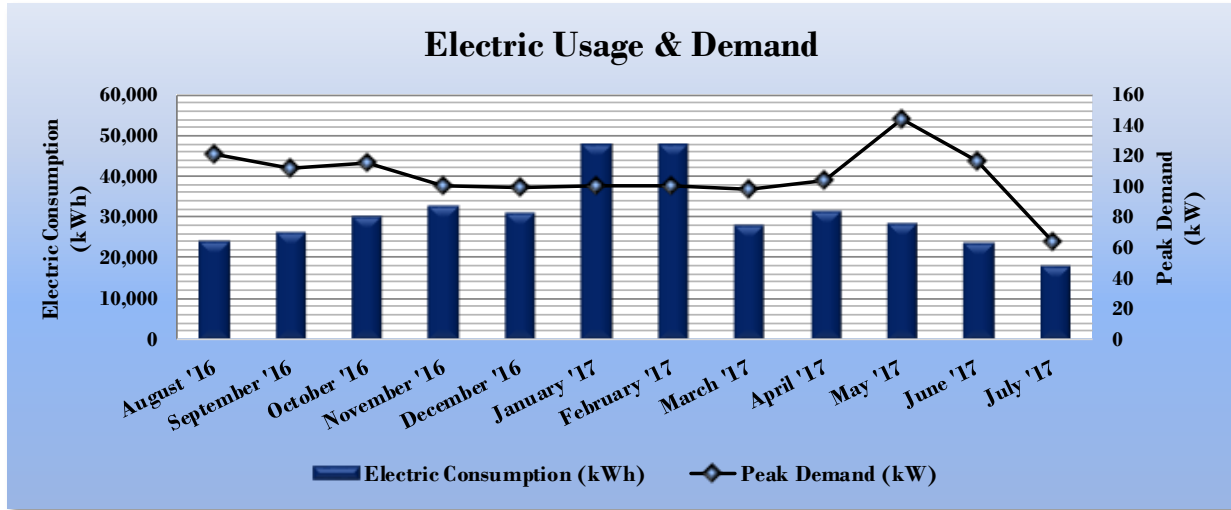


Figure 10 - Electric Usage & Demand

Electric Billing Data for Littlebrook Elementary School						
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost	TRC Estimated Usage?
9/12/16	30	24,160	122	\$538	\$4,602	No
10/10/16	28	26,560	112	\$500	\$3,666	No
11/8/16	29	30,240	115	\$515	\$4,071	No
12/9/16	30	33,120	101	\$450	\$4,366	No
1/11/17	30	31,040	99	\$443	\$4,141	No
2/9/17	28	48,160	101	\$452	\$6,455	Yes
3/13/17	27	48,160	101	\$452	\$6,455	Yes
4/11/17	28	28,000	98	\$440	\$3,847	No
5/12/17	30	31,680	104	\$469	\$4,320	No
6/13/17	30	28,800	144	\$650	\$4,836	No
7/14/17	30	23,680	117	\$527	\$3,956	No
8/11/17	27	18,080	64	\$270	\$2,642	No
Totals	347	371,680	144	\$5,707	\$53,356	2
Annual	365	390,960	144	\$6,003	\$56,124	

3.3 Natural Gas Usage

Natural gas is provided by PSE&G. The average gas cost for the past 12 months is \$0.900/therm, which is the blended rate used throughout the analyses in this report. The monthly gas consumption is shown in the chart below.

Figure 11 - Natural Gas Usage

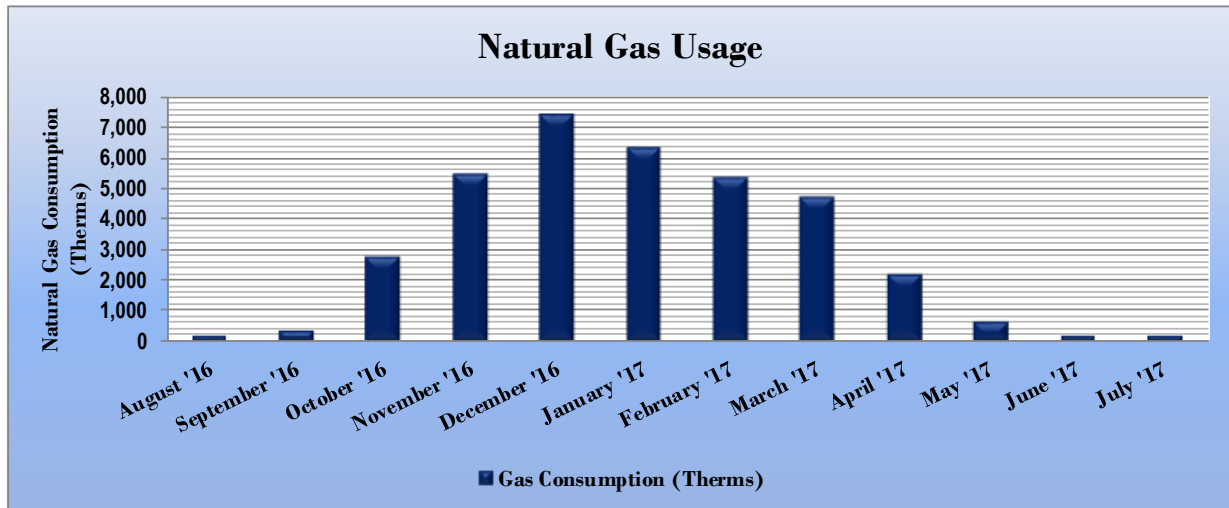


Figure 12 - Natural Gas Usage

Gas Billing Data for Littlebrook Elementary School				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
9/12/16	30	197	\$272	No
10/10/16	28	383	\$376	No
11/8/16	29	2,790	\$2,969	No
12/9/16	30	5,481	\$4,749	No
1/11/17	30	7,453	\$7,067	No
2/9/17	28	6,351	\$6,230	No
3/13/17	27	5,352	\$5,248	No
4/11/17	28	4,755	\$2,743	No
5/12/17	30	2,229	\$1,452	No
6/13/17	30	626	\$542	No
7/14/17	30	214	\$336	Yes
8/11/17	27	194	\$454	Yes
Totals	347	36,026	\$32,438	2
Annual	365	37,895	\$34,120	

3.4 Benchmarking

This facility was benchmarked using Portfolio Manager®, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager® analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

Figure 13 - Energy Use Intensity Comparison – Existing Conditions

Energy Use Intensity Comparison - Existing Conditions		
	Littlebrook Elementary School	National Median Building Type: School (K-12)
Source Energy Use Intensity (kBtu/ft ²)	149.5	141.4
Site Energy Use Intensity (kBtu/ft ²)	93.8	58.2

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

Figure 14 - Energy Use Intensity Comparison – Following Installation of Recommended Measures

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	Littlebrook Elementary School	National Median Building Type: School (K-12)
Source Energy Use Intensity (kBtu/ft ²)	122.1	141.4
Site Energy Use Intensity (kBtu/ft ²)	84.2	58.2

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75% of all similar buildings nationwide and may be eligible for ENERGY STAR® certification. This school facility has a current score of 79.

A Portfolio Manager® Statement of Energy Performance (SEP) was generated for this facility, see Appendix B: ENERGY STAR® Statement of Energy Performance.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager® account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager® regularly, so that you can keep track of your building’s performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building’s performance at: <https://www.energystar.gov/buildings/training>.

3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 15 - Energy Balance (% and kBtu/SF)

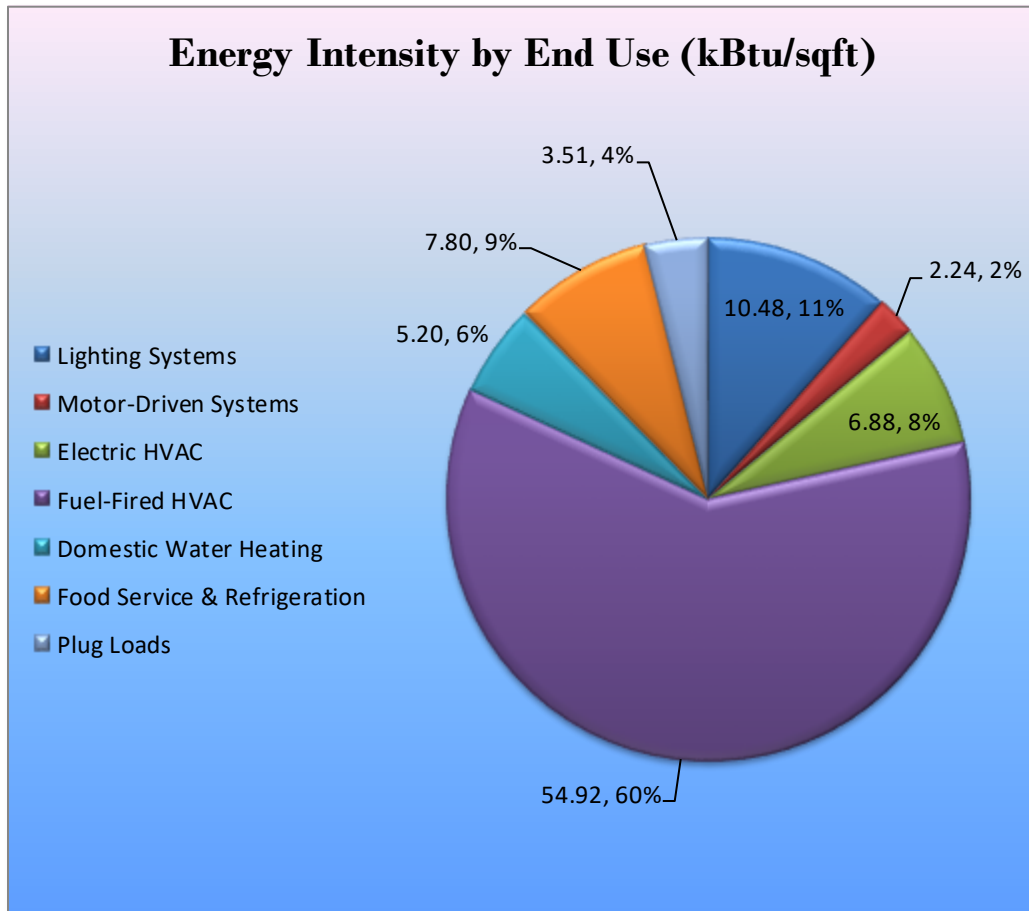

4 ENERGY CONSERVATION MEASURES

Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to Littlebrook Elementary School regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

4.1 Recommended ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 16 – Summary of Recommended ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		100,377	21.4	0.0	\$14,409.52	\$39,689.03	\$10,355.00	\$29,334.03	2.0	101,079
ECM 1	Install LED Fixtures	2,440	0.7	0.0	\$350.33	\$3,752.83	\$900.00	\$2,852.83	8.1	2,458
ECM 2	Retrofit Fixtures with LED Lamps	97,937	20.7	0.0	\$14,059.18	\$35,936.20	\$9,455.00	\$26,481.20	1.9	98,622
Lighting Control Measures		24,270	5.0	0.0	\$3,484.04	\$25,458.00	\$3,155.00	\$22,303.00	6.4	24,440
ECM 3	Install Occupancy Sensor Lighting Controls	24,270	5.0	0.0	\$3,484.04	\$25,458.00	\$3,155.00	\$22,303.00	6.4	24,440
Variable Frequency Drive (VFD) Measures		6,414	6.3	0.0	\$920.74	\$10,820.40	\$3,487.50	\$7,332.90	8.0	6,459
ECM 4	Install VFD on Variable Air Volume (VAV) HVAC	6,414	6.3	0.0	\$920.74	\$10,820.40	\$3,487.50	\$7,332.90	8.0	6,459
Domestic Water Heating Upgrade		0	0.0	73.7	\$663.63	\$229.44	\$0.00	\$229.44	0.3	8,630
ECM 5	Install Low-Flow Domestic Hot Water Devices	0	0.0	73.7	\$663.63	\$229.44	\$0.00	\$229.44	0.3	8,630
Plug Load Equipment Control - Vending Machine		1,612	0.0	0.0	\$231.39	\$230.00	\$0.00	\$230.00	1.0	1,623
ECM 6	Vending Machine Control	1,612	0.0	0.0	\$231.39	\$230.00	\$0.00	\$230.00	1.0	1,623
TOTALS		132,673	32.7	73.7	\$19,709.31	\$76,426.87	\$16,997.50	\$59,429.37	3.0	142,231

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

4.1.1 Lighting Upgrades

Our recommendations for upgrades to existing lighting fixtures are summarized in Figure 17 below.

Figure 17 – Summary of Lighting Upgrade ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		100,377	21.4	0.0	\$14,409.52	\$39,689.03	\$10,355.00	\$29,334.03	2.0	101,079
ECM 1	Install LED Fixtures	2,440	0.7	0.0	\$350.33	\$3,752.83	\$900.00	\$2,852.83	8.1	2,458
ECM 2	Retrofit Fixtures with LED Lamps	97,937	20.7	0.0	\$14,059.18	\$35,936.20	\$9,455.00	\$26,481.20	1.9	98,622

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 1: Install LED Fixtures

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0
Exterior	2,440	0.7	0.0	\$350.33	\$3,752.83	\$900.00	\$2,852.83	8.1	2,458

Measure Description

We recommend replacing existing fixtures containing metal Halide and mercury vapor lamps with new high-performance LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of HID sources such as metal halide and mercury vapor.

ECM 2: Retrofit Fixtures with LED Lamps

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	97,608	20.6	0.0	\$14,011.92	\$35,278.84	\$9,455.00	\$25,823.84	1.8	98,290
Exterior	329	0.1	0.0	\$47.26	\$657.36	\$0.00	\$657.36	13.9	332

Measure Description

We recommend retrofitting existing incandescent, compact Fluorescent T12 or T8 fluorescent fixtures by removing fluorescent tubes and ballasts and replacing them with LEDs and LED drivers (if necessary), which are designed to be used with retrofitted fluorescent fixtures. The measure uses the existing fixture housing but replaces the rest of the components with more efficient lighting technology. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tube and more than ten times longer than many incandescent lamps.

4.1.2 Lighting Control Measures

Our recommendations for upgrades to lighting control measures is summarized in Figure 18 below.

Figure 18 – Summary of Lighting Control ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		24,270	5.0	0.0	\$3,484.04	\$25,458.00	\$3,155.00	\$22,303.00	6.4	24,440
ECM 3	Install Occupancy Sensor Lighting Controls	24,270	5.0	0.0	\$3,484.04	\$25,458.00	\$3,155.00	\$22,303.00	6.4	24,440

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 3: Install Occupancy Sensor Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
24,270	5.0	0.0	\$3,484.04	\$25,458.00	\$3,155.00	\$22,303.00	6.4	24,440

Measure Description

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in restrooms, classrooms, offices areas and storage areas. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

4.1.3 Variable Frequency Drive Measures

Our recommendations for upgrades to variable frequency drive (VFD) measures is summarized in Figure 19 below.

Figure 19 – Summary of Variable Frequency Drive ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures		6,414	6.3	0.0	\$920.74	\$10,820.40	\$3,487.50	\$7,332.90	8.0	6,459
ECM 4	Install VFD on Variable Air Volume (VAV) HVAC	6,414	6.3	0.0	\$920.74	\$10,820.40	\$3,487.50	\$7,332.90	8.0	6,459

ECM 4: Install VFD on Variable Air Volume (VAV) HVAC

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
6,414	6.3	0.0	\$920.74	\$10,820.40	\$3,487.50	\$7,332.90	8.0	6,459

Measure Description

We recommend replacing existing air volume control devices on air handling units (AHUs), such as inlet vanes and variable pitch fan blades, with variable frequency drives (VFDs). Inlet guide vanes and variable pitch fan blades are an inefficient means of controlling the air volume compared to VFDs. The existing volume control device would be removed, or permanently disabled, and the control signal would be redirected to the VFD to determine proper fan motor speed. Energy savings results from more efficient control of motor energy usage when fan motors are operated at partial load. The magnitude of energy savings is based on the estimated amount of time that fan motors would be operated at partial load. The measure pertains to AHU-1.

Additional maintenance savings may result from this measure as well, since VFDs are solid state electronic device, which generally requires less maintenance than mechanical air volume control devices.

4.1.4 Domestic Hot Water Heating System Upgrades

Our recommendations for domestic water heating system improvements is summarized in Figure 20 below.

Figure 20 - Summary of Domestic Water Heating ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	73.7	\$663.63	\$229.44	\$0.00	\$229.44	0.3	8,630
ECM 5	Install Low-Flow Domestic Hot Water Devices	0	0.0	73.7	\$663.63	\$229.44	\$0.00	\$229.44	0.3	8,630

ECM 5: Install Low-Flow DHW Devices

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	73.7	\$663.63	\$229.44	\$0.00	\$229.44	0.3	8,630

Measure Description

We recommend installing low-flow domestic hot water devices to reduce overall hot water demand. Energy demand from domestic hot water heating systems can be reduced by reducing water usage in general. Faucet aerators can reduce hot water usage, relative to standard showerheads and aerators, which saves energy.

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. This reduces the amount of water used per day resulting in energy and water savings.

4.1.5 Plug Load Equipment Control - Vending Machines

Our recommendations for plug load equipment control measures are summarized in Figure 21 below.

Figure 21-Summary of Plug Load Equipment ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Plug Load Equipment Control - Vending Machine		1,612	0.0	0.0	\$231.39	\$230.00	\$0.00	\$230.00	1.0	1,623
ECM 6	Vending Machine Control	1,612	0.0	0.0	\$231.39	\$230.00	\$0.00	\$230.00	1.0	1,623

ECM 6: Vending Machine Control

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
1,612	0.0	0.0	\$231.39	\$230.00	\$0.00	\$230.00	1.0	1,623

Measure Description

Vending machines operate continuously, even during non-business hours. We recommend installing occupancy sensor controls to reduce the energy use. These controls power down vending machines when the vending machine area has been vacant for some time, then power up at regular intervals, as needed, to turn machine lights on or keep the product cool. Energy savings are a dependent on vending machine and activity level in the area surrounding the machines.

4.2 ECMs Evaluated But Not Recommended

The measures below have been evaluated by the auditor but are not recommended for implementation at the facility. Reasons for exclusion can be found in each measure description section.

Figure 22 – Summary of Measures Evaluated, But Not Recommended

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades	96	0.2	0.0	\$13.73	\$453.41	\$70.00	\$383.41	27.9	96
Retrofit Fluorescent Fixtures with LED Lamps and Drivers	96	0.2	0.0	\$13.73	\$453.41	\$70.00	\$383.41	27.9	96
Variable Frequency Drive (VFD) Measures	4,022	1.5	0.0	\$577.36	\$13,073.61	\$0.00	\$13,073.61	22.6	4,050
Install VFDs on Hot Water Pumps	4,022	1.5	0.0	\$577.36	\$13,073.61	\$0.00	\$13,073.61	22.6	4,050
Gas Heating (HVAC/Process) Replacement	0	0.0	88.9	\$800.34	\$75,760.26	\$4,500.00	\$71,260.26	89.0	10,408
Install High Efficiency Steam Boilers	0	0.0	88.9	\$800.34	\$75,760.26	\$4,500.00	\$71,260.26	89.0	10,408
Food Service Equipment & Refrigeration Measures	601	0.1	0.0	\$86.30	\$4,263.70	\$100.00	\$4,163.70	48.2	605
Replace Refrigeration Equipment	601	0.1	0.0	\$86.30	\$4,263.70	\$100.00	\$4,163.70	48.2	605
TOTALS	4,719	1.7	88.9	\$1,477.74	\$93,550.98	\$4,670.00	\$88,880.98	60.1	15,160

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	96	0.2	0.0	\$13.73	\$453.41	\$70.00	\$383.41	27.9	96
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

Measure Description

We generally recommend retrofitting existing fluorescent fixtures by removing fluorescent tubes and ballasts and replacing them with LEDs and LED drivers (if necessary), which are designed to be used retrofitted fluorescent fixtures. The measure uses the existing fixture housing but replaces the rest of the components with more efficient lighting technology. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tube.

Reasons for not Recommending

Retrofitting the few remaining T12 fluorescent fixtures with more efficient LED lamps and drivers will result in energy savings, however, the cost of installation will outweigh the energy saving advantages resulting in a very long payback. Still, the District may want to go through with the measure for the sake of uniformity if the rest of the fixtures are upgraded.

Install VFDs on Hot Water Pumps

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
4,022	1.5	0.0	\$577.36	\$13,073.61	\$0.00	\$13,073.61	22.6	4,050

Measure Description

We evaluated installing variable frequency drives (VFD) to control the hot water pumps. This measure requires that a majority of the hot water coils be served by 2-way valves and that a differential pressure sensor is installed in the hot water loop. As the hot water valves close, the differential pressure increases. The VFD modulates pump speed to maintain a differential pressure setpoint. Energy savings results from reducing pump motor speed (and power) as hot water valves close. The magnitude of energy savings is based on the estimated amount of time that the system will operate at reduced load.

Reasons for not Recommending

Installing VFD controls on existing hot water pumps will result in energy savings, however, the cost of installation will outweigh the energy saving advantages resulting in a very long payback. This makes the measure financially not viable therefore not recommended based on energy savings alone.

Install High Efficiency Steam Boilers

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	88.9	\$800.34	\$75,760.26	\$4,500.00	\$71,260.26	89.0	10,408

Measure Description

We recommend replacing older inefficient steam boilers with high efficiency steam boilers. Significant improvements have been made in combustion technology resulting in increases in overall boiler efficiency. Energy savings results from improved combustion efficiency and reduced standby losses at low loads.

Reasons for not Recommending

Replacing existing steam boilers with high efficiency steam boilers will result in energy savings, however, the cost of installation will outweigh the energy saving advantages resulting in a very long payback. This makes the measure financially not viable therefore not recommended based on energy savings alone.

Replace Refrigeration Equipment

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
601	0.1	0.0	\$86.30	\$4,263.70	\$100.00	\$4,163.70	48.2	605

Measure Description

We recommend replacing existing ice makers with new ENERGY STAR® high efficiency equipment. There have been many improvements in refrigeration system equipment, operation, and insulation. The energy savings associated with this measure come from reduced energy usage, due to more efficient technology, and reduced run times.

Reasons for not Recommending

Replacing existing refrigeration equipment with high efficiency refrigeration equipment will result in energy savings, however, the cost of installation will outweigh the energy saving advantages resulting in a very long payback. This makes the measure financially not viable therefore not recommended based on energy savings alone.

5 ENERGY EFFICIENT PRACTICES

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

Close Doors and Windows

Ensure doors and windows are closed in conditioned spaces. Leaving doors and windows open leads to a significant increase in heat transfer between conditioned spaces and the outside air. Reducing a facility's air changes per hour (ACH) can lead to increased occupant comfort as well as significant heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Perform Proper Lighting Maintenance

In order to sustain optimal lighting levels, lighting fixtures should undergo routine maintenance. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust on lamps, fixtures and reflective surfaces. Together, these factors can reduce total illumination by 20%-60% or more, while operating fixtures continue drawing full power. To limit this reduction, lamps, reflectors and diffusers should be thoroughly cleaned of dirt, dust, oil, and smoke film buildup approximately every 6-12 months.

Develop a Lighting Maintenance Schedule

In addition to routine fixture cleaning, development of a maintenance schedule can both ensure maintenance is performed regularly and can reduce the overall cost of fixture re-lamping and re-ballasting. By re-lamping and re-ballasting fixtures in groups, lighting levels are better maintained and the number of site visits by a lighting technician or contractor can be minimized, decreasing the overall cost of maintenance.

Perform Routine Motor Maintenance

Motors consist of many moving parts whose collective degradation can contribute to a significant loss of motor efficiency. In order to prevent damage to motor components, routine maintenance should be performed. This maintenance consists of cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Use Fans to Reduce Cooling Load

Utilizing ceiling fans to supplement cooling is a low cost strategy to reduce cooling load considerably. Thermostat settings can be increased by 4°F with no change in overall occupant comfort when the wind chill effect of moving air is employed for cooling.

Clean Evaporator/Condenser Coils on AC Systems

Dirty evaporators and condensers coils cause a restriction to air flow and restrict heat transfer. This results in increased evaporator and condenser fan load and a decrease in cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

Clean and/or Replace HVAC Filters

Air filters work to reduce the amount of indoor air pollution and increase occupant comfort. Over time, filters become less and less effective as particulate buildup increases. In addition to health concerns related to clogged filters, filters that have reached saturation also restrict air flow through the facility's air conditioning or heat pump system, increasing the load on the distribution fans and decreasing occupant comfort levels. Filters should be checked monthly and cleaned or replaced when appropriate.

Water Conservation

Installing low-flow faucets or faucet aerators, low-flow showerheads, and kitchen sink pre-rinse spray valves saves both energy and water. These devices save energy by reducing the overall amount of hot water used hence reducing the energy used to heat the water. The flow ratings for EPA WaterSense™ (<http://www3.epa.gov/watersense/products>) labeled devices are 1.5 gpm for bathroom faucets, 2.0 gpm for showerheads, and 1.28 gpm for pre-rinse spray valves.

Installing dual flush or low-flow toilets and low-flow or waterless urinals are additional ways to reduce the sites water use, however, these devices do not provide energy savings at the site level. Any reduction in water use does however ultimately reduce grid level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users. The EPA WaterSense™ ratings for urinals is 0.5 gpf and toilets that use as little as 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

Refer to Section 4.1.4 for any low-flow ECM recommendations.

6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey's Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State's electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility’s electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has a **High** potential for installing a PV array.

The amount of free area, ease of installation on roof, and the lack of shading elements contribute to the high potential for PV at this site. A PV array located on the roof of the main building near main parking lot may be feasible. If Littlebrook Elementary School is interested in pursuing the installation of PV, we recommended a full feasibility study be conducted.

Figure 23 - Photovoltaic Screening

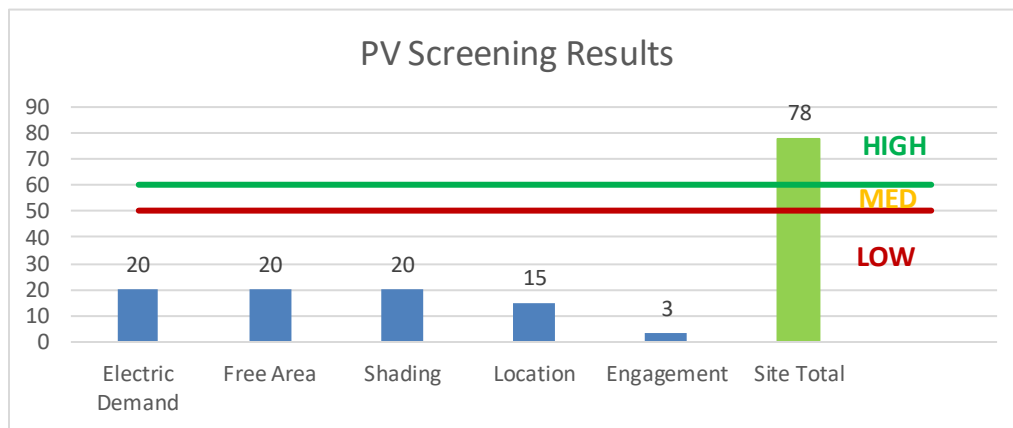

Potential	High	
System Potential	106	kW DC STC
Electric Generation	126,285	kWh/yr
Displaced Cost	\$10,990	/yr
Installed Cost	\$303,200	

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.


CHP systems are typically used to produce a portion of the electric power used onsite by a facility, with the balance of electric power needs supplied by grid purchases. The heat is used to supplement (or supplant) existing boilers for the purpose of space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for the purpose of space cooling. The key criteria used for screening, however, is the amount of time the system operates at full load and the facility's ability to use the recovered heat. Facilities with continuous use for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has a **Low** potential for installing a cost-effective CHP system.

The magnitude, type, and duration of the thermal demand, the coincident electric load, and the ease of interconnection contribute to the potential for CHP at the site. Based on the amount of steam used throughout the year and the concurrent electric demand a gas turbine/fuel cell may be feasible. If Littlebrook Elementary School is interested in pursuing the installation of CHP, we recommended a more detailed feasibility study be conducted.

For a list of qualified firms in New Jersey specializing in commercial CHP cost assessment and installation, go to: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/.

Figure 24 - Combined Heat and Power Screening

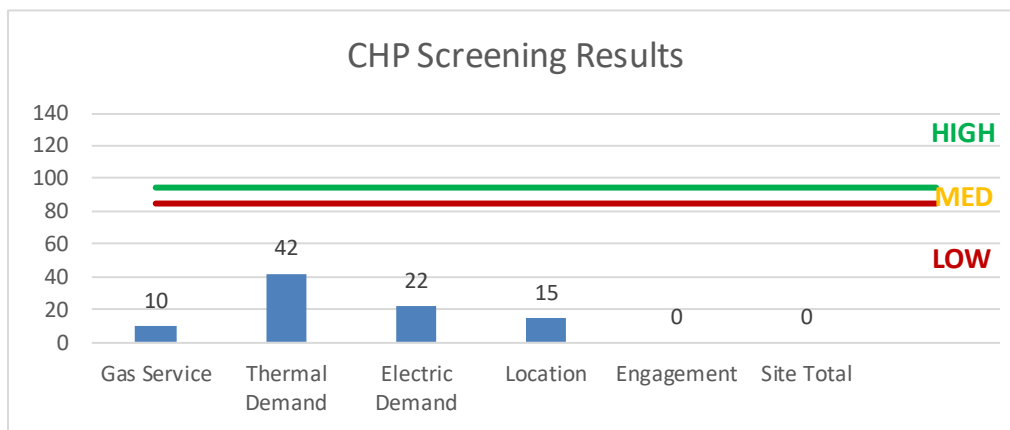

7 DEMAND RESPONSE

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

In our opinion, due to reduced summer operation hours this facility is not a good candidate for DR.

8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund, your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 25 for a list of the eligible programs identified for each recommended ECM.

Figure 25 - ECM Incentive Program Eligibility

Energy Conservation Measure		SmartStart Prescriptive	SmartStart Custom	Direct Install	Pay For Performance Existing Buildings	Large Energy Users Program	Combined Heat & Power and Fuel Cell
ECM 1	Install LED Fixtures	X		X			
ECM 2	Retrofit Fixtures with LED Lamps	X		X			
ECM 3	Install Occupancy Sensor Lighting Controls	X		X			
ECM 4	Install VFD on Variable Air Volume (VAV) HVAC	X		X			
ECM 5	Install Low-Flow Domestic Hot Water Devices			X			
ECM 6	Vending Machine Control	X		X			

SmartStart is generally well-suited for implementation of individual measures or small groups of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities that can bundle multiple ECMs together. This can greatly simplify participation and may lead to higher incentive amounts but requires the use of pre-approved contractors. The Pay for Performance (P4P) program is a “whole-building” energy improvement program designed for larger facilities. It requires implementation of multiple measures meeting minimum savings thresholds, as well as use of pre-approved consultants. The Large Energy Users Program (LEUP) is available to New Jersey’s largest energy users giving them flexibility to install as little or as many measures, in a single facility or several facilities, with incentives capped based on the entity’s annual energy consumption. LEUP applicants can use in-house staff or a preferred contractor.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: www.njcleanenergy.com/ci.

8.1 SmartStart

Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: www.njcleanenergy.com/SSB.

8.2 Direct Install

Overview

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

8.3 SREC Registration Program

The SREC (Solar Renewable Energy Certificate) Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SRP prior to the start of construction in order to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number which enables it to generate New Jersey SRECs. SRECs are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SRECs to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar RPS. One way they can meet the RPS requirements is by purchasing SRECs. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period can and will fluctuate depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.

8.4 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program description and application can be found at: www.njcleanenergy.com/ESIP.

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third-party (i.e., non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility is purchasing electricity from a third-party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third-party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility is purchasing natural gas from a third-party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third-party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

Appendix A: Equipment Inventory & Recommendations

Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
EXTERIOR	5	Metal Halide: (1) 150W Lamp	High/Low Control	190	2,002	Fixture Replacement	No	5	LED - Fixtures: Low-Bay	High/Low Control	45	2,002	0.48	1,669	0.0	\$239.61	\$3,127.36	\$750.00	9.92
EXTERIOR	1	Mercury Vapor: (1) 400W Lamp	High/Low Control	455	2,002	Fixture Replacement	No	1	LED - Fixtures: Low-Bay	High/Low Control	120	2,002	0.22	771	0.0	\$110.72	\$625.47	\$150.00	4.29
OFFICE 7	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	2,860	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,860	0.04	184	0.0	\$26.44	\$73.03	\$20.00	2.01
38B BOYS BATHROOM	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	2,860	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,002	0.14	724	0.0	\$103.97	\$489.09	\$95.00	3.79
38A GIRLS BATHROOM	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	2,860	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,002	0.14	724	0.0	\$103.97	\$489.09	\$95.00	3.79
CAFETERIA	8	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	114	2,002	Relamp	No	8	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,002	0.29	1,031	0.0	\$148.07	\$584.24	\$160.00	2.87
ROOM 28	18	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	2,860	Relamp	Yes	18	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,002	0.87	4,345	0.0	\$623.80	\$1,854.54	\$430.00	2.28
HALLWAY	47	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	2,860	Relamp	Yes	47	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,002	2.26	11,346	0.0	\$1,628.81	\$3,972.41	\$940.00	1.86
ROOM 54B	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,860	0.03	163	0.0	\$23.37	\$54.77	\$15.00	1.70
ROOM 54A	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,860	0.03	163	0.0	\$23.37	\$54.77	\$15.00	1.70
ROOM 48C	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,860	0.03	163	0.0	\$23.37	\$54.77	\$15.00	1.70
ROOM 48B	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,860	0.03	163	0.0	\$23.37	\$54.77	\$15.00	1.70
ROOM 48A	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,860	0.03	163	0.0	\$23.37	\$54.77	\$15.00	1.70
ROOM 3 BATHROOM	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	360	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	360	0.03	20	0.0	\$2.94	\$54.77	\$15.00	13.52
ROOM 26	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,860	0.03	163	0.0	\$23.37	\$54.77	\$15.00	1.70
5D BATHROOM	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	360	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	360	0.03	20	0.0	\$2.94	\$54.77	\$15.00	13.52
5C BATHROOM	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	360	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	360	0.03	20	0.0	\$2.94	\$54.77	\$15.00	13.52
ROOM 48D	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 46 STORAGE	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	360	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	252	0.08	52	0.0	\$7.43	\$225.55	\$30.00	26.30
ROOM 46	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 44	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 43E	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 43D	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 43C	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 43B	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
ROOM 43A	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 42	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 40	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 22 STORAGE	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	360	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	252	0.08	52	0.0	\$7.43	\$379.55	\$30.00	47.01
50B BOYS BATHROOM	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
50A GIRLS BATHROOM	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 24	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.12	617	0.0	\$88.60	\$434.32	\$80.00	4.00
ROOM 1B	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.16	823	0.0	\$118.13	\$489.09	\$95.00	3.34
ROOM 1A	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.16	823	0.0	\$118.13	\$489.09	\$95.00	3.34
CAFETERIA	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	2,002	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.13	456	0.0	\$65.44	\$219.09	\$60.00	2.43
ROOM 47	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.25	1,234	0.0	\$177.20	\$598.64	\$125.00	2.67
ROOM 45	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.25	1,234	0.0	\$177.20	\$598.64	\$125.00	2.67
ROOM 37	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.25	1,234	0.0	\$177.20	\$598.64	\$125.00	2.67
ROOM 25	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.25	1,234	0.0	\$177.20	\$598.64	\$125.00	2.67
ROOM 19	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.25	1,234	0.0	\$177.20	\$598.64	\$125.00	2.67
ROOM 14	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.25	1,234	0.0	\$177.20	\$598.64	\$125.00	2.67
ROOM 29	7	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	7	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.29	1,440	0.0	\$206.73	\$653.41	\$140.00	2.48
ROOM 15	7	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	7	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.29	1,440	0.0	\$206.73	\$653.41	\$140.00	2.48
ROOM 9	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	360	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	252	0.33	207	0.0	\$29.74	\$708.18	\$155.00	18.60
ROOM 8	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$390.00	\$155.00	0.99
ROOM 41	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 39	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 35	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 34	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 33	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34

Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
ROOM 32	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 31	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 30	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 3	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 28	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 13	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 12	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 11	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 10	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.33	1,646	0.0	\$236.26	\$708.18	\$155.00	2.34
ROOM 22	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.49	2,469	0.0	\$354.39	\$1,197.27	\$250.00	2.67
ROOM 1	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.49	2,469	0.0	\$354.39	\$1,197.27	\$250.00	2.67
ROOM 27	13	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	13	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.53	2,674	0.0	\$383.93	\$1,252.04	\$265.00	2.57
ROOM 23	13	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	13	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.53	2,674	0.0	\$383.93	\$1,252.04	\$265.00	2.57
ROOM 2	22	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	22	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.90	4,526	0.0	\$649.72	\$1,745.00	\$400.00	2.07
ROOM 17	23	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	23	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.94	4,732	0.0	\$679.25	\$1,799.77	\$415.00	2.04
ROOM 16	23	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	23	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.94	4,732	0.0	\$679.25	\$1,799.77	\$415.00	2.04
HALLWAY	24	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,860	Relamp	Yes	24	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,002	0.98	4,937	0.0	\$708.79	\$1,854.54	\$430.00	2.01
ROOM 56	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,860	0.02	109	0.0	\$15.58	\$36.52	\$10.00	1.70
ROOM 50	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	360	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	360	0.02	14	0.0	\$1.96	\$36.52	\$10.00	13.52
ROOM 4	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,860	0.02	109	0.0	\$15.58	\$36.52	\$10.00	1.70
OFFICE 7	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,860	0.02	109	0.0	\$15.58	\$36.52	\$10.00	1.70
FURNACE ROOM	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	360	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	360	0.02	14	0.0	\$1.96	\$36.52	\$10.00	13.52
ROOM 9	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.05	274	0.0	\$39.38	\$189.03	\$40.00	3.78
ROOM 11	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.05	274	0.0	\$39.38	\$189.03	\$40.00	3.78
ROOM 51	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
5B BOYS BATHROOM	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
5A GIRLS BATHROOM	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.08	411	0.0	\$59.07	\$379.55	\$65.00	5.33
ROOM 49	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.11	549	0.0	\$78.75	\$416.06	\$75.00	4.33
ROOM 2B	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.11	549	0.0	\$78.75	\$416.06	\$75.00	4.33
ROOM 2A	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.11	549	0.0	\$78.75	\$416.06	\$75.00	4.33
AUDITORIUM STAGE	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.11	549	0.0	\$78.75	\$416.06	\$75.00	4.33
ROOM 37	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.16	823	0.0	\$118.13	\$489.09	\$95.00	3.34
ROOM 14	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.16	823	0.0	\$118.13	\$489.09	\$95.00	3.34
ROOM 41	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 39	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 35	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 34	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 33	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 32	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 31	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 30	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 28	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 13	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
ROOM 10	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.22	1,097	0.0	\$157.51	\$562.12	\$115.00	2.84
BOILER ROOM	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	360	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	252	0.27	173	0.0	\$24.78	\$635.15	\$135.00	20.18
ROOM 8	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.33	1,646	0.0	\$236.26	\$978.18	\$190.00	3.34
ROOM 57C	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.33	1,646	0.0	\$236.26	\$978.18	\$190.00	3.34
ROOM 15	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.33	1,646	0.0	\$236.26	\$978.18	\$190.00	3.34
ROOM 12	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,860	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.33	1,646	0.0	\$236.26	\$978.18	\$190.00	3.34
CAFETERIA	32	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	2,002	Relamp	No	32	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,002	0.69	2,431	0.0	\$349.01	\$1,168.48	\$320.00	2.43

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BOILER ROOM	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	360	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	360	0.01	7	0.0	\$1.04	\$18.26	\$5.00	12.75
57C TOILET	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	360	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	360	0.01	7	0.0	\$1.04	\$18.26	\$5.00	12.75
ROOM 9A TOILET	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	360	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	360	0.02	14	0.0	\$1.96	\$64.77	\$10.00	27.93
ROOM 23 TOILET	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	360	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	360	0.02	14	0.0	\$1.96	\$64.77	\$10.00	27.93
ROOM 17A TOILET	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	360	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	360	0.02	14	0.0	\$1.96	\$64.77	\$10.00	27.93
ROOM 16	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	360	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	360	0.02	14	0.0	\$1.96	\$64.77	\$10.00	27.93
ROOM 15A TOILET	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	360	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	360	0.02	14	0.0	\$1.96	\$64.77	\$10.00	27.93
ROOM 13A TOILET	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	360	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	360	0.02	14	0.0	\$1.96	\$64.77	\$10.00	27.93
ROOM 11A TOILET	1	Linear Fluorescent - T12: 2' T12 (20W) - 2L	Wall Switch	50	360	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	360	0.02	14	0.0	\$1.96	\$64.77	\$10.00	27.93
EXTERIOR	10	LED - Fixtures: Outdoor Porch Wall Mount	High/Low Control	18	2,002	None	No	10	LED - Fixtures: Outdoor Porch Wall Mount	High/Low Control	18	2,002	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOM 38	1	Incandescent: 1 BULB	Wall Switch	60	360	Relamp	No	1	LED Screw-In Lamps: LED Lamp (9W) - 1L	Wall Switch	9	360	0.03	21	0.0	\$3.03	\$17.23	\$5.00	4.03
HALLWAY	4	Incandescent: 1 BULB	Wall Switch	60	2,860	Relamp	Yes	4	LED Screw-In Lamps: LED Lamp (9W) - 1L	Occupancy Sensor	9	2,002	0.14	706	0.0	\$101.42	\$338.90	\$55.00	2.80
AUDITORIUM STAGE	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
BOILER ROOM	3	Exit Signs: LED - 2 W Lamp	None	6	360	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	360	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
48 GYM	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
CAFETERIA	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
HALLWAY	11	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	11	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOM 6	1	Compact Fluorescent: CFL 2 PIN	Wall Switch	42	2,860	Relamp	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	29	2,860	0.01	41	0.0	\$5.95	\$36.52	\$0.00	6.14
ROOM 5	1	Compact Fluorescent: CFL 2 PIN	Wall Switch	42	2,860	Relamp	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	29	2,860	0.01	41	0.0	\$5.95	\$36.52	\$0.00	6.14
ROOM 21	1	Compact Fluorescent: CFL 2 PIN	Wall Switch	42	2,860	Relamp	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	29	2,860	0.01	41	0.0	\$5.95	\$36.52	\$0.00	6.14
57C CLOSET	1	Compact Fluorescent: CFL 2 PIN	Wall Switch	42	360	Relamp	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	29	360	0.01	5	0.0	\$0.75	\$36.52	\$0.00	48.77
HALLWAY	9	Compact Fluorescent: CFL 2 PIN	Wall Switch	42	2,860	Relamp	Yes	9	LED - Fixtures: Ceiling Mount	Occupancy Sensor	13	2,002	0.20	982	0.0	\$140.99	\$762.93	\$0.00	5.41
48 GYM	12	Compact Fluorescent: BIG E SPIRAL BULBS	Occupancy Sensor	150	2,002	Relamp	No	12	LED - Fixtures: Decorative: Other	Occupancy Sensor	105	2,002	0.35	1,243	0.0	\$178.47	\$438.24	\$0.00	2.46
EXTERIOR	16	Compact Fluorescent: 4 PIN CFL	High/Low Control	26	2,002	Relamp	No	16	LED - Fixtures: Close to Ceiling Mount	High/Low Control	18	2,002	0.08	287	0.0	\$41.25	\$584.32	\$0.00	14.17
EXTERIOR	2	Compact Fluorescent: 2 PIN CFL	High/Low Control	13	2,002	Relamp	No	2	LED - Fixtures: Close to Ceiling Mount	High/Low Control	4	2,002	0.01	42	0.0	\$6.02	\$73.04	\$0.00	12.14

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BOILER ROOM	BOILER HOT WATER	1	Heating Hot Water Pump	10.0	91.7%	No	960	No	91.7%	Yes	1	1.23	3,397	0.0	\$487.69	\$3,807.95	\$0.00	7.81
BOILER ROOM	BOILER HEATING SUPPLY/RETURN	1	Heating Hot Water Pump	2.0	80.0%	No	770	No	80.0%	Yes	1	0.28	625	0.0	\$89.68	\$2,728.85	\$0.00	30.43
BOILER ROOM	AIR COMPRESSOR	1	Air Compressor	0.5	78.2%	No	1,400	No	78.2%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	HOT WATER HEATER	1	Water Supply Pump	0.1	69.5%	No	1,400	No	69.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	AHU-1	3	Supply Fan	7.5	89.5%	No	960	No	89.5%	Yes	3	6.30	6,414	0.0	\$920.74	\$10,820.40	\$3,487.50	7.96
ROOF	RTU-4	1	Supply Fan	0.3	73.4%	No	960	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-4	1	Return Fan	0.2	69.5%	No	960	No	69.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-1,2,3,5,6	5	Supply Fan	0.8	81.1%	No	960	No	81.1%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-1,2,3,5,6	5	Return Fan	0.5	78.2%	No	960	No	78.2%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	HV-1,2	2	Supply Fan	3.0	86.9%	No	770	No	86.9%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	HV-1,2	2	Return Fan	1.5	86.5%	No	770	No	86.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	EXHAUST FAN	25	Exhaust Fan	0.3	73.4%	No	960	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	ACCU 2,3	2	Supply Fan	0.1	69.5%	No	960	No	69.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	ACCU 4	1	Supply Fan	0.3	73.4%	No	960	No	73.4%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	ACCU 4	1	Supply Fan	0.1	69.5%	No	960	No	69.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	CONDENSING UNIT	1	Supply Fan	0.1	69.5%	No	960	No	69.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
BOILER ROOM	BOILER	1	Other	1.0	83.5%	No	770	No	83.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
BOILER ROOM	BOILER	1	Other	0.5	78.2%	No	770	No	78.2%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
BOILER ROOM	BOILER HOT WATER	1	Heating Hot Water Pump	10.0	91.7%	No	0	No	91.7%	Yes	1	0.00	0	0.0	\$0.00	\$3,807.95	\$0.00	0.00
BOILER ROOM	BOILER HEATING SUPPLY/RETURN	1	Heating Hot Water Pump	2.0	80.0%	No	0	No	80.0%	Yes	1	0.00	0	0.0	\$0.00	\$2,728.85	\$0.00	0.00

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BOILER ROOM	AIR COMPRESSOR	1	Air Compressor	0.5	78.2%	No	0	No	78.2%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
BOILER ROOM	BOILER	1	Other	1.0	83.5%	No	0	No	83.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
BOILER ROOM	BOILER	1	Other	0.5	78.2%	No	0	No	78.2%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions									Energy Impact & Financial Analysis							
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
SCHOOL GENERAL	CLASSROOMS	29	Window AC	1.80		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
SCHOOL GENERAL	TEACHER'S OFFICES	2	Ductless Mini-Split AC	0.75		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
SCHOOL GENERAL	CLASSROOMS	3	Split-System AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
SCHOOL GENERAL	CLASSROOMS	1	Split-System AC	3.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-1	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-2	1	Packaged AC	2.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	HV-1	1	Packaged AC	5.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	HV-2	1	Packaged AC	5.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	ACCU 2	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	ACCU 3	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	ACCU 4	1	Packaged AC	3.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

		Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis							
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
ROOF	CONDENSING UNIT	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-3	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-4	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-5	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
ROOF	RTU-6	1	Packaged AC	1.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Fuel Heating Inventory & Recommendations

		Existing Conditions			Proposed Conditions						Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BOILER ROOM	SCHOOL GENERAL	1	Natural Draft Steam Boiler	1,875.00	Yes	1	Forced Draft Steam Boiler	1,875.00	81.00%	Et	0.00	0	44.4	\$400.17	\$37,880.13	\$2,250.00	89.04
BOILER ROOM	SCHOOL GENERAL	1	Natural Draft Steam Boiler	1,875.00	Yes	1	Forced Draft Steam Boiler	1,875.00	81.00%	Et	0.00	0	44.4	\$400.17	\$37,880.13	\$2,250.00	89.04

DHW Inventory & Recommendations

		Existing Conditions		Proposed Conditions						Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
BOILER ROOM	KITCHEN	1	Storage Tank Water Heater (> 50 Gal)	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Low-Flow Device Recommendations

Recommendation Inputs					Energy Impact & Financial Analysis						
Location	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
RESTROOMS	15	Faucet Aerator (Lavatory)	2.20	1.00	0.00	0	21.9	\$197.44	\$107.55	\$0.00	0.54
RESTROOMS	17	Faucet Aerator (Lavatory)	3.50	1.00	0.00	0	51.8	\$466.18	\$121.89	\$0.00	0.26

Commercial Refrigerator/Freezer Inventory & Recommendations

Existing Conditions				Proposed Condi	Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	ENERGY STAR Qualified?	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
KITCHEN	2	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
KITCHEN	1	Freezer Chest	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
KITCHEN	1	Stand-Up Freezer, Solid Door (31 - 50 cu. ft.)	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Commercial Ice Maker Inventory & Recommendations

Existing Conditions				Proposed Condi	Energy Impact & Financial Analysis						
Location	Quantity	Ice Maker Type	ENERGY STAR Qualified?	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
KITCHEN	1	Ice Making Head (<450 lbs/day), Batch	No	Yes	0.07	601	0.0	\$86.30	\$4,263.70	\$100.00	48.25

Cooking Equipment Inventory & Recommendations

Location	Existing Conditions			Proposed Conditions	Energy Impact & Financial Analysis						
	Quantity	Equipment Type	High Efficiency Equipment?	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
KITCHEN	1	Insulated Food Holding Cabinet (1/2 Size)	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
KITCHEN	1	Gas Rack Oven (Double)	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Dishwasher Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions	Energy Impact & Financial Analysis						
	Quantity	Dishwasher Type	Water Heater Fuel Type	Booster Heater Fuel Type	ENERGY STAR Qualified?	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Payback w/ Incentives in Years
KITCHEN	1	Single Tank Conveyor (High Temp)	Natural Gas	N/A	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00


Plug Load Inventory


Existing Conditions				
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
CLASSROOMS	37	COMPUTERS	100.0	No
CLASSROOMS	40	SMALL PRINTERS	45.0	Yes
STAFF ROOM	5	SMALL REFRIGERATOR	54.0	Yes
STAFF ROOM	6	MICROWAVE	800.0	Yes
CLASSROOMS	11	TABLE FAN	70.0	Yes
CLASSROOMS	30	PROJECTOR	200.0	Yes
CLASSROOMS	48	CEILING FAN	80.0	Yes
COMPUTER LAB	6	MEDIUM PRINTERS	80.0	Yes
COPY ROOM	6	LARGE PRINTERS	1,100.0	Yes
COPY ROOM	1	PAPER SHREDDER	80.0	Yes
MUSIC ROOMS	5	TV	250.0	No
CLASSROOMS	7	DVD SYSTEM	50.0	No
STAFF KITCHEN	2	TOASTER OVEN	1,200.0	No
STAFF KITCHEN	3	COFFEE MAKER	800.0	Yes
STAFF KITCHEN	2	LARGE REFRIGERATOR	300.0	Yes

Vending Machine Inventory & Recommendations

Existing Conditions		Proposed Conditions	Energy Impact & Financial Analysis							
Location	Quantity	Vending Machine Type	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
CAFETERIA	1	Refrigerated	Yes	0.00	1,612	0.0	\$231.39	\$230.00	\$0.00	0.99

Appendix B: ENERGY STAR® Statement of Energy Performance


ENERGY STAR® Statement of Energy Performance



LEARN MORE AT
energystar.gov

79

ENERGY STAR®
Score¹

Littlebrook Elementary School

Primary Property Type: K-12 School
Gross Floor Area (ft²): 54,628
Built: 1957

For Year Ending: July 31, 2017
Date Generated: September 20, 2018

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address Littlebrook Elementary School 39 Magnolia Lane, Princeton, New Jersey 08540	Property Owner _____ () - _____	Primary Contact _____ () - _____
Property ID: 6549873		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 28.7 kBtu/ft ²	Annual Energy by Fuel	National Median Comparison	
	Electric - Grid (kBtu) 1,206,602 (81%)	National Median Site EUI (kBtu/ft ²)	40.1
	Natural Gas (kBtu) 301,392 (19%)	National Median Source EUI (kBtu/ft ²)	98.7
		% Diff from National Median Source EUI	-28%
Source EUI 70.7 kBtu/ft ²		Annual Emissions	
		Greenhouse Gas Emissions (Metric Tons CO ₂ e/year)	144

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

() - _____

Professional Engineer Stamp
(if applicable)