



# Local Government Energy Audit: Energy Audit Report



Copyright ©2016 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

## **Long Branch Higher Education Center**

**Brookdale Community College**  
Broadway & 3rd Avenue  
Long Branch, NJ 07740

**March 27, 2018**

**Final Report by:  
TRC Energy Services**

## Disclaimer

---

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

# Table of Contents

---

<b>1</b>	<b>Executive Summary.....</b>	<b>1</b>
1.1	Facility Summary .....	1
1.2	Your Cost Reduction Opportunities.....	1
	Energy Conservation Measures.....	1
	Energy Efficient Practices .....	3
	On-Site Generation Measures.....	3
1.3	Implementation Planning.....	3
<b>2</b>	<b>Facility Information and Existing Conditions .....</b>	<b>5</b>
2.1	Project Contacts .....	5
2.2	General Site Information.....	5
2.3	Building Occupancy .....	5
2.4	Building Envelope .....	5
2.5	On-Site Generation.....	6
2.6	Energy-Using Systems .....	6
	Lighting System .....	6
	Hot Water Heating System & Direct Expansion Air Conditioning System (DX).....	7
	Domestic Hot Water Heating System.....	8
	Building Plug Load .....	8
2.7	Water-Using Systems .....	8
<b>3</b>	<b>Site Energy Use and Costs.....</b>	<b>9</b>
3.1	Total Cost of Energy .....	9
3.2	Electricity Usage .....	10
3.3	Natural Gas Usage .....	11
3.4	Benchmarking.....	12
3.5	Energy End-Use Breakdown .....	13
<b>4</b>	<b>Energy Conservation Measures .....</b>	<b>14</b>
4.1	Recommended ECMs .....	14
4.1.1	Lighting Upgrades.....	15
	ECM 1: Install LED Fixtures .....	15
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	15
	ECM 3: Retrofit Fixtures with LED Lamps.....	16
	ECM 4: Install LED Exit Signs.....	16
4.1.2	Lighting Control Measures .....	17
	ECM 5: Install Occupancy Sensor Lighting Controls .....	17
4.1.3	Plug Load Equipment Control - Vending Machines.....	17
	ECM 6: Vending Machine Control .....	17
<b>5</b>	<b>Energy Efficient Practices .....</b>	<b>18</b>
	Reduce Air Leakage .....	18
	Use Window Treatments/Coverings .....	18

Perform Proper Lighting Maintenance.....	18
Develop a Lighting Maintenance Schedule .....	18
Practice Proper Use of Thermostat Schedules and Temperature Resets .....	18
Perform Proper Water Heater Maintenance .....	19
<b>6 On-Site Generation Measures .....</b>	<b>20</b>
6.1 Photovoltaic.....	20
6.2 Combined Heat and Power .....	21
<b>7 Demand Response .....</b>	<b>22</b>
<b>8 Project Funding / Incentives .....</b>	<b>23</b>
8.1 SmartStart .....	24
8.2 Direct Install .....	25
8.3 Energy Savings Improvement Program .....	26
8.4 Demand Response Energy Aggregator .....	27
<b>9 Energy Purchasing and Procurement Strategies .....</b>	<b>28</b>
9.1 Retail Electric Supply Options.....	28
9.2 Retail Natural Gas Supply Options .....	28

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

## Table of Figures

---

Figure 1 – Previous 12 Month Utility Costs.....	2
Figure 2 – Potential Post-Implementation Costs .....	2
Figure 3 – Summary of Energy Reduction Opportunities .....	2
Figure 4 – Project Contacts .....	5
Figure 5 - Building Schedule.....	5
Figure 6 - Utility Summary .....	9
Figure 7 - Energy Cost Breakdown .....	9
Figure 8 -Electric Usage & Demand .....	10
Figure 9 -Electric Usage & Demand .....	10
Figure 10 -Natural Gas Usage .....	11
Figure 11 -Natural Gas Usage .....	11
Figure 12 - Energy Use Intensity Comparison – Existing Conditions.....	12
Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures .....	12
Figure 14 - Energy Balance (kBtu/SF,%).....	13
Figure 15 – Summary of Recommended ECMs.....	14
Figure 16 – Summary of Lighting Upgrade ECMs.....	15
Figure 17 – Summary of Lighting Control ECMs .....	17
Figure 18 - Photovoltaic Screening .....	20
Figure 19 - ECM Incentive Program Eligibility.....	23

# I EXECUTIVE SUMMARY

---

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for Long Branch Higher Education Center.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC, as part of a comprehensive effort to assist colleges and universities in New Jersey in controlling their energy costs and help protect our environment by reducing energy demand statewide.

## I.1 Facility Summary

The Long Branch Higher Education Center (HEC) is a 21,000 square-foot facility, which is comprised predominantly of classrooms and office spaces. It is an academic building with two floors and a sub-basement mechanical space. The building is occupied year-round at varying intensities depending on the classes being held.

The heating and cooling at the Long Branch HEC uses six rooftop packaged units with DX cooling and direct gas-fired heating. The lighting at the facility, consisting of mostly T8 fixtures, are inefficient and need replacement.

A thorough description of the facility and our observations are located in Section 2.

## I.2 Your Cost Reduction Opportunities

### Energy Conservation Measures

TRC recommends six measures which together represent an opportunity for Long Branch HEC to reduce its annual energy costs by \$8,360 and its annual greenhouse gas emissions by 62,584 lbs CO<sub>2</sub>e. We estimate that if all measures were implemented as recommended, the project would pay for itself in energy savings in 3.1 years. The breakdown of existing and potential utility costs, after project implementation, are illustrated in Figure 1 and Figure 2, respectively. Together these measures represent an opportunity to reduce Long Branch HEC's annual energy usage by 10%.

Figure 1 – Previous 12 Month Utility Costs


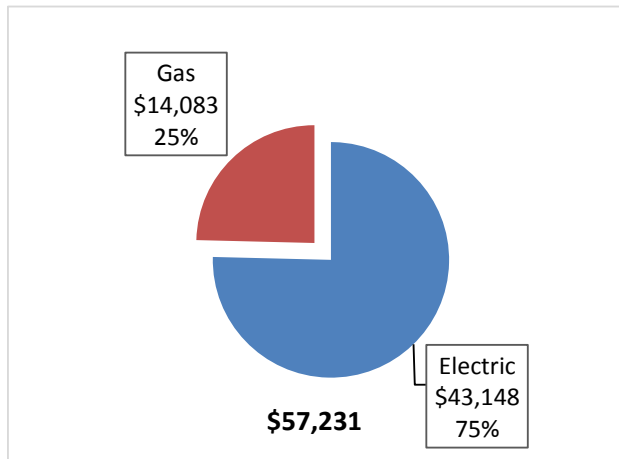


Figure 2 – Potential Post-Implementation Costs

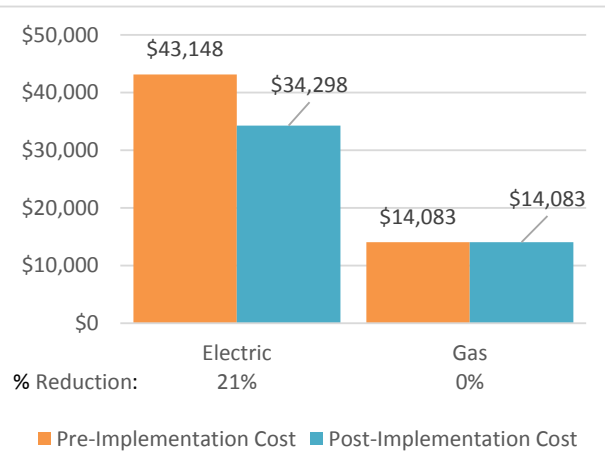

A detailed description of Long Branch HEC’s existing energy use can be found in Section 3.

Estimates of installed costs, energy savings, and financial incentives for each of the proposed energy efficient upgrades are summarized below in Figure 3. A brief description of each ECM category is provided below. A more complete description of each savings opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

Energy Conservation Measure		Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>55,171</b>	<b>11.1</b>	<b>\$7,421.31</b>	<b>\$27,116.83</b>	<b>\$4,205.00</b>	<b>\$22,911.83</b>	<b>3.1</b>	<b>55,557</b>
ECM 1	Install LED Fixtures	Yes	5,395	0.8	\$725.66	\$4,297.45	\$1,100.00	\$3,197.45	4.4	5,432
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	5,564	1.1	\$748.41	\$2,052.04	\$0.00	\$2,052.04	2.7	5,603
ECM 3	Retrofit Fixtures with LED Lamps	Yes	36,261	8.6	\$4,877.70	\$18,508.69	\$3,105.00	\$15,403.69	3.2	36,515
ECM 4	Install LED Exit Signs	Yes	7,951	0.6	\$1,069.53	\$2,258.66	\$0.00	\$2,258.66	2.1	8,007
<b>Lighting Control Measures</b>			<b>3,413</b>	<b>1.1</b>	<b>\$459.03</b>	<b>\$2,900.00</b>	<b>\$500.00</b>	<b>\$2,400.00</b>	<b>5.2</b>	<b>3,436</b>
ECM 5	Install Occupancy Sensor Lighting Controls	Yes	3,413	1.1	\$459.03	\$2,900.00	\$500.00	\$2,400.00	5.2	3,436
<b>Plug Load Equipment Control - Vending Machine</b>			<b>3,566</b>	<b>0.0</b>	<b>\$479.71</b>	<b>\$690.00</b>	<b>\$0.00</b>	<b>\$690.00</b>	<b>1.4</b>	<b>3,591</b>
ECM 6	Vending Machine Control	Yes	3,566	0.0	\$479.71	\$690.00	\$0.00	\$690.00	1.4	3,591
<b>TOTALS</b>			<b>62,149</b>	<b>12.2</b>	<b>\$8,360.05</b>	<b>\$30,706.83</b>	<b>\$4,705.00</b>	<b>\$26,001.83</b>	<b>3.1</b>	<b>62,584</b>

\* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

**Lighting Upgrades** generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measures save energy by reducing the power used by the lighting components due to improved electrical efficiency.

**Lighting Controls** measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

**Domestic Hot Water** upgrade measures generally involve replacing older inefficient domestic water heating systems with modern energy efficient systems. New domestic hot water heating systems can provide equivalent, or greater, water heating capacity compared to older systems at a reduced energy

cost. These measures save energy by reducing the fuel used for domestic hot water heating due to improved heating efficiency or reduction in hot water demand.

**Plug Load Equipment** control measures generally involve installing automated devices that limit the power usage or operation of equipment that is plugged into an electric outlet when not in use.

### **Energy Efficient Practices**

TRC also identified seven low cost (or no cost) energy efficient practices. A facility's energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. Potential opportunities identified at Long Branch HEC include:

- Reduce Air Leakage
- Use Window Treatments/Coverings
- Perform Proper Lighting Maintenance
- Develop a Lighting Maintenance Schedule
- Practice Proper Use of Thermostat Schedules and Temperature Resets
- Perform Proper Water Heater Maintenance
- Water Conservation

For details on these energy efficient practices, please refer to Section 5.

### **On-Site Generation Measures**

TRC evaluated the potential for installing on-site generation for Long Branch HEC. Based on the configuration of the site and its electric load there appears to be a low potential for installing any PV or combined heat and power (CHP) self-generation measures.

Details on our evaluation of on-site generation potential are provided in Section 6.

## **I.3 Implementation Planning**

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Direct Install
- Energy Savings Improvement Program (ESIP)
- Demand Response Energy Aggregator



For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program, you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 8.

This facility may also qualify for the Direct Install program which can provide turnkey installation of multiple measures, through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures, although measure eligibility will have to be assessed and be verified by the designated Direct Install contractor and, in most cases, they will perform the installation work.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.3 for additional information on the ESIP Program.

The Demand Response Energy Aggregator is a (non-NJCEP) program designed to reduce electric loads at commercial facilities, when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. Demand Response (DR) service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability. By enabling grid operators to call upon commercial facilities to reduce their electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and facilities receive payments whether or not they are called upon to curtail their load during times of peak demand. Refer to Section 7 for additional information on this program.

Additional information on relevant incentive programs is located in Section 8 or: [www.njcleanenergy.com/ci](http://www.njcleanenergy.com/ci).

## 2 FACILITY INFORMATION AND EXISTING CONDITIONS

### 2.1 Project Contacts

Figure 4 – Project Contacts

Name	Role	E-Mail	Phone #
<b>Customer</b>			
Timothy Drury	Director of facilities Management and Construction	tdrury@brookdalecc.edu	(732) 224-2217
<b>TRC Energy Services</b>			
Smruti Srinivasan	Auditor	ssrinivasan@trcsolutions.com	(732) 855-0033

### 2.2 General Site Information

On December 14, 2016, TRC performed an energy audit at Long Branch Higher Education Center (HEC) located in Long Branch, New Jersey. TRC’s team met with Nathaniel Stokes to review the facility operations and help focus our investigation on specific energy-using systems.

Long Branch HEC is a 21,000 square-foot facility, which is comprised predominantly of classrooms and office spaces. It is an academic building with two floors and a sub-basement mechanical space. The building was constructed in 1981.

### 2.3 Building Occupancy

The building is open Monday through Friday from 7:30 AM to 10:00 PM. The typical schedule is presented in the table below. During a typical day, the facility is occupied by approximately 325 people including staff and students.

Figure 5 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
Long Branch Higher Education Center	Weekday	Monday - Thursday: 7:30AM - 10PM Friday: 7:30AM - 5PM
Long Branch Higher Education Center	Weekend	Saturday: 7:30AM - 3PM Sunday: No Operation

### 2.4 Building Envelope

Both buildings are constructed of concrete block, and structural steel with a brick facade. The buildings have partly pitched and flat roof covered with PVC ply membrane. The buildings have single pane windows which were found to be in poor condition. We observed signs of excessive infiltration in a few rooms. The exterior doors are constructed of aluminum framed double pane glass and appeared to be in fair condition.



*Image 1: Building envelope*

## 2.5 On-Site Generation

Long Branch HEC does not have any on-site electric generating equipment.

## 2.6 Energy-Using Systems

Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment

### Lighting System

Lighting at the facility is provided mostly by 32-Watt linear fluorescent T8 lamps, with electronic ballasts as well as some compact fluorescent lamps (CFL) and incandescent lamps. Most of the linear fluorescent fixtures are 2-lamp fixtures, although a few have 3 lamps.

A small area of the building is primarily lit with 26-Watt CFL lamps or 60-Watt incandescent lamps. There was limited access to the exit signs, however the site contact reported that they contain incandescent lamps.

Lighting control in most spaces is provided by wall switches. The building’s exterior lighting is minimal and consists primarily of high pressure sodium (HPS) fixtures and a few incandescent fixtures, which are controlled by timers.



*Image 2: Some examples of typical light fixtures at the facility*

### **Hot Water Heating System & Direct Expansion Air Conditioning System (DX)**

The Long Branch HEC building is heated and cooled by six packaged roof-top units.

The building is cooled by four 8.5-ton and two 40-ton direct expansion (DX) packaged air conditioning units. The same rooftop units also contain gas-fired furnaces, which provide heat to each zone. The furnace portion of the units have output capacities of 224 MBH and 300 MBH respectively.

The temperature control and setpoints for this campus are set and controlled by the main campus at Lincroft.

A dedicated mini-split AC unit, with a capacity of 0.75 tons, provides supplemental cooling to the server room.



*Image 3 (Left): Min-split AC unit in the server closet | (Right): Temperature controls*



## Domestic Hot Water Heating System

Domestic hot water is provided by two electric hot water heaters (A.O. Smith and Bradford & White) with 20-gallon and 50-gallon storage tank capacities respectively. They each have input capacity of 9kW. Both water heaters are five (5) years old and found to be in good condition.




*Image 4 Domestic Hot Water heaters (Left: AO Smith, Right: Bradford White)*

## Building Plug Load

There are 64 computer work stations throughout the facility and about 90% of the computers are desktop units with LCD monitors. There is no centralized PC power management software currently installed. The facility has two refrigerated and one non-refrigerated vending machines.

## 2.7 Water-Using Systems

There are six restrooms at this facility. A sampling of restrooms found that faucets were automatic low-flow rated fixtures with sensors. The toilets and urinals were sampled at 2 gallons per flush (gpf) or less and are therefore not recommended for upgrade.

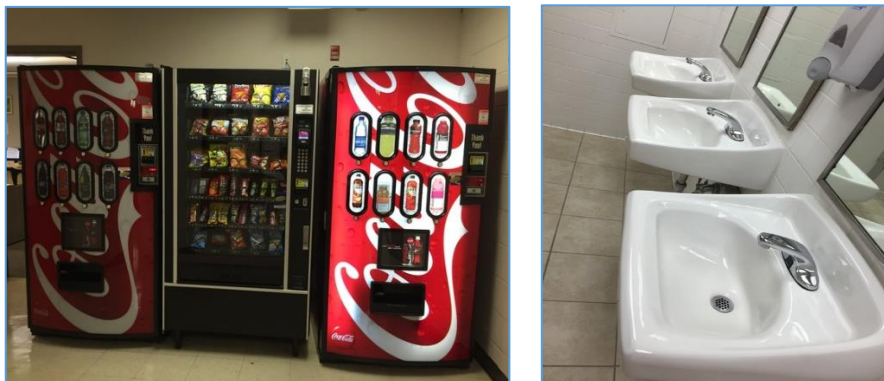

*Image 5 (Left): Refrigerated and non-refrigerated vending machines | (Right): Sample of low-flow fixtures*

### 3 SITE ENERGY USE AND COSTS

Utility data for electricity and natural gas service was analyzed to identify opportunities for savings. In addition, data for electricity and natural gas was evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 3.4 for additional information.

#### 3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

*Figure 6 - Utility Summary*

Utility Summary for Long Branch Higher Education Center		
Fuel	Usage	Cost
Electricity	320,764 kWh	\$43,148
Natural Gas	11,560 Therms	\$14,083
<b>Total</b>		<b>\$57,231</b>

The current annual energy cost for this facility is \$57,231 as shown in the chart below.

*Figure 7 - Energy Cost Breakdown*

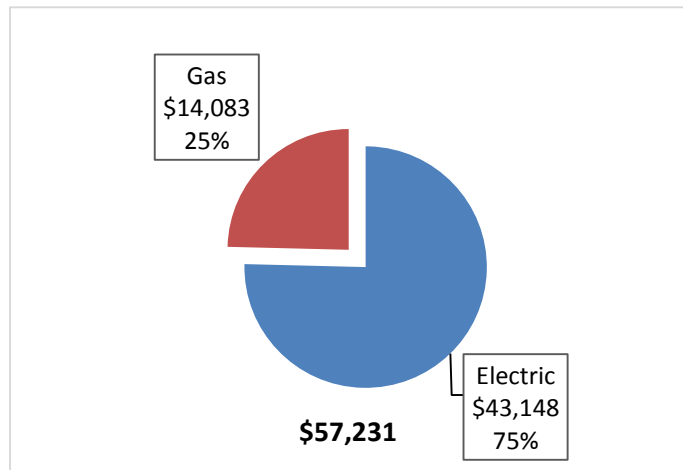

### 3.2 Electricity Usage

Electricity is provided by JCP&L. The average electric cost over the past 12 months was \$0.135/kWh, which is the blended rate that includes energy supply, distribution, and other charges. This rate is used throughout the analyses in this report to assess energy costs and savings. The monthly electricity consumption and peak demand are shown in the chart below.

Figure 8 -Electric Usage & Demand

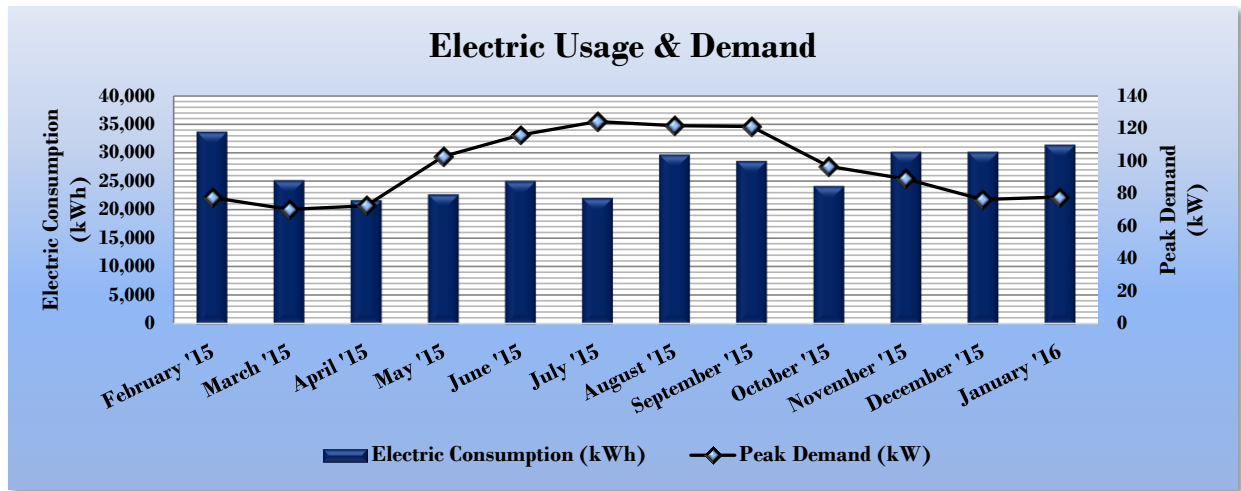


Figure 9 -Electric Usage & Demand

Electric Billing Data for Long Branch Higher Education Center					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
3/3/15	32	33,640	77	\$371	\$4,080
4/1/15	29	25,160	70	\$327	\$3,158
5/1/15	30	21,680	72	\$294	\$2,749
6/1/15	31	22,720	103	\$498	\$3,073
7/1/15	30	25,000	116	\$576	\$3,398
7/31/15	30	22,080	124	\$626	\$3,133
9/2/15	33	29,640	122	\$611	\$3,935
10/2/15	30	28,520	121	\$567	\$3,636
11/2/15	31	24,160	97	\$430	\$3,052
12/3/15	31	30,148	89	\$499	\$4,941
1/4/16	32	30,131	76	\$424	\$4,766
2/3/16	30	31,400	78	\$459	\$3,699
<b>Totals</b>	<b>369</b>	<b>324,279</b>	<b>124.2</b>	<b>\$5,683</b>	<b>\$43,620</b>
<b>Annual</b>	<b>365</b>	<b>320,764</b>	<b>124.2</b>	<b>\$5,622</b>	<b>\$43,148</b>

### 3.3 Natural Gas Usage

Natural gas is provided by New Jersey Natural Gas. The average gas cost for the past 12 months is \$1.218/therm, which is the blended rate used throughout the analyses in this report. The monthly gas consumption is shown in the chart below.

Figure 10 -Natural Gas Usage

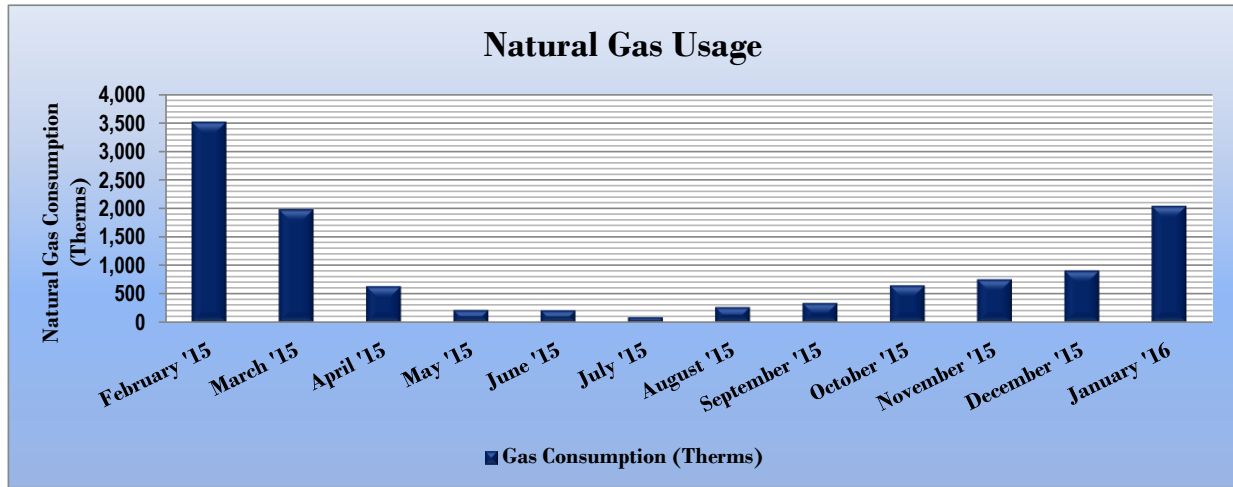


Figure 11 -Natural Gas Usage

Gas Billing Data for Long Branch Higher Education Center			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
3/1/15	30	3,520	\$3,808
4/1/15	31	1,986	\$2,238
5/1/15	30	634	\$854
6/1/15	31	213	\$424
7/1/15	30	212	\$416
8/1/15	31	88	\$294
9/1/15	31	268	\$471
10/1/15	30	343	\$545
11/1/15	31	650	\$844
12/1/15	30	757	\$950
1/1/16	31	912	\$1,102
2/1/16	31	2,043	\$2,214
<b>Totals</b>	<b>367</b>	<b>11,624</b>	<b>\$14,160</b>
<b>Annual</b>	<b>365</b>	<b>11,560</b>	<b>\$14,083</b>



### 3.4 Benchmarking

This facility was benchmarked using Portfolio Manager, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

**Figure 12 - Energy Use Intensity Comparison – Existing Conditions**

Energy Use Intensity Comparison - Existing Conditions		
	Long Branch Higher Education Center	National Median Building Type: Higher Education - Public
Source Energy Use Intensity (kBtu/ft <sup>2</sup> )	221.4	262.6
Site Energy Use Intensity (kBtu/ft <sup>2</sup> )	107.2	130.7

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

**Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures**

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	Long Branch Higher Education Center	National Median Building Type: Higher Education - Public
Source Energy Use Intensity (kBtu/ft <sup>2</sup> )	187.9	262.6
Site Energy Use Intensity (kBtu/ft <sup>2</sup> )	96.5	130.7

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide and may be eligible for ENERGY STAR® certification. This building’s type is not one that is currently eligible to receive an ENERGY STAR® score.

A Portfolio Manager Statement of Energy Performance (SEP) was generated for this facility, see Appendix B: ENERGY STAR® Statement of Energy Performance.

For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.


A Portfolio Manager account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager regularly, so that you can keep track of your building’s performance. Free online training is

available to help you use ENERGY STAR® Portfolio Manager to track your building’s performance at: <https://www.energystar.gov/buildings/training>.

### 3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 14 - Energy Balance (kBtu/SF,%)

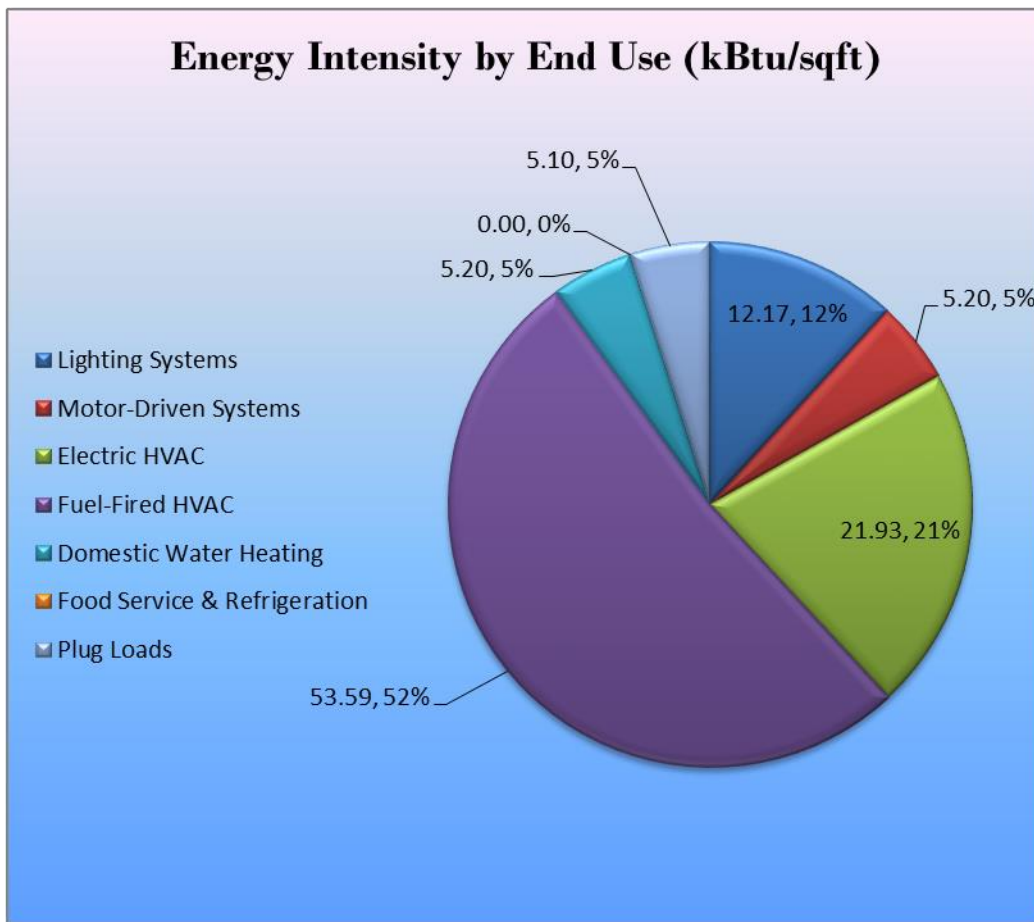

## 4 ENERGY CONSERVATION MEASURES

### Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to Brookdale Community College regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

### 4.1 Recommended ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 15 – Summary of Recommended ECMs

Energy Conservation Measure		Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>55,171</b>	<b>11.1</b>	<b>\$7,421.31</b>	<b>\$27,116.83</b>	<b>\$4,205.00</b>	<b>\$22,911.83</b>	<b>3.1</b>	<b>55,557</b>
ECM 1	Install LED Fixtures	Yes	5,395	0.8	\$725.66	\$4,297.45	\$1,100.00	\$3,197.45	4.4	5,432
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	5,564	1.1	\$748.41	\$2,052.04	\$0.00	\$2,052.04	2.7	5,603
ECM 3	Retrofit Fixtures with LED Lamps	Yes	36,261	8.6	\$4,877.70	\$18,508.69	\$3,105.00	\$15,403.69	3.2	36,515
ECM 4	Install LED Exit Signs	Yes	7,951	0.6	\$1,069.53	\$2,258.66	\$0.00	\$2,258.66	2.1	8,007
<b>Lighting Control Measures</b>			<b>3,413</b>	<b>1.1</b>	<b>\$459.03</b>	<b>\$2,900.00</b>	<b>\$500.00</b>	<b>\$2,400.00</b>	<b>5.2</b>	<b>3,436</b>
ECM 5	Install Occupancy Sensor Lighting Controls	Yes	3,413	1.1	\$459.03	\$2,900.00	\$500.00	\$2,400.00	5.2	3,436
<b>Plug Load Equipment Control - Vending Machine</b>			<b>3,566</b>	<b>0.0</b>	<b>\$479.71</b>	<b>\$690.00</b>	<b>\$0.00</b>	<b>\$690.00</b>	<b>1.4</b>	<b>3,591</b>
ECM 6	Vending Machine Control	Yes	3,566	0.0	\$479.71	\$690.00	\$0.00	\$690.00	1.4	3,591
<b>TOTALS</b>			<b>62,149</b>	<b>12.2</b>	<b>\$8,360.05</b>	<b>\$30,706.83</b>	<b>\$4,705.00</b>	<b>\$26,001.83</b>	<b>3.1</b>	<b>62,584</b>

\* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Pay back Period is based on net measure costs (i.e. after incentives).

## 4.1.1 Lighting Upgrades

Recommended upgrades to existing lighting fixtures are summarized in Figure 16 below.

*Figure 16 – Summary of Lighting Upgrade ECMs*

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>55,171</b>	<b>11.1</b>	<b>0.0</b>	<b>\$7,421.31</b>	<b>\$27,116.83</b>	<b>\$4,205.00</b>	<b>\$22,911.83</b>	<b>3.1</b>	<b>55,557</b>
ECM 1	Install LED Fixtures	5,395	0.8	0.0	\$725.66	\$4,297.45	\$1,100.00	\$3,197.45	4.4	5,432
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	5,564	1.1	0.0	\$748.41	\$2,052.04	\$0.00	\$2,052.04	2.7	5,603
ECM 3	Retrofit Fixtures with LED Lamps	36,261	8.6	0.0	\$4,877.70	\$18,508.69	\$3,105.00	\$15,403.69	3.2	36,515
ECM 4	Install LED Exit Signs	7,951	0.6	0.0	\$1,069.53	\$2,258.66	\$0.00	\$2,258.66	2.1	8,007

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

### **ECM 1: Install LED Fixtures**

#### *Summary of Measure Economics*

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
Interior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0
Exterior	5,395	0.8	0.0	\$725.66	\$4,297.45	\$1,100.00	\$3,197.45	4.4	5,432

#### *Measure Description*

We recommend replacing existing exterior lighting fixtures containing HID or incandescent lamps with new high-performance LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tube and more than 10 times longer than many incandescent lamps.

### **ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers**

#### *Summary of Measure Economics*

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
Interior	5,564	1.1	0.0	\$748.41	\$2,052.04	\$0.00	\$2,052.04	2.7	5,603
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

### Measure Description

We recommend retrofitting existing fluorescent fixtures by removing fluorescent tubes and ballasts and replacing them with LEDs and LED drivers (if necessary), which are designed to be used retrofitted fluorescent fixtures. The measure uses the existing fixture housing but replaces the rest of the components with more efficient lighting technology. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tube and more than 10 times longer than many incandescent lamps.

## **ECM 3: Retrofit Fixtures with LED Lamps**

### Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
Interior	33,300	8.2	0.0	\$4,479.30	\$17,334.45	\$3,045.00	\$14,289.45	3.2	33,532
Exterior	2,962	0.4	0.0	\$398.40	\$1,174.24	\$60.00	\$1,114.24	2.8	2,982

### Measure Description

We recommend retrofitting existing incandescent, halogen, HID or other lighting technologies with LED lamps. Many LED tube lamps are direct replacements for existing fluorescent lamps and can be installed while leaving the fluorescent fixture ballast in place. LED bulbs can be used in existing fixtures as a direct replacement for most other lighting technologies. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

## **ECM 4: Install LED Exit Signs**

### Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
Interior	7,951	0.6	0.0	\$1,069.53	\$2,258.66	\$0.00	\$2,258.66	2.1	8,007
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

### Measure Description

We recommend replacing all incandescent or compact fluorescent exit signs with LED exit signs. LED exit signs require virtually no maintenance and have a life expectancy of at least 20 years. This measure saves energy by installing LED fixtures, which use less power than other technologies with an equivalent lighting output.

## 4.1.2 Lighting Control Measures

Figure 17 – Summary of Lighting Control ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>	<b>3,413</b>	<b>1.1</b>	<b>0.0</b>	<b>\$459.03</b>	<b>\$2,900.00</b>	<b>\$500.00</b>	<b>\$2,400.00</b>	<b>5.2</b>	<b>3,436</b>
ECM 5   Install Occupancy Sensor Lighting Controls	3,413	1.1	0.0	\$459.03	\$2,900.00	\$500.00	\$2,400.00	5.2	3,436

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

### ECM 5: Install Occupancy Sensor Lighting Controls

#### *Measure Description*

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in all restrooms, storage rooms, classrooms and offices areas. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

## 4.1.3 Plug Load Equipment Control - Vending Machines

### ECM 6: Vending Machine Control

#### *Summary of Measure Economics*

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO <sub>2</sub> e Emissions Reduction (lbs)
3,566	0.0	0.0	\$479.71	\$690.00	\$0.00	\$690.00	1.4	3,591

#### *Measure Description*

Vending machines operate continuously, even during non-business hours. It is recommended to install occupancy sensor controls to reduce the energy use. These controls power down vending machines when the vending machine area has been vacant for some time, then power up at regular intervals, as needed, to turn machine lights on or keep the product cool. Energy savings are a dependent on vending machine and activity level in the area surrounding the machines.

## 5 ENERGY EFFICIENT PRACTICES

---

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Reduce Air Leakage**

Air leakage, or infiltration, occurs when outside air enters a building uncontrollably through cracks and openings. Properly sealing such cracks and openings can significantly reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. This includes caulking or installing weather stripping around leaky doors and windows allowing for better control of indoor air quality through controlled ventilation.

### **Use Window Treatments/Coverings**

A substantial amount of heat gain can occur through uncovered or untreated windows, especially older single pane windows and east or west-facing windows. Treatments such as high-reflectivity films or covering windows with shades or shutters can reduce solar heat gain and, consequently, cooling load and can reduce internal heat loss and the associated heating load.

### **Perform Proper Lighting Maintenance**

In order to sustain optimal lighting levels, lighting fixtures should undergo routine maintenance. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust on lamps, fixtures and reflective surfaces. Together, these factors can reduce total illumination by 20%-60% or more, while operating fixtures continue drawing full power. To limit this reduction, lamps, reflectors and diffusers should be thoroughly cleaned of dirt, dust, oil, and smoke film buildup approximately every 6- 12 months.

### **Develop a Lighting Maintenance Schedule**

In addition to routine fixture cleaning, development of a maintenance schedule can both ensure maintenance is performed regularly and can reduce the overall cost of fixture re-lamping and re-ballasting. By re-lamping and re-ballasting fixtures in groups, lighting levels are better maintained and the number of site visits by a lighting technician or contractor can be minimized, decreasing the overall cost of maintenance.

### **Practice Proper Use of Thermostat Schedules and Temperature Resets**

Ensure thermostats are correctly set back. By employing proper set back temperatures and schedules, facility heating and cooling costs can be reduced dramatically during periods of low or no occupancy. As such, thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced further by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.



## **Perform Proper Water Heater Maintenance**

At least once a year, drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Once a year check for any leaks or heavy corrosion on the pipes and valves. For gas water heaters, check the draft hood and make sure it is placed properly, with a few inches of air space between the tank and where it connects to the vent. Look for any corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional. For electric water heaters, look for any signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank. For water heaters over three to four years old have a technician inspect the sacrificial anode annually.



## 6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey’s Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State’s electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


### 6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility’s electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has a Low Potential for installing a PV array.

In order to be cost-effective, a solar PV array needs certain minimum criteria, such as flat or south-facing rooftop or other unshaded space on which to place the PV panels. In our opinion, the facility does appear not meet these minimum criteria for cost-effective PV installation.

*Figure 18 - Photovoltaic Screening*

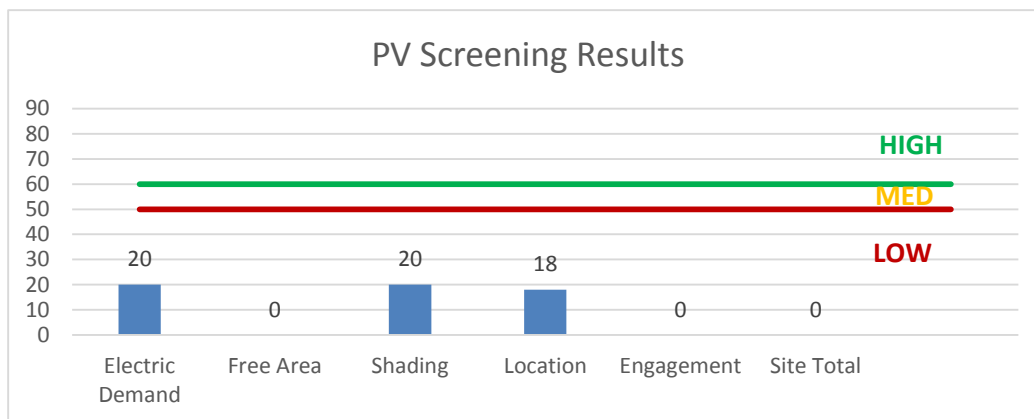

Solar projects must register their projects in the SREC Registration Program prior to the start of construction in order to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about developed new solar projects and insight into future SREC pricing.

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.

CHP systems are typically used to produce a portion of the electric power used onsite by a facility, with the balance of electric power needs supplied by grid purchases. The heat is used to supplement (or supplant) existing boilers for the purpose of space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for the purpose of space cooling. The key criteria used for screening, however, is the amount of time the system operates at full load and the facility's ability to use the recovered heat. Facilities with continuous use for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has a Low Potential for installing a cost-effective CHP system. In our opinion, the facility does not appear to meet the minimum thermal load requirements for a cost-effective CHP installation.

For a list of qualified firms in New Jersey specializing in commercial CHP cost assessment and installation, go to: [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/.](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/)

## 7 DEMAND RESPONSE

---

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically, an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

## 8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 19 for a list of the eligible programs identified for each recommended ECM.

*Figure 19 - ECM Incentive Program Eligibility*

Energy Conservation Measure		SmartStart Prescriptive	SmartStart Custom	Direct Install
ECM 1	Install LED Fixtures			X
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	X		X
ECM 3	Retrofit Fixtures with LED Lamps	X		X
ECM 4	Install LED Exit Signs			X
ECM 5	Install Occupancy Sensor Lighting Controls	X		X
ECM 6	Vending Machine Control			X

SmartStart is generally well-suited for implementation of individual measures or small group of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities that can bundle multiple ECMs together. This can greatly simplify participation and may lead to higher incentive amounts, but requires the use of pre-approved contractors. The Pay for Performance (P4P) program is a “whole-building” energy improvement program designed for larger facilities. It requires implementation of multiple measures meeting minimum savings thresholds, as well as use of pre-approved consultants. The Large Energy Users Program (LEUP) is available to New Jersey’s largest energy users giving them flexibility to install as little or as many measures, in a single facility or several facilities, with incentives capped based on the entity’s annual energy consumption. LEUP applicants can use in-house staff or a preferred contractor.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: [www.njcleanenergy.com/ci](http://www.njcleanenergy.com/ci).

## 8.1 SmartStart

### Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

### **Equipment with Prescriptive Incentives Currently Available:**

*Electric Chillers*

*Electric Unitary HVAC*

*Gas Cooling*

*Gas Heating*

*Gas Water Heating*

*Ground Source Heat Pumps*

*Lighting*

*Lighting Controls*

*Refrigeration Doors*

*Refrigeration Controls*

*Refrigerator/Freezer Motors*

*Food Service Equipment*

*Variable Frequency Drives*

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

### Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom Measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

### How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: [www.njcleanenergy.com/SSB](http://www.njcleanenergy.com/SSB).

## 8.2 Direct Install

### Overview

Direct Install is a turnkey program available to existing small to medium-sized facilities with a peak electric demand that does not exceed 200 kW for any recent 12-month period. You will work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

### Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Direct Install participants will also be held to a fiscal year cap of \$250,000 per entity.

### How to Participate

To participate in the Direct Install program, you will need to contact the participating contractor who the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Since Direct Install offers a free assessment of eligible measures, Direct Install is also available to small businesses and other commercial facilities too that may not be eligible for the more detailed facility audits provided by LGEA.

Detailed program descriptions and applications can be found at: [www.njcleanenergy.com/DI](http://www.njcleanenergy.com/DI).

### 8.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program descriptions and application can be found at:

[www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

## 8.4 Demand Response Energy Aggregator

The first step toward participation in a Demand Response (DR) program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding the program rules and requirements for metering and controls, a facility's ability to temporarily reduce electric load, as well as the payments involved in participating in the program. Also, these providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment to help ensure compliance of all terms and conditions of a DR contract.

See Section 7 for additional information.



## 9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third party supplier, consider shopping for a reduced rate from third party electric suppliers. If your facility is purchasing electricity from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

### 9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third party supplier, consider shopping for a reduced rate from third party natural gas suppliers. If your facility is purchasing natural gas from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

# Appendix A: Equipment Inventory & Recommendations

## Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
2nd floor - Sitting Area	1	Linear Fluorescent - T 12: 4' T 12 (40W) - 3L	Wall Switch	127	3,640	Fixture Replacement	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	3,640	0.06	350	0.0	\$47.02	\$138.46	\$0.00	2.94
2nd floor - Sitting Area	3	Exit Signs: Incandescent	None	45	8,760	Fixture Replacement	No	3	LED Exit Signs: 2 W Lamp	None	6	8,760	0.09	1,179	0.0	\$158.55	\$322.67	\$0.00	2.04
Hallway	3	Linear Fluorescent - T 12: 4' T 12 (40W) - 3L	Wall Switch	127	3,640	Fixture Replacement	No	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	3,640	0.18	1,049	0.0	\$141.05	\$415.38	\$0.00	2.94
Hallway	1	U-Bend Fluorescent - T 8: U T 8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.02	138	0.0	\$18.58	\$58.50	\$10.00	2.61
Women Restroom	3	Linear Fluorescent - T 12: 4' T 12 (40W) - 3L	Wall Switch	127	1,200	Fixture Replacement	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	840	0.21	400	0.0	\$53.77	\$531.38	\$20.00	9.51
Pantry	2	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	1,200	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,200	0.05	91	0.0	\$12.25	\$117.00	\$20.00	7.92
Storage	1	Linear Fluorescent - T 8: 4' T 8 (32W) - 3L	Wall Switch	93	52	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	52	0.04	3	0.0	\$0.40	\$75.20	\$15.00	151.19
Conference Room	28	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	750	Relamp	No	28	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	750	0.93	1,087	0.0	\$146.18	\$1,349.60	\$280.00	7.32
Stairwell	6	Compact Fluorescent: Chandelier fixtures - 6 (2 foot) bulbs per fixture)	Wall Switch	102	8,760	Relamp	No	6	LED - Linear Tubes: (6) 2' Lamps	Wall Switch	51	8,760	0.23	3,083	0.0	\$414.66	\$548.60	\$180.00	0.89
Stairwell	6	Incandescent: Chandelier fixtures - 1 bulb	Wall Switch	60	8,760	Relamp	No	6	LED Screw-In Lamps: Chandelier fixture - 1 bulb	Wall Switch	11	8,760	0.22	2,962	0.0	\$398.40	\$293.12	\$30.00	0.66
Men's Restroom	3	Linear Fluorescent - T 12: 4' T 12 (40W) - 3L	Wall Switch	127	1,200	Fixture Replacement	No	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,200	0.18	346	0.0	\$46.50	\$415.38	\$0.00	8.93
1st floor - 100D	2	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	2,080	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,456	0.06	199	0.0	\$26.83	\$233.00	\$40.00	7.19
1st floor - 100 C	2	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	2,080	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,456	0.06	199	0.0	\$26.83	\$233.00	\$40.00	7.19
Front office	14	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.34	1,934	0.0	\$260.14	\$819.00	\$140.00	2.61
Hallway	5	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.12	691	0.0	\$92.91	\$292.50	\$50.00	2.61
Hallway	4	Exit Signs: Incandescent	None	45	8,760	Fixture Replacement	No	4	LED Exit Signs: 2 W Lamp	None	6	8,760	0.11	1,572	0.0	\$211.40	\$430.22	\$0.00	2.04
Stairwell to basement	2	Linear Fluorescent - T 12: 4' T 12 (40W) - 2L	Wall Switch	88	8,760	Fixture Replacement	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.09	1,189	0.0	\$159.90	\$166.86	\$0.00	1.04
Stairwell to basement	2	Exit Signs: Incandescent	None	45	8,760	Fixture Replacement	No	2	LED Exit Signs: 2 W Lamp	None	6	8,760	0.06	786	0.0	\$105.70	\$215.11	\$0.00	2.04
Basement	6	Linear Fluorescent - T 12: 8' T 12 (75W) - 2L	Wall Switch	120	3,640	Fixture Replacement	No	6	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.40	2,286	0.0	\$307.44	\$500.58	\$0.00	1.63
1st floor - 100 A testing room	2	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	600	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	600	0.05	46	0.0	\$6.13	\$117.00	\$20.00	15.83
Women Restroom	3	Linear Fluorescent - T 8: 4' T 8 (32W) - 3L	Wall Switch	93	1,200	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	840	0.14	259	0.0	\$34.83	\$341.60	\$65.00	7.94
Men's Restroom	3	Linear Fluorescent - T 8: 4' T 8 (32W) - 3L	Wall Switch	93	1,200	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	840	0.14	259	0.0	\$34.83	\$341.60	\$65.00	7.94
Entrance interior	2	High-Pressure Sodium: (1) 100W Lamp	Wall Switch	100	3,640	Relamp	No	2	LED Screw-In Lamps: Wall mount fixture	Wall Switch	30	3,640	0.10	586	0.0	\$78.83	\$97.71	\$10.00	1.11
Stairwell	5	Compact Fluorescent: Wall mount fixture - 2 bulbs	Wall Switch	52	8,760	Relamp	No	5	LED Screw-In Lamps: Wall mount fixture - 2 bulbs	Wall Switch	14	8,760	0.14	1,914	0.0	\$257.47	\$537.53	\$50.00	1.89
Hallway	3	Linear Fluorescent - T 8: 4' T 8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.07	414	0.0	\$55.74	\$175.50	\$30.00	2.61

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	52	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	52	0.05	4	0.0	\$0.53	\$117.00	\$20.00	182.71
Mechanical Room	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.15	829	0.0	\$111.49	\$351.00	\$60.00	2.61
Hallway	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.10	553	0.0	\$74.33	\$234.00	\$40.00	2.61
ITV-CR - 121	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.19	1,105	0.0	\$148.65	\$468.00	\$80.00	2.61
Room 101 - Student Success Center	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.34	1,934	0.0	\$260.14	\$819.00	\$140.00	2.61
Office 101B	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,080	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,456	0.12	399	0.0	\$53.67	\$350.00	\$60.00	5.40
Hallway	3	Exit Signs: Incandescent	None	45	8,760	Fixture Replacement	No	3	LED Exit Signs: 2 W Lamp	None	6	8,760	0.09	1,179	0.0	\$158.55	\$322.67	\$0.00	2.04
Student Success Center	1	Exit Signs: Incandescent	None	45	2,080	Fixture Replacement	No	1	LED Exit Signs: 2 W Lamp	None	6	2,080	0.03	93	0.0	\$12.55	\$107.56	\$0.00	8.57
Hallway	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.12	691	0.0	\$92.91	\$292.50	\$50.00	2.61
Room 102 - Literary Volunteer	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	2,080	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,080	0.15	474	0.0	\$63.71	\$351.00	\$60.00	4.57
Classroom 103	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Classroom 104	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Classroom 105	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Classroom 106	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Computer Classroom	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Women Restroom	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	1,200	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	840	0.27	502	0.0	\$67.48	\$408.50	\$70.00	5.02
Men's Restroom	7	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	1,200	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	840	0.37	702	0.0	\$94.47	\$525.50	\$90.00	4.61
Computer Classroom	9	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	2,100	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.48	1,580	0.0	\$212.55	\$642.50	\$110.00	2.51
Classroom 108	11	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	11	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.34	1,108	0.0	\$149.01	\$759.50	\$130.00	4.22
Hallway	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.02	138	0.0	\$18.58	\$58.50	\$10.00	2.61
IT closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	208	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	208	0.02	8	0.0	\$1.06	\$58.50	\$10.00	45.68
Classroom 112	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.28	906	0.0	\$121.92	\$642.50	\$110.00	4.37
Classroom 114	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Classroom 115	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.28	906	0.0	\$121.92	\$642.50	\$110.00	4.37
Classroom 111	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 113	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Classroom 116	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.18	604	0.0	\$81.28	\$467.00	\$80.00	4.76
Classroom 117	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Classroom 118	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Room 119 - office	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,080	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,456	0.25	798	0.0	\$107.34	\$584.00	\$100.00	4.51
Hallway	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.07	414	0.0	\$55.74	\$175.50	\$30.00	2.61
Classroom 120	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,100	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,470	0.25	806	0.0	\$108.37	\$584.00	\$100.00	4.47
Hallway	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	3,640	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,640	0.05	276	0.0	\$37.16	\$117.00	\$20.00	2.61
Hallway	8	Exit Signs: Incandescent	None	45	8,760	Fixture Replacement	No	8	LED Exit Signs: 2 W Lamp	None	6	8,760	0.23	3,143	0.0	\$422.79	\$860.44	\$0.00	2.04
Exterior lights	6	Incandescent: Wall mount fixture - 2 bulbs	Wall Switch	120	4,380	Relamp	No	6	LED Screw-In Lamps: Wall mount fixture - 2 bulbs	Wall Switch	22	4,380	0.43	2,962	0.0	\$398.40	\$1,174.24	\$60.00	2.80
Exterior lights	9	High-Pressure Sodium: (1) 100W Lamp	Wall Switch	138	4,380	Fixture Replacement	No	9	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	29	4,380	0.72	4,941	0.0	\$664.68	\$3,516.09	\$900.00	3.94
Exterior lights	2	High-Pressure Sodium: (1) 70W Lamp	Wall Switch	95	4,380	Fixture Replacement	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	50	4,380	0.07	453	0.0	\$60.98	\$781.35	\$200.00	9.53

### Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Elevator Room	Elevator	1	Other	20.0	91.0%	No	3,391	No	91.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Basement and mechanical room	DHW	2	Water Supply Pump	0.3	77.0%	No	2,745	No	77.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

### Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis							
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof top unit 1	Long branch higher education center	4	Packaged AC	8.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Roof top unit 2	Long branch higher education center	2	Packaged AC	40.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
IT room - heat pump	Long branch higher education center	1	Ductless Mini-Split HP	0.75	9.00	No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

### Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions						Energy Impact & Financial Analysis							
		System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years		
Rooftop	Longbranch campus	4	Furnace	300.00	No								0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Rooftop	Longbranch campus	2	Furnace	224.00	No								0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

### DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Basement	Long Branch higher secondary School	1	Storage Tank Water Heater (≤ 50 Gal)	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical Room	Long Branch higher secondary School	1	Storage Tank Water Heater (≤ 50 Gal)	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00


### Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Long branch higher education center	64	Computer	75.0	Yes
Long branch higher education center	4	Printer Small	18.0	Yes
Long branch higher education center	5	Printer medium	21.0	No
Long branch higher education center	6	Printer large	30.0	Yes
Long branch higher education center	2	Paper shredder	360.0	No
Long branch higher education center	15	Projector	200.0	Yes
Long branch higher education center	2	Microwave	900.0	No
Long branch higher education center	1	Refrigerator medium	50.0	No
Long branch higher education center	1	Refrigerator large	300.0	No
Long branch higher education center	1	Toaster	850.0	No
Long branch higher education center	1	Toaster over	1,200.0	No
Long branch higher education center	7	Television - CRT	150.0	No
Long branch higher education center	1	LCD TV	120.0	No
Long branch higher education center	1	Space heater	1,500.0	No

**Vending Machine Inventory & Recommendations**

Location	Existing Conditions		Proposed Conditions	Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Hallway	2	Refrigerated	Yes	0.00	3,224	0.0	\$433.63	\$460.00	\$0.00	1.06
Hallway	1	Non-Refrigerated	Yes	0.00	343	0.0	\$46.07	\$230.00	\$0.00	4.99

## Appendix B: ENERGY STAR® Statement of Energy Performance



# ENERGY STAR® Statement of Energy Performance

LEARN MORE AT [energystar.gov](http://energystar.gov)

N/A

### Long Branch Higher Education Center

Primary Property Type: College/University  
 Gross Floor Area (ft²): 21,000  
 Built: 1981

For Year Ending: February 29, 2016  
 Date Generated: May 07, 2017

ENERGY STAR®  
Score<sup>1</sup>

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
<b>Property Address</b> Long Branch Higher Education Center 213 Broadway Long Branch, New Jersey 07740	<b>Property Owner</b> Brookdale Community College 765 Newman Springs Road Lincroft, NJ 07738 (732) 224-2217	<b>Primary Contact</b> Timothy Drury 765 Newman Springs Road Lincroft, NJ 07738 (732) 224-2217 tdrury@brookdalecc.edu
<b>Property ID:</b> 5811158		

Energy Consumption and Energy Use Intensity (EUI)				
<b>Site EUI</b> 100.1 kBtu/ft²	<b>Annual Energy by Fuel</b>		<b>National Median Comparison</b>	
	Natural Gas (kBtu)	1,018,064 (48%)	National Median Site EUI (kBtu/ft²)	123.4
	Electric - Grid (kBtu)	1,083,543 (52%)	National Median Source EUI (kBtu/ft²)	262.6
			% Diff from National Median Source EUI	-19%
<b>Source EUI</b> 212.9 kBtu/ft²			<b>Annual Emissions</b>	
			Greenhouse Gas Emissions (Metric Tons CO2e/year)	178

### Signature & Stamp of Verifying Professional

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Licensed Professional

\_\_\_\_\_  
,  
( ) \_\_\_\_\_  
\_\_\_\_\_



Professional Engineer Stamp  
(if applicable)