



Local Government Energy Audit: Energy Audit Report



George Hess Educational Complex

Hamilton Township School District
700 Babcock Road
Mays Landing, NJ 08330

July 3, 2018

Final Report by:
TRC Energy Services

Copyright ©2018 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents,

Disclaimer

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

Table of Contents

1	Executive Summary.....	6
1.1	Facility Summary	6
1.2	Your Cost Reduction Opportunities.....	6
	Energy Conservation Measures.....	6
	Energy Efficient Practices	8
	On-Site Generation Measures.....	9
1.3	Implementation Planning.....	9
2	Facility Information and Existing Conditions	11
2.1	Project Contacts	11
2.2	General Site Information.....	11
2.3	Building Occupancy	11
2.4	Building Envelope	11
2.5	On-Site Generation.....	12
2.6	Energy-Using Systems	12
	Lighting System	12
	Chilled Water or Condenser Water System	12
	Hot Water Heating System.....	13
	Direct Expansion Air Conditioning System (DX)	13
	Chilled Water Air Conditioning System (CHW).....	13
	Domestic Hot Water Heating System.....	13
	Refrigeration	13
	Building Plug Load	13
2.7	Water-Using Systems	14
3	Site Energy Use and Costs.....	15
3.1	Total Cost of Energy	15
3.2	Electricity Usage	16
3.3	Natural Gas Usage	17
3.4	Benchmarking.....	18
3.5	Energy End-Use Breakdown	20
4	Energy Conservation Measures	21
4.1	High Priority ECMs.....	21
4.1.1	Lighting Upgrades.....	22
	ECM 1: Install LED Fixtures	22
	ECM 2: Retrofit Fixtures with LED Lamps	22
4.1.2	Lighting Control Measures	23
	ECM 3: Install Occupancy Sensor Lighting Controls	23
	ECM 4: Install High/Low Lighting Controls	24
4.1.3	Motor Upgrades	25
	ECM 5: Premium Efficiency Motors.....	25

4.1.4	Variable Frequency Drive Measures	25
	ECM 6: Install VFD on Variable Air Volume (VAV) HVAC.....	25
	ECM 7: Install VFDs on Cooling Tower Fans	26
4.1.5	Gas-Fired Heating System Replacements.....	26
	ECM 8: Install High Efficiency Hot Water Boilers	27
4.1.6	Plug Load Equipment Control - Vending Machines.....	27
	ECM 9: Vending Machine Control	27
4.2	Other Evaluated ECMs.....	28
4.2.1	Domestic Hot Water Heating System Upgrades	28
	Install High Efficiency Gas-Fired Water Heater	28
5	Energy Efficient Practices	29
	Close Doors and Windows	29
	Use Window Treatments/Coverings	29
	Ensure Lighting Controls Are Operating Properly	29
	Perform Routine Motor Maintenance	29
	Use Fans to Reduce Cooling Load	29
	Practice Proper Use of Thermostat Schedules and Temperature Resets	30
	Perform Proper Boiler Maintenance.....	30
	Perform Proper Water Heater Maintenance	30
	Plug Load Controls.....	30
	Water Conservation	30
6	On-Site Generation Measures	32
6.1	Photovoltaic.....	32
6.2	Combined Heat and Power	33
7	Demand Response	34
8	Project Funding / Incentives	35
8.1	SmartStart	36
8.2	Pay for Performance - Existing Buildings.....	37
8.3	SREC Registration Program.....	37
8.4	Energy Savings Improvement Program	38
	Energy Purchasing and Procurement Strategies	39
8.5	Retail Electric Supply Options.....	39
8.6	Retail Natural Gas Supply Options	39

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

Table of Figures

Figure 1 – Previous 12 Month Utility Costs..... 7

Figure 2 – Potential Post-Implementation Costs 7

Figure 3 – Summary of Energy Reduction Opportunities 7

Figure 4 – Project Contacts 11

Figure 5 - Building Schedule..... 11

Figure 6 - Utility Summary 15

Figure 7 - Energy Cost Breakdown 15

Figure 8 - Electric Usage & Demand..... 16

Figure 9 - Electric Usage & Demand..... 16

Figure 10 - Natural Gas Usage..... 17

Figure 11 - Natural Gas Usage..... 17

Figure 12 - Energy Use Intensity Comparison – Existing Conditions..... 18

Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures 18

Figure 14 - Energy Balance (kBtu/SF)..... 20

Figure 15 – Summary of High Priority ECMs 21

Figure 16 – Summary of Lighting Upgrade ECMs..... 22

Figure 17 – Summary of Lighting Control ECMs 23

Figure 18 – Summary of Variable Frequency Drive ECMs 25

Figure 19 - Summary of Gas-Fired Heating Replacement ECMs..... 26

Figure 20 - ECM Incentive Program Eligibility..... 35

I EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for George Hess Educational Complex.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist Hamilton Township School District in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

I.1 Facility Summary

George Hess Educational Complex is a 210,000 square foot facility. The two-story school building primarily includes classrooms, offices, gym, swimming pool, cafeteria, and mechanical spaces.

Lighting consists primarily of a mixture of T8 fluorescent sources, which are inefficient as compared to currently available alternatives. Cooling and ventilation are provided by combination of water source heat pumps and air handling units (AHUs). A chiller provides cooling for the AHUs. All of the units are approximately 25 years old and less efficient than currently available equipment. A boiler provides hot water to the AHUs as well as to terminal units located in the zones. There are two furnaces that also provide space heating. A second boiler serves the pool complex. The facility is equipped with rooftop mounted solar photovoltaic panels that can generate up to 50 kW. A thorough description of the facility and our observations are located in Section 2.

I.2 Your Cost Reduction Opportunities

Energy Conservation Measures

TRC evaluated ten measures with nine of those measures representing an opportunity for George Hess Educational Complex to reduce annual energy costs by roughly \$143,239 and annual greenhouse gas emissions by 1,238,248 lbs CO₂e. We estimate that if all nine measures are implemented, the project would pay for itself in 4.6 years. TRC defines measures as "high priority measures" as those measures that have a simple payback period which is less than the rated useful lifetime of the proposed equipment. The breakdown of existing and potential utility costs and the estimated savings are shown in Figure 1 and Figure 2, respectively. Together these measures would reduce onsite energy usage by about 21%.

Figure 1 – Previous 12 Month Utility Costs


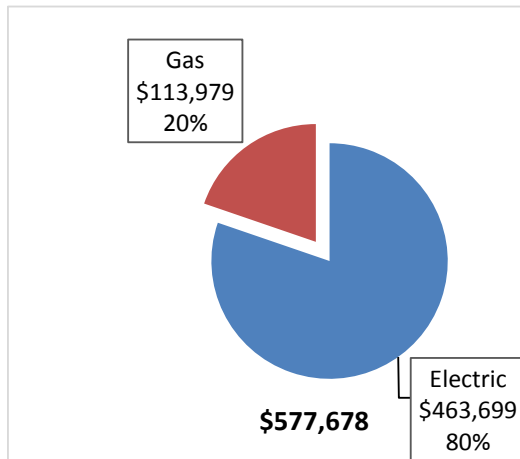


Figure 2 – Potential Post-Implementation Costs

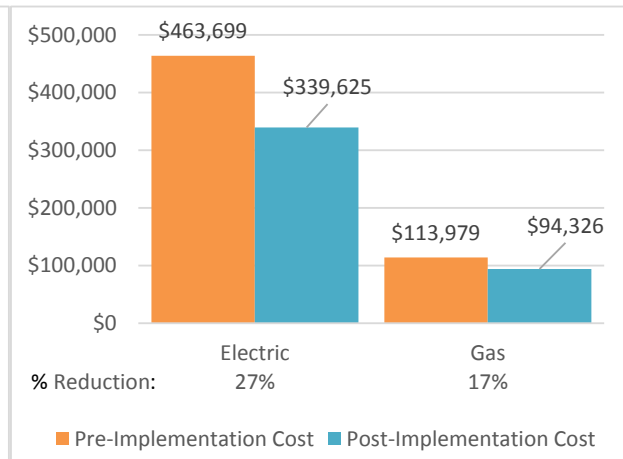

A detailed description of George Hess Educational Complex’s existing energy use can be found in Section 3.

Estimates of the total cost, energy savings, and financial incentives for the evaluated energy efficient upgrades are summarized below in Figure 3. A brief description of each category can be found below and a description of savings opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

Energy Conservation Measure	High Priority?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades										
ECM 1 Install LED Fixtures	Yes	142,031	16.2	0.0	\$18,956.63	\$54,912.59	\$8,050.00	\$46,862.59	2.5	143,024
ECM 2 Retrofit Fixtures with LED Lamps	Yes	575,638	70.2	0.0	\$76,829.50	\$183,013.82	\$26,010.00	\$157,003.82	2.0	579,663
Lighting Control Measures										
ECM 3 Install Occupancy Sensor Lighting Controls	Yes	91,110	10.4	0.0	\$12,160.34	\$40,500.00	\$4,480.00	\$36,020.00	3.0	91,747
ECM 4 Install High/Low Lighting Controls	Yes	9,705	1.1	0.0	\$1,295.29	\$8,540.00	\$1,115.00	\$7,425.00	5.7	9,773
Motor Upgrades										
ECM 5 Premium Efficiency Motors	Yes	16,528	3.0	0.0	\$2,205.96	\$27,934.86	\$0.00	\$27,934.86	12.7	16,644
Variable Frequency Drive (VFD) Measures										
ECM 6 Install VFD on Variable Air Volume (VAV) HVAC	Yes	73,180	18.0	0.0	\$9,767.21	\$41,434.40	\$13,650.00	\$27,784.40	2.8	73,692
ECM 7 Install VFDs on Cooling Tower Fans	Yes	18,197	0.0	0.0	\$2,428.77	\$12,567.00	\$0.00	\$12,567.00	5.2	18,325
Gas Heating (HVAC/Process) Replacement										
ECM 8 Install High Efficiency Hot Water Boilers	Yes	0	0.0	2,580.4	\$19,165.21	\$338,428.23	\$0.00	\$338,428.23	17.7	302,136
Domestic Water Heating Upgrade										
Install High Efficiency Gas Water Heater	No	0	0.0	65.7	\$487.85	\$120,264.00	\$4,200.00	\$116,064.00	237.9	7,691
Plug Load Equipment Control - Vending Machine										
ECM 9 Vending Machine Control	Yes	3,224	0.0	0.0	\$430.26	\$690.00	\$0.00	\$690.00	1.6	3,246
TOTALS FOR HIGH PRIORITY MEASURES		929,612	118.9	2,580.4	\$143,239.19	\$708,020.90	\$53,305.00	\$654,715.90	4.6	1,238,248
TOTALS FOR ALL EVALUATED MEASURES		929,612	118.9	2,646.1	\$143,727.03	\$828,284.90	\$57,505.00	\$770,779.90	5.4	1,245,939

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Pay back Period is based on net measure costs (i.e. after incentives).

The “high efficiency gas hot water heater” upgrade measure was not found to be cost effective on the basis of energy savings alone. Therefore, it was not included among the “high priority” measures. However, one of the school’s two domestic hot water boilers has recently failed, so the school may want to include this measure regardless of its long simple payback period.

Lighting Upgrades generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measures save energy by reducing the power used by the lighting components due to improved electrical efficiency.

Lighting Controls measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

Motor Upgrades generally involve replacing older standard efficiency motors with high efficiency standard (IHP 2014). Motors replacements generally assume the same size motors, just higher efficiency. Although occasionally additional savings can be achieved by downsizing motors to better meet current load requirements. This measure saves energy by reducing the power used by the motors, due to improved electrical efficiency.

Variable Frequency Drives (VFDs) are motor control devices. These measures control the speed of a motor so that the motor spins at peak efficiency during partial load conditions. Sensors adapt the speed to flow, temperature, or pressure settings which is much more efficient than using a valve or damper to control flow rates, or running the motor at full speed when only partial power is needed. These measures save energy by controlling motor usage more efficiently.

Gas Heating (HVAC/Process) measures generally involve replacing older inefficient hydronic heating systems with modern energy efficient systems. Gas heating systems can provide equivalent heating compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel demands for heating, due to improved combustion and heat transfer efficiency.

Domestic Hot Water upgrade measures generally involve replacing older inefficient domestic water heating systems with modern energy efficient systems. New domestic hot water heating systems can provide equivalent, or greater, water heating capacity compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel used for domestic hot water heating due to improved heating efficiency or reducing standby losses.

Plug Load Equipment control measures generally involve installing automated devices that limit the power usage or operation of equipment that is plugged into an electric outlet when not in use.

Energy Efficient Practices

TRC also identified ten low cost (or no cost) energy efficient practices. A facility's energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. Potential opportunities identified at George Hess Educational Complex include:

- Close Doors and Windows
- Use Window Treatments/Coverings
- Ensure Lighting Controls Are Operating Properly
- Perform Routine Motor Maintenance
- Use Fans to Reduce Cooling Load
- Use Thermostat Schedules and Temperature Resets
- Perform Boiler Maintenance
- Perform Water Heater Maintenance
- Install Plug Load Controls
- Water Conservation

For details on these energy efficient practices, please refer to Section 5.

On-Site Generation Measures

TRC evaluated the potential for installing on-site generation for George Hess Educational Complex. There is already a photovoltaic array on the roof, and reportedly the site has no interest in expanding the system at this time.

For details on our evaluation and on-site generation potential, please refer to Section 6.

1.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Pay for Performance - Existing Building (P4P)
- Energy Savings Improvement Program (ESIP)

For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 7.

Larger facilities with an interest in a more comprehensive whole building approach to energy conservation should consider participating in the Pay for Performance (P4P) program. Projects eligible for this project program must meet minimum savings requirements. Final incentives are calculated based on actual measured performance achieved at the end of the project. The application process is more involved, and it requires working with a qualified P4P contractor, but the process may result in greater energy savings overall and more lucrative incentives, up to 50% of project's total cost. This facility does not currently meet all of the criteria for participating in the P4P program. However, since additional measures may be identified during the P4P evaluation and the facility is close to meeting the P4P program criteria it is worth considering the P4P program for this site.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.4 for additional information on the ESIP Program.

Additional information on relevant incentive programs is located in Section 7. You may also check the following website for more details: www.njcleanenergy.com/ci.

2 FACILITY INFORMATION AND EXISTING CONDITIONS

2.1 Project Contacts

Figure 4 – Project Contacts

Name	Role	E-Mail	Phone #
Customer			
Anne-Marie Fala	Business Administrator	falaa@hamiltonschools.org	609-476-6303
Designated Representative			
Bryan C. McGair	Account Executive	bryan.mcgair@schneider-electric.com	609-868-2750
TRC Energy Services			
Tom Page	Auditor	tpage@TRCsolutions.com	(732) 855-0033

2.2 General Site Information

On April 5, 2017, TRC performed an energy audit at George Hess Educational Complex located in Mays Landing, New Jersey. TRC’s team met with Ian Nelson to review the facility operations and help focus our investigation on specific energy-using systems.

George Hess Educational Complex is a 210,000 square foot facility. The building was constructed in 1992. The two-story school building primarily includes classrooms, offices, gym, swimming pool, cafeteria, and mechanical spaces.

Lighting at George Hess Educational Complex consists primarily of T8 fluorescent sources, which are inefficient as compared to currently available alternatives. Cooling and ventilation are provided by a combination of water source heat pumps and air handling units (AHUs). A chiller provides cooling for the AHUs. All of the units are approximately 25 years old and less efficient than currently available equipment. A boiler provides hot water to the AHUs as well as to terminal units located in the zones. There are two furnaces that also provide space heating. A second boiler serves the pool complex. The facility is equipped with rooftop mounted solar photovoltaic panels that can generate up to 50 kW.

2.3 Building Occupancy

The school building is open Monday through Friday from approximately 7:00 AM through 9:00 PM during the school year, September through June. During a typical day, the facility is occupied by a total of 650 staff and students.

Figure 5 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
George Hess Education Complex	Weekday	7am - 9pm
George Hess Education Complex	Weekend	CLOSED

2.4 Building Envelope

The George Hess Educational Complex building is constructed of masonry and structural steel. The building has a flat built-up roof that is in good condition. There are also some pitched skylights on the roof. The building has double pane windows which are in good condition and show little sign of excessive infiltration. The exterior doors are constructed of metal and are in good condition.



2.5 On-Site Generation

George Hess Educational Complex has installed a 50 kW solar energy project. The project included photovoltaic (PV) arrays on the roof. The systems provide 3% of the electricity required by the facility. TRC noted that there is space available to increase the current system, but the site is not interested in expanding capacity at this time.

2.6 Energy-Using Systems

Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

Lighting System

Interior lighting at the facility is provided mostly by linear fluorescent T8 lamps with electronic ballasts and compact fluorescent screw-in lamps. The linear fluorescent fixtures are located in all areas of the building. The site has upgraded some fixtures to more efficient LED technology including the building exit signs. The interior lighting controls use a combination of occupancy sensors and manually operated switches.

The building's exterior lighting consists primarily of pole and building mounted metal halide (MH) and high-pressure sodium (HPS) with manual controls.

Chilled Water or Condenser Water System

The facility is served by a single chilled water plant which supplies chilled water to 11 air handling units throughout the facility. The chiller plant consists of a 200-ton centrifugal chiller. The chiller is arranged in a constant flow primary loop configuration.

Hot Water Heating System

The heating hot water system consists of one non-condensing boiler of 9,230 MBh output capacity operating at approximately 80% efficiency. The boiler provides heat to the AHUs, terminal units, and supplemental heat to the heat pumps. Hot water is circulated by two 15 horsepower circulation pumps operating in a lead/lag configuration. Only one pump is needed to circulate hot water. The boiler approximately 25 years old and at the end of its useful life.

The facility also has a 450 MBh Lochinvar boiler which is about seven years old and is used to heat the Olympic-sized swimming pool.

Direct Expansion Air Conditioning System (DX)

There are ten water-source heat pumps (WSHPs) supplying heating, cooling, and ventilation to the building. They range in capacity from 20 tons to 30 tons. The units are located in mechanical closets throughout the building. As needed, heat is added to the water loop by the boiler or removed with a cooling tower (CT1). The WSHPs are constant air volume units with a supply fans ranging from 5 - 15 hp. All of the WSHPs use direct-expansion (DX) coils for cooling and heating. The WSHPs utilize either scroll or reciprocating compressors depending on the model and age of the unit. Hot water reheat coils in the zones provide supplemental heating as needed. The units are controlled by individual thermostats located in zones.

Chilled Water Air Conditioning System (CHW)

There are 11 air handling units (AHU) located throughout the facility that serve the building. The AHU are single zone constant air volume (CAV) systems. Depending on location, the AHU have either a single 5-hp supply fan or single 10-hp return fan.

Domestic Hot Water Heating System

The domestic hot water heating system consists of two gas-fired water heaters with a 750-gallon storage tank performing at 83% efficiency. The gas water heater serves the kitchen and restrooms.

Refrigeration

The kitchen has one walk-in refrigerator and two walk-in freezers. All are approximately 200 cubic feet in volume. The refrigerator is set to 40°F and the freezers to 2°F.

Building Plug Load

There are approximately 200 computer work stations, the majority with LCD monitors. Classrooms are equipped with smart boards and projectors. Additional plug load includes several copiers, printers, other office equipment, televisions and a washer and dryer. A breakroom includes a refrigerator, microwave, and dishwasher. There are also two refrigerated and one non-refrigerated vending machines on site.

2.7 Water-Using Systems

There are 25 restrooms at this facility. A sampling of restrooms found that all fixtures meet current water-conservation guidelines for low-flow devices. The faucets are all rated below 2.2 gallons per minute (gpm). The toilets are all rated at less than 2.5 gallons per flush (gpf) and the urinals are rated at less than 2 gpf.

3 SITE ENERGY USE AND COSTS

Utility data for electricity and natural gas was analyzed to identify opportunities for savings. In addition, data for electricity and natural gas was evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 0 for additional information.

3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

Figure 6 - Utility Summary

Utility Summary for George Hess Education Complex		
Fuel	Usage	Cost
Electricity	3,505,094 kWh	\$463,699
Natural Gas	153,463 Therms	\$113,979
Total		\$577,678

The current annual energy cost for this facility is \$577,678 as shown in the chart below.

Figure 7 - Energy Cost Breakdown

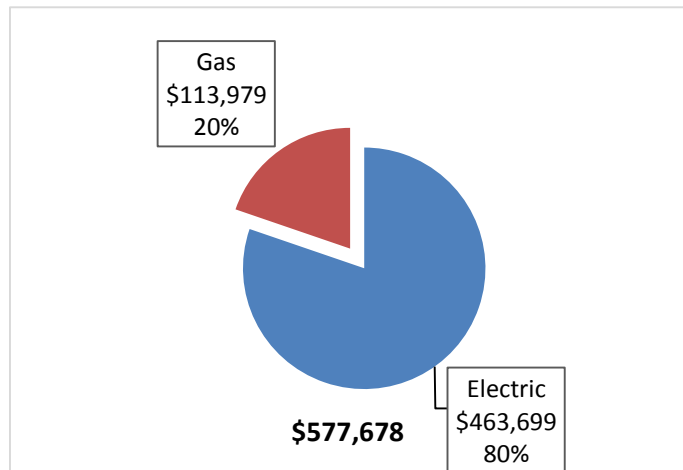

3.2 Electricity Usage

Electricity is provided by Atlantic City Electric. The average electric cost over the past 12 months was \$0.133/kWh, which is the blended rate that includes energy supply, distribution, and other charges including onsite solar generation. This rate is used throughout the analyses in this report to assess energy costs and savings. The monthly demand charges were included with the total electric cost. The monthly electricity consumption and peak demand are shown in the chart below.

Figure 8 - Electric Usage & Demand

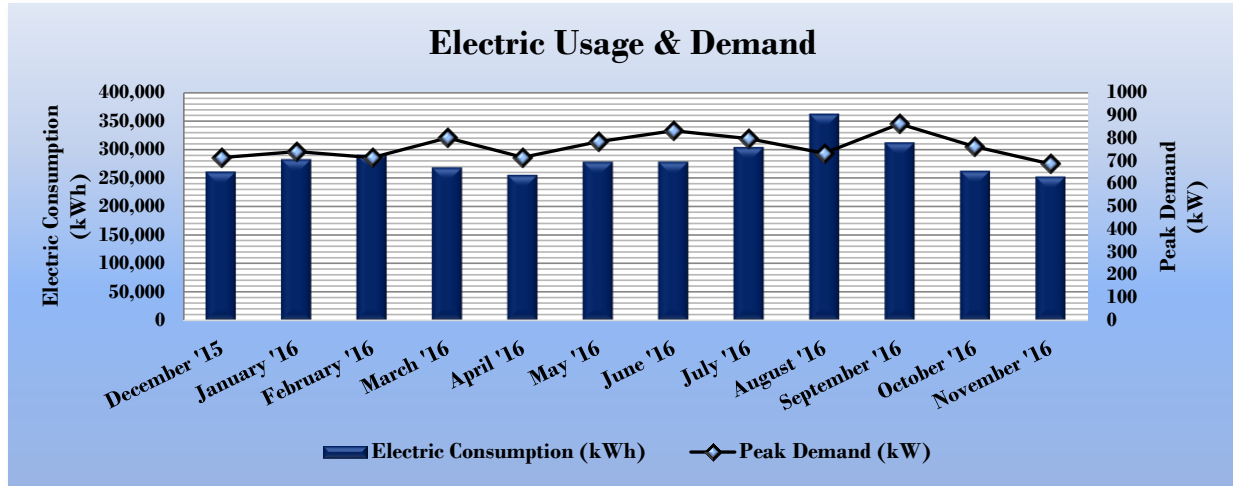


Figure 9 - Electric Usage & Demand

Electric Billing Data for George Hess Education Complex				
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Total Electric Cost
12/30/15	30	260,238	715	\$35,686
1/28/16	28	281,834	741	\$39,144
2/28/16	30	289,614	714	\$40,611
3/30/16	30	267,392	802	\$35,055
4/28/16	28	254,335	716	\$34,615
5/30/16	31	277,927	785	\$38,275
6/29/16	29	277,928	833	\$36,780
7/28/16	28	303,332	798	\$39,670
8/30/16	32	361,443	734	\$45,701
9/29/16	29	311,555	863	\$38,694
10/30/16	30	262,012	763	\$33,259
11/29/16	29	251,851	688	\$32,237
Totals	354	3,399,461	863.28	\$449,725
Annual	365	3,505,094	863.28	\$463,699

3.3 Natural Gas Usage

Natural gas is provided by South Jersey Gas. The average gas cost for the past 12 months is \$0.743/therm, which is the blended rate used throughout the analyses in this report. The monthly gas consumption is shown in the chart below.

Figure 10 - Natural Gas Usage

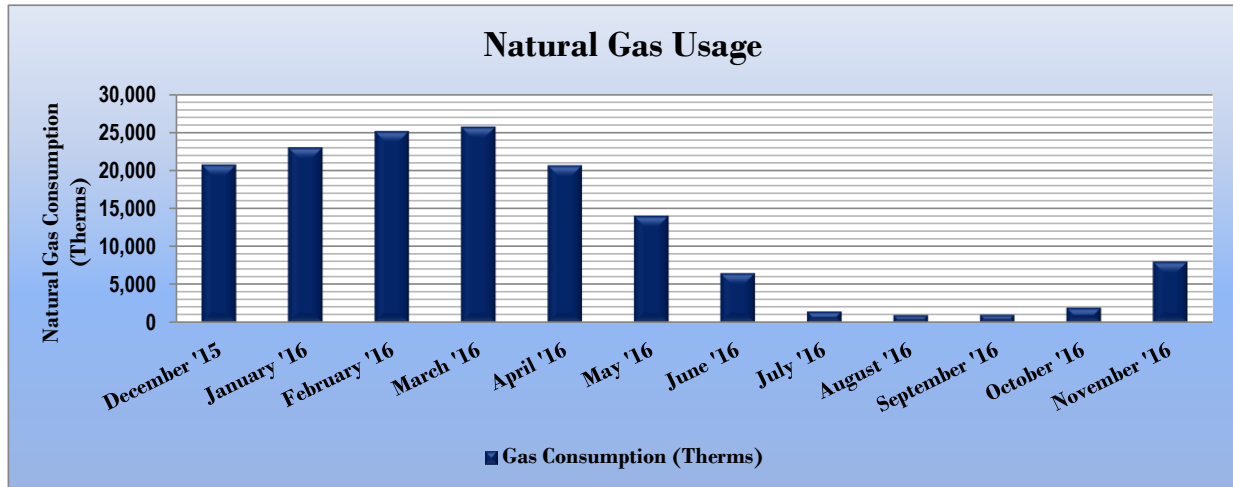


Figure 11 - Natural Gas Usage

Gas Billing Data for George Hess Education Complex			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
12/30/15	30	20,713	\$14,919
1/28/16	28	22,953	\$17,242
2/28/16	30	25,089	\$18,592
3/30/16	30	25,690	\$18,081
4/28/16	28	20,595	\$13,822
5/30/16	31	13,989	\$9,435
6/29/16	29	6,450	\$4,880
7/28/16	28	1,440	\$1,610
8/30/16	32	973	\$1,407
9/29/16	29	1,002	\$1,504
10/30/16	30	1,951	\$2,134
11/29/16	29	7,993	\$6,916
Totals	354	148,838	\$110,544
Annual	365	153,463	\$113,979

3.4 Benchmarking

This facility was benchmarked using Portfolio Manager, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

Figure 12 - Energy Use Intensity Comparison – Existing Conditions

Energy Use Intensity Comparison - Existing Conditions		
	George Hess Education Complex	National Median Building Type: School (K-12)
Source Energy Use Intensity (kBtu/ft ²)	255.6	141.4
Site Energy Use Intensity (kBtu/ft ²)	130.0	58.2

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	George Hess Education Complex	National Median Building Type: School (K-12)
Source Energy Use Intensity (kBtu/ft ²)	194.9	141.4
Site Energy Use Intensity (kBtu/ft ²)	102.3	58.2

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide and may be eligible for ENERGY STAR® certification. Your building is one of the building categories that are eligible to receive a score. This facility has a current score of 28.

One reason why the school has a higher than average EUI score, compared to other schools, is because it has an Olympic-sized swimming pool, which is used year round. Indoor swimming pools always increase a building’s energy usage per square foot significantly.

A Portfolio Manager Statement of Energy Performance (SEP) was generated for this facility, see Appendix B: ENERGY STAR® Statement of **Energy Performance**.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 14 - Energy Balance (kBtu/SF)

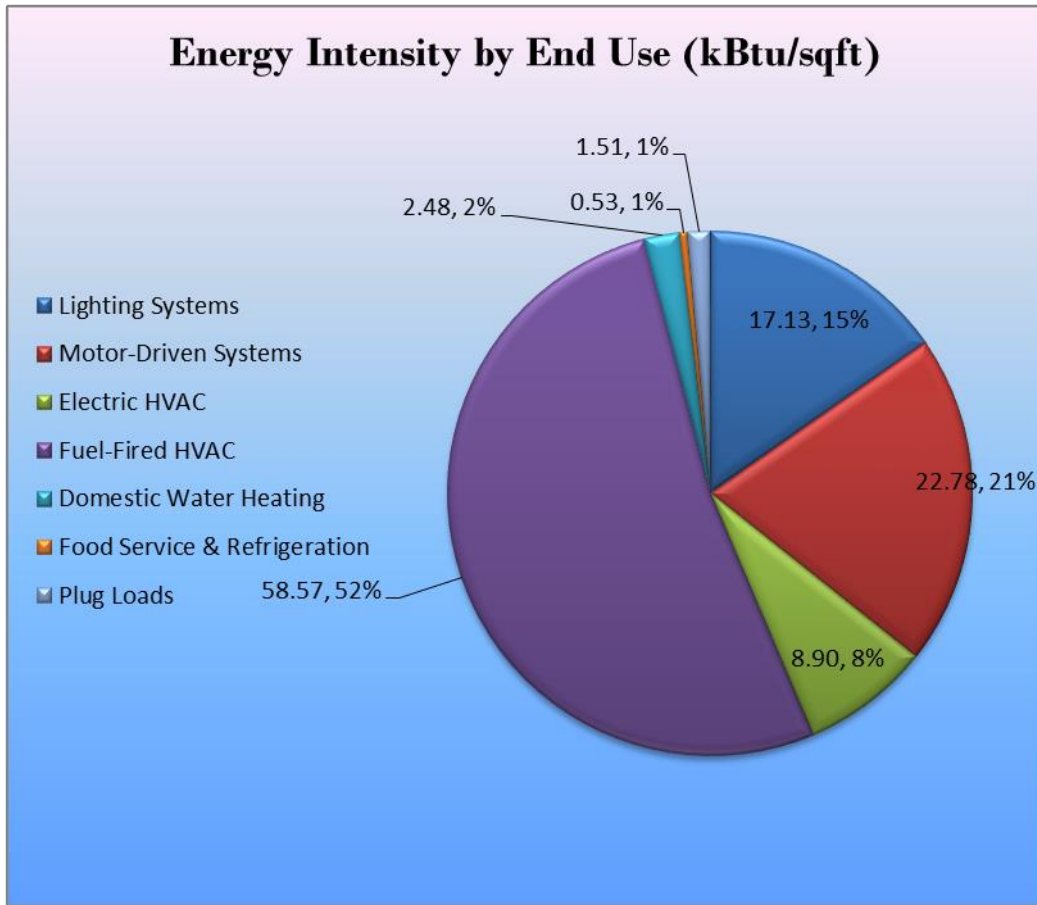

4 ENERGY CONSERVATION MEASURES

Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to the George Hess Educational Complex regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 7.

The following sections describe the evaluated measures.

4.1 High Priority ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 15 – Summary of High Priority ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		717,668	86.4	0.0	\$95,786.13	\$237,926.40	\$34,060.00	\$203,866.40	2.1	722,686
ECM 1	Install LED Fixtures	142,031	16.2	0.0	\$18,956.63	\$54,912.59	\$8,050.00	\$46,862.59	2.5	143,024
ECM 2	Retrofit Fixtures with LED Lamps	575,638	70.2	0.0	\$76,829.50	\$183,013.82	\$26,010.00	\$157,003.82	2.0	579,663
Lighting Control Measures		100,815	11.5	0.0	\$13,455.63	\$49,040.00	\$5,595.00	\$43,445.00	3.2	101,520
ECM 3	Install Occupancy Sensor Lighting Controls	91,110	10.4	0.0	\$12,160.34	\$40,500.00	\$4,480.00	\$36,020.00	3.0	91,747
ECM 4	Install High/Low Lighting Controls	9,705	1.1	0.0	\$1,295.29	\$8,540.00	\$1,115.00	\$7,425.00	5.7	9,773
Motor Upgrades		16,528	3.0	0.0	\$2,205.96	\$27,934.86	\$0.00	\$27,934.86	12.7	16,644
ECM 5	Premium Efficiency Motors	16,528	3.0	0.0	\$2,205.96	\$27,934.86	\$0.00	\$27,934.86	12.7	16,644
Variable Frequency Drive (VFD) Measures		91,377	18.0	0.0	\$12,195.99	\$54,001.40	\$13,650.00	\$40,351.40	3.3	92,016
ECM 6	Install VFD on Variable Air Volume (VAV) HVAC	73,180	18.0	0.0	\$9,767.21	\$41,434.40	\$13,650.00	\$27,784.40	2.8	73,692
ECM 7	Install VFDs on Cooling Tower Fans	18,197	0.0	0.0	\$2,428.77	\$12,567.00	\$0.00	\$12,567.00	5.2	18,325
Gas Heating (HVAC/Process) Replacement		0	0.0	2,580.4	\$19,165.21	\$338,428.23	\$0.00	\$338,428.23	17.7	302,136
ECM 8	Install High Efficiency Hot Water Boilers	0	0.0	2,580.4	\$19,165.21	\$338,428.23	\$0.00	\$338,428.23	17.7	302,136
Plug Load Equipment Control - Vending Machine		3,224	0.0	0.0	\$430.26	\$690.00	\$0.00	\$690.00	1.6	3,246
ECM 9	Vending Machine Control	3,224	0.0	0.0	\$430.26	\$690.00	\$0.00	\$690.00	1.6	3,246
TOTALS FOR HIGH PRIORITY MEASURES		929,612	118.9	2,580.4	\$143,239.19	\$708,020.90	\$53,305.00	\$654,715.90	4.6	1,238,248

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

4.1.1 Lighting Upgrades

Recommended upgrades to existing lighting fixtures are summarized in Figure 16 below.

Figure 16 – Summary of Lighting Upgrade ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		717,668	86.4	0.0	\$95,786.13	\$237,926.40	\$34,060.00	\$203,866.40	2.1	722,686
ECM 1	Install LED Fixtures	142,031	16.2	0.0	\$18,956.63	\$54,912.59	\$8,050.00	\$46,862.59	2.5	143,024
ECM 2	Retrofit Fixtures with LED Lamps	575,638	70.2	0.0	\$76,829.50	\$183,013.82	\$26,010.00	\$157,003.82	2.0	579,663

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 1: Install LED Fixtures

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0
Exterior	142,031	16.2	0.0	\$18,956.63	\$54,912.59	\$8,050.00	\$46,862.59	2.5	143,024

Measure Description

We recommend replacing existing fixtures containing fluorescent, HID, or incandescent lamps with new high performance LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tube and more than ten times longer than many incandescent lamps.

ECM 2: Retrofit Fixtures with LED Lamps

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	575,638	70.2	0.0	\$76,829.50	\$183,013.82	\$26,010.00	\$157,003.82	2.0	579,663
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

Measure Description

We recommend retrofitting existing incandescent and fluorescent lighting technologies with LED lamps. Many LED tube lamps are direct replacements for existing fluorescent lamps and can be installed while leaving the fluorescent fixture ballast in place. LED bulbs can be used in existing fixtures as a direct replacement for most other lighting technologies. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tube and more than ten times longer than many incandescent lamps.

4.1.2 Lighting Control Measures

Figure 17 – Summary of Lighting Control ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures	100,815	11.5	0.0	\$13,455.63	\$49,040.00	\$5,595.00	\$43,445.00	3.2	101,520
ECM 3 Install Occupancy Sensor Lighting Controls	91,110	10.4	0.0	\$12,160.34	\$40,500.00	\$4,480.00	\$36,020.00	3.0	91,747
ECM 4 Install High/Low Lighting Controls	9,705	1.1	0.0	\$1,295.29	\$8,540.00	\$1,115.00	\$7,425.00	5.7	9,773

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 3: Install Occupancy Sensor Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
91,110	10.4	0.0	\$12,160.34	\$40,500.00	\$4,480.00	\$36,020.00	3.0	91,747

Measure Description

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in all restrooms, storage rooms, classrooms, offices areas, etc. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 4: Install High/Low Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
9,705	1.1	0.0	\$1,295.29	\$8,540.00	\$1,115.00	\$7,425.00	5.7	9,773

Measure Description

We recommend installing occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons. Typical areas for such lighting control are stairwells, interior corridors, parking lots, and parking garages.

Lighting fixtures with these controls operate at default low levels when the area is not occupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. The lighting systems are switched to full lighting levels whenever an occupant is detected. Fixtures are automatically switched back to low level after an area has been vacant for a preset period of time. Energy savings results from only providing full lighting levels when it is required.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage needs to be provided to ensure that lights turn on in each area as an occupant approaches.

Additional savings from reduced lighting maintenance may also result from this measure, due to reduced lamp operation.

4.1.3 Motor Upgrades

ECM 5: Premium Efficiency Motors

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
16,528	3.0	0.0	\$2,205.96	\$27,934.86	\$0.00	\$27,934.86	12.7	16,644

Measure Description

We recommend replacing standard efficiency motors with IHP 2014 efficiency motors. Our evaluation assumes that existing motors will be replaced with motors of equivalent size and type. Although occasionally additional savings can be achieved by downsizing motors to better meet the motor's current load requirements. The base case motor efficiencies are estimated from nameplate information and our best estimates of motor run hours. Efficiencies of proposed motor upgrades are obtained from the New Jersey's Clean Energy Program Protocols to Measure Resource Savings (2016). Savings are based on the difference between baseline and proposed efficiencies and the assumed annual operating hours.

4.1.4 Variable Frequency Drive Measures

Our recommendations for variable frequency drive (VFD) measures are summarized in Figure 18 below.

Figure 18 – Summary of Variable Frequency Drive ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures	91,377	18.0	0.0	\$12,195.99	\$54,001.40	\$13,650.00	\$40,351.40	3.3	92,016
ECM 6 Install VFD on Variable Air Volume (VAV) HVAC	73,180	18.0	0.0	\$9,767.21	\$41,434.40	\$13,650.00	\$27,784.40	2.8	73,692
ECM 7 Install VFDs on Cooling Tower Fans	18,197	0.0	0.0	\$2,428.77	\$12,567.00	\$0.00	\$12,567.00	5.2	18,325

ECM 6: Install VFD on Variable Air Volume (VAV) HVAC

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
73,180	18.0	0.0	\$9,767.21	\$41,434.40	\$13,650.00	\$27,784.40	2.8	73,692

Measure Description

We recommend replacing existing air volume control devices on air handling units (AHUs), such as inlet vanes and variable pitch fan blades, with variable frequency drives (VFDs). Inlet guide vanes and variable pitch fan blades are an inefficient means of controlling the air volume compared to VFDs. The existing

volume control device would be removed, or permanently disabled, and the control signal would be redirected to the VFD to determine proper fan motor speed. Energy savings results from more efficient control of motor energy usage when fan motors are operated at partial load. The magnitude of energy savings is based on the estimated amount of time that fan motors would be operated at partial load.

Additional maintenance savings may result from this measure as well, since VFDs are solid state electronic device, which generally requires less maintenance than mechanical air volume control devices.

ECM 7: Install VFDs on Cooling Tower Fans

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
18,197	0.0	0.0	\$2,428.77	\$12,567.00	\$0.00	\$12,567.00	5.2	18,325

Measure Description

We recommend installing variable frequency drives (VFD) to control the cooling tower fan motors. The VFD will allow the cooling tower fan to operate at the minimum speed necessary to maintain the temperature of the condenser water returning to the chiller. Energy savings results from reducing fan speed (and power) when there is a reduced load on the chiller and outside air wet bulb temperatures are depressed. The magnitude of energy savings is based on the estimated amount of time that the system will operate at reduced load.

4.1.5 Gas-Fired Heating System Replacements

Our recommendations for gas-fired heating system replacements are summarized in Figure 19 below.

Figure 19 - Summary of Gas-Fired Heating Replacement ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Gas Heating (HVAC/Process) Replacement	0	0.0	2,580.4	\$19,165.21	\$338,428.23	\$0.00	\$338,428.23	17.7	302,136
ECM 8 Install High Efficiency Hot Water Boilers	0	0.0	2,580.4	\$19,165.21	\$338,428.23	\$0.00	\$338,428.23	17.7	302,136

ECM 8: Install High Efficiency Hot Water Boilers

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	2,580.4	\$19,165.21	\$338,428.23	\$0.00	\$338,428.23	17.7	302,136

Measure Description

We recommend replacing older, inefficient hot water boilers with high efficiency hot water boilers. Significant improvements have been made in combustion technology resulting in increased overall boiler efficiency. Energy savings results from improved combustion efficiency and reduced standby losses at low loads.

The most notable efficiency improvement is condensing hydronic boilers that can achieve over 90% efficiency under the proper conditions. Condensing hydronic boilers typically operate at efficiencies between 85% and 87% (comparable to other high efficiency boilers) when the return water temperature is above 130°F. The boiler efficiency increases as the return water temperature drops below 130°F. Therefore, condensing hydronic boilers were only evaluated when the return water temperature is less than 130°F during most of the operating hours. As a result, condensing hydronic boilers are recommended for this site.

4.1.6 Plug Load Equipment Control - Vending Machines

ECM 9: Vending Machine Control

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
3,224	0.0	0.0	\$430.26	\$690.00	\$0.00	\$690.00	1.6	3,246

Measure Description

Vending machines operate continuously, even during non-business hours. We recommend installing occupancy sensor controls to reduce the energy use. These controls power down vending machines when the vending machine area has been vacant for some time, then power up at regular intervals, as needed, to turn machine lights on or keep the product cool. Energy savings are a dependent on vending machine and activity level in the area surrounding the machines.

4.2 Other Evaluated ECMs

The measures below have been evaluated by the auditor but are not recommended for implementation at the facility. Reasons for exclusion can be found in each measure description section.

4.2.1 Domestic Hot Water Heating System Upgrades

Install High Efficiency Gas-Fired Water Heater

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	65.7	\$487.85	\$120,264.00	\$4,200.00	\$116,064.00	237.9	7,691

Measure Description

We evaluated replacing the existing tank water heater with a high efficiency tank water heater. Improvements in combustion efficiency and reductions in heat losses have improved the overall efficiency of storage water heaters. Energy savings results from using less gas to heat water, due to higher unit efficiency, and fewer run hours to maintain the tank water temperature. Due to the project economics, this measure cannot be recommended based only on savings.

5 ENERGY EFFICIENT PRACTICES

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

Close Doors and Windows

Ensure doors and windows are closed in conditioned spaces. Leaving doors and windows open leads to a significant increase in heat transfer between conditioned spaces and the outside air. Reducing a facility's air changes per hour (ACH) can lead to increased occupant comfort as well as significant heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Use Window Treatments/Coverings

A substantial amount of heat gain can occur through uncovered or untreated windows, especially older single pane windows and east or west-facing windows. Treatments such as high-reflectivity films or covering windows with shades or shutters can reduce solar heat gain and, consequently, cooling load and can reduce internal heat loss and the associated heating load.

Ensure Lighting Controls Are Operating Properly

Lighting controls are very cost effective energy efficient devices, when installed and operating correctly. As part of a lighting maintenance schedule, lighting controls should be tested annually to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight sensors, maintenance involves cleaning of sensor lenses and confirming setpoints and sensitivity are appropriately configured.

Perform Routine Motor Maintenance

Motors consist of many moving parts whose collective degradation can contribute to a significant loss of motor efficiency. In order to prevent damage to motor components, routine maintenance should be performed. This maintenance consists of cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Use Fans to Reduce Cooling Load

Utilizing ceiling fans to supplement cooling is a low cost strategy to reduce cooling load considerably. Thermostat settings can be increased by 4°F with no change in overall occupant comfort when the wind chill effect of moving air is employed for cooling.

Use Thermostat Schedules and Temperature Resets

Ensure thermostats are correctly set back. By employing proper set back temperatures and schedules, facility heating and cooling costs can be reduced dramatically during periods of low or no occupancy. As such, thermostats should be programmed for a setback of 5°F-10 °F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced further by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Perform Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to retain proper functionality and efficiency of the heating system. Fuel burning equipment should undergo yearly tune-ups to ensure they are operating as safely and efficiently as possible from a combustion standpoint. A tune-up should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely. Buildup of dirt, dust, or deposits on the internal surfaces of a boiler can greatly affect its heat transfer efficiency. These deposits can accumulate on the water side or fire side of the boiler. Boilers should be cleaned regularly according to the manufacturer's instructions to remove this build up in order to sustain efficiency and equipment life.

Perform Water Heater Maintenance

At least once a year, drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Once a year check for any leaks or heavy corrosion on the pipes and valves. For gas water heaters, check the draft hood and make sure it is placed properly, with a few inches of air space between the tank and where it connects to the vent. Look for any corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional. For electric water heaters, look for any signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank. For water heaters over three to four years old have a technician inspect the sacrificial anode annually.

Plug Load Controls

There are a variety of ways to limit the energy use of plug loads including increasing occupant awareness, removing under-utilized equipment, installing hardware controls, and using software controls. Some control steps to take are to enable the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips. For additional information refer to "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

Water Conservation

Installing low-flow faucets or faucet aerators, low-flow showerheads, and kitchen sink pre-rinse spray valves saves both energy and water. These devices save energy by reducing the overall amount of hot water used hence reducing the energy used to heat the water. The flow ratings for EPA WaterSense™ (<http://www3.epa.gov/watersense/products>) labeled devices are 1.5 gpm for bathroom faucets, 2.0 gpm for showerheads, and 1.28 gpm for pre-rinse spray valves.

Installing dual flush or low-flow toilets and low-flow or waterless urinals are additional ways to reduce the sites water use, however, these devices do not provide energy savings at the site level. Any reduction in water use does, however, ultimately reduce grid level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users. The EPA WaterSense™ ratings for urinals is 0.5 gpf and toilets that use as little as 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey's Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State's electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility's electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

The facility already has a PV array on a portion of the roof with some free space remaining. TRC noted that there is space available to increase the current system, but the site is reportedly not interested in expanding capacity at this time.

Solar projects must register their projects in the SREC Registration Program prior to the start of construction in order to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about developed new solar projects and insight into future SREC pricing. Refer to Section 8.3 for additional information.

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.

CHP systems are typically used to produce a portion of the electric power used onsite by a facility, with the balance of electric power needs supplied by grid purchases. The heat is used to supplement (or supplant) existing boilers for the purpose of space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for the purpose of space cooling. The key criteria used for screening, however, is the amount of time the system operates at full load and the facility's ability to use the recovered heat. Facilities with continuous use for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has a Low potential for installing a cost-effective CHP system.

For a list of qualified firms in New Jersey specializing in commercial CHP cost assessment and installation, go to: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/.

7 DEMAND RESPONSE

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and, therefore, a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 20 for a list of the eligible programs identified for each recommended ECM.

Figure 20 - ECM Incentive Program Eligibility

Energy Conservation Measure		SmartStart Prescriptive	SmartStart Custom	Direct Install	Pay For Performance Existing Buildings
ECM 1	Install LED Fixtures	X			X
ECM 2	Retrofit Fixtures with LED Lamps	X			X
ECM 3	Install Occupancy Sensor Lighting Controls	X			X
ECM 4	Install High/Low Lightng Controls	X			X
ECM 5	Premium Efficiency Motors				X
ECM 6	Install VFD on Variable Air Volume (VAV) HVAC	X			X
ECM 7	Install VFDs on Cooling Tower Fans	X			X
ECM 8	Install High Efficiency Hot Water Boilers				X
ECM 9	Vending Machine Control				X

SmartStart is generally well-suited for implementation of individual measures or small group of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities that can bundle multiple ECMs together. This can greatly simplify participation and may lead to higher incentive amounts, but requires the use of pre-approved contractors. The Pay for Performance (P4P) program is a “whole-building” energy improvement program designed for larger facilities. It requires implementation of multiple measures meeting minimum savings thresholds, as well as use of pre-approved consultants. This facility appears to meet all of the criteria for participating in the P4P program based on the measures identified in this study. Additional measures may be identified during the P4P evaluation so it is worth considering the P4P program for this site. The Large Energy Users Program (LEUP) is available to New Jersey’s largest energy users giving them flexibility to install as little or as many measures, in a single facility or several facilities, with incentives capped based on the entity’s annual energy consumption. LEUP applicants can use in-house staff or a preferred contractor.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: www.njcleanenergy.com/ci.

8.1 SmartStart

Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: www.njcleanenergy.com/SSB.

8.2 Pay for Performance - Existing Buildings

Overview

The Pay for Performance – Existing Buildings (P4P EB) program is designed for larger customers with a peak demand over 200 kW in any of the preceding 12 months. Under this program the minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings. P4P is a generally a good option for medium to large sized facilities looking to implement as many measures as possible under a single project in order to achieve deep energy savings. This program has an added benefit of evaluating a broad spectrum of measures that may not otherwise qualify under other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also utilize the P4P program.

Incentives

Incentives are calculated based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

To participate in the P4B EB program you will need to contact one of the pre-approved consultants and contractors (“Partners”). Under direct contract to you, the Partner will help further evaluate the measures identified in this report through development of the Energy Reduction Plan (ERP), assist you in implementing selected measures, and verify actual savings one year after the installation. At each of these three milestones your Partner will also facilitate securing program incentives.

Approval of the final scope of work is required by the program prior to installation completion. Although installation can be accomplished by a contractor of your choice (some P4P Partners are also contractors) or by internal personnel, the Partner must remain involved to ensure compliance with the program guidelines and requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: www.njcleanenergy.com/P4P.

8.3 SREC Registration Program

The SREC Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SRP prior to the start of construction in order to establish the project’s eligibility to earn SRECs. Registration of the intent to participate in New Jersey’s solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number which enables it to generate New Jersey SRECs. SREC’s are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SRECs to be placed in the customer’s electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project’s life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar RPS. One way they can meet the RPS requirements is by purchasing SRECs. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period can and will fluctuate depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.

8.4 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program description and application can be found at: www.njcleanenergy.com/ESIP.

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.5 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third party supplier, consider shopping for a reduced rate from third party electric suppliers. If your facility is purchasing electricity from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

8.6 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third party supplier, consider shopping for a reduced rate from third party natural gas suppliers. If your facility is purchasing natural gas from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

Appendix A: Equipment Inventory & Recommendations

Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Rm	27	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	27	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.74	6,474	0.0	\$864.07	\$1,849.50	\$305.00	1.79
Boiler Rm	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Fire Panel Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.04	266	0.0	\$35.46	\$117.00	\$20.00	2.74
Electric Panel Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Fire Pump Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Kitchen (Back)	18	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	18	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.87	7,597	0.0	\$1,013.95	\$1,982.40	\$395.00	1.57
Dishwash Rm	5	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	5	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.24	2,110	0.0	\$281.65	\$745.67	\$135.00	2.17
Laundry Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Serving Line 1	8	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	8	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.11	1,005	0.0	\$134.15	\$557.20	\$75.00	3.59
Serving Line 1	5	Compact Fluorescent: 2 x 26W CFL (recessed cans)	Wall Switch	52	5,000	Relamp	Yes	5	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.14	1,254	0.0	\$167.30	\$709.53	\$35.00	4.03
Walk-in Cooler	2	Compact Fluorescent: 17W CFL screw-in	Wall Switch	17	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.01	127	0.0	\$16.88	\$87.91	\$0.00	5.21
Walk-in Freezer	2	Compact Fluorescent: 17W CFL screw-in	Wall Switch	17	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.01	127	0.0	\$16.88	\$87.91	\$0.00	5.21
Outside Walk-ins	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Outside Walk-ins	1	Compact Fluorescent: 17W CFL screw-in	Wall Switch	17	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.01	63	0.0	\$8.44	\$43.95	\$0.00	5.21
Area near Walk-ins	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.08	719	0.0	\$96.01	\$445.50	\$30.00	4.33
Area near Walk-ins	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Kitchen Storage	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.08	719	0.0	\$96.01	\$445.50	\$30.00	4.33
Kitchen Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$460.27	\$40.00	3.73
Kitchen Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$460.27	\$75.00	3.42
Kitchen Office	1	Compact Fluorescent: 17W CFL screw-in	Wall Switch	17	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.01	63	0.0	\$8.44	\$43.95	\$0.00	5.21
Kitchen Locker Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Kitchen Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Serving Line 2	10	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	10	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.14	1,256	0.0	\$167.69	\$629.00	\$85.00	3.24
Serving Line 2	5	Compact Fluorescent: 2 x 26W CFL (recessed cans)	Wall Switch	52	5,000	Relamp	Yes	5	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.14	1,254	0.0	\$167.30	\$709.53	\$35.00	4.03
Pantry	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.19	1,688	0.0	\$225.32	\$650.53	\$115.00	2.38

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Cafeteria 1	142	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	142	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	2.03	17,841	0.0	\$2,381.15	\$5,367.80	\$745.00	1.94
Cafeteria 1	23	Compact Fluorescent: 2 x 26W CFL (recessed cans)	Wall Switch	52	5,000	Relamp	Yes	23	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.66	5,766	0.0	\$769.59	\$2,291.84	\$35.00	2.93
Cafeteria 1	6	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	6	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.07	587	0.0	\$78.28	\$263.72	\$0.00	3.37
Cafeteria 1	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Faculty Dining	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$87.91	\$0.00	3.37
Faculty Dining	1	Incandescent 60W Incandescent Bulb	Wall Switch	60	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.04	311	0.0	\$41.44	\$43.95	\$5.00	0.94
Mens Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Womens Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Cafeteria 2	142	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	142	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	2.03	17,841	0.0	\$2,381.15	\$5,367.80	\$745.00	1.94
Cafeteria 2	21	Compact Fluorescent: 2 x 26W CFL (recessed cans)	Wall Switch	52	5,000	Relamp	Yes	21	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.60	5,265	0.0	\$702.67	\$2,116.03	\$35.00	2.96
Cafeteria 2	6	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	6	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.07	587	0.0	\$78.28	\$263.72	\$0.00	3.37
Cafeteria 2	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Attic Mech Rm	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.57	5,035	0.0	\$672.05	\$1,498.50	\$245.00	1.87
Principals Office	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Womens Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.02	133	0.0	\$17.73	\$58.50	\$10.00	2.74
Copy Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.13	797	0.0	\$106.37	\$300.80	\$60.00	2.26
Mens Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.02	133	0.0	\$17.73	\$58.50	\$10.00	2.74
Guidance Corridor	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.13	797	0.0	\$106.37	\$300.80	\$60.00	2.26
Guidance Office 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.06	398	0.0	\$53.18	\$150.40	\$30.00	2.26
Guidance Office 2	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.06	398	0.0	\$53.18	\$150.40	\$30.00	2.26
Guidance Office 3	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.06	398	0.0	\$53.18	\$150.40	\$30.00	2.26
Guidance Office 4	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.06	398	0.0	\$53.18	\$150.40	\$30.00	2.26
Guidance Office 5	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.06	398	0.0	\$53.18	\$150.40	\$30.00	2.26
Guidance Office 6	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	114	3,500	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.07	451	0.0	\$60.17	\$190.27	\$40.00	2.50
Copy Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	High/Low Control	114	3,500	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	High/Low Control	58	3,500	0.07	451	0.0	\$60.17	\$190.27	\$40.00	2.50

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Crisis Counselor Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	High/Low Control	114	3,500	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	High/Low Control	58	3,500	0.07	451	0.0	\$60.17	\$190.27	\$40.00	2.50
Psychologist Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	High/Low Control	114	3,500	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	High/Low Control	58	3,500	0.07	451	0.0	\$60.17	\$190.27	\$40.00	2.50
Counseling Waiting Area	4	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,000	None	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.05	400	0.0	\$53.41	\$270.00	\$35.00	4.40
Main Entrance Foyer	34	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	34	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.57	5,005	0.0	\$667.98	\$3,388.80	\$0.00	5.07
Main Entrance Foyer	9	Incandescent: 75W Spotlights (BR30)	Wall Switch	75	5,000	Relamp	Yes	9	LED Screw-In Lamps: Screw-in (6W) - 1L	High/Low Control	6	3,500	0.42	3,664	0.0	\$489.02	\$595.58	\$45.00	1.13
Main Entrance Foyer	8	Compact Fluorescent: 2 x 23W CFL	Wall Switch	46	5,000	Relamp	Yes	8	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.20	1,730	0.0	\$230.85	\$903.25	\$0.00	3.91
Main Entrance Foyer	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Main Entrance Alcove	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$87.91	\$0.00	3.37
Corridor B	12	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	Yes	12	LED Screw-In Lamps: Screw-in (6W) - 1L	High/Low Control	6	3,500	0.15	1,297	0.0	\$173.14	\$927.44	\$0.00	5.36
Corridor B	6	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	6	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.10	883	0.0	\$117.88	\$927.44	\$0.00	7.87
Corridor B	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Corridor B	1	Compact Fluorescent: 4x 17W CFL Screw-in	Wall Switch	68	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.04	357	0.0	\$47.58	\$43.95	\$0.00	0.92
Vice Principal Outer Office	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	High/Low Control	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Vice Principal Outer Office	6	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	6	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.10	883	0.0	\$117.88	\$1,067.44	\$70.00	8.46
Vice Principal Conf Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.16	1,439	0.0	\$192.01	\$570.80	\$95.00	2.48
Vice Principal Office	8	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	8	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.11	1,005	0.0	\$134.15	\$557.20	\$75.00	3.59
Vice Principal Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.01	70	0.0	\$9.40	\$35.90	\$5.00	3.29
Copy Room	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.19	1,688	0.0	\$225.32	\$650.53	\$115.00	2.38
Small Kitchen	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.01	70	0.0	\$9.40	\$35.90	\$5.00	3.29
Corridor E	38	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	38	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.54	4,774	0.0	\$637.21	\$1,904.20	\$190.00	2.69
Corridor E	9	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	9	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.15	1,325	0.0	\$176.82	\$1,191.15	\$0.00	6.74
Corridor E	2	Compact Fluorescent: 2 x 23W CFL	Wall Switch	46	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.04	391	0.0	\$52.19	\$175.81	\$0.00	3.37
Stairwell	4	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.06	506	0.0	\$67.54	\$351.62	\$0.00	5.21
Stairwell	3	Incandescent: 100W Screw-in bulbs (recessed cans)	Wall Switch	100	5,000	Relamp	Yes	3	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	6	3,500	0.19	1,653	0.0	\$220.56	\$401.86	\$15.00	1.75
Courtyard	4	High-Pressure Sodium: (1) 70W Lamp	Wall Switch	95	5,000	Fixture Replacement	No	1	LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture	Wall Switch	20	5,000	0.24	2,070	0.0	\$276.28	\$1,952.99	\$100.00	6.71

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class E-5	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class E-6	15	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	15	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.62	5,395	0.0	\$720.05	\$1,398.00	\$260.00	1.58
Stairwell 5	4	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.06	506	0.0	\$67.54	\$351.62	\$0.00	5.21
Stairwell 5	3	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.03	293	0.0	\$39.14	\$131.86	\$0.00	3.37
Corridor A	47	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	47	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.67	5,905	0.0	\$788.13	\$1,957.30	\$235.00	2.19
Corridor A	14	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	14	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.23	2,061	0.0	\$275.05	\$1,630.68	\$0.00	5.93
Corridor A	3	Compact Fluorescent: 2 x 23W CFL	Wall Switch	46	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.07	587	0.0	\$78.28	\$263.72	\$0.00	3.37
Corridor A	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairwell 2	5	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	5	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.07	633	0.0	\$84.42	\$439.53	\$0.00	5.21
Stairwell 2	3	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.03	293	0.0	\$39.14	\$131.86	\$0.00	3.37
Stairwell 1	4	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.06	506	0.0	\$67.54	\$351.62	\$0.00	5.21
Stairwell 1	3	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.03	293	0.0	\$39.14	\$131.86	\$0.00	3.37
Pre-K Vice Principal Office	8	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	8	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.13	1,178	0.0	\$157.17	\$973.25	\$35.00	5.97
Pre-K Vice Principal Office	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.21	1,798	0.0	\$240.02	\$646.00	\$110.00	2.23
Vice Principal Office 2	2	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.03	253	0.0	\$33.77	\$175.81	\$0.00	5.21
Copy Rm	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.12	1,079	0.0	\$144.01	\$495.60	\$80.00	2.89
VP Office Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Pre-K Office Corridor	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.57	5,035	0.0	\$672.05	\$1,768.50	\$210.00	2.32
Pre-K Office Corridor	6	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	6	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.07	587	0.0	\$78.28	\$263.72	\$0.00	3.37
Pre-K Office Corridor	3	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.04	380	0.0	\$50.65	\$263.72	\$0.00	5.21
Pre-K Office Corridor	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Tech Dept D-101	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Mens Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.04	266	0.0	\$35.46	\$117.00	\$20.00	2.74
Mens Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Womens Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.04	266	0.0	\$35.46	\$117.00	\$20.00	2.74

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Womens Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Nurse Outer Office	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.19	1,688	0.0	\$225.32	\$650.53	\$115.00	2.38
Nurse Outer Office	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Nurse Outer Office	2	Incandescent 60W Incandescent Bulb	Wall Switch	60	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) -1L	Wall Switch	6	5,000	0.07	621	0.0	\$82.88	\$87.91	\$10.00	0.94
Nurses Office Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Nurses Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.04	380	0.0	\$50.65	\$117.00	\$20.00	1.92
Trophy Case	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	None	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	None	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Boys Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Boys Rm	3	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	3	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.03	302	0.0	\$40.29	\$107.70	\$15.00	2.30
Girls Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Girls Rm	3	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	3	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.03	302	0.0	\$40.29	\$107.70	\$15.00	2.30
Handicapped Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.01	70	0.0	\$9.40	\$35.90	\$5.00	3.29
Corridor B	17	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	17	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.24	2,136	0.0	\$285.07	\$880.30	\$85.00	2.79
Corridor B	5	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	5	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.07	633	0.0	\$84.42	\$439.53	\$0.00	5.21
Corridor B	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Teachers Workroom	4	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	5,000	None	No	4	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	5,000	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairway 5	4	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.06	506	0.0	\$67.54	\$351.62	\$0.00	5.21
Stairway 5	3	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.03	293	0.0	\$39.14	\$131.86	\$0.00	3.37
Stairway 6	4	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.06	506	0.0	\$67.54	\$351.62	\$0.00	5.21
Stairway 6	3	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.03	293	0.0	\$39.14	\$131.86	\$0.00	3.37
Boys Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.09	531	0.0	\$70.91	\$234.00	\$40.00	2.74
Boys Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.02	141	0.0	\$18.80	\$71.80	\$10.00	3.29
Girls Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.09	531	0.0	\$70.91	\$234.00	\$40.00	2.74
Girls Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.02	141	0.0	\$18.80	\$71.80	\$10.00	3.29
Handicapped Restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.02	141	0.0	\$18.80	\$71.80	\$10.00	3.29

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class C-101	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class C-102	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-103	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class C-104	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-105	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-106	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-107	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-108	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-109	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-110	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-111	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class C-112	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Basement Mech Rm (pool)	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.22	1,918	0.0	\$256.02	\$738.00	\$115.00	2.43
Pool Area	24	LED Screw-In Lamps: 92W LED (replacement for 250W MH)	Wall Switch	92	5,000	None	Yes	24	LED Screw-In Lamps: 92W LED (replacement for 250W MH)	High/Low Control	92	3,500	0.43	3,809	0.0	\$508.35	\$400.00	\$840.00	-0.87
Pool Area	16	LED Screw-In Lamps: 4x 13W LED Screw-in	Wall Switch	52	5,000	None	Yes	16	LED Screw-In Lamps: 4x 13W LED Screw-in	High/Low Control	52	3,500	0.16	1,435	0.0	\$191.55	\$400.00	\$560.00	-0.84
Pool Area	7	Compact Fluorescent: 40W CFLs	Wall Switch	40	5,000	Relamp	Yes	7	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.14	1,272	0.0	\$169.76	\$1,015.34	\$245.00	4.54
Pool Area	7	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	7	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Upstairs Mech Rm (pool)	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.66	5,755	0.0	\$768.06	\$1,674.00	\$275.00	1.82
Gym	29	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	29	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	1.40	12,239	0.0	\$1,633.58	\$3,028.87	\$615.00	1.48
Gym	11	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	11	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.18	1,619	0.0	\$216.11	\$1,506.97	\$70.00	6.65
Gym	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Pool Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$460.27	\$75.00	3.42
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.01	70	0.0	\$9.40	\$35.90	\$5.00	3.29
Boys Locker Rm	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.33	2,877	0.0	\$384.03	\$972.00	\$155.00	2.13
Washer Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Girls Locker Rm	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.33	2,877	0.0	\$384.03	\$972.00	\$155.00	2.13
Gym Hallway	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.17	1,508	0.0	\$201.22	\$700.80	\$95.00	3.01
Gym Hallway	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Gym Office Area	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Gym Office 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$730.27	\$40.00	6.13
Gym Office 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,000	0.04	322	0.0	\$42.98	\$95.13	\$20.00	1.75
Corridor (Pool to Boiler Rm)	38	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	38	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.64	5,594	0.0	\$746.57	\$3,740.43	\$0.00	5.01
Corridor (Pool to Boiler Rm)	24	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	Yes	24	LED Screw-In Lamps: Screw-in (6W) - 1L	High/Low Control	6	3,500	0.30	2,594	0.0	\$346.27	\$1,454.87	\$0.00	4.20
Corridor (Pool to Boiler Rm)	1	Compact Fluorescent: 40W CFLs	Wall Switch	40	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$43.95	\$0.00	1.68
Corridor (Pool to Boiler Rm)	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Foyer (Pool Area)	6	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	6	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.10	883	0.0	\$117.88	\$927.44	\$0.00	7.87
Alcove (Door 8)	3	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.04	380	0.0	\$50.65	\$263.72	\$0.00	5.21
Boys Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Girls Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Nurses Office	5	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	5	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.24	2,110	0.0	\$281.65	\$745.67	\$135.00	2.17
Nurses Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Nurses Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Boiler Rm Hallway	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Elevators (2)	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	None	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	None	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Library Mech Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
2nd Fir Mech Rm	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.22	1,918	0.0	\$256.02	\$738.00	\$115.00	2.43
2nd Fir Mech Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
2nd Fir Mech Rm 2 (over stage)	4	Compact Fluorescent: 17W CFL screw-in	Wall Switch	17	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.03	253	0.0	\$33.77	\$175.81	\$0.00	5.21
Above Stage	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Above Stage	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Stage	17	High-Pressure Sodium: (1) 250W Lamp	Wall Switch	295	5,000	None	No	17	High-Pressure Sodium: (1) 250W Lamp	Wall Switch	295	5,000	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stage	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Auditorium	132	Halogen Incandescent: 75W Spotlights (BR38)	Wall Switch	75	5,000	Relamp	Yes	132	LED Screw-In Lamps: Screw-in (6W) - 1L	Occupancy Sensor	6	3,500	6.13	53,737	0.0	\$7,172.22	\$6,071.80	\$695.00	0.75
Auditorium	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Main Office	9	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	9	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.15	1,325	0.0	\$176.82	\$1,061.15	\$35.00	5.80
Main Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.04	380	0.0	\$50.65	\$117.00	\$20.00	1.92
Main Office Conf Rm	14	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	14	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.20	1,759	0.0	\$234.76	\$772.60	\$105.00	2.84
T - Hallway	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.17	1,508	0.0	\$201.22	\$700.80	\$60.00	3.18
T - Hallway	12	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	12	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.20	1,766	0.0	\$235.76	\$1,454.87	\$0.00	6.17
T - Hallway	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
T - Hallway	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$87.91	\$0.00	3.37
Rm T-101	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.49	4,316	0.0	\$576.04	\$1,323.00	\$215.00	1.92
Rm T-102	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$460.27	\$75.00	3.42
Rm T-103	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.49	4,316	0.0	\$576.04	\$1,323.00	\$215.00	1.92
Rm T-104	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$460.27	\$75.00	3.42
Rm T-106	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$460.27	\$75.00	3.42
Rm T-108	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	5,000	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,500	0.10	844	0.0	\$112.66	\$460.27	\$75.00	3.42
Class Rm B-101	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-102	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-103	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-104	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-105	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-106	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-107	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-108	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class Rm B-109	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-110	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-111	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-112	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-114	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class Rm B-116	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Custodial Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.04	380	0.0	\$50.65	\$117.00	\$20.00	1.92
Custodial Locker Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Custodial Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Custodial Workshop	20	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	20	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.55	4,796	0.0	\$640.05	\$1,440.00	\$235.00	1.88
Sprinkler Valve Rm	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.16	1,439	0.0	\$192.01	\$621.00	\$95.00	2.74
Class A101	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class A102	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class A103	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class A104	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class A105	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A106	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A107	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A108	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A109	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A110	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A111	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A112	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A113	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class A114	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class A116	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Class A118	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.25	2,158	0.0	\$288.02	\$721.20	\$125.00	2.07
Boys Rm	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.08	719	0.0	\$96.01	\$445.50	\$65.00	3.96
Boys Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Girls Rm	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.08	719	0.0	\$96.01	\$445.50	\$65.00	3.96
Girls Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Handicapped Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Alcove (Door 21)	4	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.04	391	0.0	\$52.19	\$175.81	\$0.00	3.37
Alcove (Door 23)	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$87.91	\$0.00	3.37
Alcove (Door 24)	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$87.91	\$0.00	3.37
Janitors Closet (T1)	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
Corridor D	53	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	53	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.76	6,659	0.0	\$888.74	\$2,172.70	\$265.00	2.15
Corridor D	2	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.03	253	0.0	\$33.77	\$175.81	\$0.00	5.21
Corridor D	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Class D-1	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-1	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Class D-1	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Class D-2	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-2	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Class D-2	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Class D-3	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-3	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Class D-3	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Class D-4	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-4	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class D-4	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Class D-5	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-5	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Class D-5	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Class D-6	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-6	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Class D-6	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Class D-7	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-7	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Class D-7	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Class D-8	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Class D-8	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	5	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.06	503	0.0	\$67.15	\$179.50	\$25.00	2.30
Class D-8	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Library	110	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	110	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	3.01	26,375	0.0	\$3,520.27	\$6,705.00	\$1,135.00	1.58
Library	26	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	26	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.44	3,827	0.0	\$510.81	\$3,635.56	\$175.00	6.77
Library	11	Halogen Incandescent: 100W Screw-in bulbs	Wall Switch	100	5,000	Relamp	Yes	11	LED Screw-In Lamps: Screw-in (6W) -1L	Occupancy Sensor	6	3,500	0.69	6,059	0.0	\$808.73	\$753.48	\$90.00	0.82
Library	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Library Server Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.04	380	0.0	\$50.65	\$117.00	\$20.00	1.92
Comp Lab A204	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Library Office	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.22	1,918	0.0	\$256.02	\$738.00	\$115.00	2.43
Class A203	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.33	2,877	0.0	\$384.03	\$972.00	\$155.00	2.13
Top of Main Stairs (2nd Flr)	21	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	21	LED Screw-In Lamps: Screw-in (6W) - 2L	Occupancy Sensor	12	3,500	0.35	3,091	0.0	\$412.58	\$2,386.03	\$0.00	5.78
Top of Main Stairs (2nd Flr)	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.33	2,877	0.0	\$384.03	\$972.00	\$120.00	2.22
Top of Main Stairs (2nd Flr)	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Boys Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boys Rm	3	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	3	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.03	302	0.0	\$40.29	\$107.70	\$15.00	2.30
Girls Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Girls Rm	3	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	3	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.03	302	0.0	\$40.29	\$107.70	\$15.00	2.30
Handicapped Restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Janitors Closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,000	0.02	190	0.0	\$25.33	\$58.50	\$10.00	1.92
2nd Flr Front Hallway	14	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	Yes	14	LED Screw-In Lamps: Screw-in (6W) - 1L	High/Low Control	6	3,500	0.17	1,513	0.0	\$201.99	\$1,015.34	\$0.00	5.03
2nd Flr Front Hallway	8	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	8	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.13	1,178	0.0	\$157.17	\$1,103.25	\$0.00	7.02
2nd Flr Front Hallway	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Class D-205	11	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	11	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.45	3,956	0.0	\$528.04	\$1,097.20	\$200.00	1.70
Class D-205 Restroom 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Class D-205 Restroom 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Corridor C-200	29	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	29	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.42	3,643	0.0	\$486.29	\$1,311.10	\$145.00	2.40
Corridor C-200	9	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	9	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.15	1,325	0.0	\$176.82	\$1,191.15	\$0.00	6.74
Corridor C-200	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$87.91	\$0.00	3.37
Corridor C-200	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairway 6	4	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	4	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.06	506	0.0	\$67.54	\$351.62	\$0.00	5.21
Stairway 6	3	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.03	293	0.0	\$39.14	\$131.86	\$0.00	3.37
2nd Flr Back Corridor	18	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	18	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.26	2,261	0.0	\$301.84	\$916.20	\$90.00	2.74
2nd Flr Back Corridor	3	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	3	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.04	380	0.0	\$50.65	\$263.72	\$0.00	5.21
2nd Flr Back Corridor	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	34	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.04	322	0.0	\$42.98	\$87.91	\$0.00	2.05
2nd Flr Back Corridor	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Corridor B-200	29	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	29	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.42	3,643	0.0	\$486.29	\$1,311.10	\$145.00	2.40
Corridor B-200	7	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	7	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.12	1,030	0.0	\$137.53	\$1,015.34	\$0.00	7.38
Corridor B-200	2	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	2	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.02	196	0.0	\$26.09	\$87.91	\$0.00	3.37
Corridor B-200	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class B201	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B202	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B203	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B204	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B205	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B206	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B207	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B208	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B209	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B210	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class B211	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class B212	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class B214	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class C201	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.03	199	0.0	\$26.59	\$75.20	\$15.00	2.26
Class C201 Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	5,000	0.03	285	0.0	\$37.99	\$75.20	\$15.00	1.58
Class C202	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class C203	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C204	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class C205	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C206	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C207	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C208	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C209	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C210	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C211	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class C212	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C213	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C214	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class C215	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class C216	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Boys Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	4	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.05	403	0.0	\$53.72	\$143.60	\$20.00	2.30
Boys Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Girls Rm	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	5,000	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.11	959	0.0	\$128.01	\$504.00	\$75.00	3.35
Girls Rm	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	2	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.02	201	0.0	\$26.86	\$71.80	\$10.00	2.30
Handicapped Restroom 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Handicapped Restroom 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Corridor D-200	8	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	Yes	8	LED Screw-In Lamps: Screw-in (6W) - 1L	High/Low Control	6	3,500	0.10	865	0.0	\$115.42	\$751.62	\$0.00	6.51
Corridor D-200	6	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	6	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.10	883	0.0	\$117.88	\$927.44	\$0.00	7.87
Corridor D-200	6	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	6	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.09	754	0.0	\$100.61	\$485.40	\$30.00	4.53
Corridor D-200	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Art Class D-202	12	Halogen Incandescent: 75W Spotlights	Wall Switch	75	5,000	Relamp	Yes	12	LED Screw-In Lamps: Screw-in (6W) - 1L	Occupancy Sensor	6	3,500	0.56	4,885	0.0	\$652.02	\$797.44	\$95.00	1.08
Art Class D-202	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Art Class D-202	1	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.01	127	0.0	\$16.88	\$87.91	\$0.00	5.21
Art Class D-204	12	Halogen Incandescent: 75W Spotlights	Wall Switch	75	5,000	Relamp	Yes	12	LED Screw-In Lamps: Screw-in (6W) - 1L	Occupancy Sensor	6	3,500	0.56	4,885	0.0	\$652.02	\$797.44	\$95.00	1.08
Art Class D-204	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	93	5,000	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.49	4,316	0.0	\$576.04	\$1,172.40	\$215.00	1.66
Art Class D-204	1	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 2L	Wall Switch	12	5,000	0.01	127	0.0	\$16.88	\$87.91	\$0.00	5.21
Corridor A-200	48	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	Yes	48	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.69	6,031	0.0	\$804.90	\$1,993.20	\$240.00	2.18
Corridor A-200	12	Compact Fluorescent: 2 x 17W CFL (recessed cans)	Wall Switch	34	5,000	Relamp	Yes	12	LED Screw-In Lamps: Screw-in (6W) - 2L	High/Low Control	12	3,500	0.20	1,766	0.0	\$235.76	\$1,454.87	\$0.00	6.17
Corridor A-200	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Class A-201	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Class A-203	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class A-203	1	Compact Fluorescent: 23W CFL screw-in	Wall Switch	23	5,000	Relamp	No	1	LED Screw-In Lamps: Screw-in (6W) - 1L	Wall Switch	6	5,000	0.01	98	0.0	\$13.05	\$43.95	\$0.00	3.37
Class A-205	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class A-206	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-207	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-208	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-209	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-210	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.26	1,594	0.0	\$212.74	\$601.60	\$120.00	2.26
Class A-210	4	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	4	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.05	282	0.0	\$37.60	\$143.60	\$20.00	3.29
Class A-210 Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	32	3,500	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,500	0.01	70	0.0	\$9.40	\$35.90	\$5.00	3.29
Class A-211	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-212	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-213	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-214	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-215	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class A-216	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.39	2,391	0.0	\$319.10	\$902.40	\$180.00	2.26
Class A-218	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Class A-220	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	93	3,500	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,500	0.19	1,195	0.0	\$159.55	\$451.20	\$90.00	2.26
Boys Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Girls Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Handicapped Restroom 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Handicapped Restroom 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	32	5,000	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	5,000	0.01	101	0.0	\$13.43	\$35.90	\$5.00	2.30
Janitor Closet J-6	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	62	3,500	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,500	0.06	398	0.0	\$53.18	\$175.50	\$30.00	2.74
Display Case	6	Halogen Incandescent: Small café lights (MR16)	None	50	5,000	Relamp	Yes	6	LED Screw-In Lamps: Screw-in (6W) - 1L	Occupancy Sensor	6	3,500	0.18	1,580	0.0	\$210.89	\$533.72	\$65.00	2.22
Exterior Columns	9	High-Pressure Sodium: (1) 100W Lamp	Wall Switch	138	5,000	Fixture Replacement	No	9	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	20	5,000	0.70	6,107	0.0	\$815.03	\$3,516.09	\$900.00	3.21

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Front Soffit	5	High-Pressure Sodium: (1) 100W Lamp	Wall Switch	138	5,000	Fixture Replacement	No	5	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	20	5,000	0.39	3,393	0.0	\$452.79	\$1,953.39	\$500.00	3.21
Over Front Door	2	High-Pressure Sodium: (1) 100W Lamp	Wall Switch	138	5,000	Fixture Replacement	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	20	5,000	0.15	1,357	0.0	\$181.12	\$781.35	\$200.00	3.21
Poles at Front Walk	39	High-Pressure Sodium: (1) 150W Lamp	Wall Switch	188	5,000	Fixture Replacement	No	39	LED - Fixtures: Outdoor Pole/Arm-Mounted Decorative Fixture	Wall Switch	20	5,000	4.29	37,674	0.0	\$5,028.29	\$13,501.22	\$1,950.00	2.30
Building Perimeter	34	High-Pressure Sodium: (1) 100W Lamp	Wall Switch	138	5,000	Fixture Replacement	No	34	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	20	5,000	2.63	23,069	0.0	\$3,078.99	\$13,283.02	\$3,400.00	3.21
Building Perimeter	10	High-Pressure Sodium: (1) 150W Lamp	Wall Switch	188	5,000	Fixture Replacement	No	10	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	20	5,000	1.10	9,660	0.0	\$1,289.31	\$3,906.77	\$1,000.00	2.25
Building Perimeter	5	LED - Fixtures: Wall-Wash Lights	Wall Switch	37	5,000	None	No	5	LED - Fixtures: Wall-Wash Lights	Wall Switch	37	5,000	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Parking Lot Lights	41	High-Pressure Sodium: (1) 250W Lamp	Wall Switch	295	5,000	Fixture Replacement	No	41	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	46	5,000	6.69	58,702	0.0	\$7,834.84	\$16,017.76	\$0.00	2.04

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Outside	Cooling tower	2	Cooling Tower Fan	5.0	87.5%	No	3,020	No	87.5%	Yes	2	0.00	11,198	0.0	\$1,494.63	\$6,551.70	\$0.00	4.38
Outside	Cooling tower	2	Cooling Tower Fan	3.0	84.0%	No	3,020	No	84.0%	Yes	2	0.00	6,999	0.0	\$934.14	\$6,015.30	\$0.00	6.44
Boiler room	Condenser water	2	Condenser Water Pump	50.0	94.1%	Yes	4,474	No	94.1%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Boiler room	Domestic hot water	1	Water Supply Pump	0.8	82.5%	No	3,020	No	82.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Boiler room	Space heating	2	Heating Hot Water Pump	15.0	91.7%	Yes	3,730	No	91.7%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Boiler room	Space cooling	2	Water-Source Heat Pump Circulation Pump	75.0	94.1%	Yes	5,862	Yes	95.0%	No		0.63	4,953	0.0	\$661.06	\$10,894.00	\$0.00	16.48
Boiler room	Fire pump	1	Other	30.0	88.5%	No	100	No	88.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Pool mechanical	Filter	1	Process Pump	10.0	84.0%	No	3,730	Yes	91.7%	No		0.41	2,086	0.0	\$278.45	\$1,343.55	\$0.00	4.83
Pool mechanical	Sump	2	Process Pump	5.0	84.0%	No	3,020	Yes	89.5%	No		0.30	1,236	0.0	\$164.96	\$1,600.74	\$0.00	9.70
Whole builling	Heat pumps	4	Supply Fan	7.5	88.5%	No	3,730	Yes	91.0%	Yes	4	4.33	18,262	0.0	\$2,437.36	\$18,952.96	\$4,650.00	5.87
Whole builling	Heat pumps	3	Supply Fan	15.0	89.5%	No	3,730	Yes	93.0%	Yes	3	6.55	27,790	0.0	\$3,709.12	\$21,123.51	\$5,400.00	4.24
Whole builling	Heat pumps	3	Supply Fan	10.0	87.5%	No	3,730	Yes	91.7%	Yes	3	8.79	35,381	0.0	\$4,722.25	\$15,454.50	\$3,600.00	2.51
Whole builling	AHU	4	Supply Fan	5.0	82.5%	No	3,020	No	82.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Whole builling	AHU	7	Supply Fan	10.0	82.5%	No	3,730	No	82.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions									Energy Impact & Financial Analysis							
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical rooms	Space cooling	4	Water Source HP	25.00	0.00	No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical rooms	Space cooling	3	Water Source HP	30.00	0.00	No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Mechanical rooms	Space cooling	3	Water Source HP	20.00	0.00	No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric Chiller Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions								Energy Impact & Financial Analysis							
		Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/ Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Mechanical room	Space cooling	1	Water-Cooled Centrifugal Chiller	200.00	No								0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler room	Space heating	1	Non-Condensing Hot Water Boiler	9,230.00	Yes	2	Condensing Hot Water Boiler	9,230.00	93.00%	Ec	0.00	0	2,580.4	\$19,165.21	\$338,428.23	\$0.00	17.66
Boiler room	Pool	1	Non-Condensing Hot Water Boiler	450.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Whole building	Space heating	2	Furnace	80.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions						Energy Impact & Financial Analysis					
		System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler room	Domestic hot water	2	Storage Tank Water Heater (> 50 Gal)	Yes	2	Storage Tank Water Heater (> 50 Gal)	Natural Gas	95.00%	Et	0.00	0	65.7	\$487.85	\$120,264.00	\$4,200.00	237.91

Commercial Refrigerator/Freezer Inventory & Recommendations

Location	Existing Conditions			Proposed Condi	Energy Impact & Financial Analysis						
	Quantity	Refrigerator/ Freezer Type	ENERGY STAR Qualified?	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Stand-Up Freezer, Solid Door (>50 cu. ft.)	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Kitchen	1	Stand-Up Refrigerator, Solid Door (>50 cu. ft.)	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Kitchen	1	Stand-Up Freezer, Solid Door (>50 cu. ft.)	Yes	No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00


Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Whole building	200	Desktop	110.0	Yes
Whole building	4	Copier	1,400.0	Yes
Whole building	9	Printer	460.0	Yes
Whole building	25	CRT (25")	120.0	Yes
Whole building	6	Microwave	1,000.0	No
Whole building	5	Refrigerator	750.0	Yes
Whole building	5	Refrigerator	750.0	Yes
Whole building	1	Dishwasher	1,500.0	Yes
Whole building	1	Washing machine	900.0	Yes
Whole building	1	Dryer	1,600.0	Yes
Whole building	6	LCD (42")	120.0	Yes

Vending Machine Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions	Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Break room	2	Refrigerated	Yes	0.00	3,224	0.0	\$430.26	\$460.00	\$0.00	1.07
Break room	1	Non-Refrigerated	No	0.00	0	0.0	\$0.00	\$230.00	\$0.00	0.00

Appendix B: ENERGY STAR® Statement of Energy Performance



ENERGY STAR® Statement of Energy Performance

28

ENERGY STAR®
Score¹

George Hess Education Complex

Primary Property Type: K-12 School
Gross Floor Area (ft²): 210,000
Built: 1992

For Year Ending: October 31, 2016
Date Generated: August 18, 2017

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address George Hess Education Complex 700 Babcock Road Mays Landing, New Jersey 08330	Property Owner Hamilton Township School District 1876 Dr. Dennis Foreman Drive Mays Landing, NJ 08330 609-476-6303	Primary Contact Anne-Marie Fala 1876 Dr. Dennis Foreman Drive Mays Landing, NJ 08330 609-476-6303 falaa@hamiltonschools.org
Property ID: 5999262		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 126.7 kBtu/ft ²	Annual Energy by Fuel		National Median Comparison
	Natural Gas (kBtu)	15,042,003 (56%)	National Median Site EUI (kBtu/ft ²)
	Electric - Solar (kBtu)	305,779 (1%)	National Median Source EUI (kBtu/ft ²)
	Electric - Grid (kBtu)	11,260,578 (42%)	% Diff from National Median Source EUI
Source EUI 245 kBtu/ft ²			Annual Emissions
			Greenhouse Gas Emissions (Metric Tons CO ₂ e/year)
			2,048

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer Stamp
(if applicable)