



Local Government Energy Audit: Energy Audit Report



Copyright ©2016 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

**Iselin Branch
Public Library**

Township of Woodbridge

1081 Green Street
Iselin, NJ 08830

April 26, 2018

Final Report by:
TRC Energy Services

Disclaimer

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

Table of Contents

| | | |
|----------|---|-----------|
| 1 | Executive Summary..... | 1 |
| 1.1 | Facility Summary | 1 |
| 1.2 | Your Cost Reduction Opportunities..... | 1 |
| | Energy Conservation Measures..... | 1 |
| | Energy Efficient Practices | 2 |
| | On-Site Generation Measures..... | 3 |
| 1.3 | Implementation Planning..... | 3 |
| 2 | Facility Information and Existing Conditions | 5 |
| 2.1 | Project Contacts | 5 |
| 2.2 | General Site Information..... | 5 |
| 2.3 | Building Occupancy | 5 |
| 2.4 | Building Envelope | 6 |
| 2.5 | On-site Generation..... | 6 |
| 2.6 | Energy-Using Systems | 6 |
| | Lighting System | 6 |
| | Air Conditioning (DX) and Heating System..... | 7 |
| | Domestic Hot Water..... | 7 |
| | Plug load & Vending Machines | 7 |
| 2.7 | Water-Using Systems | 7 |
| 3 | Site Energy Use and Costs..... | 8 |
| 3.1 | Total Cost of Energy | 8 |
| 3.2 | Electricity Usage | 9 |
| 3.3 | Natural Gas Usage | 10 |
| 3.4 | Benchmarking..... | 11 |
| 3.5 | Energy End-Use Breakdown | 12 |
| 4 | Energy Conservation Measures | 13 |
| 4.1 | Recommended ECMs | 13 |
| 4.1.1 | Lighting Upgrades..... | 14 |
| | ECM 1: Install LED Fixtures..... | 14 |
| | ECM 2: Retrofit Fixtures with LED Lamps..... | 15 |
| | ECM 3: Install LED Exit Signs..... | 15 |
| 4.1.2 | Lighting Control Measures | 16 |
| | ECM 4: Install Occupancy Sensor Lighting Controls | 16 |
| 4.1.3 | Domestic Water Heating Upgrade | 17 |
| | ECM 5: Install Low-Flow DHW Devices..... | 17 |
| 5 | Energy Efficient Practices | 18 |
| | Reduce Air Leakage | 18 |
| | Close Doors and Windows | 18 |
| | Perform Proper Lighting Maintenance..... | 18 |

| | |
|--|-----------|
| Develop a Lighting Maintenance Schedule | 18 |
| Ensure Lighting Controls Are Operating Properly | 18 |
| Use Fans to Reduce Cooling Load | 19 |
| Practice Proper Use of Thermostat Schedules and Temperature Resets | 19 |
| Clean and/or Replace HVAC Filters | 19 |
| Check for and Seal Duct Leakage | 19 |
| Perform Proper Water Heater Maintenance | 19 |
| Water Conservation | 20 |
| 6 On-Site Generation Measures | 21 |
| 6.1 Photovoltaic..... | 21 |
| 6.2 Combined Heat and Power | 22 |
| 7 Demand Response | 24 |
| 8 Project Funding / Incentives | 25 |
| 8.1 SmartStart | 26 |
| 8.2 Direct Install | 27 |
| 8.3 Energy Savings Improvement Program | 28 |
| 9 Energy Purchasing and Procurement Strategies | 29 |
| 9.1 Retail Electric Supply Options..... | 29 |
| 9.2 Retail Natural Gas Supply Options | 29 |

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

Table of Figures

Figure 1 – Previous 12 Month Utility Costs..... 1

Figure 2 – Potential Post-Implementation Costs 1

Figure 3 – Summary of Energy Reduction Opportunities 2

Figure 4 – Project Contacts 5

Figure 5 - Building Schedule..... 5

Figure 6 - Utility Summary 8

Figure 7 - Energy Cost Breakdown 8

Figure 8 -Electric Usage & Demand 9

Figure 9 -Electric Usage & Demand 9

Figure 10 -Natural Gas Usage 10

Figure 11 -Natural Gas Usage 10

Figure 12 - Energy Use Intensity Comparison – Existing Conditions..... 11

Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures 11

Figure 14 - Energy Balance kBtu/SF, %) 12

Figure 15 – Summary of Recommended ECMs..... 13

Figure 16 – Summary of Lighting Upgrade ECMs..... 14

Figure 17 – Summary of Lighting Control ECMs 16

Figure 18 - Summary of Domestic Water Heating ECMs 17

Figure 19 - Photovoltaic Screening 21

Figure 20 - Combined Heat and Power Screening 23

Figure 21 - ECM Incentive Program Eligibility 25

I EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for the Iselin Branch Public Library.

The goal of a LGEA is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and to allow you to implement the ECMs. The LGEA also sets you on the path to receive financial incentives from New Jersey’s Clean Energy Program (NJCEP) for implementing the ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist New Jersey municipalities in controlling energy costs and protecting our environment by offering a full spectrum of energy management options.

I.1 Facility Summary

The Iselin Branch Public Library is a two-story, 8,700 square-foot building constructed in 1969. The building has a shed roof type and exterior walls are finished with brick masonry. The windows are glazed with insulated panes set in metal frames. Interior lighting consists of a combination of T5 linear fixtures and lamps and compact fluorescent lamps (CFL). Lighting control is provided by manual wall switches. Heating is provided by two gas-fired furnaces. Cooling is provided by two Carrier indoor packaged cooling units located on the attic floor.

A thorough description of the facility and our observations are located in Section 2.

I.2 Your Cost Reduction Opportunities

Energy Conservation Measures

TRC evaluated five projects which represent an opportunity for the Iselin Branch Public Library to reduce annual energy costs by \$2,541 and annual greenhouse gas emissions by 14,750 lbs CO₂e. The measures would pay for themselves in four years. The breakdown of existing and potential utility costs is illustrated in Figure 1 and Figure 2, respectively. These projects represent an opportunity to reduce the Iselin Branch Public Library’s annual energy use by 6.7%.

Figure 1 – Previous 12 Month Utility Costs


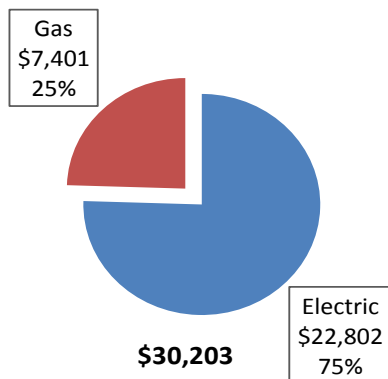


Figure 2 – Potential Post-Implementation Costs

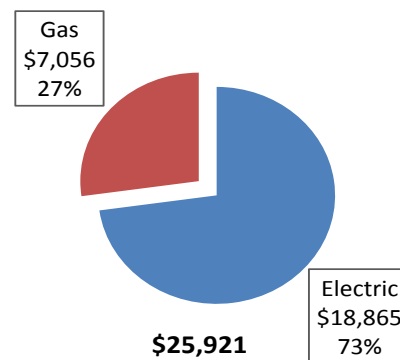

A detailed description of the Iselin Branch Public Library’s existing energy use can be found in Section 3.

The evaluated measures have been listed and grouped into major categories as shown in Figure 3. Brief descriptions of the categories can be found below and descriptions of the individual opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

| Energy Conservation Measure | | Recommend? | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$)* | Estimated Net Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|---------------------------------------|---|------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|---------------------------|-------------------------|-------------------------------|---|
| Lighting Upgrades | | | 11,033 | 4.6 | 0.0 | \$2,186.14 | \$11,717.11 | \$1,550.00 | \$10,167.11 | 4.65 | 11,110 |
| ECM 1 | Install LED Fixtures | Yes | 3,943 | 1.9 | 0.0 | \$781.17 | \$4,363.35 | \$405.00 | \$3,958.35 | 5.07 | 3,970 |
| ECM 2 | Retrofit Fixtures with LED Lamps | Yes | 6,616 | 2.7 | 0.0 | \$1,310.83 | \$6,708.43 | \$1,145.00 | \$5,563.43 | 4.24 | 6,662 |
| ECM 3 | Install LED Exit Signs | Yes | 475 | 0.0 | 0.0 | \$94.14 | \$645.33 | \$0.00 | \$645.33 | 6.85 | 478 |
| Lighting Control Measures | | | 45 | 0.0 | 0.0 | \$8.86 | \$348.00 | \$60.00 | \$288.00 | 32.49 | 45 |
| ECM 4 | Install Occupancy Sensor Lighting Controls | Yes | 45 | 0.0 | 0.0 | \$8.86 | \$348.00 | \$60.00 | \$288.00 | 32.49 | 45 |
| Domestic Water Heating Upgrade | | | 0 | 0.0 | 30.7 | \$345.69 | \$43.02 | \$0.00 | \$43.02 | 0.12 | 3,595 |
| ECM 5 | Install Low-Flow Domestic Hot Water Devices | Yes | 0 | 0.0 | 30.7 | \$345.69 | \$43.02 | \$0.00 | \$43.02 | 0.12 | 3,595 |
| TOTALS | | | 11,078 | 4.6 | 30.7 | \$2,540.70 | \$12,108.13 | \$1,610.00 | \$10,498.13 | 4.13 | 14,750 |

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Lighting Upgrades generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measures save energy by reducing the power used by the lighting components due to improved electrical efficiency.

Lighting Controls measures generally involve the installation of automated controls to turn off lights or reduce light output when conditions allow. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

Domestic Water Heating upgrade measures generally involve replacing old inefficient domestic water heating systems with modern energy efficient systems. New domestic water heating systems can provide equivalent or greater capacity as older systems, but use less energy. These measures save energy by reducing the fuel used by the domestic water heating systems due to improved efficiency or the removal of standby losses.

Energy Efficient Practices

TRC also identified 11 low cost (or no cost) energy efficient practices. A facility’s energy performance can be significantly improved by employing certain behavioral and operational adjustments as well as performing routine maintenance on building systems. Through these practices equipment lifetime can be extended; occupant comfort, health and safety can be improved; and annual energy, operation, and maintenance costs can be reduced. Opportunities identified at the Iselin Branch Public Library include:

- Reduce Air Leakage
- Close Doors and Windows
- Perform Proper Lighting Maintenance
- Develop a Lighting Maintenance Schedule
- Ensure Lighting Controls Are Operating Properly
- Use Fans to Reduce Cooling Load
- Practice Proper Use of Thermostat Schedules and Temperature Resets
- Clean and/or Replace HVAC Filters
- Check for and Seal Duct Leakage

- Perform Proper Water Heater Maintenance
- Water Conservation

For details on these energy efficient practices, please refer to Section 5.

On-Site Generation Measures

TRC evaluated the potential for installing self-generation sources for the Iselin Branch Public Library. Based on the configuration of the site and its loads there is a low potential for installing any PV and combined heat and power self-generation measures.

For details on our evaluation and the on-site generation potential, please refer to Section 6.

I.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, the equipment changes outlined for each ECM need to be selected and installed through project implementation. One of the first considerations is if there is capital available for project implementation. Another consideration is whether to pursue individual ECMs, a group of ECMs, or a comprehensive approach wherein all ECMs are pursued, potentially in conjunction with other facility projects or improvements.

Rebates, incentives, and financing are available from the NJBPU, NJCEP, as well as some of the state's investor-owned utilities, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any project, please review the appropriate incentive program guidelines before proceeding. This is important because in most cases you will need to submit an application for the incentives before purchasing materials and beginning installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Direct Install
- Energy Savings Improvement Program (ESIP)

For facilities with capital available for implementation of selected individual measures or phasing implementation of selected measures over multiple years, incentives are available through the SmartStart program. To participate in this program, you may utilize internal resources, or an outside firm or contractor, to design the ECM(s), select the equipment and apply for the incentive(s). Program pre-approval is required for some SmartStart incentives, so only after receiving approval may the ECM(s) be installed. The incentive values listed above in Figure 3 represent the SmartStart program and will be explained further in Section 8, as well as the other programs as mentioned below.

This facility also qualifies for the Direct Install program which, through an authorized network of participating contractors, can assist with the implementation of a group of measures versus installing individual measures or phasing implementation. This program is designed to be turnkey and will provide an incentive up to 70% of the cost of the project identified by the designated contractor.

For facilities without capital available to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with external project development, design, and implementation services as well as financing for implementing ECMs. This LGEA report is the first step for participating in ESIP and should help you determine next steps. Refer to Section 8.3 for additional information on the ESIP Program.

Additional descriptions of all relevant incentive programs are located in Section 8 or: www.njcleanenergy.com/ci.

To ensure projects are implemented such that maximum savings and incentives are achieved, bids and specifications should be reviewed by your procurement personnel and/or consultant(s) to ensure that selected equipment coincides with LGEA recommendations, as well as applicable incentive program guidelines and requirements.

2 FACILITY INFORMATION AND EXISTING CONDITIONS

2.1 Project Contacts

Figure 4 – Project Contacts

| Name | Role | E-Mail | Phone # |
|----------------------------------|-------------------------|--|----------------|
| Customer | | | |
| Brian B. Burke | Building Superintendent | brian.burke@twp.woodbridge.nj.us | (732) 634-4500 |
| Designated Representative | | | |
| Demuis Kasiewicz | Custodian | | (732) 726-7073 |
| TRC Energy Services | | | |
| Moussa Traore | Auditor | mtraore@trcsolutions.com | (732) 855-0033 |

2.2 General Site Information

On September 1, 2016, TRC performed an energy audit at the Iselin Branch Public Library located in Iselin, New Jersey. TRC’s auditor met with Demuis Kasiewicz to review the facility operations and focus the investigation on specific energy-using systems.

The 8,700 square-foot library is a two-story building constructed in 1969.

The township’s library system is very interested in exploring cost-effective options that can make the building and its systems more efficient.



2.3 Building Occupancy

The Iselin Branch Public Library is open Monday through Saturday with an early closure on Saturday. The typical schedule is presented in the table below.

Figure 5 - Building Schedule

| Building Name | Weekday/Weekend | Operating Schedule |
|------------------------------|-----------------|--------------------|
| Iselin Branch Public Library | Weekday | 10:00 AM - 5:30 PM |
| Iselin Branch Public Library | Weekend | 10:00 AM - 1:00 PM |

2.4 Building Envelope

The foundation consists of cast-in-place concrete perimeter wall footings. Exterior walls are finished with brick masonry. The building has a shed roof type that was inaccessible during the field audit, however it is reported to be in good condition by the site contact.

The entrance door is fully glazed and metal framed. The windows are glazed with insulated panes set in metal frames. The windows are part of a metal-framed storefront system incorporating the front entry door.

The building base and its perimeter were inspected for signs of uncontrolled moisture or water presence and other energy-compromising issues. Overall, the building envelope appeared to be in relatively good condition with no obvious signs of leakage or excessive air infiltration.



2.5 On-site Generation

Iselin Branch Public Library does not have any on-site electric generation capacity.

2.6 Energy-Using Systems

Please refer to Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

Lighting System

The lighting system consists of 28-Watt linear fluorescent T5 lamps and fixtures with electronic ballasts and compact fluorescent lamps (CFL). The main area and the reception area are lit with a combination of linear fluorescent T5 and (CFL). The meeting room is lit with T5 linear recessed and surfaced mounted fixtures. The work area, the office, the kitchen, the maintenance room, and restrooms are all lit with T5 linear fluorescent lamps and fixtures. Lighting control is provided by manual wall switches.

The facility has minimal exterior lighting which consists of metal halide outdoor wall-mounted fixtures. They are controlled with photocells.



Air Conditioning (DX) and Heating System



Cooling is provided by two Carrier indoor packaged cooling units associated with two outdoor air-cooled condensers. The units are six years old and appeared to be in good condition. The 10-ton unit serves the meeting room and the offices. The 20-ton unit serves the main floor area of the library.

The heating system consists of two gas-fired furnaces and one Sterling gas-fired unit heater that serves the attic floor. Each unit's main supply air duct splits into two heating zones.

The HVAC control system consists of seven-day programmable thermostats.

Domestic Hot Water

Domestic hot water is provided by one A.O. Smith gas fired non-condensing hot water heater with an input rating of 4,000 KBtu/hr and a nominal efficiency of 80%. The water heater has 40-gallon storage tank. The water heater is two years old and appears to be in good working condition.



Plug load & Vending Machines

There are 18 computer work stations throughout the facility and they are mostly desktop units with LCD monitors. There is no centralized PC power management software currently installed. There are no beverage vending machines in the library.

2.7 Water-Using Systems

There are three restrooms at this facility. Faucets are rated for 2.2 gallons per minute (gpm) or higher, the toilets are rated at 2.5 gallons per flush (gpf) and the urinals are rated at 2 gpf.

3 SITE ENERGY USE AND COSTS

Utility data for electricity and natural gas was analyzed to identify opportunities for savings. In addition, data for electricity and natural gas was evaluated to determine the annual energy performance metrics for the building in energy cost/ft² and energy use/ft². These energy use indices are indicative of the relative energy effectiveness of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy use for other facilities identified as: Library. Specific local climate conditions, daily occupancy hours of the facility, seasonal fluctuations in occupancy, daily operating hours of energy use systems, and the behavior of the occupants with regard to operating systems that impact energy use such as turning off appliances and leaving windows open. Please refer to the Benchmarking section within Section 3.4 for additional information.

3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility usage data that was provided for each utility. The annual consumption and cost was developed from this information.

Figure 6 - Utility Summary

| Utility Summary for Iselin Branch Public Library | | |
|--|--------------|-----------------|
| Fuel | Usage | Cost |
| Electricity | 104,860 kWh | \$22,802 |
| Natural Gas | 6,573 Therms | \$7,401 |
| Total | | \$30,203 |

The current utility cost for this site is \$30,203 as shown in the chart below.

Figure 7 - Energy Cost Breakdown

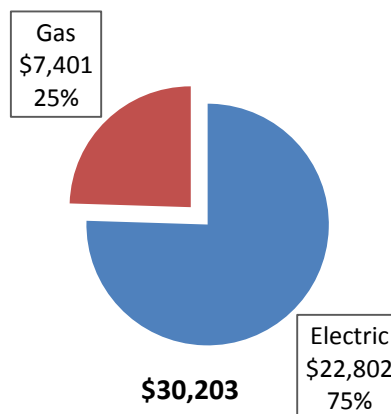

3.2 Electricity Usage

Electricity is provided by PSE&G. The average electric cost (combined for commodity, transmission and distribution) for the past 12 months is \$0.198/kWh, which is the blended rate used throughout the analyses in this report. The monthly electricity consumption and peak demand is represented graphically in the chart below.

Figure 8 -Electric Usage & Demand

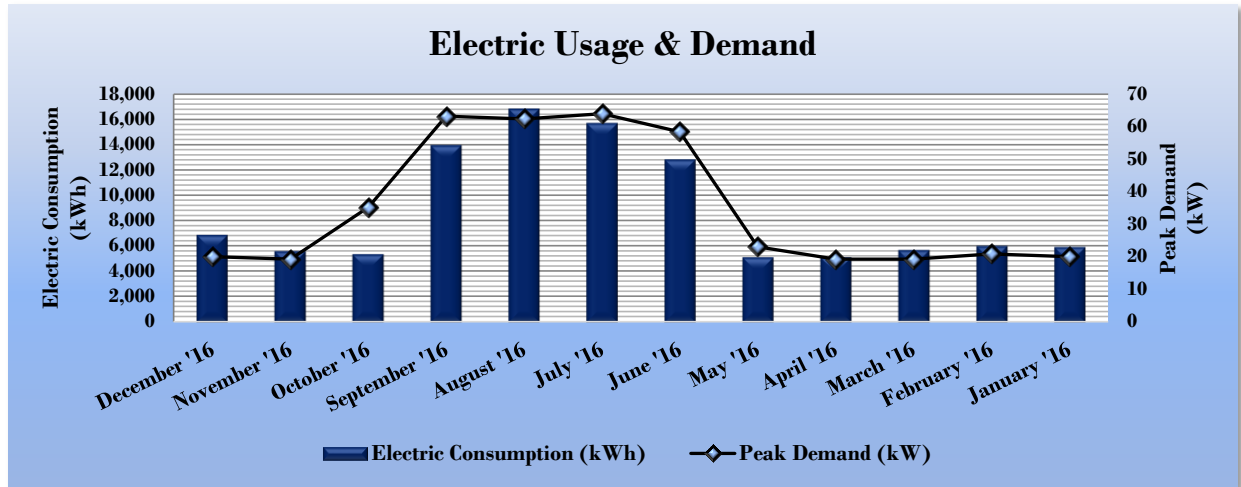


Figure 9 -Electric Usage & Demand

| Electric Billing Data for Iselin Branch Public Library | | | | | |
|--|----------------|----------------------|-------------|----------------|---------------------|
| Period Ending | Days in Period | Electric Usage (kWh) | Demand (kW) | Demand Cost | Total Electric Cost |
| 12/27/16 | 34 | 6,880 | 20 | \$89 | \$1,466 |
| 11/23/16 | 29 | 5,600 | 19 | \$86 | \$1,362 |
| 10/25/16 | 29 | 5,360 | 35 | \$157 | \$1,421 |
| 9/26/16 | 32 | 13,920 | 63 | \$282 | \$2,842 |
| 8/25/16 | 29 | 16,800 | 62 | \$275 | \$3,104 |
| 7/27/16 | 30 | 15,660 | 64 | \$285 | \$3,169 |
| 6/27/16 | 32 | 12,800 | 58 | \$257 | \$2,753 |
| 5/26/16 | 29 | 5,120 | 23 | \$247 | \$1,427 |
| 4/27/16 | 29 | 5,120 | 19 | \$85 | \$1,287 |
| 3/29/16 | 32 | 5,680 | 19 | \$84 | \$1,335 |
| 2/26/16 | 30 | 6,000 | 21 | \$91 | \$1,318 |
| 1/27/16 | 30 | 5,920 | 20 | \$87 | \$1,318 |
| Totals | 365 | 104,860 | 64 | \$2,025 | \$22,802 |
| Annual | 365 | 104,860 | 64 | \$2,025 | \$22,802 |

3.3 Natural Gas Usage

Natural gas is provided by Elizabethtown Gas. The average gas cost for the past 12 months is \$1.126/therm, which is the blended rate used throughout the analyses in this report. The monthly gas consumption is represented graphically in the chart below.

Figure 10 -Natural Gas Usage

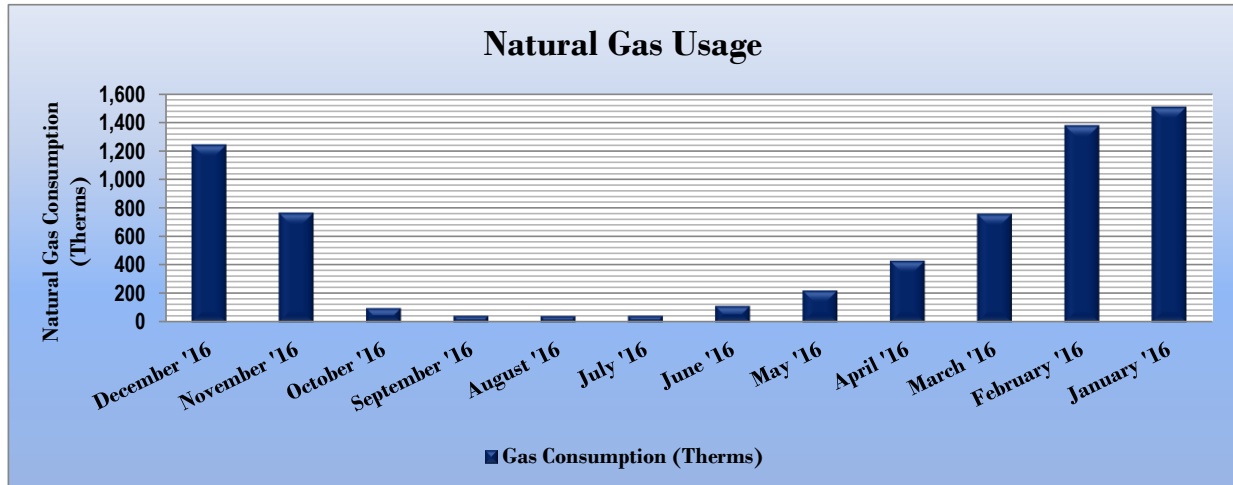


Figure 11 -Natural Gas Usage

| Gas Billing Data for Iselin Branch Public Library | | | | |
|---|----------------|----------------------------|------------------|----------------------|
| Period Ending | Days in Period | Natural Gas Usage (Therms) | Natural Gas Cost | TRC Estimated Usage? |
| 12/27/16 | 29 | 1,243 | \$1,393 | No |
| 11/28/16 | 33 | 768 | \$883 | No |
| 10/26/16 | 29 | 99 | \$241 | No |
| 9/27/16 | 32 | 46 | \$159 | Yes |
| 8/26/16 | 30 | 44 | \$158 | Yes |
| 7/27/16 | 30 | 46 | \$159 | Yes |
| 6/27/16 | 32 | 115 | \$157 | No |
| 5/26/16 | 30 | 223 | \$326 | No |
| 4/26/16 | 29 | 432 | \$493 | No |
| 3/28/16 | 32 | 760 | \$749 | No |
| 2/25/16 | 30 | 1,379 | \$1,310 | No |
| 1/26/16 | 34 | 1,509 | \$1,476 | No |
| Totals | 370 | 6,663 | \$7,503 | 3 |
| Annual | 365 | 6,573 | \$7,401 | |

3.4 Benchmarking

This facility was benchmarked through Portfolio Manager, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager analyzes your building’s consumption data, cost information, and operational use details and compares its performance against a yearly baseline, national medians, or similar buildings in your portfolio. Metrics used in this comparison are the Energy Use Intensity (EUI) and ENERGY STAR® score.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more energy than similar buildings on a square foot basis or if that building performs better than the median. EUI is presented in both site energy and source energy. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy is the raw fuel consumed to generate the energy consumed at the site, factoring in energy production and distribution losses.

Figure 12 - Energy Use Intensity Comparison – Existing Conditions

| Energy Use Intensity Comparison - Existing Conditions | | |
|---|------------------------------|---|
| | Iselin Branch Public Library | National Median Building Type: Library |
| Source Energy Use Intensity (kBtu/ft ²) | 208.5 | 235.6 |
| Site Energy Use Intensity (kBtu/ft ²) | 116.7 | 91.6 |

By implementing all recommended measures covered in this reporting, the building’s estimated post-implementation EUI improves as shown in the table below:

Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures

| Energy Use Intensity Comparison - Following Installation of Recommended Measures | | |
|--|------------------------------|---|
| | Iselin Branch Public Library | National Median Building Type: Library |
| Source Energy Use Intensity (kBtu/ft ²) | 191.1 | 235.6 |
| Site Energy Use Intensity (kBtu/ft ²) | 108.8 | 91.6 |

Many buildings can also receive a 1–100 ENERGY STAR® score. This score compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide — and may be eligible for ENERGY STAR® certification. Your building is not one of the building categories that are eligible to receive a score.

The Portfolio Manager, Statement of Energy Performance can be found in Appendix B: ENERGY STAR® Statement of Energy Performance.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager regularly, so that you can keep track of your building’s performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager to track your building’s performance at: <https://www.energystar.gov/buildings/training>.

3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building and determine their proportional contribution to overall building energy usage. This visual representation of energy end uses highlights systems that may benefit most from energy efficiency projects.

Figure 14 - Energy Balance kBtu/SF, %)

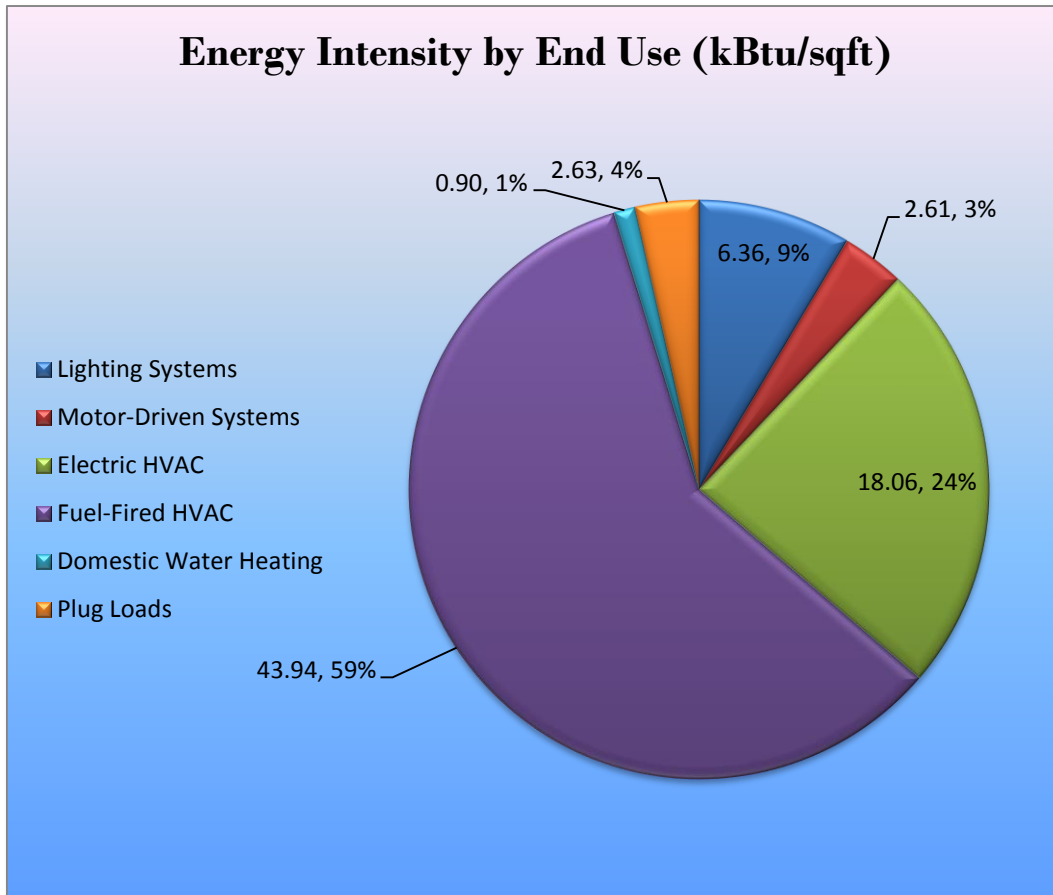

4 ENERGY CONSERVATION MEASURES

Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to the the Iselin Branch Public Library regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

4.1 Recommended ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 15 – Summary of Recommended ECMs

| Energy Conservation Measure | | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$)* | Estimated Net Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|---------------------------------------|---|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|---------------------------|-------------------------|-------------------------------|---|
| Lighting Upgrades | | 11,033 | 4.6 | 0.0 | \$2,186.14 | \$11,717.11 | \$1,550.00 | \$10,167.11 | 4.65 | 11,110 |
| ECM 1 | Install LED Fixtures | 3,943 | 1.9 | 0.0 | \$781.17 | \$4,363.35 | \$405.00 | \$3,958.35 | 5.07 | 3,970 |
| ECM 2 | Retrofit Fixtures with LED Lamps | 6,616 | 2.7 | 0.0 | \$1,310.83 | \$6,708.43 | \$1,145.00 | \$5,563.43 | 4.24 | 6,662 |
| ECM 3 | Install LED Exit Signs | 475 | 0.0 | 0.0 | \$94.14 | \$645.33 | \$0.00 | \$645.33 | 6.85 | 478 |
| Lighting Control Measures | | 45 | 0.0 | 0.0 | \$8.86 | \$348.00 | \$60.00 | \$288.00 | 32.49 | 45 |
| ECM 4 | Install Occupancy Sensor Lighting Controls | 45 | 0.0 | 0.0 | \$8.86 | \$348.00 | \$60.00 | \$288.00 | 32.49 | 45 |
| Domestic Water Heating Upgrade | | 0 | 0.0 | 30.7 | \$345.69 | \$43.02 | \$0.00 | \$43.02 | 0.12 | 3,595 |
| ECM 5 | Install Low-Flow Domestic Hot Water Devices | 0 | 0.0 | 30.7 | \$345.69 | \$43.02 | \$0.00 | \$43.02 | 0.12 | 3,595 |
| TOTALS | | 11,078 | 4.6 | 30.7 | \$2,540.70 | \$12,108.13 | \$1,610.00 | \$10,498.13 | 4.13 | 14,750 |

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

4.1.1 Lighting Upgrades

Recommended upgrades to existing lighting features are summarized in Figure 16 below.

Figure 16 – Summary of Lighting Upgrade ECMs

| Energy Conservation Measure | | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|-----------------------------|----------------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|--------------------------|-------------------------|-----------------------------|---|
| Lighting Upgrades | | 11,033 | 4.6 | 0.0 | \$2,186.14 | \$11,717.11 | \$1,550.00 | \$10,167.11 | 4.65 | 11,110 |
| ECM 1 | Install LED Fixtures | 3,943 | 1.9 | 0.0 | \$781.17 | \$4,363.35 | \$405.00 | \$3,958.35 | 5.07 | 3,970 |
| ECM 2 | Retrofit Fixtures with LED Lamps | 6,616 | 2.7 | 0.0 | \$1,310.83 | \$6,708.43 | \$1,145.00 | \$5,563.43 | 4.24 | 6,662 |
| ECM 3 | Install LED Exit Signs | 475 | 0.0 | 0.0 | \$94.14 | \$645.33 | \$0.00 | \$645.33 | 6.85 | 478 |

ECM 1: Install LED Fixtures

Summary of Measure Economics

| Interior/ Exterior | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|-----------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|--------------------------|-------------------------|-----------------------------|---|
| Interior | 2,657 | 1.0 | 0.0 | \$526.54 | \$2,800.64 | \$5.00 | \$2,795.64 | 5.31 | 2,676 |
| Exterior | 1,285 | 0.9 | 0.0 | \$254.63 | \$1,562.71 | \$400.00 | \$1,162.71 | 4.57 | 1,294 |

Measure Description

This measure evaluates replacing existing fixtures containing fluorescent, and HID lamps with new high-performance LED light fixtures. This measure saves energy by installing LED sources which use less power than other technologies with a comparable light output.

Maintenance savings are anticipated since LED sources have burn hours which are generally more than twice that of a fluorescent source and more than 10 times incandescent sources. Maintenance savings may be partially offset by the higher material costs associated with LED sources.

During planning and design for the installation of new fixtures, we recommend a holistic approach that considers both the technology of the lighting sources and how they are controlled.

ECM 2: Retrofit Fixtures with LED Lamps

Summary of Measure Economics

| Interior/ Exterior | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|-----------------------|--|-----------------------------------|--------------------------------------|--|-----------------------------------|--------------------------------|-------------------------------|--------------------------------------|--|
| Interior | 6,616 | 2.7 | 0.0 | \$1,310.83 | \$6,708.43 | \$1,145.00 | \$5,563.43 | 4.24 | 6,662 |
| Exterior | 0 | 0.0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | 0.00 | 0 |

Measure Description

This measure evaluates replacing linear fluorescent lamps with LED tube lamps. Many LED tube lamps are direct replacements for existing fluorescent lamps and can be installed although there is a fluorescent fixture ballast in place. Other tube lamps require that fluorescent fixture ballasts be removed or replaced with LED drivers. This measure saves energy by installing LED sources which use less power than other technologies with a comparable light output.

Maintenance savings are anticipated since LED sources have burn hours which are more than twice that of a fluorescent source and more than 10 times incandescent sources. LED lamps that use the existing fluorescent fixture ballast will be constrained by the remaining hours of the ballast. Maintenance savings may be partially offset by the higher material costs associated with LED sources.

During retrofit planning and design, we recommend a holistic approach that considers both the technology of the lighting sources and how they are controlled.

ECM 3: Install LED Exit Signs

Summary of Measure Economics

| Interior/ Exterior | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|-----------------------|--|-----------------------------------|--------------------------------------|--|-----------------------------------|--------------------------------|-------------------------------|--------------------------------------|--|
| Interior | 475 | 0.0 | 0.0 | \$94.14 | \$645.33 | \$0.00 | \$645.33 | 6.85 | 478 |
| Exterior | 0 | 0.0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | 0.00 | 0 |

Measure Description

This measure evaluates replacing compact fluorescent lighting in exit signs with LEDs. LED sources require virtually no maintenance and LED exit signs have a life expectancy of at least 20 years. Many manufacturers can provide retrofit kits that meet fire and safety code requirements. Retrofit kits are less expensive and simpler to install than replacement signs, however, new fixtures would have a longer useful life and are therefore recommended.

A reduction in maintenance costs will be realized with the proposed retrofit because lamps will not have to be replaced as frequently.

4.1.2 Lighting Control Measures

Recommended lighting control measures are summarized in Figure 17 below.

Figure 17 – Summary of Lighting Control ECMs

| Energy Conservation Measure | | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|----------------------------------|--|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|--------------------------|-------------------------|-----------------------------|---|
| Lighting Control Measures | | 45 | 0.0 | 0.0 | \$8.86 | \$348.00 | \$60.00 | \$288.00 | 32.49 | 45 |
| ECM 4 | Install Occupancy Sensor Lighting Controls | 45 | 0.0 | 0.0 | \$8.86 | \$348.00 | \$60.00 | \$288.00 | 32.49 | 45 |

ECM 4: Install Occupancy Sensor Lighting Controls

Summary of Measure Economics

| Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|--------------------------|-------------------------|-----------------------------|---|
| 45 | 0.0 | 0.0 | \$8.86 | \$348.00 | \$60.00 | \$288.00 | 32.49 | 45 |

Measure Description

This measure evaluates installing occupancy sensors to control light fixtures that are currently manually controlled in restrooms, storage rooms, and private offices. Sensors detect occupancy using ultrasonic and/or infrared wave technologies. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Occupants will also be able to manually turn off fixtures. Energy savings result from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. Ceiling-mounted or remote-mounted sensors require the use of low voltage switching relays or a wireless signal to the switch. In general, use wall switch replacement sensors for single occupant offices and other small rooms. Install ceiling-mounted or remote mounted sensors in locations without local switching, in situations where the existing wall switches are not in the line-of-sight of the main work area, and in large spaces. We recommend a holistic design approach that considers both the technology of the lighting sources and how they are controlled.

Maintenance savings are anticipated due to reduced lamp operation however, additional maintenance costs may be incurred because the occupancy sensors may require periodic adjustment; it is anticipated that the net effect on maintenance costs will be negligible.

4.1.3 Domestic Water Heating Upgrade

Recommended domestic hot water upgrades are summarized in Figure 18 below.

Figure 18 - Summary of Domestic Water Heating ECMs

| Energy Conservation Measure | | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|---------------------------------------|---|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|--------------------------|-------------------------|-----------------------------|---|
| Domestic Water Heating Upgrade | | 0 | 0.0 | 30.7 | \$345.69 | \$43.02 | \$0.00 | \$43.02 | 0.12 | 3,595 |
| ECM 5 | Install Low-Flow Domestic Hot Water Devices | 0 | 0.0 | 30.7 | \$345.69 | \$43.02 | \$0.00 | \$43.02 | 0.12 | 3,595 |

ECM 5: Install Low-Flow DHW Devices

Summary of Measure Economics

| Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated Install Cost (\$) | Estimated Incentive (\$) | Estimated Net Cost (\$) | Simple Payback Period (yrs) | CO ₂ e Emissions Reduction (lbs) |
|-------------------------------|--------------------------|-----------------------------|---------------------------------|-----------------------------|--------------------------|-------------------------|-----------------------------|---|
| 0 | 0.0 | 30.7 | \$345.69 | \$43.02 | \$0.00 | \$43.02 | 0.12 | 3,595 |

Measure Description

This measure evaluates the savings from installing low flow domestic water devices to reduce overall water flow in general and hot water flow. Low flow showerheads and faucet aerators reduce the water flow, relative to standard showerheads and aerators, from the fixture. Pre-rinse spray valves often used in commercial and institutional kitchens are designed to remove food waste from dishes prior to dishwashing. Replacing standard pre-rinse spray valves with low flow valves will reduce water use.

The low flow devices reduce the overall water flow from the fixture which generally reduces the amount of hot water used resulting in energy and water savings.

5 ENERGY EFFICIENT PRACTICES

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of low or no-cost efficiency strategies. By employing certain behavioral and operational adjustments as well as performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and annual energy, operation, and maintenance costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. Consult with qualified equipment specialists for details on proper maintenance and system operation.

Reduce Air Leakage

Air leakage, or infiltration, occurs when outside air enters a building uncontrollably through cracks and openings. Properly sealing such cracks and openings can significantly reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. This includes caulking or installing weather stripping around leaky doors and windows allowing for better control of indoor air quality through controlled ventilation.

Close Doors and Windows

Ensure doors and windows are closed in conditioned spaces. Leaving doors and windows open leads to a significant increase in heat transfer between conditioned spaces and the outside air. Reducing a facility's air changes per hour (ACH) can lead to increased occupant comfort as well as significant heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Perform Proper Lighting Maintenance

In order to sustain optimal lighting levels, lighting fixtures should undergo routine maintenance. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust on lamps, fixtures and reflective surfaces. Together, these factors can reduce total illumination by 20%-60% or more, while operating fixtures continue drawing full power. To limit this reduction, lamps, reflectors and diffusers should be thoroughly cleaned of dirt, dust, oil, and smoke film buildup approximately every 6–12 months.

Develop a Lighting Maintenance Schedule

In addition to routine fixture cleaning, development of a maintenance schedule can both ensure maintenance is performed regularly and can reduce the overall cost of fixture re-lamping and re-ballasting. By re-lamping and re-ballasting fixtures in groups, lighting levels are better maintained and the number of site visits by a lighting technician or contractor can be minimized, decreasing the overall cost of maintenance.

Ensure Lighting Controls Are Operating Properly

Lighting controls are very cost-effective energy efficient devices, when installed and operating correctly. As part of a lighting maintenance schedule, lighting controls should be tested annually to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight sensors, maintenance involves cleaning of sensor lenses and confirming setpoints and sensitivity are appropriately configured.

Use Fans to Reduce Cooling Load

Utilizing ceiling fans to supplement cooling is a low-cost strategy to reduce cooling load considerably. Thermostat settings can be increased by 4°F with no change in overall occupant comfort when the wind chill effect of moving air is employed for cooling.

Practice Proper Use of Thermostat Schedules and Temperature Resets

Ensure thermostats are correctly set back. By employing proper set back temperatures and schedules, facility heating and cooling costs can be reduced dramatically during periods of low or no occupancy. As such, thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced further by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Clean and/or Replace HVAC Filters

Air filters work to reduce the amount of indoor air pollution and increase occupant comfort. Over time, filters become less and less effective as particulate buildup increases. In addition to health concerns related to clogged filters, filters that have reached saturation also restrict air flow through the facility's air conditioning or heat pump system, increasing the load on the distribution fans and decreasing occupant comfort levels. Filters should be checked monthly and cleaned or replaced when appropriate.

Check for and Seal Duct Leakage

Duct leakage in commercial buildings typically accounts for 5% to 25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building, significantly increasing cooling and heating costs. By sealing sources of leakage, cooling, heating, and ventilation energy use can be reduced significantly, depending on the severity of air leakage.

Perform Proper Water Heater Maintenance

At least once a year, drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Once a year check for any leaks or heavy corrosion on the pipes and valves. For gas water heaters, check the draft hood and make sure it is placed properly, with a few inches of air space between the tank and where it connects to the vent. Look for any corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional. For electric water heaters, look for any signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank. For water heaters over three to four years old have a technician inspect the sacrificial anode annually.

Water Conservation

Installing low flow faucets or faucet aerators, low flow showerheads, and kitchen sink pre-rinse spray valves saves both energy and water. These devices save energy by reducing the overall amount of hot water used hence reducing the energy used to heat the water. The flow ratings for EPA WaterSense (<http://www3.epa.gov/watersense/products>) labeled devices are 1.5 gpm for bathroom faucets, 2.0 gpm for showerheads, and 1.28 gpm for pre-rinse spray valves.

Installing dual flush or low flow toilets and low flow or waterless urinals are additional ways to reduce the sites water use, however, these devices do not provide energy savings at the site level. Any reduction in water use does however ultimately reduce grid level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users. The EPA WaterSense ratings for urinals is 0.5 gpf and toilets that use as little as 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

Refer to Section 4.1.3 for any low-flow ECM recommendations.

6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey’s Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State’s electrical needs to be met by renewable sources by 2050.

Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility’s electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has a Low potential for installing a PV array.

In order to be cost-effective, a solar PV array generally needs a minimum of 4,000 square feet of flat or south-facing rooftop, or other unshaded space, on which to place the PV panels. In our opinion, the facility does appear not meet these minimum criteria for cost-effective PV installation.

Figure 19 - Photovoltaic Screening

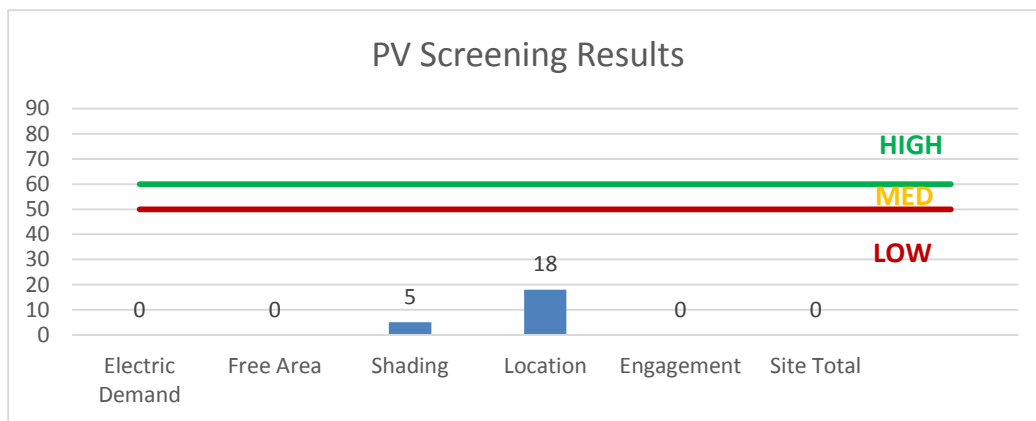

Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SREC (Solar Renewable Energy Certificate) Registration Program (SRP) prior to the start of construction in order to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

In non-industrial settings, combined heat and power (CHP) is the on-site generation of electricity and recovery of heat which is put to beneficial use. Common prime movers in CHP applications include reciprocating engines, microturbines, fuel cells, and (at large facilities) gas turbines. Electricity is typically interconnected to the sites local distribution system. Heat is recovered from the exhaust stream and the ancillary cooling system and interconnected to the existing hot water (or steam) distribution system.


CHP systems are typically used to produce a portion of the electricity needed by a facility, with the balance of electric needs satisfied by purchase from the grid. The heat is used to supplement (or supplant) existing boilers for of space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for of space cooling. The key criteria used for screening, however, is the amount of time the system operates at full load and the facility's ability to use the recovered heat. Facilities with continuous use for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has a Low potential for installing a cost-effective CHP system.

Low or infrequent thermal load, and lack of space near the existing thermal generation are the most significant factors contributing to the low potential for CHP at the site. In our opinion, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation.

For a list of qualified firms in NJ specializing in commercial CHP cost assessment and installation, go to: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/.

Figure 20 - Combined Heat and Power Screening

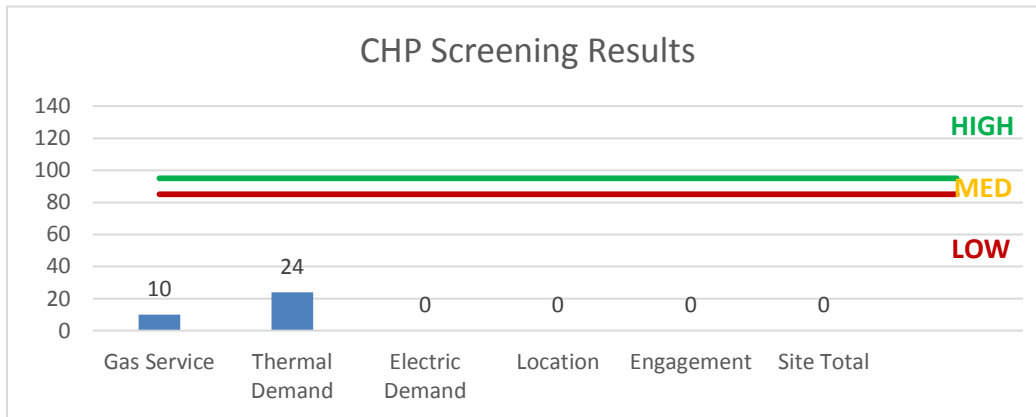

7 DEMAND RESPONSE

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically, an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section.. Please refer to Figure 21 for a list of the eligible programs identified for each recommended ECM.

Figure 21 - ECM Incentive Program Eligibility

| Energy Conservation Measure | | SmartStart Prescriptive | SmartStart Custom | Direct Install |
|-----------------------------|---|-------------------------|-------------------|----------------|
| ECM 1 | Install LED Fixtures | x | | x |
| ECM 2 | Retrofit Fixtures with LED Lamps | x | | x |
| ECM 3 | Install LED Exit Signs | | | x |
| ECM 4 | Install Occupancy Sensor Lighting Controls | x | | x |
| ECM 5 | Install Low-Flow Domestic Hot Water Devices | | | x |

SmartStart is generally well suited for implementation of individual or small sets of measures, with the flexibility to install projects at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities to bundle measures and simplify participation, but requires the use of pre-approved contractors.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent comparison of available incentives.

Brief descriptions of all relevant alternative financing and incentive programs are located in the sections below. You may also check the following website for further information, including most current program availability, requirements, and incentive levels: www.njcleanenergy.com/ci.

8.1 SmartStart

Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

Prescriptive Equipment Incentives Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Variable Frequency Drives

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom Measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at the lesser of 50% of the total installed incremental project cost, or a buy down to a one-year payback. Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

To participate in the SmartStart program, you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: www.njcleanenergy.com/SSB.

8.2 Direct Install

Overview

Direct Install is a turnkey program available to existing small to mid-sized facilities with a peak electric demand that did not exceed 200 kW in any of the preceding 12 months. You will work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and install those measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Direct Install participants will also be held to a fiscal year cap of \$250,000 per entity.

How to Participate

To participate in the Direct Install program, you will need to contact the participating contractor assigned to the county where your facility is located; a complete list is provided on the Direct Install website identified below. The contractor will be paid the program incentive directly which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps mentioned above, and the remaining 30% of the cost is your responsibility to the contractor.

Since Direct Install offers a free assessment, LGEA applicants that do not meet the audit program eligibility requirements, but do meet the Direct Install requirements, may be moved directly into this program.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

8.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program descriptions and application can be found at:

www.njcleanenergy.com/ESIP.

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize the incentive programs to help further reduce costs when compiling the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third party supplier, consider shopping for a reduced rate from third party electric suppliers. If your facility is purchasing electricity from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third party supplier, consider shopping for a reduced rate from third party natural gas suppliers. If your facility is purchasing natural gas from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

Appendix A: Equipment Inventory & Recommendations

Lighting Inventory & Recommendations

| Location | Existing Conditions | | | | | Proposed Conditions | | | | | | | | Energy Impact & Financial Analysis | | | | | | |
|--------------------|---------------------|---|------------------|-------------------|------------------------|------------------------|---------------|------------------|---|------------------|-------------------|------------------------|-----------------------|------------------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|--|
| | Fixture Quantity | Fixture Description | Control System | Watts per Fixture | Annual Operating Hours | Fixture Recommendation | Add Controls? | Fixture Quantity | Fixture Description | Control System | Watts per Fixture | Annual Operating Hours | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Total Installation Cost | Total Incentives | Simple Payback w/ Incentives in Years | |
| Main Library Room | 52 | Linear Fluorescent - T5: 4' T5 (28W) - 2L | Wall Switch | 60 | 1,950 | Relamp | No | 52 | LED - Linear Tubes: (2) 4' Lamps | Wall Switch | 29 | 1,950 | 1.31 | 3,552 | 0.0 | \$703.80 | \$3,042.00 | \$520.00 | 3.58 | |
| Main Library Room | 2 | Exit Signs: Incandescent | None | 14 | 8,760 | Fixture Replacement | No | 2 | LED Exit Signs: 2 W Lamp | None | 6 | 8,760 | 0.01 | 158 | 0.0 | \$31.38 | \$215.11 | \$0.00 | 6.85 | |
| Main Library Room | 39 | Compact Fluorescent: CFL Scree in | Wall Switch | 34 | 1,950 | Fixture Replacement | No | 39 | LED - Fixtures: Downlight Solid State Retrofit | Wall Switch | 7 | 1,950 | 0.86 | 2,320 | 0.0 | \$459.74 | \$2,482.39 | \$0.00 | 5.40 | |
| Main Library Room | 1 | Compact Fluorescent: CFL Spiral 32W | Wall Switch | 32 | 1,950 | Fixture Replacement | No | 1 | LED - Fixtures: Downlight Solid State Retrofit | Wall Switch | 7 | 1,950 | 0.02 | 55 | 0.0 | \$10.92 | \$63.65 | \$0.00 | 5.83 | |
| Main Library Room | 4 | Compact Fluorescent: CFL 4 pin | Wall Switch | 40 | 1,950 | Relamp | No | 4 | LED - Linear Tubes: (1) U-Lamp | Wall Switch | 17 | 1,950 | 0.08 | 207 | 0.0 | \$41.04 | \$158.93 | \$0.00 | 3.87 | |
| Reception Area | 16 | Linear Fluorescent - T5: 2' T5 (14W) - 2L | Wall Switch | 34 | 1,950 | Relamp | No | 16 | LED - Linear Tubes: (2) 2' Lamps | Wall Switch | 17 | 1,950 | 0.22 | 599 | 0.0 | \$118.76 | \$771.20 | \$160.00 | 5.15 | |
| Reception Area | 3 | Compact Fluorescent: 32W 4-PIN | Wall Switch | 32 | 1,950 | Fixture Replacement | No | 3 | LED - Fixtures: Downlight Solid State Retrofit | Wall Switch | 7 | 1,950 | 0.06 | 165 | 0.0 | \$32.75 | \$190.95 | \$0.00 | 5.83 | |
| Reception Area | 1 | Exit Signs: Incandescent | None | 14 | 8,760 | Fixture Replacement | No | 1 | LED Exit Signs: 2 W Lamp | None | 6 | 8,760 | 0.01 | 79 | 0.0 | \$15.69 | \$107.56 | \$0.00 | 6.85 | |
| Office | 4 | Linear Fluorescent - T5: 2' T5 (14W) - 2L | Occupancy Sensor | 34 | 1,950 | Relamp | No | 4 | LED - Linear Tubes: (2) 2' Lamps | Occupancy Sensor | 17 | 1,950 | 0.06 | 150 | 0.0 | \$29.69 | \$192.80 | \$40.00 | 5.15 | |
| Work Area | 6 | Linear Fluorescent - T5: 4' T5 (28W) - 1L | Occupancy Sensor | 30 | 1,950 | Relamp | No | 6 | LED - Linear Tubes: (1) 4' Lamp | Occupancy Sensor | 15 | 1,950 | 0.08 | 205 | 0.0 | \$40.60 | \$215.40 | \$30.00 | 4.57 | |
| Work Area | 6 | Linear Fluorescent - T5: 2' T5 (14W) - 2L | Occupancy Sensor | 34 | 1,950 | Relamp | No | 6 | LED - Linear Tubes: (2) 2' Lamps | Occupancy Sensor | 17 | 1,950 | 0.08 | 225 | 0.0 | \$44.53 | \$289.20 | \$60.00 | 5.15 | |
| Kitchen | 1 | Linear Fluorescent - T5: 4' T5 (28W) - 2L | Wall Switch | 60 | 1,300 | Relamp | Yes | 1 | LED - Linear Tubes: (1) 4' Lamp | Occupancy Sensor | 15 | 910 | 0.04 | 73 | 0.0 | \$14.51 | \$151.90 | \$25.00 | 8.75 | |
| Bathroom | 1 | Linear Fluorescent - T5: 2' T5 (14W) - 2L | Wall Switch | 34 | 1,300 | Relamp | Yes | 1 | LED - Linear Tubes: (1) 4' Lamp | Occupancy Sensor | 15 | 910 | 0.02 | 35 | 0.0 | \$6.94 | \$151.90 | \$25.00 | 18.28 | |
| Maintenance Room | 5 | Linear Fluorescent - T5: 4' T5 (28W) - 1L | Wall Switch | 30 | 1,300 | Relamp | Yes | 5 | LED - Linear Tubes: (1) 4' Lamp | Occupancy Sensor | 15 | 910 | 0.08 | 146 | 0.0 | \$28.89 | \$295.50 | \$45.00 | 8.67 | |
| Maintenance Room | 1 | Exit Signs: Incandescent | Wall Switch | 14 | 8,760 | Fixture Replacement | No | 1 | LED Exit Signs: 2 W Lamp | Wall Switch | 6 | 8,760 | 0.01 | 79 | 0.0 | \$15.69 | \$107.56 | \$0.00 | 6.85 | |
| Electrical Room | 2 | Linear Fluorescent - T5: 4' T5 (28W) - 1L | Wall Switch | 30 | 1,560 | Relamp | No | 2 | LED - Linear Tubes: (1) 4' Lamp | Wall Switch | 15 | 1,560 | 0.03 | 55 | 0.0 | \$10.83 | \$71.80 | \$10.00 | 5.71 | |
| Meeting Room | 2 | Exit Signs: Incandescent | None | 14 | 8,760 | Fixture Replacement | No | 2 | LED Exit Signs: 2 W Lamp | None | 6 | 8,760 | 0.01 | 158 | 0.0 | \$31.38 | \$215.11 | \$0.00 | 6.85 | |
| Meeting Room | 15 | Linear Fluorescent - T5: 4' T5 (28W) - 2L | Occupancy Sensor | 60 | 1,474 | Relamp | No | 15 | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29 | 1,474 | 0.38 | 775 | 0.0 | \$153.48 | \$877.50 | \$150.00 | 4.74 | |
| Meeting Room | 6 | Linear Fluorescent - T5: 4' T5 (28W) - 1L | Occupancy Sensor | 30 | 1,474 | Relamp | No | 6 | LED - Linear Tubes: (1) 4' Lamp | Occupancy Sensor | 15 | 1,474 | 0.08 | 155 | 0.0 | \$30.70 | \$215.40 | \$30.00 | 6.04 | |
| Men's Bathroom | 3 | Linear Fluorescent - T5: 4' T5 (28W) - 2L | Occupancy Sensor | 60 | 1,474 | Relamp | No | 3 | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29 | 1,474 | 0.08 | 155 | 0.0 | \$30.70 | \$175.50 | \$30.00 | 4.74 | |
| Women's Bathroom | 2 | Linear Fluorescent - T5: 2' T5 (14W) - 2L | Occupancy Sensor | 34 | 1,300 | Relamp | No | 2 | LED - Linear Tubes: (2) 2' Lamps | Occupancy Sensor | 17 | 1,300 | 0.03 | 50 | 0.0 | \$9.90 | \$96.40 | \$20.00 | 7.72 | |
| Stairway | 1 | Incandescent: 60W A Lamp | Wall Switch | 60 | 1,950 | Fixture Replacement | No | 1 | LED - Fixtures: Downlight Solid State Retrofit | Wall Switch | 7 | 1,950 | 0.04 | 117 | 0.0 | \$23.14 | \$63.65 | \$5.00 | 2.53 | |
| Attic Floor | 6 | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch | 62 | 1,248 | Relamp | No | 6 | LED - Linear Tubes: (2) 4' Lamps | Wall Switch | 29 | 1,248 | 0.16 | 279 | 0.0 | \$55.33 | \$351.00 | \$60.00 | 5.26 | |
| Exterior Perimeter | 4 | Metal Halide: (1) 250W Lamp | Daylight Dimming | 295 | 1,053 | Fixture Replacement | No | 4 | LED - Fixtures: Outdoor Wall-Mounted Area Fixture | Daylight Dimming | 25 | 1,053 | 0.88 | 1,285 | 0.0 | \$254.63 | \$1,562.71 | \$400.00 | 4.57 | |

Motor Inventory & Recommendations

| Location | Area(s)/System(s) Served | Existing Conditions | | | | | | Proposed Conditions | | | | Energy Impact & Financial Analysis | | | | | | |
|---------------|--------------------------|---------------------|-------------------|--------------|----------------------|--------------|------------------------|---------------------------------|----------------------|---------------|----------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | | Motor Quantity | Motor Application | HP Per Motor | Full Load Efficiency | VFD Control? | Annual Operating Hours | Install High Efficiency Motors? | Full Load Efficiency | Install VFDs? | Number of VFDs | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Total Installation Cost | Total Incentives | Simple Payback w/ Incentives in Years |
| Rear Building | Air-Cooled Condenser | 3 | Supply Fan | 1.5 | 82.0% | No | 1,300 | No | 82.0% | No | | 0.00 | 0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | 0.00 |
| Rear Building | Air-Cooled Condenser | 2 | Supply Fan | 1.5 | 82.0% | No | 1,300 | No | 82.0% | No | | 0.00 | 0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | 0.00 |

Electric HVAC Inventory & Recommendations

| Location | Area(s)/System(s) Served | Existing Conditions | | | | Proposed Conditions | | | | | | | | Energy Impact & Financial Analysis | | | | | | |
|-------------|--------------------------|---------------------|-------------|----------------------------------|-------------------------------------|---------------------------------|-----------------|-------------|----------------------------------|-------------------------------------|------------------------------------|-------------------------------|-----------------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | | System Quantity | System Type | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (kBtu/hr) | Install High Efficiency System? | System Quantity | System Type | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (kBtu/hr) | Cooling Mode Efficiency (SEER/EER) | Heating Mode Efficiency (COP) | Install Dual Enthalpy Economizer? | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Total Installation Cost | Total Incentives | Simple Payback w/ Incentives in Years |
| Attic Floor | Meeting Room/Offices | 1 | Packaged AC | 10.00 | | No | | | | | | | No | 0.00 | 0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | 0.00 |
| Attic Floor | Library | 1 | Packaged AC | 30.00 | | No | | | | | | | No | 0.00 | 0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | 0.00 |

Fuel Heating Inventory & Recommendations

| Location | Area(s)/System(s) Served | Existing Conditions | | | | Proposed Conditions | | | | | | Energy Impact & Financial Analysis | | | | | | |
|------------------|--------------------------|---------------------|----------------------|--------------------------------|---------------------------------|---------------------|-------------|--------------------------------|--------------------|--------------------------|-----------------------|------------------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|------|
| | | System Quantity | System Type | Output Capacity per Unit (MBh) | Install High Efficiency System? | System Quantity | System Type | Output Capacity per Unit (MBh) | Heating Efficiency | Heating Efficiency Units | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Total Installation Cost | Total Incentives | Simple Payback w/ Incentives in Years | |
| Attic Floor | Attic Floor | 1 | Warm Air Unit Heater | 50.00 | No | | | | | | | 0.00 | 0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | 0.00 |
| Maintenance Room | Building | 2 | Furnace | 113.00 | No | | | | | | | 0.00 | 0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | 0.00 |

DHW Inventory & Recommendations

| Location | Area(s)/System(s) Served | Existing Conditions | | | Proposed Conditions | | | | | | Energy Impact & Financial Analysis | | | | | | | |
|-------------|--------------------------|---------------------|--------------------------------------|----------|---------------------|-------------|-----------|-------------------|------------------|-----------------------|------------------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|--------|------|
| | | System Quantity | System Type | Replace? | System Quantity | System Type | Fuel Type | System Efficiency | Efficiency Units | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Total Installation Cost | Total Incentives | Simple Payback w/ Incentives in Years | | |
| Attic Floor | Building | 1 | Storage Tank Water Heater (≤ 50 Gal) | No | | | | | | | | 0.00 | 0 | 0.0 | \$0.00 | \$0.00 | \$0.00 | 0.00 |

Low-Flow Device Recommendations

| Location | Recommendation Inputs | | | | Energy Impact & Financial Analysis | | | | | | |
|------------------|-----------------------|---------------------------|--------------------------|--------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | Device Quantity | Device Type | Existing Flow Rate (gpm) | Proposed Flow Rate (gpm) | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Total Installation Cost | Total Incentives | Simple Payback w/ Incentives in Years |
| Men's Bathroom | 2 | Faucet Aerator (Lavatory) | 2.20 | 1.00 | 0.00 | 0 | 11.7 | \$131.69 | \$14.34 | \$0.00 | 0.11 |
| Women's Bathroom | 2 | Faucet Aerator (Lavatory) | 2.20 | 1.00 | 0.00 | 0 | 11.7 | \$131.69 | \$14.34 | \$0.00 | 0.11 |
| Kitchen | 1 | Faucet Aerator (Kitchen) | 2.50 | 2.20 | 0.00 | 0 | 1.5 | \$16.46 | \$7.17 | \$0.00 | 0.44 |
| Bathroom | 1 | Faucet Aerator (Lavatory) | 2.20 | 1.00 | 0.00 | 0 | 5.8 | \$65.85 | \$7.17 | \$0.00 | 0.11 |

Plug Load Inventory

| Location | Existing Conditions | | | |
|-------------|---------------------|--------------------------|-----------------|------------------------|
| | Quantity | Equipment Description | Energy Rate (W) | ENERGY STAR Qualified? |
| Kitchen | 1 | Microwave | 1,000.0 | No |
| Library | 18 | Desktop With LCD Monitor | 191.0 | Yes |
| Work Area | 1 | Microwave | 1,000.0 | No |
| Main Office | 1 | Refrigerator | 250.0 | No |

Appendix B: ENERGY STAR® Statement of Energy Performance

ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

N/A

Iselin Branch Public Library

Primary Property Type: Library
Gross Floor Area (ft²): 8,700
Built: 1969

For Year Ending: March 31, 2017
Date Generated: May 23, 2017

ENERGY STAR® Score¹

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

| Property & Contact Information | | |
|---|-----------------------|------------------------|
| Property Address | Property Owner | Primary Contact |
| Iselin Branch Public Library 1081 Green St Iselin, New Jersey 08830 | _____ | _____ |
| | () - _____ | () - _____ |
| Property ID: 5880905 | | |

| Energy Consumption and Energy Use Intensity (EUI) | | | |
|---|------------------------------|---------------|---|
| Site EUI | Annual Energy by Fuel | | National Median Comparison |
| 119.3 kBtu/ft ² | Electric - Grid (kBtu) | 364,698 (35%) | National Median Site EUI (kBtu/ft ²) 132.1 |
| | Natural Gas (kBtu) | 673,322 (65%) | National Median Source EUI (kBtu/ft ²) 235.6 |
| | | | % Diff from National Median Source EUI -10% |
| Source EUI | | | Annual Emissions |
| 212.9 kBtu/ft ² | | | Greenhouse Gas Emissions (Metric Tons CO ₂ /year) 78 |

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer Stamp
(if applicable)