



Local Government Energy Audit Report

E. H. Slaybaugh Primary School

July 11, 2019

Prepared for:

Egg Harbor Township School District
13 Swift Drive
Egg Harbor Township, New Jersey 08234

Prepared by:

TRC Energy Services
900 Route 9 North
Woodbridge, New Jersey 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC Energy Services (TRC) reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. We encourage the owner of the facility to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2019 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents


1	Executive Summary.....	1
1.1	Planning Your Project	4
	Pick Your Installation Approach	4
	More Options from Around the State.....	6
2	Existing Conditions.....	7
2.1	Site Overview.....	7
2.2	Building Occupancy	7
2.3	Building Envelope	8
2.4	Lighting Systems.....	9
2.5	Heating and Cooling Distribution Systems	11
	Packaged Units.....	11
2.6	Chilled Water and Heating Hot Water Systems	12
2.7	Condensing Water Systems.....	13
2.8	Building Energy Management Systems (EMS)	14
2.9	Domestic Hot Water	15
2.10	Food Service Equipment.....	16
2.11	Refrigeration.....	17
2.12	Plug Load & Vending Machines.....	18
2.13	Water-Using Systems	19
2.14	On-Site Generation.....	19
3	Energy Use and Costs	20
3.1	Electricity	22
3.2	Natural Gas.....	23
3.3	Benchmarking.....	24
	Tracking Your Energy Performance	25
4	Energy Conservation Measures	26
4.1	Lighting	29
	ECM 1: Install LED Fixtures	29
	ECM 2: Retrofit Fixtures with LED Lamps.....	29
4.2	Lighting Controls.....	30
	ECM 3: Install Occupancy Sensor Lighting Controls	30
	ECM 4: Install High/Low Lighting Controls	30
4.3	HVAC.....	31
	ECM 5: Implement Demand Control Ventilation (DCV)	31
4.4	Domestic Water Heating	32
	ECM 6: Install Low-Flow DHW Devices.....	32
4.5	Food Service & Refrigeration Measures.....	33

ECM 7: Replace Refrigeration Equipment.....	33
ECM 8: Vending Machine Control.....	33
5 Energy Efficient Best Practices.....	34
Energy Tracking with ENERGY STAR® Portfolio Manager®.....	34
Doors and Windows.....	34
Window Treatments/Coverings.....	34
Lighting Maintenance.....	34
Lighting Controls.....	34
Motor Controls.....	35
Motor Maintenance.....	35
Thermostat Schedules and Temperature Resets.....	35
Economizer Maintenance.....	35
Chiller Maintenance.....	35
HVAC Filter Cleaning and Replacement.....	35
Boiler Maintenance.....	36
Water Heater Maintenance.....	36
Plug Load Controls.....	36
Computer Power Management Software.....	36
Water Conservation.....	37
Procurement Strategies.....	37
6 On-site Generation.....	38
6.1 Solar Photovoltaic.....	38
6.2 Combined Heat and Power.....	40
7 Project Funding and Incentives.....	41
7.1 SmartStart.....	42
7.2 Direct Install.....	43
7.3 Energy Savings Improvement Program.....	44
7.4 SREC Registration Program.....	45
8 Energy Purchasing and Procurement Strategies.....	46
8.1 Retail Electric Supply Options.....	46
8.2 Retail Natural Gas Supply Options.....	46
Appendix A: Equipment Inventory & Recommendations.....	A-1
Appendix B: ENERGY STAR® Statement of Energy Performance.....	B-1
Appendix C: Glossary.....	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for E. H. Slaybaugh Primary School. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC Energy Services (TRC) conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

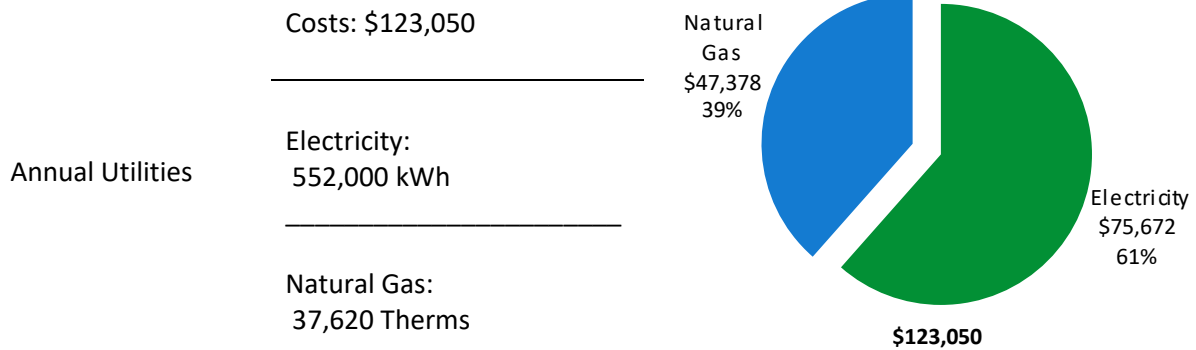

ENERGY STAR® Benchmarking Score	35 <i>(1-100 scale)</i>	This building performs at or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.
------------------------------------	----------------------------	--

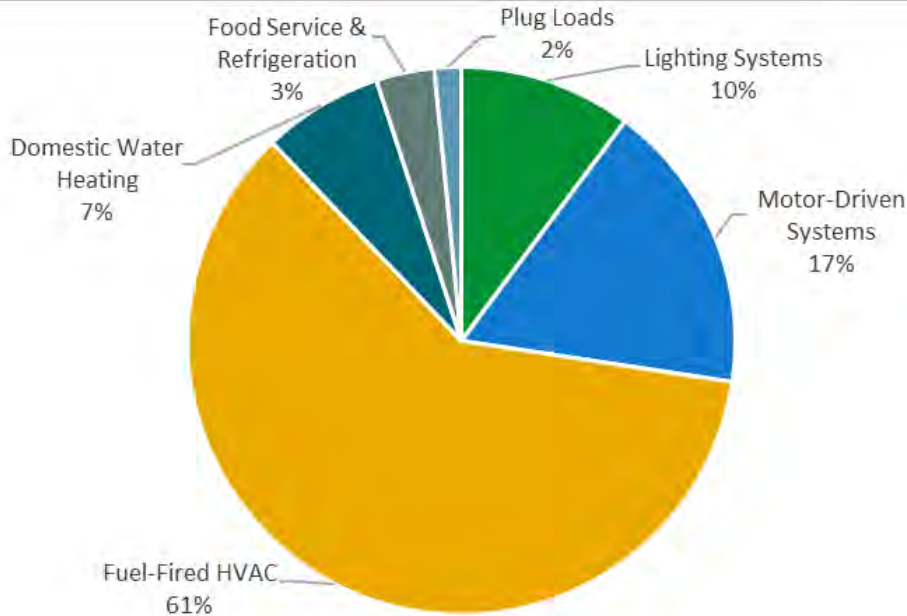


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$97,227
Potential Rebates & Incentives ¹	\$13,363
Annual Cost Savings	\$12,992
Annual Energy Savings	Electricity: 88,786 kWh Natural Gas: 1,125 Therms
Greenhouse Gas Emission Savings	49 Tons
Simple Payback	6.5 Years
Site Energy Savings (all utilities)	7%

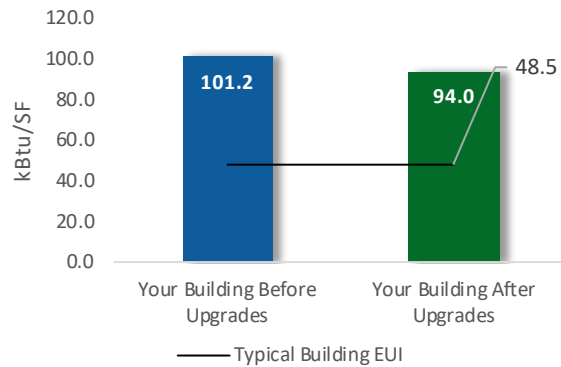

Scenario 2: Cost Effective Package²

Installation Cost	\$95,595
Potential Rebates & Incentives	\$13,238
Annual Cost Savings	\$12,904
Annual Energy Savings	Electricity: 88,141 kWh Natural Gas: 1,125 Therms
Greenhouse Gas Emission Savings	49 Tons
Simple Payback	6.4 Years
Site Energy Savings (all utilities)	7%

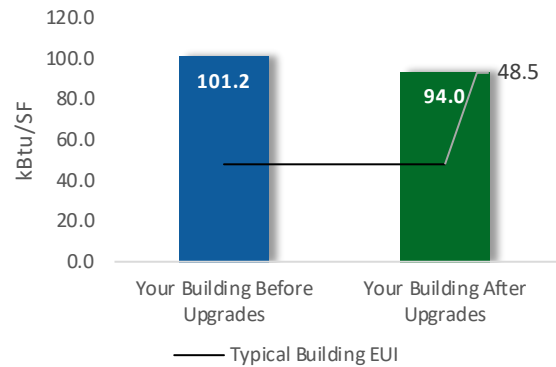

On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other Program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		73,643	20.9	-15	\$9,911	\$148,672	\$77,530	\$12,018	\$65,512	6.6	72,447
ECM 1	Install LED Fixtures	26,674	3.0	0	\$3,657	\$54,850	\$40,571	\$4,200	\$36,371	9.9	26,861
ECM 2	Retrofit Fixtures with LED Lamps	46,969	17.8	-15	\$6,255	\$93,822	\$36,960	\$7,818	\$29,142	4.7	45,587
Lighting Control Measures		6,924	2.3	-2	\$923	\$7,383	\$11,988	\$1,120	\$10,868	11.8	6,728
ECM 3	Install Occupancy Sensor Lighting Controls	5,034	1.7	-1	\$672	\$5,372	\$8,988	\$1,120	\$7,868	11.7	4,897
ECM 4	Install High/Low Lighting Controls	1,890	0.6	-1	\$251	\$2,011	\$3,000	\$0	\$3,000	11.9	1,832
HVAC System Improvements		0	0.0	46	\$573	\$8,597	\$5,438	\$0	\$5,438	9.5	5,329
ECM 5	Implement Demand Control Ventilation (DCV)	0	0.0	46	\$573	\$8,597	\$5,438	\$0	\$5,438	9.5	5,329
Domestic Water Heating Upgrade		0	0.0	84	\$1,054	\$10,545	\$179	\$0	\$179	0.2	9,804
ECM 6	Install Low-Flow DHW Devices	0	0.0	84	\$1,054	\$10,545	\$179	\$0	\$179	0.2	9,804
Food Service & Refrigeration Measures		3,869	0.4	0	\$530	\$3,272	\$2,092	\$225	\$1,867	3.5	3,896
	Replace Refrigeration Equipment	646	0.1	0	\$89	\$1,062	\$1,632	\$125	\$1,507	17.0	650
ECM 7	Vending Machine Control	3,224	0.4	0	\$442	\$2,210	\$460	\$100	\$360	0.8	3,246
TOTALS		84,436	23.6	113	\$12,992	\$178,469	\$97,227	\$13,363	\$83,864	6.5	98,204

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey’s Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures	X	X	
ECM 2	Retrofit Fixtures with LED Lamps	X	X	
ECM 3	Install Occupancy Sensor Lighting Controls	X	X	
ECM 4	Install High/Low Lighting Controls		X	
ECM 5	Implement Demand Control Ventilation	X		
ECM 6	Install Low-Flow Domestic Hot Water Devices		X	
ECM 7	Vending Machine Control	X	X	

Figure 3 – Funding Options



New Jersey's Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified partner to develop your energy reduction plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.

Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for E. H. Slaybaugh Primary School. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey’s Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On December 13, 2018, TRC performed an energy audit at E. H. Slaybaugh Primary School located in Egg Harbor Township, New Jersey. TRC met with Shawn Braue to review the facility operations and help focus our investigation on specific energy-using systems.

E. H. Slaybaugh Primary School is a one-story, 55,800 square foot building built in 2005. Spaces include: classrooms, a gymnasium, offices, a cafeteria, corridors, ballrooms, a conference room, a commercial kitchen and a mechanical space.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

2.2 Building Occupancy

The building is occupied year-round and school operates from September through June during a year. Typical weekday occupancy is 95 staff and 446 students.

Summer occupancy includes a summer school program and continuing maintenance activities. There are no weekend activities.

Building Name	Weekday/Weekend	Operating Schedule
E. H. Slaybaugh Primary School	Weekday	8:00 AM - 4:00 PM
	Weekend	Unoccupied

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are concrete block over structural steel with a decorative concrete masonry unit facade.

Steel trusses support a pitched roof with a metal deck covered with asphalt shingles. The roof encloses conditioned space. The thermal barrier is between this space and the conditioned space below. The gymnasium has a flat roof with a steel deck supported with steel trusses, with an unknown weather barrier.

Windows are double glazed and have aluminum frames with a thermal break vinyl frame. The glass-to-frame seals are in good condition. The operable window weather seals are in good condition, showing no evidence of excessive wear. Exterior doors have aluminum frames and are in good condition with undamaged door seals.



Building Windows



Shingles on Roof



Flat Roof



Building Exterior

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps that use electronic ballasts. Additionally, there are some compact fluorescent lamps (CFL), incandescent, metal halide, and LED general purpose lamps.

T-8 fixture types include 2-, 3-, and 4-lamp, 2- and 4-foot long troffers, recessed and surface-mounted fixtures, and 2-foot fixtures with linear tube lamps.

Most fixtures are in good condition.

Cafeteria fixtures have 1000-Watt metal halide lamps and are manually controlled.

Library fixtures have decorative pendant metal halide bulbs as well as 2-foot linear fluorescent tubes and are manually controlled.

All exit signs are LED.

Interior lighting levels were generally sufficient.



Gym Lighting



Stage Lighting



Classroom Lighting



Boiler Room Lighting

Lighting fixtures in classrooms, restrooms, and offices are controlled by occupancy sensors, and the remaining fixtures are controlled by wall switches.

Exterior fixtures include wall-mounted 150-Watt metal halide fixtures, 26-Watt or 42-Watt canopy mounted can fixtures, and door-mounted long U-type CFL fixtures.

Exterior light fixtures are controlled by photocell.



Exterior Lighting



Wall-Mounted Exterior Fixture



Wall-Mounted Exterior Fixtures



Exterior Door-Mounted Fixture

2.5 Heating and Cooling Distribution Systems

Packaged Units

The building heating and cooling system supplies hot and chilled water to unit ventilators and air handlers throughout the building. There is an attic below the roof containing 19 air handler units (AHU-1 to 18, 20) with hot water and chilled water coils which serve the library, multipurpose room, bathrooms, kitchen, stage, and all the classrooms in A-, B-, C-, and D-wings of the building. These AHUs have variable speed supply fans ranging in size from 0.3 hp to 10 hp as well variable speed return fans ranging in size from 0.3 hp to 5 hp. Variable frequency drives control the supply and return air fans. All AHUs are monitored and controlled by BMS.



AHU-12 in Attic



AHU Nameplate

2.6 Chilled Water and Heating Hot Water Systems

The building has one natural gas-fired, 215-ton Broad® absorption chiller with a heating capacity of 2525 MBh. The burners are non-modulating with a nominal efficiency of 93.25%. One 746 MBh Lochinvar provides hot water to the absorption chiller. The units provide either heating water or chilled water for unit ventilators and air handlers located throughout the building. The system generally operates in heating mode from mid-October through mid-April and in cooling mode the rest of the year. Supply heating water is circulated by two of three 10 hp variable flow pumps (P-1 and 2). Supply chilled water is circulated by two 20 hp variable flow pumps (P-3 and 4). Heating water is supplied at 160 °F and chilled water is supplied at 45 °F.

The absorption chillers are controlled by a Broad AI Control panel and operate in a lead/lag configuration. Installed in 2009, the system is in good condition and in well condition. There is a service contract in place.



Boiler



Water Supply Pump



Boiler Nameplate



Heating Hot Water Pumps

2.7 Condensing Water Systems

Outside of the building there is an open cell Reyma cooling tower (CT1) with one variable flow 15 hp fan and one variable flow 15 hp circulation pump (P-5). Fan motor is staged based on maintaining basin water temperature. The condenser water temperature is reset with water supplied at 85°F and return water temperature is 95°F.

The fill of the cooling tower was noted in be in good condition. There are no leaks from cooling tower at the time of site visit.



Absorption Chiller



Chilled Water Pipes



Chilled Water Pump



Cooling Tower

2.8 Building Energy Management Systems (EMS)

A Siemens Insight EMS controls the HVAC equipment, hot water system and chilled water system, the air handlers, and the package units. The EMS provides equipment scheduling control and monitors and controls space temperatures, supply air temperatures, humidity, heating water loop temperatures, and chilled water loop temperatures.

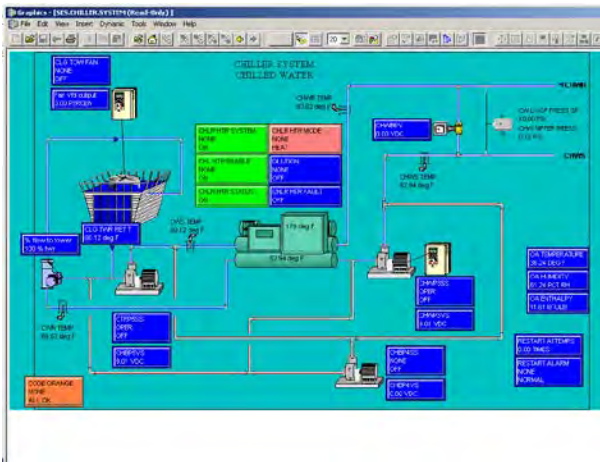


Image 1 Chilled Water System

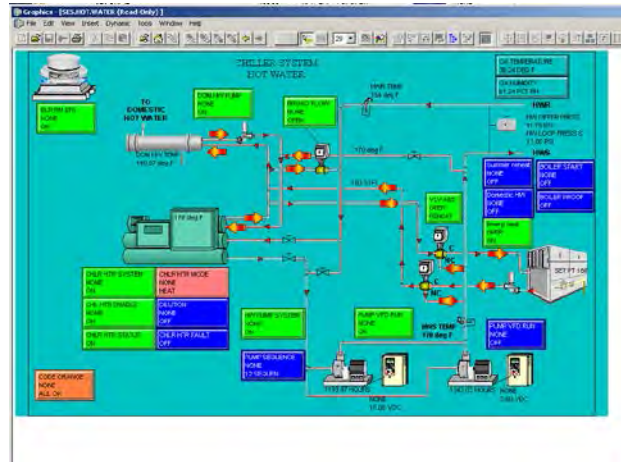


Image 2 Hot Water System

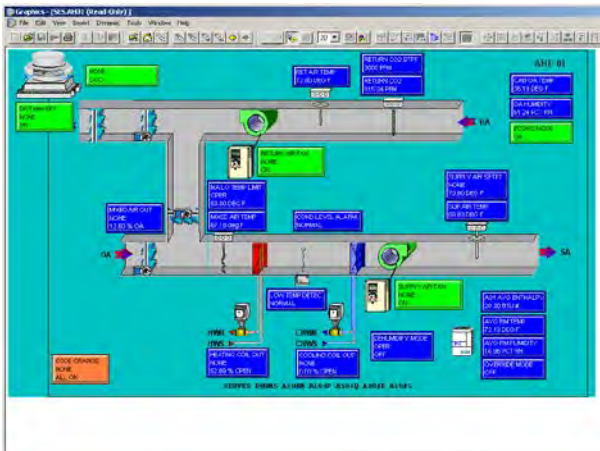


Image 3 AHU Graphic on BMS



Image 4 School Floor Plan

2.9 Domestic Hot Water

Hot water is produced with an indirect system from a Lochinvar hot water gas-fired boiler, which has a 250-gallon storage tank attached and input capacity of 746 MBh with an efficiency of 93.25%. One 1 hp domestic hot water pump supplies hot water to kitchen and restroom areas.

At the time of the site visit, the domestic water heaters were set at 134°F.

The domestic hot water pipes are insulated, and the insulation is in good condition.



DHW Boiler



DHW Heater Nameplate



Re-circulation Pump



DHW Heater Nameplate

2.10 Food Service Equipment

The kitchen has mixed gas and electric equipment that is used to prepare lunches. Most cooking is done using a one convection electric and one gas fired convection oven. Bulk prepared foods are held in several electric holding cabinets. Equipment is high-efficiency and is in good condition.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high-efficiency food service equipment.



Gas Steamer



Electric Oven



Heated Cabinet



Kitchen Sink

2.11 Refrigeration

The kitchen has one energy-efficient stand-up refrigerator and one standard-efficiency stand-up refrigerator with solid doors. There is also an energy-efficient stand-up solid door freezer. There is one chest-type cooler used to store milk beverages. All equipment is high-efficiency and in good condition.

The walk-in refrigerator has an estimated 1-ton compressor located outdoor on unit itself and two fan evaporators with evaporator fan control.

The walk-in low-temperature freezer has a 1-ton compressor located outdoor on unit itself and two fan evaporators with evaporator fan control and electric defrost control.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Stand Up Refrigerator



Milk Cooler



Stand Up Freezer



Walk-in Units

2.12 Plug Load & Vending Machines

The utility bill analysis indicates that plug loads consume approximately 1.58% percent of total building energy use. This is lower than a typical building.

You seem to already be doing a great job managing your electrical plug loads. This report makes additional suggestions for ECMs in this area as well as Energy Efficient Best Practices.


There are approximately 131 computer work stations throughout the Primary School. Plug loads throughout the building include general cafeteria and office equipment. There are classroom typical loads such as SmartBoards, projectors, printers, and portable fans.

There are several residential-style refrigerators throughout the building that are used to store staff lunches and cold beverages. These vary in condition and efficiency.

There are two refrigerated beverage vending machines in break room. Vending machines are not equipped with occupancy-based control.



Copy Machine

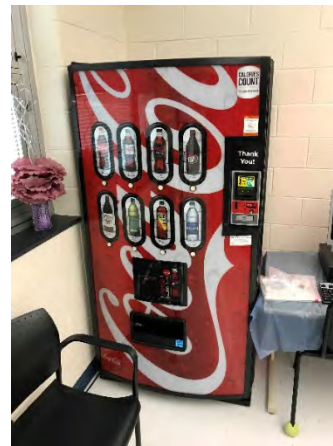

Refrigerated Vending Machine



Under-Counter Dishwasher



Vending Machine

2.13 Water-Using Systems

There are approximately 22 restrooms with toilets, urinals, and sinks. Faucet flow rates are at 2.2 gallons per minute (gpm) or higher. Toilets are rated at 1.6 gallons per flush (gpf), and urinals are rated at 1.2 gpf.


2.14 On-Site Generation

Davenport Primary School has an emergency generator that, in the event of a power outage, serves critical services (lighting, elevator, heating-boiler and pumps) and is only used for emergency needs.

3 ENERGY USE AND COSTS

12 months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	552,000 kWh	\$75,672
Natural Gas	37,620 Therms	\$47,378
Total		\$123,050

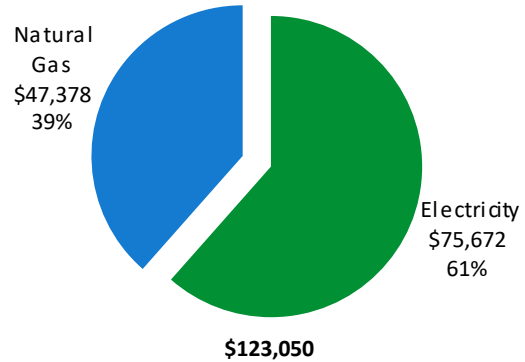

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


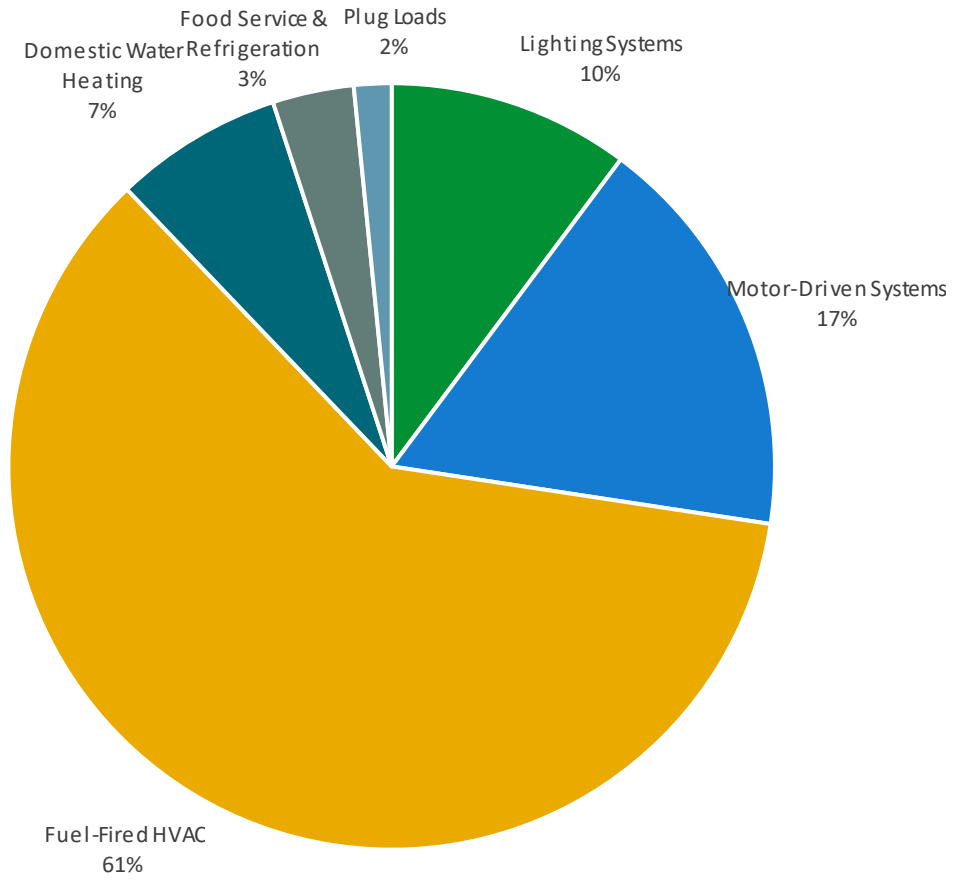


Figure 5 - Energy Balance

3.1 Electricity

Atlantic City Electric delivers electricity under rate class Annual General Service Secondary.

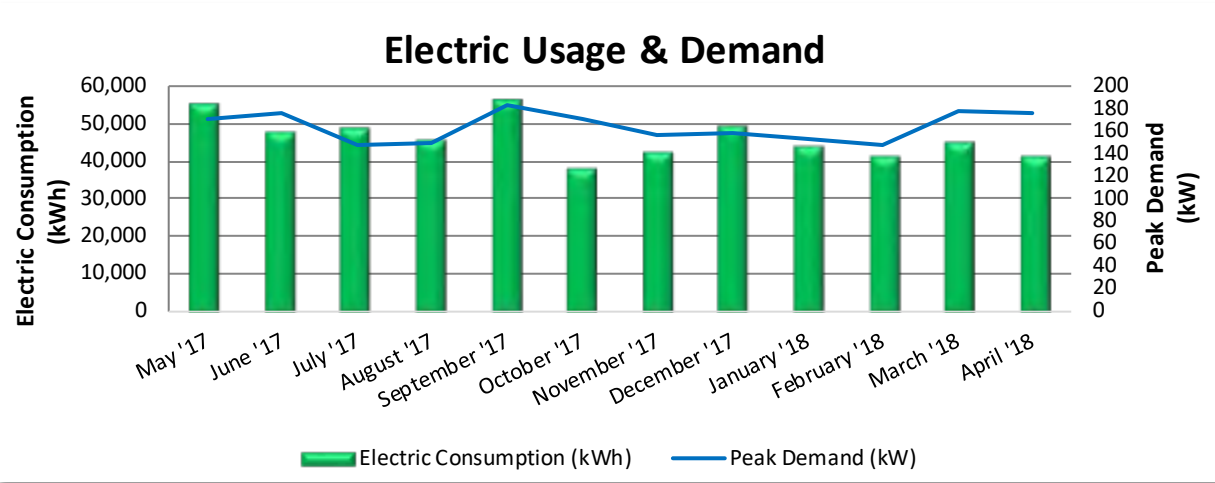


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
5/31/17	31	54,900	172	\$1,659	\$8,052
6/30/17	30	47,400	177	\$1,561	\$6,413
7/31/17	31	48,600	147	\$1,253	\$6,255
8/31/17	31	45,600	150	\$1,499	\$6,218
9/30/17	30	55,800	183	\$1,595	\$7,248
10/31/17	31	37,800	171	\$1,559	\$5,343
11/30/17	30	42,000	156	\$1,626	\$5,851
12/31/17	31	49,200	159	\$1,760	\$6,727
1/31/18	31	43,800	153	\$1,392	\$5,927
2/28/18	28	41,100	147	\$1,338	\$5,609
3/31/18	31	44,700	177	\$1,613	\$6,271
4/30/18	30	41,100	177	\$1,504	\$5,759
Totals	365	552,000	183	\$18,359	\$75,672
Annual	365	552,000	183	\$18,359	\$75,672

Notes:

- Peak demand of 183 kW occurred in September '17.
- The average electric cost over the past 12 months was \$0.137/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- Some of the electricity generated on-site is used on-site and the remainder is exported to the grid.

3.2 Natural Gas

South Jersey Gas delivers natural gas under rate class General Service.

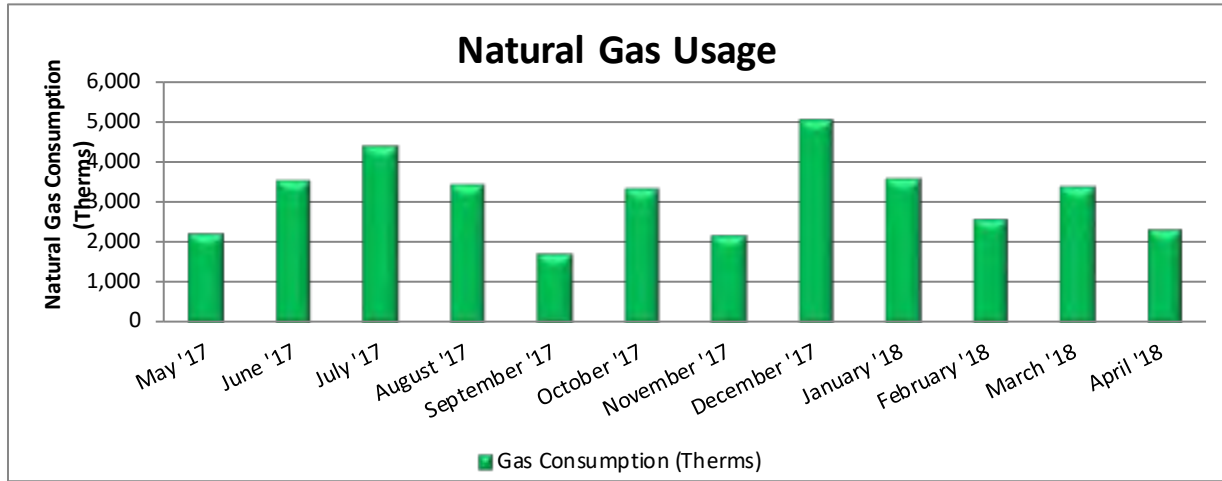

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
5/31/17	31	2,233	\$2,302
6/30/17	30	3,505	\$3,686
7/31/17	31	4,376	\$4,680
8/31/17	31	3,415	\$3,113
9/30/17	30	1,732	\$1,883
10/31/17	31	3,302	\$3,692
11/30/17	30	2,180	\$2,681
12/31/17	31	5,006	\$6,160
1/31/18	31	3,560	\$8,987
2/28/18	28	2,590	\$3,225
3/31/18	31	3,380	\$4,180
4/30/18	30	2,341	\$2,788
Totals	365	37,620	\$47,378
Annual	365	37,620	\$47,378

Notes:

- The average gas cost for the past 12 months is \$1.259/therm, which is the blended rate used throughout the analysis.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the county, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

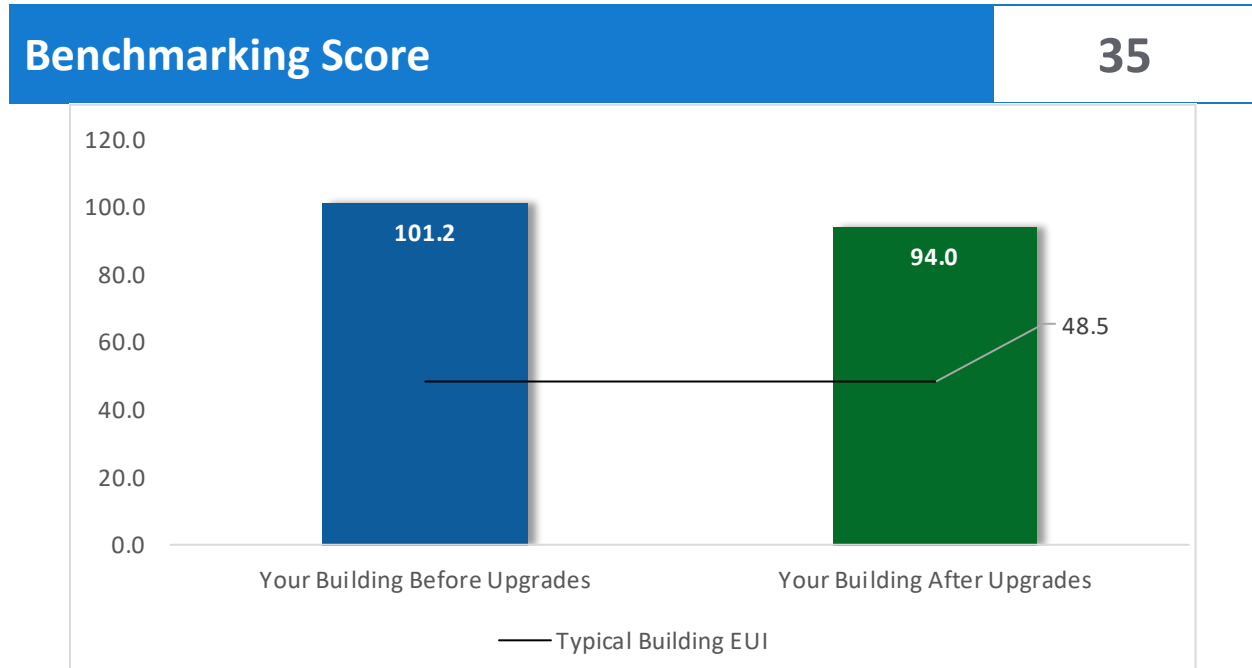


Figure 6 - Energy Use Intensity Comparison

This building performs below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website³.

³ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		73,643	20.9	-15	\$9,911	\$77,530	\$12,018	\$65,512	6.6	72,447
ECM 1	Install LED Fixtures	26,674	3.0	0	\$3,657	\$40,571	\$4,200	\$36,371	9.9	26,861
ECM 2	Retrofit Fixtures with LED Lamps	46,969	17.8	-15	\$6,255	\$36,960	\$7,818	\$29,142	4.7	45,587
Lighting Control Measures		6,924	2.3	-2	\$923	\$11,988	\$1,120	\$10,868	11.8	6,728
ECM 3	Install Occupancy Sensor Lighting Controls	5,034	1.7	-1	\$672	\$8,988	\$1,120	\$7,868	11.7	4,897
ECM 4	Install High/Low Lighting Controls	1,890	0.6	-1	\$251	\$3,000	\$0	\$3,000	11.9	1,832
HVAC System Improvements		0	0.0	46	\$573	\$5,438	\$0	\$5,438	9.5	5,329
ECM 5	Implement Demand Control Ventilation (DCV)	0	0.0	46	\$573	\$5,438	\$0	\$5,438	9.5	5,329
Domestic Water Heating Upgrade		0	0.0	84	\$1,054	\$179	\$0	\$179	0.2	9,804
ECM 6	Install Low-Flow DHW Devices	0	0.0	84	\$1,054	\$179	\$0	\$179	0.2	9,804
Food Service & Refrigeration Measures		3,869	0.4	0	\$530	\$2,092	\$225	\$1,867	3.5	3,896
	Replace Refrigeration Equipment	646	0.1	0	\$89	\$1,632	\$125	\$1,507	17.0	650
ECM 7	Vending Machine Control	3,224	0.4	0	\$442	\$460	\$100	\$360	0.8	3,246
TOTALS		84,436	23.6	113	\$12,992	\$97,227	\$13,363	\$83,864	6.5	98,204

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		73,643	20.9	-15	\$9,911	\$77,530	\$12,018	\$65,512	6.6	72,447
ECM 1	Install LED Fixtures	26,674	3.0	0	\$3,657	\$40,571	\$4,200	\$36,371	9.9	26,861
ECM 2	Retrofit Fixtures with LED Lamps	46,969	17.8	-15	\$6,255	\$36,960	\$7,818	\$29,142	4.7	45,587
Lighting Control Measures		6,924	2.3	-2	\$923	\$11,988	\$1,120	\$10,868	11.8	6,728
ECM 3	Install Occupancy Sensor Lighting Controls	5,034	1.7	-1	\$672	\$8,988	\$1,120	\$7,868	11.7	4,897
ECM 4	Install High/Low Lighting Controls	1,890	0.6	-1	\$251	\$3,000	\$0	\$3,000	11.9	1,832
HVAC System Improvements		0	0.0	46	\$573	\$5,438	\$0	\$5,438	9.5	5,329
ECM 5	Implement Demand Control Ventilation (DCV)	0	0.0	46	\$573	\$5,438	\$0	\$5,438	9.5	5,329
Domestic Water Heating Upgrade		0	0.0	84	\$1,054	\$179	\$0	\$179	0.2	9,804
ECM 6	Install Low-Flow DHW Devices	0	0.0	84	\$1,054	\$179	\$0	\$179	0.2	9,804
Food Service & Refrigeration Measures		3,224	0.4	0	\$442	\$460	\$100	\$360	0.8	3,246
ECM 7	Vending Machine Control	3,224	0.4	0	\$442	\$460	\$100	\$360	0.8	3,246
TOTALS		83,791	23.5	113	\$12,904	\$95,595	\$13,238	\$82,357	6.4	97,554

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		73,643	20.9	-15	\$9,911	\$77,530	\$12,018	\$65,512	6.6	72,447
ECM 1	Install LED Fixtures	26,674	3.0	0	\$3,657	\$40,571	\$4,200	\$36,371	9.9	26,861
ECM 2	Retrofit Fixtures with LED Lamps	46,969	17.8	-15	\$6,255	\$36,960	\$7,818	\$29,142	4.7	45,587

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all fixtures of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the Primary School, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace existing fixtures containing metal halide lamps with new LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixtures.

Maintenance savings may also be achieved as LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected building areas: exterior fixtures.

ECM 2: Retrofit Fixtures with LED Lamps

Replace linear fluorescent, CFLs, and incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected building areas: cafeteria, offices, conference rooms, classrooms, library, restrooms, storage rooms, and all areas with fluorescent fixtures with T8 tubes.

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		6,924	2.3	-2	\$923	\$11,988	\$1,120	\$10,868	11.8	6,728
ECM 3	Install Occupancy Sensor Lighting Controls	5,034	1.7	-1	\$672	\$8,988	\$1,120	\$7,868	11.7	4,897
ECM 4	Install High/Low Lighting Controls	1,890	0.6	-1	\$251	\$3,000	\$0	\$3,000	11.9	1,832

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 3: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote-mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected building areas: offices, conference rooms, classrooms, library, restrooms, and storage rooms.

ECM 4: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be taken into account when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected building areas: hallways.

For this type of measure, the occupancy sensors will generally be ceiling- or fixture-mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as an occupant approaches.

4.3 HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
HVAC System Improvements		0	0.0	46	\$573	\$5,438	\$0	\$5,438	9.5	5,329
ECM 5	Implement Demand Control Ventilation (DCV)	0	0.0	46	\$573	\$5,438	\$0	\$5,438	9.5	5,329

ECM 5: Implement Demand Control Ventilation (DCV)

Demand control ventilation (DCV) monitors the indoor air's carbon dioxide (CO₂) content to measure room occupancy. This data is used to regulate the amount of outdoor air provided to the space for ventilation.

Standard ventilation systems often provide outside air based on a space's estimated maximum occupancy but not actual occupancy. During low occupancy periods, the space may then be over-ventilated. This wastes energy through heating and cooling the excess outside air flow. DCV reduces unnecessary outdoor air intake by regulating ventilation based on actual occupancy levels. DCV is most suited for facilities where occupancy levels vary significantly from hour to hour and day to day.

Energy savings associated with DCV are based on hours of operation, space occupancy, outside air reduction, and other factors. Energy savings results from eliminating unnecessary ventilation and space conditioning.

Affected building areas: multipurpose room.

4.4 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	84	\$1,054	\$179	\$0	\$179	0.2	9,804
ECM 6	Install Low-Flow DHW Devices	0	0.0	84	\$1,054	\$179	\$0	\$179	0.2	9,804

ECM 6: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Pre-rinse spray valves (PRSVs) — often used in commercial and institutional kitchens — remove food waste from dishes prior to dishwashing.

Additional cost savings may result from reduced water usage.

4.5 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		3,869	0.4	0	\$530	\$2,092	\$225	\$1,867	3.5	3,896
	Replace Refrigeration Equipment	646	0.1	0	\$89	\$1,632	\$125	\$1,507	17.0	650
ECM 7	Vending Machine Control	3,224	0.4	0	\$442	\$460	\$100	\$360	0.8	3,246

ECM 7: Replace Refrigeration Equipment

Replace existing commercial stand-up refrigerators with new ENERGY STAR® rated equipment. The energy savings associated with this measure come from reduced energy usage, due to more efficient technology, and reduced run times.

ECM 8: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time and power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions.⁴ Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Doors and Windows

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour (ACH) can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Window Treatments/Coverings

Use high-reflectivity films or cover windows with shades or shutters to reduce solar heat gain and reduce the load on cooling and heating systems. Older, single pane windows and east or west-facing windows are especially prone to solar heat gain. In addition, use shades or shutters at night during cold weather to reduce heat loss.

Lighting Maintenance



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Lighting Controls

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

Motor Controls

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Whenever possible, use automatic devices such as twist timers or occupancy sensors to turn off motors when they are not needed.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control, or dampers that are stuck or improperly adjusted.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

Chiller Maintenance

Service chillers regularly to keep them operating properly. Chillers are responsible for a substantial portion of a commercial building's overall energy usage and when they do not work well, there is usually a noticeable increase in energy bills and increased occupant complaints. Regular diagnostics and service can save five to ten percent of the cost of operating your chiller. If you already have a maintenance contract in place, your existing service company should be able to provide these services.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Boiler Maintenance


Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the water side or fire side of the boiler.

Water Heater Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Plug Load Controls



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips⁵. Your local utility may offer incentives or rebates for this equipment.

Computer Power Management Software

Many computers consume power during nights, weekends, and holidays. Screen savers are commonly confused as a power management strategy. This contributes to avoidable, excessive electrical energy consumption. There are innovative power management software packages available that are designed to deliver significant energy saving and provide ongoing tracking measurements. A central power management platform helps enforce energy savings policies as well as identify and eliminate underutilized devices

⁵ For additional information refer to "Assessing and Reducing Plug and Process Loads in Office Buildings" <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense™ ratings for urinals is 0.5 gpf and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense™ website⁶ or download a copy of EPA's "WaterSense™ at Work: Best Management Practices for Commercial and Institutional Facilities"⁷ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense™ products where available.

⁶ <https://www.epa.gov/watersense>

⁷ <https://www.epa.gov/watersense/watersense-work-0>

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the Primary School's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

The amount of free area, ease of installation on roof, and the lack of shading elements contribute to the high potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

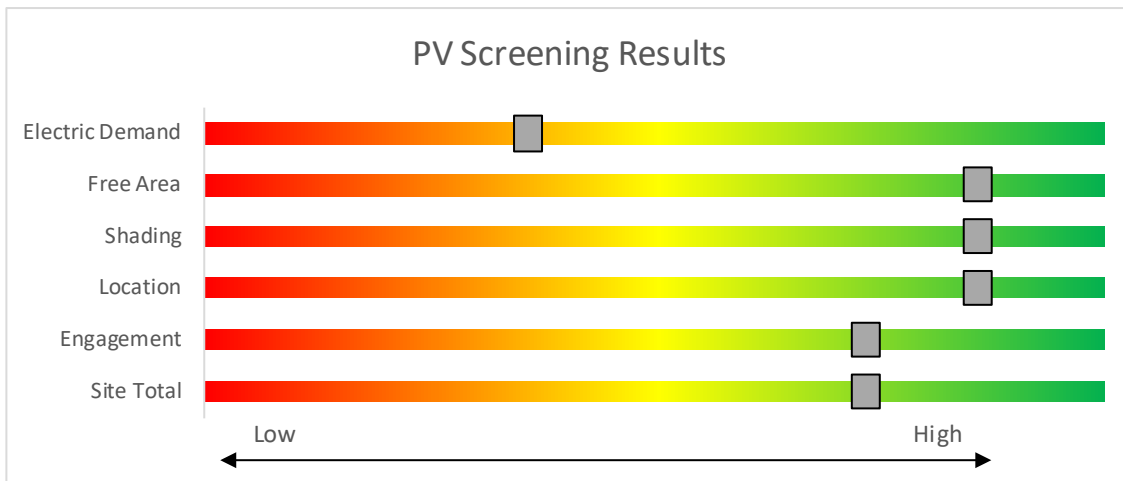


Figure 9 - Photovoltaic Screening

Solar Renewable Energy Credit (SREC) Registration Program (SPR)

Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SREC Registration Program before starting construction. Once your PV system is up and running, you periodically earn credits, which can then be sold on the open market for up to 15 years.

If you are considering installing solar photovoltaics on your building, visit www.njcleanenergy.com/srec for more information about the SREC Registration Program.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- **Basic Info on Solar PV in New Jersey:** www.njcleanenergy.com/whysolar
- **New Jersey Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs
- **Approved Solar Installers in the New Jersey Market:** www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) generate electricity at the Primary School and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the Primary School has **no** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the Primary School does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

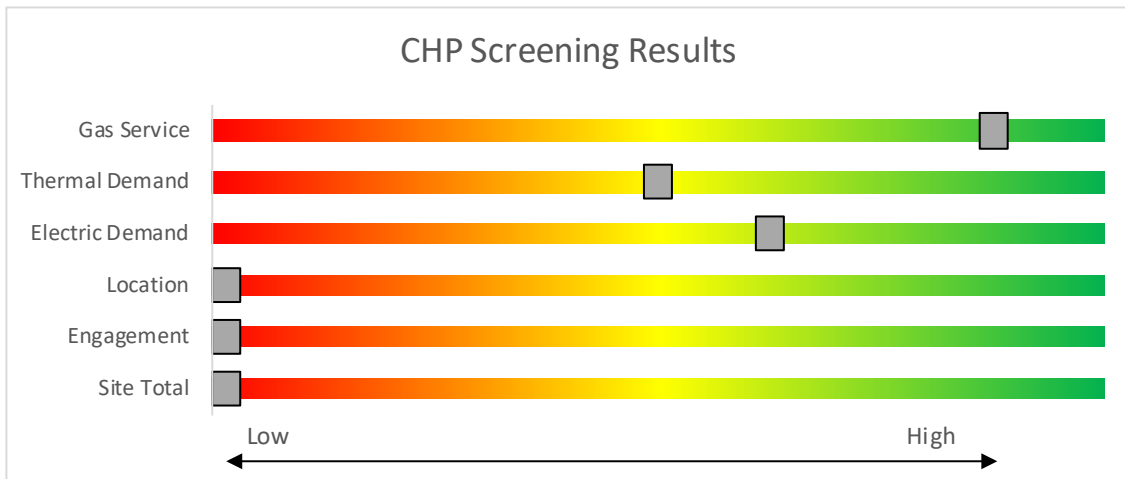


Figure 10 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? Pick the program that works best for you. Incentive programs that may apply to the Primary School are identified in the Executive Summary. This section provides an overview of currently available New Jersey’s Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			

7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficient equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.

7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

7.4 SREC Registration Program

The SREC Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey SRECs. SREC's are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SREC's to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar Renewable Portfolio Standard. Purchasing SRECs can help them meet those requirements. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period fluctuates depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.

8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁸.

8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website⁹.

⁸ www.state.nj.us/bpu/commercial/shopping.html.

⁹ www.state.nj.us/bpu/commercial/shopping.html

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Exterior	42	Metal Halide: (1) 150W Lamp	Photocell		190	4,380	1	Fixture Replacement	No	42	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	45	4,380	3.0	26,674	0	\$3,657	\$40,571	\$4,200	9.9
A105 BAS	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,435	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.0	57	0	\$8	\$73	\$20	7.0
A106D Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	2, 3	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.1	219	0	\$29	\$416	\$75	11.7
A100D Test	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,435	2	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.1	114	0	\$15	\$146	\$40	7.0
B103 Office	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	2, 3	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.1	328	0	\$44	\$489	\$95	9.0
A110	5	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,435	2	Relamp	No	5	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.1	285	0	\$38	\$365	\$100	7.0
A104B	8	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	2, 3	Relamp	Yes	8	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.3	874	0	\$116	\$854	\$195	5.7
A104 Hall	10	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	2, 4	Relamp	Yes	10	LED - Linear Tubes: (4) 4' Lamps	High/Low Control	58	1,435	0.4	1,093	0	\$145	\$1,130	\$200	6.4
A104P	7	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	2, 3	Relamp	Yes	7	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.3	765	0	\$102	\$781	\$175	6.0
A104Q	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	2, 3	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.1	219	0	\$29	\$416	\$75	11.7
Custodian	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.0	50	0	\$7	\$55	\$15	5.9
Office	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	151	0	\$20	\$164	\$45	5.9
B101 Speech	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	372	0	\$49	\$489	\$95	8.0
B102	10	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	10	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.2	504	0	\$67	\$548	\$150	5.9
D103	10	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	10	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.2	504	0	\$67	\$548	\$150	5.9
D104	10	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	10	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.2	504	0	\$67	\$548	\$150	5.9
D101	15	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	15	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.5	1,395	0	\$186	\$1,092	\$260	4.5
D101B	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	186	0	\$25	\$380	\$65	12.7
D105	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.4	1,116	0	\$148	\$927	\$215	4.8
D107	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	252	0	\$34	\$274	\$75	5.9
D109	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	252	0	\$34	\$274	\$75	5.9
D110	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	252	0	\$34	\$274	\$75	5.9
D112	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	252	0	\$34	\$274	\$75	5.9
D111	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	252	0	\$34	\$274	\$75	5.9
A103 Nurse	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	202	0	\$27	\$219	\$60	5.9

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Conference Room	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	202	0	\$27	\$219	\$60	5.9
A102B	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	151	0	\$20	\$164	\$45	5.9
A102 Office	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	303	0	\$40	\$329	\$90	5.9
A102C	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	202	0	\$27	\$219	\$60	5.9
Lounge	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,435	2	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	151	0	\$20	\$164	\$45	5.9
Lounge	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	279	0	\$37	\$434	\$80	9.5
A104G	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	372	0	\$49	\$489	\$95	8.0
A104F	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.2	558	0	\$74	\$599	\$125	6.4
A104E	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	372	0	\$49	\$489	\$95	8.0
A104D	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	372	0	\$49	\$489	\$95	8.0
A104C	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	372	0	\$49	\$489	\$95	8.0
A104S	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	372	0	\$49	\$489	\$95	8.0
A104R	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	372	0	\$49	\$489	\$95	8.0
A104N	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	279	0	\$37	\$434	\$80	9.5
A104M	11	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 3	Relamp	Yes	11	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.3	1,023	0	\$136	\$872	\$200	4.9
A104M	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,080	0.0	73	0	\$10	\$55	\$15	4.1
Hallway	57	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	2, 4	Relamp	Yes	57	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	1,435	1.8	5,302	-2	\$705	\$5,122	\$855	6.1
A100F Storage	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	202	0	\$27	\$219	\$60	5.9
A106 Storage	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	186	0	\$25	\$226	\$30	7.9
Boys	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	186	0	\$25	\$380	\$65	12.7
Girls	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	186	0	\$25	\$380	\$65	12.7
A106B Kitchen	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2, 3	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	434	0	\$58	\$526	\$105	7.3
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
A109 Storage	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	248	0	\$33	\$262	\$40	6.7
A109A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
Computer Lab	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	471	0	\$63	\$511	\$140	5.9
A100E Tech	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
B101 Speech	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	97	0	\$13	\$73	\$20	4.1
B102 KG	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.3	868	0	\$115	\$781	\$175	5.2
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
B104 KG	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	471	0	\$63	\$511	\$140	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
B105 KG	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	471	0	\$63	\$511	\$140	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
B107 KG	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	471	0	\$63	\$511	\$140	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
B106	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	471	0	\$63	\$511	\$140	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
B109	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	471	0	\$63	\$511	\$140	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
B108	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	471	0	\$63	\$511	\$140	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
Girls	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	101	0	\$13	\$110	\$30	5.9
Boys	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	101	0	\$13	\$110	\$30	5.9
C104	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	336	0	\$45	\$365	\$100	5.9
C103	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	336	0	\$45	\$365	\$100	5.9
C105	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
C106	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
C108	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
C107	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
C110	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
C109	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
C112	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
C111	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
C100A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
D101A	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	97	0	\$13	\$73	\$20	4.1
D106	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.2	404	0	\$54	\$438	\$120	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
D107	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	235	0	\$31	\$256	\$70	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
D109	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	235	0	\$31	\$256	\$70	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
D110	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	235	0	\$31	\$256	\$70	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9

Existing Conditions		Proposed Conditions											Energy Impact & Financial Analysis								
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
D112	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	235	0	\$31	\$256	\$70	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
D111	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	235	0	\$31	\$256	\$70	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
A103 Nurse	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	135	0	\$18	\$146	\$40	5.9
A103 Nurse	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	101	0	\$13	\$110	\$30	5.9
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,435	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.0	34	0	\$4	\$37	\$10	5.9
Hallway	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	1,435	0.1	310	0	\$41	\$383	\$50	8.1
A104T	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	97	0	\$13	\$73	\$20	4.1
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	49	0	\$6	\$37	\$10	4.1
Vestibule	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	97	0	\$13	\$73	\$20	4.1
C100B MDF	1	Linear Fluorescent - T8: 2' T8 (17W) - 3L	Wall Switch	S	53	2,080	2	Relamp	No	1	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	26	2,080	0.0	41	0	\$5	\$49	\$9	7.4
Hallway	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,080	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,080	0.0	24	0	\$3	\$33	\$6	8.4
Case Light	2	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Wall Switch	S	22	2,080	2	Relamp	No	2	LED - Linear Tubes: (1) 2' Lamp	Wall Switch	9	2,080	0.0	40	0	\$5	\$33	\$6	5.0
Library	1	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	2,080		None	No	1	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	40	2,080	0.0	0	0	\$0	\$0	\$0	0.0
Hallway	4	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	2,080		None	No	4	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	40	2,080	0.0	0	0	\$0	\$0	\$0	0.0
Custodian	1	Incandescent: Bulb (60W) - 1L	Wall Switch	S	60	2,080	2	Relamp	No	1	LED Screw-In Lamps: Bulb (9W) - 1L	Wall Switch	9	2,080	0.0	75	0	\$10	\$17	\$1	1.6
Restroom	1	Incandescent: Bulb (60W) - 1L	Wall Switch	S	60	2,080	2	Relamp	No	1	LED Screw-In Lamps: Bulb (9W) - 1L	Wall Switch	9	2,080	0.0	75	0	\$10	\$17	\$1	1.6
Stage Light	9	Halogen Incandescent: Spots	Wall Switch	S	50	2,080	2	Relamp	No	9	LED Screw-In Lamps: Bulb - 1L	Wall Switch	8	2,080	0.2	565	0	\$75	\$155	\$9	1.9
Cafeteria	48	Halogen Incandescent: Pendant Fixture	Wall Switch	S	150	2,080	2, 3	Relamp	Yes	48	LED Screw-In Lamps: Bulb - 1L	Occupancy Sensor	23	1,435	3.2	9,532	-3	\$1,268	\$1,907	\$188	1.4
A105 Boiler	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
A106 Storage	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Cafeteria	6	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stage	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Office	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
D101	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
A104C	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Vestibule	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Hallway	17	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	17	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
A104G	8	Compact Fluorescent: Spiral Bulb	Wall Switch	S	26	2,080	2, 3	Relamp	Yes	8	LED Screw-In Lamps: Bulb - 1L	Occupancy Sensor	18	1,435	0.1	159	0	\$21	\$408	\$43	17.3
Exterior	15	Compact Fluorescent: Spiral Bulb	PhotoCell		26	4,380	2	Relamp	No	15	LED Screw-In Lamps: Bulb - 1L	PhotoCell	18	4,380	0.1	512	0	\$70	\$453	\$15	6.2
Library	26	Compact Fluorescent: Long U type Lamp (55W) - 2L	Wall Switch	S	110	2,080	2, 3	Relamp	Yes	26	LED - Fixtures: Other	Occupancy Sensor	77	1,435	0.7	2,184	-1	\$290	\$1,964	\$70	6.5
Hallway	12	Compact Fluorescent: Long U type Lamp (55W) - 2L	Wall Switch	S	110	2,080	2, 4	Relamp	Yes	12	LED - Fixtures: Other	High/Low Control	77	1,435	0.3	1,008	0	\$134	\$1,057	\$0	7.9
Exterior	10	Compact Fluorescent: Long U type Lamp (55W) - 2L	Wall Switch		110	2,080	2, 3	Relamp	Yes	10	LED - Fixtures: Other	Occupancy Sensor	77	1,435	0.3	1,183	0	\$162	\$818	\$35	4.8
A105 Boiler	8	Compact Fluorescent: Honeycomb Fixture (42W) - 8L	Wall Switch	S	336	2,080	2	Relamp	No	8	LED - Fixtures: Decorative: Other	Wall Switch	235	2,080	0.4	1,191	0	\$158	\$1,600	\$0	10.1
A105 BAS	2	Compact Fluorescent: Honeycomb Fixture (42W) - 8L	Wall Switch	S	336	2,080	2, 3	Relamp	Yes	2	LED - Fixtures: Decorative: Other	Occupancy Sensor	235	1,435	0.2	513	0	\$68	\$670	\$35	9.3
Stage	8	Compact Fluorescent: Honeycomb Fixture (42W) - 8L	Wall Switch	S	336	2,080	2	Relamp	No	8	LED - Fixtures: Decorative: Other	Wall Switch	235	2,080	0.4	1,191	0	\$158	\$1,600	\$0	10.1
A106F Storage	2	Compact Fluorescent: Honeycomb Fixture (42W) - 8L	Wall Switch	S	336	2,080	2, 3	Relamp	Yes	2	LED - Fixtures: Decorative: Other	Occupancy Sensor	235	1,435	0.2	513	0	\$68	\$516	\$0	7.6
Exterior	12	Compact Fluorescent: 4 Pin Bulb	PhotoCell		42	4,380	2	Relamp	No	12	LED - Fixtures: Outdoor Post-Mount	PhotoCell	29	4,380	0.1	662	0	\$91	\$438	\$0	4.8

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	P-1	1	Heating Hot Water Pump	10.0	91.7%	Yes	W	3,066		No	91.7%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	P-2	1	Heating Hot Water Pump	10.0	91.7%	Yes	W	3,066		No	91.7%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	P-3	1	Chilled Water Pump	20.0	93.0%	Yes	W	3,066		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	P-4	1	Chilled Water Pump	20.0	93.0%	Yes	W	3,066		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	P-5	1	Chilled Water Pump	15.0	92.4%	Yes	W	2,190		No	92.4%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	P-6	1	Heating Hot Water Pump	1.0	85.5%	No	W	2,190		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	P-7	1	Other	2.0	86.5%	Yes	W	2,745		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
A wing	AHU-1	1	Supply Fan	3.0	86.5%	Yes	W	2,600		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
A wing	AHU-2	1	Supply Fan	3.0	86.5%	Yes	W	2,600		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Library/A107A	AHU-3	1	Supply Fan	3.0	86.5%	Yes	W	2,600		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Computer Lab	AHU-4	1	Supply Fan	1.0	82.5%	No	W	2,600		No	82.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
B wing	AHU-5	1	Supply Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
B wing	AHU-6	1	Supply Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
C wing	AHU-7	1	Supply Fan	10.0	89.5%	Yes	W	2,600		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
C wing	AHU-8	1	Supply Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
D wing	AHU-9	1	Supply Fan	10.0	89.5%	Yes	W	2,600		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
D wing	AHU-10	1	Supply Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Copy Laminator Room	AHU-11	1	Supply Fan	0.5	76.2%	No	W	2,600		No	76.2%	No		0.0	0	0	\$0	\$0	\$0	0.0
Stage	AHU-12	1	Supply Fan	0.5	76.2%	No	W	2,600		No	76.2%	No		0.0	0	0	\$0	\$0	\$0	0.0
Multipurpose Room South	AHU-13	1	Supply Fan	10.0	89.5%	Yes	W	2,600		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions				Energy Impact & Financial Analysis							
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Multipurpose Room North	AHU-14	1	Supply Fan	10.0	89.5%	Yes	W	2,600		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	AHU-15	1	Supply Fan	0.3	68.0%	No	W	2,600		No	68.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Kitchen Exhaust Make Up Unit	AHU-16	1	Makeup Air Fan	0.5	76.2%	No	W	2,600		No	76.2%	No		0.0	0	0	\$0	\$0	\$0	0.0
MDF Room	AHU-17	1	Supply Fan	0.5	76.2%	No	W	2,600		No	76.2%	No		0.0	0	0	\$0	\$0	\$0	0.0
A wing	AHU-18	1	Supply Fan	0.3	68.0%	Yes	W	2,600		No	68.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Multipurpose Room Bathrooms	AHU-20	1	Supply Fan	0.3	68.0%	No	W	2,600		No	68.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
A wing	AHU-1	1	Return Fan	1.5	84.0%	Yes	W	2,600		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
A wing	AHU-2	1	Return Fan	1.0	82.5%	Yes	W	2,600		No	82.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Library/A107A	AHU-3	1	Return Fan	1.5	84.0%	Yes	W	2,600		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
B wing	AHU-5	1	Return Fan	2.0	86.5%	Yes	W	2,600		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
B wing	AHU-6	1	Return Fan	2.0	86.5%	Yes	W	2,600		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
C wing	AHU-7	1	Return Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
C wing	AHU-8	1	Return Fan	2.0	86.5%	Yes	W	2,600		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
D wing	AHU-9	1	Return Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
D wing	AHU-10	1	Return Fan	3.0	86.5%	Yes	W	2,600		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Multipurpose Room South	AHU-13	1	Return Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Multipurpose Room North	AHU-14	1	Return Fan	5.0	87.5%	Yes	W	2,600		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
A wing	AHU-18	1	Return Fan	0.3	68.0%	Yes	W	2,600		No	68.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Outdoor	Cooling Tower	1	Cooling Tower Fan	15.0	93.0%	Yes	W	3,391		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	Absorption Chiller/Heater	1	Furnace	#####	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Demand Control Ventilation Recommendations

Location	Area(s)/System(s) Affected	Recommendation Inputs					Energy Impact & Financial Analysis							
		ECM #	Number of Zones	Cooling Capacity of Controlled System (Tons)	Electric Heating Capacity of Controlled System (kBtu/hr)	Output Heating Capacity of Controlled System (MBh)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Multipurpose Room South	AHU-13	6	2.00	0.00		346.36	0.0	0	23	\$287	\$2,719	\$0	9.5	
Multipurpose Room North	AHU-14	6	2.00	0.00		346.36	0.0	0	23	\$287	\$2,719	\$0	9.5	

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	Boiler	1	Indirect System	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Low-Flow Device Recommendations

Location	Recommendation Inputs					Energy Impact & Financial Analysis						
	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restrooms	7	25	Faucet Aerator (Lavatory)	2.50	0.50	0.0	0	84	\$1,054	\$179	\$0	0.2

Walk-In Cooler/Freezer Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions				Energy Impact & Financial Analysis						
	Cooler/Freezer Quantity	Case Type/Temperature	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Outdoor	1	Cooler (35F to 55F)		No	No	No	0.0	0	0	\$0	\$0	\$0	0.0
Outdoor	1	Low Temp Freezer (-35F to -5F)		No	No	No	0.0	0	0	\$0	\$0	\$0	0.0

Commercial Refrigerator/Freezer Inventory & Recommendations

Location	Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Refrigerator/Freezer Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	2	Refrigerator Chest	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Stand-Up Freezer, Solid Door (31 - 50 cu. ft.)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	No	NR	Yes	0.1	646	0	\$89	\$1,632	\$125	17.0

Cooking Equipment Inventory & Recommendations

Location	Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Equipment Type	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Gas Convection Oven (Half Size)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Electric Convection Oven (Half Size)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Insulated Food Holding Cabinet (Full Size)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?
Classrooms	131	Computers	120.0	Yes
Classrooms	21	Small Printer	55.0	Yes
Office	11	Medium Printer	60.0	Yes
Copy room	10	Copy Machine	600.0	Yes
Office	2	Paper Shredder	80.0	No
Classrooms	27	Projectors	120.0	Yes
Break Room	5	Microwave	800.0	Yes
Classrooms	9	Small Refrigerator	120.0	No
Break Room	4	Large Refrigerator	255.0	Yes
Office	6	Coffee Machine	300.0	No
Break Room	2	Toaster	300.0	No
Break Room	2	Toaster Oven	500.0	No
Classrooms	6	Portable Fan	45.0	No
Break Room	3	Dishwasher	120.0	Yes
Classrooms	3	CRT Tv	244.0	No
Main Office	3	LCD Tv	120.0	No

Vending Machine Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Break Room	2	Refrigerated	8	Yes	0.4	3,224	0	\$442	\$460	\$100	0.8

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

35

ENERGY STAR®
Score¹

E. H. Slaybaugh Primary

Primary Property Type: K-12 School
Gross Floor Area (ft²): 55,800
Built: 2005

For Year Ending: April 30, 2018
Date Generated: February 01, 2019

¹ The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address E. H. Slaybaugh Primary 13 Swift Avenue Egg Harbor Township, New Jersey 08234	Property Owner _____ () - _____	Primary Contact _____ () - _____
Property ID: 6631194		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 101.2 kBtu/ft ²	Annual Energy by Fuel		National Median Comparison
	Electric - Grid (kBtu)	1,883,424 (33%)	National Median Site EUI (kBtu/ft ²) 88.7
	Natural Gas (kBtu)	3,762,048 (67%)	National Median Source EUI (kBtu/ft ²) 144.9
			% Diff from National Median Source EUI 14%
Source EUI 165.3 kBtu/ft ²			Annual Emissions
			Greenhouse Gas Emissions (Metric Tons CO ₂ e/year) 391

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer Stamp
(if applicable)

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR®	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> : gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium</i> : a type of HID lamp.
HSPF	<i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt</i> : equal to 1,000 Watts.
kWh	<i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide</i> : a type of HID lamp.
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor</i> : a type of HID lamp.
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.
psig	Pounds per square inch gauge
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
-------------	---

SEP	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR® Portfolio Manager®.
------------	---

Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
-----------------------	--

SREC	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
-------------	--

T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
--------------------	--

Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
-----------------------------	--

therm	100,000 Btu. Typically used as a measure of natural gas consumption.
--------------	--

tons	A unit of cooling capacity equal to 12,000 Btu/hr.
-------------	--

Turnkey	Provision of a complete product or service that is ready for immediate use
----------------	--

VAV	<i>Variable air volume</i>
------------	----------------------------

VFD	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
------------	---

WaterSense™	The symbol for water efficiency. The WaterSense™ program is managed by the EPA.
--------------------	---

Watt (W)	Unit of power commonly used to measure electricity use.
-----------------	---
