



Local Government Energy Audit: Energy Audit Report



Copyright ©2017 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

***Brick Township High School
Transportation Building***

Brick Township BOE

346 Chambersbridge Road

Brick Township, NJ 08723

April 17, 2018

Final Report by:

TRC Energy Services

Disclaimer

The intent of this energy analysis report is to identify energy savings opportunities and recommend upgrades to the facility's energy using equipment and systems. Approximate savings are included in this report to help make decisions about reducing energy use at the facility. This report, however, is not intended to serve as a detailed engineering design document. Further design and analysis may be necessary in order to implement some of the measures recommended in this report.

The energy conservation measures and estimates of energy savings have been reviewed for technical accuracy. However, estimates of final energy savings are not guaranteed, because final savings may depend on behavioral factors and other uncontrollable variables. TRC Energy Services (TRC) and New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

Estimated installation costs are based on TRC's experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. The owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Since actual installed costs can vary widely for certain measures and conditions, TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. The owner of the facility should review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

Table of Contents

1	Executive Summary.....	1
1.1	Facility Summary	1
1.2	Your Cost Reduction Opportunities.....	1
	Energy Conservation Measures.....	1
	Energy Efficient Best Practices	3
	On-Site Generation Measures.....	3
1.3	Implementation Planning.....	3
2	Facility Information and Existing Conditions	5
2.1	Project Contacts	5
2.2	General Site Information.....	5
2.3	Building Occupancy	5
2.4	Building Envelope	5
2.5	On-Site Generation.....	6
2.6	Energy-Using Systems	6
	Lighting System	6
	Heating System	6
	Direct Expansion Air Conditioning System (DX)	7
	Domestic Hot Water Heating System.....	8
	Building Plug Load	8
2.7	Water-Using Systems	8
3	Site Energy Use and Costs.....	9
3.1	Total Cost of Energy	9
3.2	Electricity Usage	10
3.3	Natural Gas Usage	11
3.4	Benchmarking.....	12
3.5	Energy End-Use Breakdown	13
4	Energy Conservation Measures	14
4.1	Recommended ECMs	14
4.1.1	Lighting Upgrades.....	15
	ECM 1: Install LED Fixtures	15
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	16
	ECM 3: Retrofit Fixtures with LED Lamps.....	16
4.1.2	Lighting Control Measures	17
	ECM 4: Install Occupancy Sensor Lighting Controls	17
4.1.3	Domestic Hot Water Heating System Upgrades	18
	ECM 5: Install Low-Flow DHW Devices.....	18
4.1.4	Plug Load Equipment Control-Vending Machines.....	19
	ECM 6: Vending Machine Control	19

4.2	ECMs Evaluated but Not Recommended	20
	Install High Efficiency Unit Heaters	20
5	Energy Efficient Best Practices	21
	Reduce Air Leakage	21
	Develop a Lighting Maintenance Schedule	21
	Ensure Lighting Controls Are Operating Properly	21
	Check for and Seal Duct Leakage	21
	Perform Proper Furnace Maintenance	21
	Perform Proper Water Heater Maintenance	22
	Water Conservation	22
6	On-Site Generation Measures	23
6.1	Photovoltaic.....	23
6.2	Combined Heat and Power	24
7	Demand Response	25
8	Project Funding / Incentives	26
8.1	SmartStart	27
8.2	Direct Install	28
8.3	Energy Savings Improvement Program	29
9	Energy Purchasing and Procurement Strategies	30
9.1	Retail Electric Supply Options.....	30
9.2	Retail Natural Gas Supply Options	30

Appendix A: Equipment Inventory & Recommendations

Appendix B: ENERGY STAR® Statement of Energy Performance

Table of Figures

Figure 1 – Previous 12 Month Utility Costs.....	2
Figure 2 – Potential Post-Implementation Costs	2
Figure 3 – Summary of Energy Reduction Opportunities	2
Figure 4 – Project Contacts	5
Figure 5 - Building Schedule.....	5
Figure 6 - Utility Summary	9
Figure 7 - Energy Cost Breakdown	9
Figure 8 - Electric Usage & Demand.....	10
Figure 9 - Electric Usage & Demand.....	10
Figure 10 - Natural Gas Usage.....	11
Figure 11 - Natural Gas Usage.....	11
Figure 12 - Energy Use Intensity Comparison – Existing Conditions.....	12
Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures	12
Figure 14 - Energy Balance (% and kBtu/SF)	13
Figure 15 – Summary of Recommended ECMs.....	14
Figure 16 – Summary of Lighting Upgrade ECMs.....	15
Figure 17 – Summary of Lighting Control ECMs	17
Figure 18 - Summary of Domestic Water Heating ECMs	18
Figure 19 - Summary of Plug Load Equipment Control ECMs.....	19
Figure 20 – Summary of Measures Evaluated, but Not Recommended.....	20
Figure 21 - Photovoltaic Screening	23
Figure 22 - Combined Heat and Power Screening	24
Figure 23 - ECM Incentive Program Eligibility.....	26

I EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for Brick Township High School Transportation Building.

The goal of an LGEA report is to provide you with information on how your facility uses energy, identify energy conservation measures (ECMs) that can reduce your energy use, and provide information and assistance to help facilities implement ECMs. The LGEA report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

This study was conducted by TRC Energy Services (TRC), as part of a comprehensive effort to assist New Jersey school districts in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

I.1 Facility Summary

Brick Township High School Transportation Building is a two-story building totaling 6,900 square feet constructed in 1976. The building has a flat roof and exterior walls are constructed of concrete block, painted white. The only windows in the building are on the second floor. They are double pane, operable clear glass with aluminum frames. Interior lighting is provided by a combination of linear T5, T8, T12 fixtures, HID and incandescent lamps which are controlled by manual wall switches. The heating system is comprised of a gas fired furnace, unit heaters, and the cooling system consists of split system direct expansion (DX) air conditioners.

A thorough description of the facility and our observations are located in Section 2.

I.2 Your Cost Reduction Opportunities

Energy Conservation Measures

TRC evaluated seven measures, and recommends six measures which represent an opportunity for Brick Township High School Transportation Building to reduce annual energy costs by \$4,053 and annual greenhouse gas emissions by 21,515 lbs CO₂e. We estimate that if these five measures were implemented as recommended, the project would pay for itself in 2.6 years. The breakdown of existing and potential utility costs after project implementation are illustrated in Figure 1 and Figure 2, respectively. Together these measures represent an opportunity to reduce Brick Township High School Transportation Building's annual energy use by 8.4%.

Figure 1 – Previous 12 Month Utility Costs


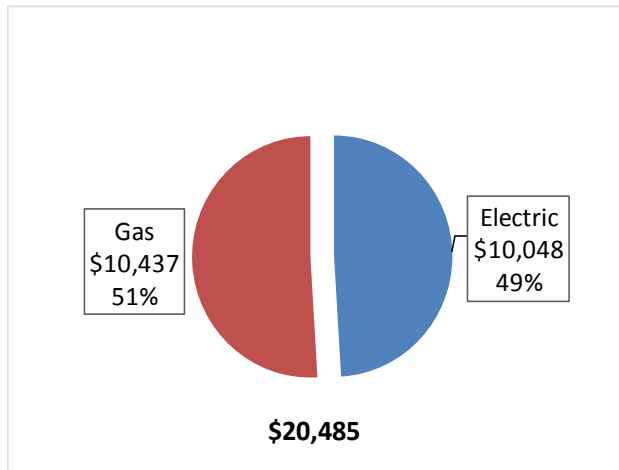


Figure 2 – Potential Post-Implementation Costs

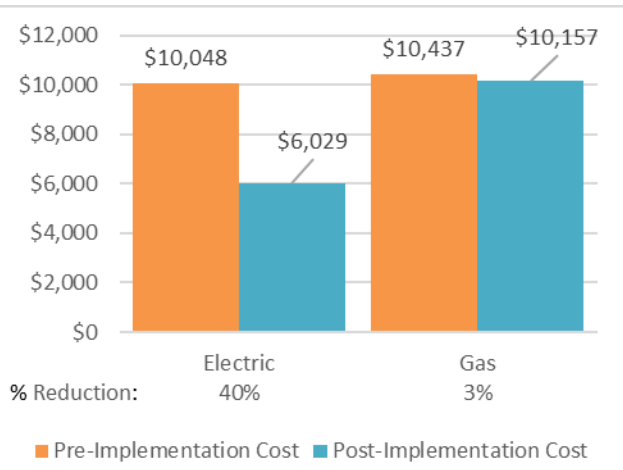

A detailed description of Brick Township High School Transportation Building’s existing energy use can be found in Section 3.

Estimates of the total cost, energy savings, and financial incentives for the proposed energy efficient upgrades are summarized below in Figure 3. A brief description of each category can be found below and a description of savings opportunities can be found in Section 4.

Figure 3 – Summary of Energy Reduction Opportunities

Energy Conservation Measure	Recommend?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Natural Gas Savings (MMBtu)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades											
ECM 1	Install LED Fixtures	2,834	1.1	0.0	0.0	\$542.59	\$3,170.55	\$510.00	\$2,660.55	4.9	2,854
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	4,470	1.3	0.0	0.0	\$855.87	\$3,476.33	\$270.00	\$3,206.33	3.7	4,501
ECM 3	Retrofit Fixtures with LED Lamps	10,603	3.2	0.0	0.0	\$2,030.12	\$3,968.30	\$330.00	\$3,638.30	1.8	10,677
Lighting Control Measures											
ECM 4	Install Occupancy Sensor Lighting Controls	672	0.2	0.0	0.0	\$128.73	\$812.00	\$120.00	\$692.00	5.4	677
Gas Heating (HVAC/Process) Replacement											
	Install High Efficiency Unit Heaters	0	0.0	23.3	23.3	\$245.93	\$4,675.37	\$0.00	\$4,675.37	19.0	2,723
Domestic Water Heating Upgrade											
ECM 5	Install Low-Flow Domestic Hot Water Devices	798	0.0	3.2	3.2	\$186.91	\$28.68	\$0.00	\$28.68	0.2	1,182
Plug Load Equipment Control - Vending Machine											
ECM 6	Vending Machine Control	1,612	0.0	0.0	0.0	\$308.61	\$460.00	\$0.00	\$460.00	1.5	1,623
TOTAL FOR RECOMMENDED MEASURES		20,989	6	3	3	\$4,052.82	\$11,915.86	\$1,230.00	\$10,685.86	2.6	21,515
TOTALS FOR ALL EVALUATED MEASURES		20,989	5.8	26.5	26.5	\$4,298.75	\$16,591.22	\$1,230.00	\$15,361.22	3.6	24,238

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Lighting Upgrades generally involve the replacement of existing lighting components such as lamps and ballasts (or the entire fixture) with higher efficiency lighting components. These measures save energy by reducing the power used by the lighting components due to improved electrical efficiency.

Lighting Controls measures generally involve the installation of automated controls to turn off lights or reduce light output when not needed. Automated control reduces reliance on occupant behavior for adjusting lights. These measures save energy by reducing the amount of time lights are on.

Gas Heating (HVAC/Process) measures generally involve replacing older inefficient hydronic heating systems with modern energy efficient systems. Gas heating systems can provide equivalent heating compared to older systems at a reduced energy cost. These measures save energy by reducing the fuel demands for heating, due to improved combustion and heat transfer efficiency.

Domestic Hot Water upgrade measures generally involve replacing older inefficient domestic water heating systems with modern energy efficient systems. Additional measures include devices intended to limit the use of hot water to reduce energy use. These measures save energy by reducing the fuel used for domestic hot water heating due to improved heating efficiency or reducing standby losses.

Energy Efficient Best Practices

TRC also identified seven low cost (or no cost) energy efficient best practices. A facility's energy performance can be significantly improved by employing certain behavioral or operational adjustments and by performing better routine maintenance on building systems. These best practices can extend equipment lifetime, improve occupant comfort, provide better health and safety, as well as reduce annual energy and O&M costs. It is our understanding Brick Township Board of Education is already implementing many of the best practices described in the audit reports, however they are listed for representative purposes only

- Reduce Air Leakage
- Develop a Lighting Maintenance Schedule
- Ensure Lighting Controls Are Operating Properly
- Check for and Seal Duct Leakage
- Perform Proper Furnace Maintenance
- Perform Proper Water Heater Maintenance
- Water Conservation

For details on these energy efficient best practices, please refer to Section 5.

On-Site Generation Measures

TRC evaluated the potential for installing on-Site generation for Brick Township High School Transportation Building. Based on the configuration of the site and its loads there is a low potential for installing any PV and combined heat and power self-generation measures.

For details on our evaluation and on-site generation potential, please refer to Section 6.

1.3 Implementation Planning

To realize the energy savings from the ECMs listed in this report, a project implementation plan must be developed. Available capital must be considered and decisions need to be made whether it is best to pursue individual ECMs separately, groups of ECMs, or a comprehensive approach where all ECMs are implemented together, possibly in conjunction with other facility upgrades or improvements.

Rebates, incentives, and financing are available from NJCEP, as well as other sources, to help reduce the costs associated with the implementation of energy efficiency projects. Prior to implementing any measure, please review the relevant incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives prior to purchasing materials or commencing with installation.

The ECMs outlined in this report may qualify under the following program(s):

- SmartStart
- Direct Install
- Energy Savings Improvement Program (ESIP)

For facilities wanting to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate in this program you may utilize internal resources, or an outside firm or contractor, to do the final design of the ECM(s) and do the installation. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation. The incentive estimates listed above in Figure 3 are based on the SmartStart program. More details on this program and others are available in Section 8.

This facility may also qualify for the Direct Install program which can provide turnkey installation of multiple measures, through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures, although measure eligibility will have to be assessed and be verified by the designated Direct Install contractor and, in most cases, they will perform the installation work.

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the Energy Savings Improvement Program (ESIP). Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. An LGEA report (or other approved energy audit) is required for participation in ESIP. Please refer to Section 8.3 for additional information on the ESIP Program.

Additional information on relevant incentive programs is located in Section 8 or: www.njcleanenergy.com/ci.

2 FACILITY INFORMATION AND EXISTING CONDITIONS

2.1 Project Contacts

Figure 4 – Project Contacts

Name	Role	E-Mail	Phone #
Customer			
James W. Edwards, Jr.	Business Administrator/Board Secretary	jedwards@brickschools.org	732 785-3000
Designated Representative			
James W. Edwards, Jr.	Business Administrator/Board Secretary	jedwards@brickschools.org	732 785-3000
TRC Energy Services			
Brian Deluca	Auditor	bdeluca@trcsolutions.com	(732) 855-0033

2.2 General Site Information

On October 27, 2017, TRC performed an energy audit at Brick Township High School Transportation Building located in Brick Township, New Jersey. TRC’s auditor was provided access by facility personnel to review the facility operations and help focus our investigation on specific energy-using systems.

The Brick Township High School Transportation Garage is located at 346 Chambers Bridge Road in Brick, New Jersey. The 6,900 square foot facility that was built in 1976. The building is a two-story facility comprised of maintenance area, parts storage, break room, locker room and storage room. The building is primarily used as a maintenance garage.

2.3 Building Occupancy

The building is open Monday through Friday and the typical schedule is presented in the table below.

Figure 5 - Building Schedule

Building Name	Weekday/Weekend	Operating Schedule
Brick Township High School Grounds Building	Weekday	5:30 AM - 8:00 PM
Brick Township High School Grounds Building	Weekend	Closed

2.4 Building Envelope

The one-story building has a concrete foundation, a flat, built up roof that was not accessible during the site visit. Exterior walls are constructed of concrete bloc, painted white. The only windows in the building are on the second floor. They are double pane, operable clear glass with aluminum frames. There are two steel rollup doors located on the south west side of the building.



2.5 On-Site Generation

Brick Township High School Transportation Building does not have any on-site electric generation capacity. There is one generator located rear the building and runs on diesel. The generator is used only as a backup for the fuel pumping station.

2.6 Energy-Using Systems

Please see Appendix A: Equipment Inventory & Recommendations for an inventory of the facility's equipment.

Lighting System



Interior lighting is provided by a combination of linear fluorescent fixtures and incandescent lamps which are mostly controlled by manual wall switches. The part storage room, shop office, locker room, restrooms, and the stairwell are all illuminated with 32-Watt linear fluorescent T8 lamps while the main office and other private offices are mainly illuminated with 40-Watt linear fluorescent T12 lamps. The bay area of the garage is primarily lit with 54-Watt linear high output fluorescent T5 lamps. The bay area also has one 250-Watt and one 400-Watt metal halide lamp. Wattages of HID equipment are estimated based on size and fixture configuration. Small number of 60-Watt incandescent lamps are found in spaces such as closets and electrical room. Exit signs throughout the building are upgraded to LEDs. The facility exterior lighting system is comprised of 250-Watt, and 400-Watt metal halide lamps illuminating the fuel pumping area, and 100-Watt LED and 250-Watt metal halide wall mounted area fixtures. The exterior garage fixtures attached to the facility and those in the center of the adjacent parking lot have been retrofitted to LED fixtures. Exterior lighting system is controlled with timers.

Heating System

The second floor and part of the first floor offices are served by one Reznor 280 MBh output forced air furnace with a combustion efficiency of 80%. The unit is five years old and appears to be in good condition. The maintenance garage area of the building is served by three gas fired unit heaters that range in size from 100 MBH to 207 MBH. The unit heaters and the gas fired furnace are controlled by individual dial-type wall mounted non-programmable thermostats.



Direct Expansion Air Conditioning System (DX)



The cooling system is comprised of one 2 ton Fujitsu split air conditioner serving the shop office and one 7.5 ton Goodman split system serving various offices. The Goodman condensing unit is located on the roof and is connected to a single zone single duct air handler. Conditioned air is distributed through ducts to six variable air volume (VAV) terminal units. The units are five years old and appear in good condition. The cooling system is controlled by programmable thermostats.

Domestic Hot Water Heating System

Domestic hot water for the restrooms is provided by a 40 gallon A.O. Smith electric hot water heater, capacity of 4500 Watts. The hot water is approximately 10 years old and is located in the closet. There is an additional hot water heater located in the garage area that provides hot water to the service sinks. This hot water heater is an 85 gallon Ruud gas fired hot water heater with a capacity of 200 MBh.

Building Plug Load

The building has approximately eight computers with LCD monitors that are used daily, one large photocopier and one water cooler. There are two vending machines located in the employee break room. In addition, there are various maintenance tools that are in the garage and they are run by a motor. They include the air compressor, bench grinder, drill press, and machine lathes. These machine tools represent about 2% of the overall electricity consumption of the facility.



2.7 Water-Using Systems

There are three restrooms at this facility. The faucets rated for 2.2 gallons per minute (gpm) or higher, the toilets are rated at 2.5 gallons per flush (gpf) and the urinals are rated at 2 gpf.

3 SITE ENERGY USE AND COSTS

Utility data for electricity and natural gas was analyzed to identify opportunities for savings. In addition, data for electricity and natural gas was evaluated to determine the annual energy performance metrics for the building in energy cost per square foot and energy usage per square foot. These metrics are an estimate of the relative energy efficiency of this building. There are a number of factors that could cause the energy use of this building to vary from the “typical” energy usage profile for facilities with similar characteristics. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and energy efficient behavior of occupants all contribute to benchmarking scores. Please refer to the Benchmarking section within Section 3.4 for additional information.

3.1 Total Cost of Energy


The following energy consumption and cost data is based on the last 12-month period of utility billing data that was provided for each utility. A profile of the annual energy consumption and energy cost of the facility was developed from this information.

Figure 6 - Utility Summary

Utility Summary for Brick Township High School Transportation Building		
Fuel	Usage	Cost
Electricity	52,480 kWh	\$10,048
Natural Gas	9,872 Therms	\$10,437
Total		\$20,485

The current annual energy cost for this facility is \$20,485 as shown in the chart below.

Figure 7 - Energy Cost Breakdown

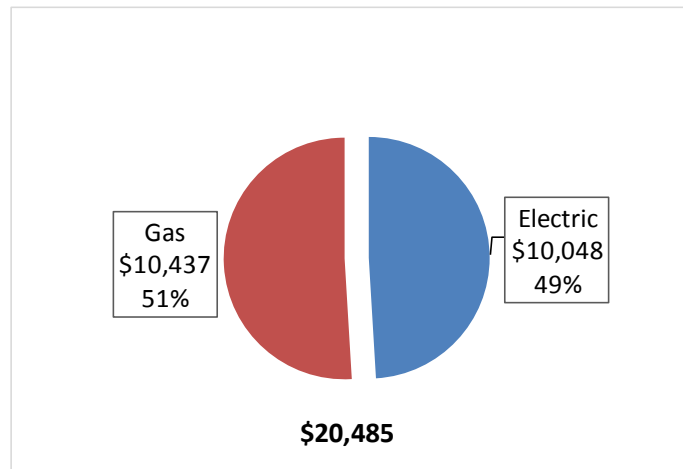

3.2 Electricity Usage

Electricity is provided by JCP&L. The average electric cost over the past 12 months was \$0.191/kWh, which is the blended rate that includes energy supply, distribution, and other charges. This rate is used throughout the analyses in this report to assess energy costs and savings. The monthly electricity consumption and peak demand are shown in the chart below. The electricity use profile reflects high occupancy in the summer months.

Figure 8 - Electric Usage & Demand

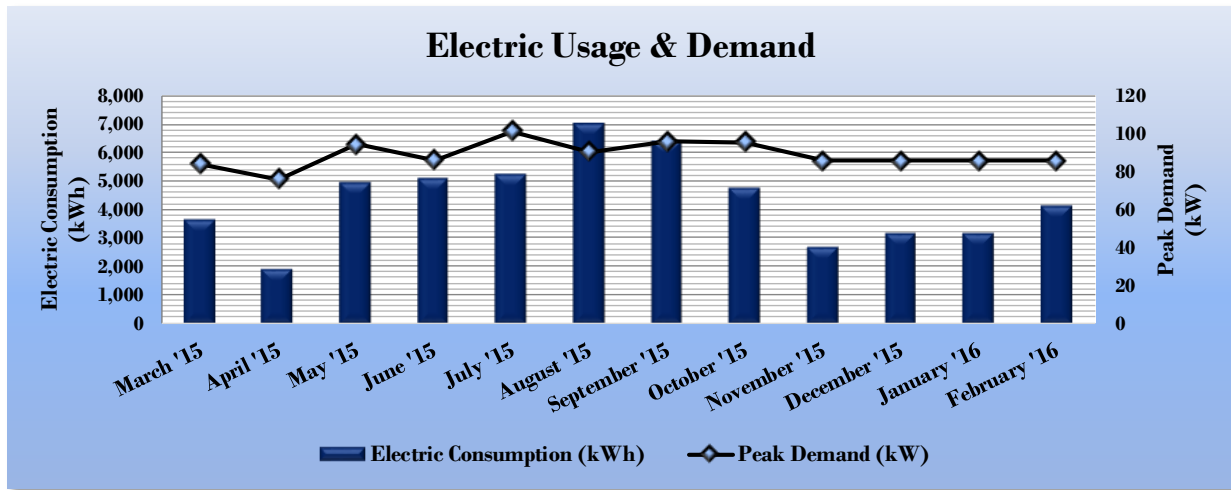


Figure 9 - Electric Usage & Demand

Electric Billing Data for Brick Township High School Transportation Building					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Total Electric Cost	TRC Estimated Usage?
4/15/15	30	3,680	84	\$731	No
5/14/15	31	1,920	76	\$535	No
6/15/15	30	4,960	94	\$1,052	No
7/14/15	31	5,120	86	\$1,016	No
8/15/15	31	5,280	101	\$852	No
9/14/15	30	7,040	90	\$1,231	No
10/15/15	31	6,400	96	\$1,163	No
11/14/15	30	4,800	96	\$1,006	No
12/15/15	31	2,720	86	\$556	No
1/14/16	31	3,200	86	\$348	No
2/15/16	28	3,200	86	\$858	No
3/14/16	31	4,160	86	\$697	No
Totals	365	52,480	101.2	\$10,048	0
Annual	365	52,480	101.2	\$10,048	

3.3 Natural Gas Usage

Natural Gas is provided by NJ Natural Gas. The average gas cost for the past 12 months is \$1.057/therm, which is the blended rate used throughout the analyses in this report. The monthly gas consumption is shown in the chart below. The gas use profile is typical for a facility with a significant heating load relative to other ends.

Figure 10 - Natural Gas Usage

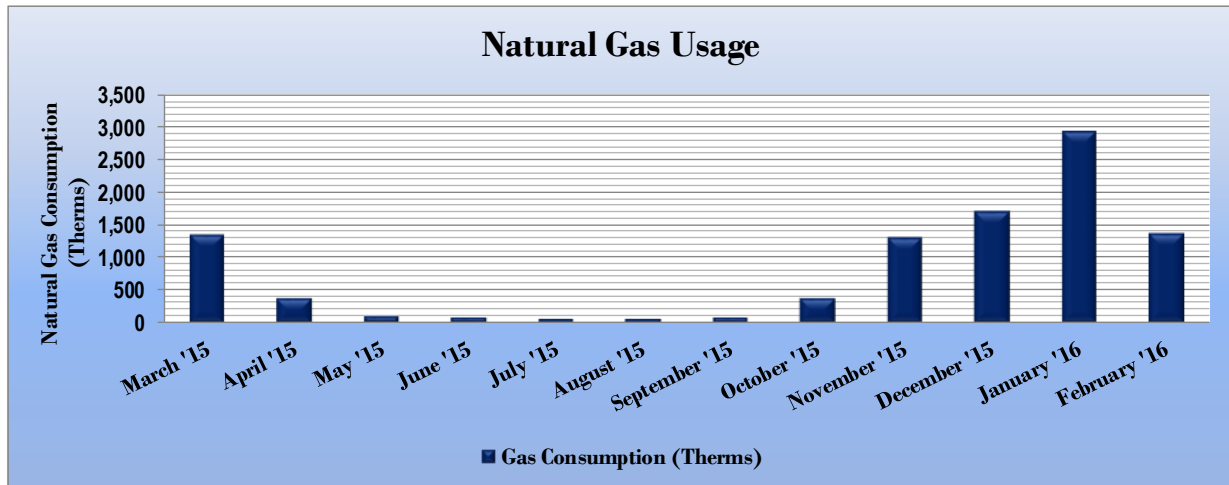


Figure 11 - Natural Gas Usage

Gas Billing Data for Brick Township High School Transportation Building			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
4/15/15	30	1,352	\$1,324
5/14/15	31	389	\$528
6/15/15	30	101	\$287
7/14/15	31	86	\$275
8/15/15	31	68	\$260
9/14/15	30	76	\$266
10/15/15	31	81	\$269
11/14/15	30	378	\$503
12/15/15	31	1,307	\$1,290
1/14/16	31	1,716	\$1,576
2/15/16	28	2,937	\$2,551
3/14/16	31	1,382	\$1,308
Totals	365	9,872	\$10,437
Annual	365	9,872	\$10,437

3.4 Benchmarking

This facility was benchmarked using Portfolio Manager, an online tool created and managed by the United States Environmental Protection Agency (EPA) through the ENERGY STAR® program. Portfolio Manager analyzes your building’s consumption data, cost information, and operational use details and then compares its performance against a national median for similar buildings of its type. Metrics provided by this analysis are Energy Use Intensity (EUI) and an ENERGY STAR® score for select building types.

The EUI is a measure of a facility’s energy consumption per square foot, and it is the standard metric for comparing buildings’ energy performance. Comparing the EUI of a building with the national median EUI for that building type illustrates whether that building uses more or less energy than similar buildings of its type on a square foot basis. EUI is presented in terms of “site energy” and “source energy.” Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

Figure 12 - Energy Use Intensity Comparison – Existing Conditions

Energy Use Intensity Comparison - Existing Conditions		
	Brick Township High School Grounds Building	National Median Building Type: Garage
Source Energy Use Intensity (kBtu/ft ²)	231.7	123.1
Site Energy Use Intensity (kBtu/ft ²)	169.0	78.8

Implementation of all recommended measures in this report would improve the building’s estimated EUI significantly, as shown in the table below:

Figure 13 - Energy Use Intensity Comparison – Following Installation of Recommended Measures

Energy Use Intensity Comparison - Following Installation of Recommended Measures		
	Brick Township High School Transportation Building	National Median Building Type: Garage
Source Energy Use Intensity (kBtu/ft ²)	198.6	123.1
Site Energy Use Intensity (kBtu/ft ²)	158.2	78.8

Many types of commercial buildings are also eligible to receive an ENERGY STAR® score. This score is a percentile ranking from 1 to 100. It compares your building’s energy performance to similar buildings nationwide. A score of 50 represents median energy performance, while a score of 75 means your building performs better than 75 percent of all similar buildings nationwide and may be eligible for ENERGY STAR® certification. This building is not eligible to receive a score because the property type falls under Repair Services type, which is currently not being rated by ENERGY STAR® score.

A Portfolio Manager Statement of Energy Performance (SEP) was generated for this facility, see Appendix B: ENERGY STAR® Statement of Energy Performance.


For more information on ENERGY STAR® certification go to: <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

A Portfolio Manager account has been created online for your facility and you will be provided with the login information for the account. We encourage you to update your utility information in Portfolio Manager regularly, so that you can keep track of your building’s performance. Free online training is available to help you use ENERGY STAR® Portfolio Manager to track your building’s performance at: <https://www.energystar.gov/buildings/training>.

3.5 Energy End-Use Breakdown

In order to provide a complete overview of energy consumption across building systems, an energy balance was performed at this facility. An energy balance utilizes standard practice engineering methods to evaluate all components of the various electric and fuel-fired systems found in a building to determine their proportional contribution to overall building energy usage. This chart of energy end uses highlights the relative contribution of each equipment category to total energy usage. This can help determine where the greatest benefits might be found from energy efficiency measures.

Figure 14 - Energy Balance (% and kBtu/SF)

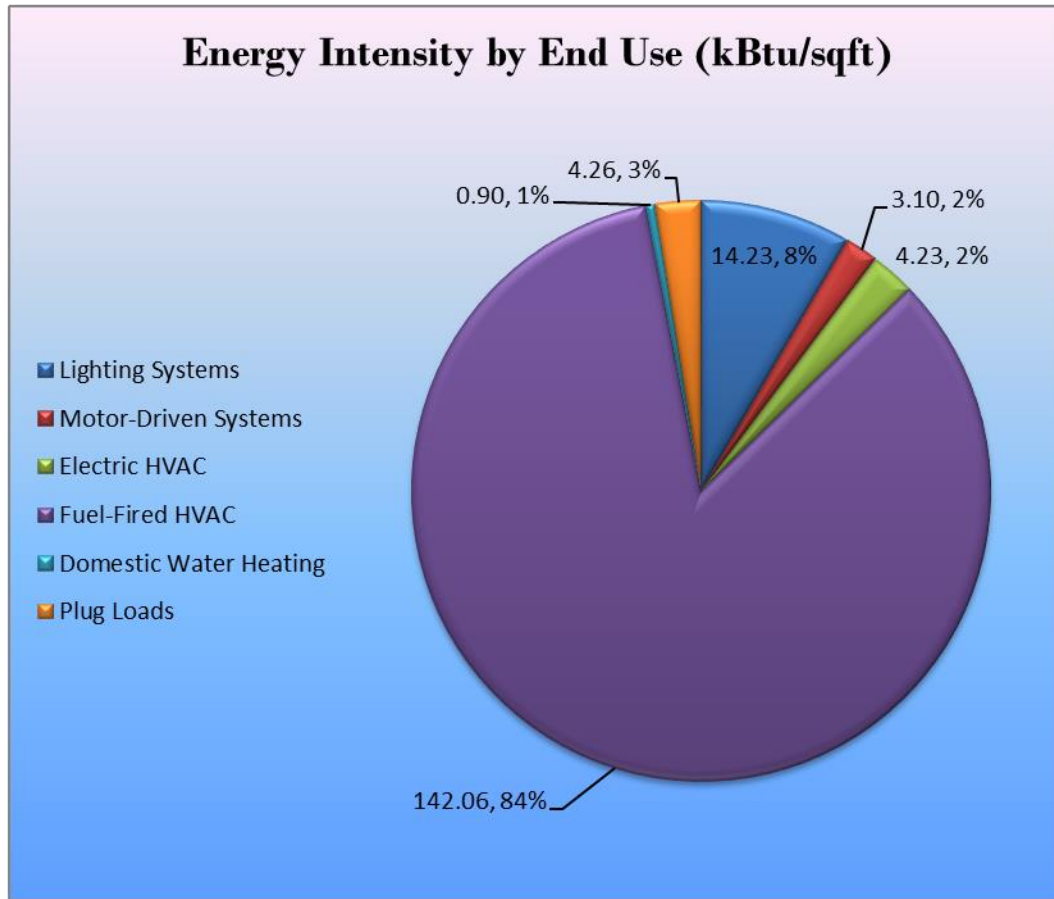

4 ENERGY CONSERVATION MEASURES

Level of Analysis

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information to the Brick Township High School Transportation Building regarding financial incentives for which they may qualify to implement the recommended measures. For this audit report, most measures have received only a preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to demonstrate project cost-effectiveness and help prioritize energy measures. Savings are based on the New Jersey Clean Energy Program Protocols to Measure Resource Savings dated June 29, 2016, approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances. A higher level of investigation may be necessary to support any custom SmartStart or Pay for Performance, or Direct Install incentive applications. Financial incentives for the ECMs identified in this report have been calculated based the NJCEP prescriptive SmartStart program. Some measures and proposed upgrade projects may be eligible for higher incentives than those shown below through other NJCEP programs as described in Section 8.

The following sections describe the evaluated measures.

4.1 Recommended ECMs

The measures below have been evaluated by the auditor and are recommended for implementation at the facility.

Figure 15 – Summary of Recommended ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		17,907	5.6	0.0	\$3,428.58	\$10,615.18	\$1,110.00	\$9,505.18	2.8	18,033
ECM 1	Install LED Fixtures	2,834	1.1	0.0	\$542.59	\$3,170.55	\$510.00	\$2,660.55	4.9	2,854
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	4,470	1.3	0.0	\$855.87	\$3,476.33	\$270.00	\$3,206.33	3.7	4,501
ECM 3	Retrofit Fixtures with LED Lamps	10,603	3.2	0.0	\$2,030.12	\$3,968.30	\$330.00	\$3,638.30	1.8	10,677
Lighting Control Measures		672	0.2	0.0	\$128.73	\$812.00	\$120.00	\$692.00	5.4	677
ECM 4	Install Occupancy Sensor Lighting Controls	672	0.2	0.0	\$128.73	\$812.00	\$120.00	\$692.00	5.4	677
Domestic Water Heating Upgrade		798	0.0	3.2	\$186.91	\$28.68	\$0.00	\$28.68	0.2	1,182
ECM 5	Install Low-Flow Domestic Hot Water Devices	798	0.0	3.2	\$186.91	\$28.68	\$0.00	\$28.68	0.2	1,182
Plug Load Equipment Control - Vending Machine		1,612	0.0	0.0	\$308.61	\$460.00	\$0.00	\$460.00	1.5	1,623
ECM 6	Vending Machine Control	1,612	0.0	0.0	\$308.61	\$460.00	\$0.00	\$460.00	1.5	1,623
TOTALS		20,989	5.8	3.2	\$4,052.82	\$11,915.86	\$1,230.00	\$10,685.86	2.6	21,515

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

4.1.1 Lighting Upgrades

Recommended upgrades to existing lighting fixtures are summarized in Figure 16 below.

Figure 16 – Summary of Lighting Upgrade ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		17,907	5.6	0.0	\$3,428.58	\$10,615.18	\$1,110.00	\$9,505.18	2.8	18,033
ECM 1	Install LED Fixtures	2,834	1.1	0.0	\$542.59	\$3,170.55	\$510.00	\$2,660.55	4.9	2,854
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	4,470	1.3	0.0	\$855.87	\$3,476.33	\$270.00	\$3,206.33	3.7	4,501
ECM 3	Retrofit Fixtures with LED Lamps	10,603	3.2	0.0	\$2,030.12	\$3,968.30	\$330.00	\$3,638.30	1.8	10,677

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 1: Install LED Fixtures

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	1,166	0.3	0.0	\$223.33	\$1,217.16	\$10.00	\$1,207.16	5.4	1,175
Exterior	1,668	0.7	0.0	\$319.26	\$1,953.39	\$500.00	\$1,453.39	4.6	1,679

Measure Description

We recommend replacing existing fixtures containing HID lamps with new high performance LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tubes and more than 10 times longer than many incandescent lamps. An additional benefit of LED over HID lighting is greater lumen maintenance. Lumen maintenance refers to the amount of light output retained over the course of time. The higher the rating, the less light will be lost from new.

ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	4,470	1.3	0.0	\$855.87	\$3,476.33	\$270.00	\$3,206.33	3.7	4,501
Exterior	0	0.0	0.0	\$0.00	\$0.00	\$0.00	\$0.00	0.0	0

Measure Description

We recommend retrofitting existing fluorescent T12 fixtures by removing fluorescent tubes and ballasts and replacing them with LEDs and LED drivers (if necessary), which are designed to be used retrofitted fluorescent fixtures. The measure uses the existing fixture housing but replaces the rest of the components with more efficient lighting technology. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

ECM 3: Retrofit Fixtures with LED Lamps

Summary of Measure Economics

Interior/ Exterior	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Interior	10,353	3.1	0.0	\$1,982.23	\$3,860.79	\$330.00	\$3,530.79	1.8	10,425
Exterior	250	0.1	0.0	\$47.89	\$107.51	\$0.00	\$107.51	2.2	252

Measure Description

We recommend retrofitting existing linear T8 and T5, incandescent and halogen incandescent lamps with LED lamps. Many LED tube lamps are direct replacements for existing fluorescent lamps and can be installed while leaving the fluorescent fixture ballast in place. LED bulbs can be used in existing fixtures as a direct replacement for most other lighting technologies. This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space.

Additional savings from lighting maintenance can be anticipated since LEDs have lifetimes which are more than twice that of a fluorescent tubes and more than 10 times longer than many incandescent lamps.

4.1.2 Lighting Control Measures

Figure 17 – Summary of Lighting Control ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures	672	0.2	0.0	\$128.73	\$812.00	\$120.00	\$692.00	5.4	677
ECM 4 Install Occupancy Sensor Lighting Controls	672	0.2	0.0	\$128.73	\$812.00	\$120.00	\$692.00	5.4	677

During lighting upgrade planning and design, we recommend a comprehensive approach that considers both the efficiency of the lighting fixtures and how they are controlled.

ECM 4: Install Occupancy Sensor Lighting Controls

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
672	0.2	0.0	\$128.73	\$812.00	\$120.00	\$692.00	5.4	677

Measure Description

We recommend installing occupancy sensors to control lighting fixtures that are currently controlled by manual switches in restrooms, storage rooms, and offices. Lighting sensors detect occupancy using ultrasonic and/or infrared sensors. For most spaces, we recommend lighting controls use dual technology sensors, which can eliminate the possibility of any lights turning off unexpectedly. Lighting systems are enabled when an occupant is detected. Fixtures are automatically turned off after an area has been vacant for a preset period. Some controls also provide dimming options and all modern occupancy controls can be easily over-ridden by room occupants to allow them to manually turn fixtures on or off, as desired. Energy savings results from only operating lighting systems when they are required.

Occupancy sensors may be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are recommended for single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in locations without local switching or where wall switches are not in the line-of-sight of the main work area and in large spaces. During the audit, it was identified that some areas may not be suitable for occupancy sensors as the lighting within a space was controlled by one switch for multiple offices. We recommend a comprehensive approach to lighting design that upgrades both the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

4.1.3 Domestic Hot Water Heating System Upgrades

Our recommendations for domestic water heating system improvements are summarized in Figure 18 below.

Figure 18 - Summary of Domestic Water Heating ECMs

Energy Conservation Measure		Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		798	0.0	3.2	\$186.91	\$28.68	\$0.00	\$28.68	0.2	1,182
ECM 5	Install Low-Flow Domestic Hot Water Devices	798	0.0	3.2	\$186.91	\$28.68	\$0.00	\$28.68	0.2	1,182

ECM 5: Install Low-Flow DHW Devices

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
798	0.0	3.2	\$186.91	\$28.68	\$0.00	\$28.68	0.2	1,182

Measure Description

We recommend installing low-flow domestic hot water devices to reduce overall hot water demand. Energy demand from domestic hot water heating systems can be reduced by reducing water usage in general. Faucet aerators can reduce hot water usage, relative to standard aerators, which saves energy. Low-flow devices reduce the overall water flow from the fixture, while still adequate pressure for washing. This reduces the amount of water used per day resulting in energy and water savings.

4.1.4 Plug Load Equipment Control-Vending Machines

Our recommendations for plug load equipment controls are summarized in Figure 19 below.

Figure 19 - Summary of Plug Load Equipment Control ECMs

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Natural Gas Savings (MMBtu)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Plug Load Equipment Control - Vending Machine	1,612	0.0	0.0	0.0	\$308.61	\$460.00	\$0.00	\$460.00	1.5	1,623
ECM 6 Vending Machine Control	1,612	0.0	0.0	0.0	\$308.61	\$460.00	\$0.00	\$460.00	1.5	1,623

ECM 6: Vending Machine Control

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
1,612	0.0	0.0	\$308.61	\$460.00	\$0.00	\$460.00	1.5	1,623

Measure Description

Vending machines operate continuously, even during non-business hours. It is recommended to install occupancy sensor controls to reduce the energy use. These controls power down vending machines when the vending machine area has been vacant for some time, then power up at regular intervals, as needed, to turn machine lights on or keep the product cool. Energy savings are a dependent on vending machine and activity level in the area surrounding the machines.

4.2 ECMs Evaluated but Not Recommended

The measures below have been evaluated by the auditor but are not recommended for implementation at the facility. Reasons for exclusion can be found in each measure description section.

Figure 20 – Summary of Measures Evaluated, but Not Recommended

Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Gas Heating (HVAC/Process) Replacement	0	0.0	23.3	\$245.93	\$4,675.37	\$0.00	\$4,675.37	19.0	2,723
Install High Efficiency Unit Heaters	0	0.0	23.3	\$245.93	\$4,675.37	\$0.00	\$4,675.37	19.0	2,723
TOTALS	0	0.0	23.3	\$245.93	\$4,675.37	\$0.00	\$4,675.37	19.0	2,723

* - All incentives presented in this table are based on NJ Smart Start Building equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Install High Efficiency Unit Heaters

Summary of Measure Economics

Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)	Estimated Net Cost (\$)	Simple Payback Period (yrs)	CO ₂ e Emissions Reduction (lbs)
0	0.0	23.3	\$245.93	\$4,675.37	\$0.00	\$4,675.37	19.0	2,723

Measure Description

We evaluated replacing existing standard 160MBh gas-fired unit heater with high efficiency gas-fired unit heater. Improved combustion technology and heat exchanger design optimize the heat recovery from the combustion gases which can significantly improve unit heater efficiency. Savings result from improved system efficiency.

Reasons for not Recommending

The simple payback of this measure exceeds the expected useful life of the equipment and is therefore not recommended based on energy savings alone.

5 ENERGY EFFICIENT BEST PRACTICES

In addition to the quantifiable savings estimated in Section 4, a facility's energy performance can also be improved through application of many low cost or no-cost energy efficiency strategies. By employing certain behavioral and operational changes and performing routine maintenance on building systems, equipment lifetime can be extended; occupant comfort, health and safety can be improved; and energy and O&M costs can be reduced. The recommendations below are provided as a framework for developing a whole building maintenance plan that is customized to your facility. The recommendations below are for informational purposes only and do not reflect actual efforts actively being performed by Brick Township Board of Education

Reduce Air Leakage

Air leakage, or infiltration, occurs when outside air enters a building uncontrollably through cracks and openings. Properly sealing such cracks and openings can significantly reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. This includes caulking or installing weather stripping around leaky doors and windows allowing for better control of indoor air quality through controlled ventilation.

Develop a Lighting Maintenance Schedule

In addition to routine fixture cleaning, development of a maintenance schedule can both ensure maintenance is performed regularly and can reduce the overall cost of fixture re-lamping and re-ballasting. By re-lamping and re-ballasting fixtures in groups, lighting levels are better maintained and the number of site visits by a lighting technician or contractor can be minimized, decreasing the overall cost of maintenance.

Ensure Lighting Controls Are Operating Properly

Lighting controls are very cost effective energy efficient devices, when installed and operating correctly. As part of a lighting maintenance schedule, lighting controls should be tested annually to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight sensors, maintenance involves cleaning of sensor lenses and confirming setpoints and sensitivity are appropriately configured.

Check for and Seal Duct Leakage

Duct leakage in commercial buildings typically accounts for 5% to 25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building, significantly increasing cooling and heating costs. By sealing sources of leakage, cooling, heating, and ventilation energy use can be reduced significantly, depending on the severity of air leakage.

Perform Proper Furnace Maintenance

Preventative furnace maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should include tasks such as checking for gas / carbon monoxide leaks; changing the air and fuel filters; checking components for cracks, corrosion, dirt, or debris build-up; ensuring the ignition system is working properly; testing and adjusting operation and safety controls; inspecting the electrical connections; and ensuring proper lubrication for motors and bearings.

Perform Proper Water Heater Maintenance

At least once a year, drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Once a year check for any leaks or heavy corrosion on the pipes and valves. For gas water heaters, check the draft hood and make sure it is placed properly, with a few inches of air space between the tank and where it connects to the vent. Look for any corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional. For electric water heaters, look for any signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank. For water heaters over three to four years old have a technician inspect the sacrificial anode annually.

Water Conservation

Installing low-flow faucets or faucet aerators, low-flow showerheads, and kitchen sink pre-rinse spray valves saves both energy and water. These devices save energy by reducing the overall amount of hot water used hence reducing the energy used to heat the water. The flow ratings for EPA WaterSense™ (<http://www3.epa.gov/watersense/products>) labeled devices are 1.5 gpm for bathroom faucets, 2.0 gpm for showerheads, and 1.28 gpm for pre-rinse spray valves.

Installing dual flush or low-flow toilets and low-flow or waterless urinals are additional ways to reduce the sites water use, however, these devices do not provide energy savings at the site level. Any reduction in water use does however ultimately reduce grid level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users. The EPA WaterSense™ ratings for urinals is 0.5 gpf and toilets that use as little as 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

Refer to Section 4.1.3 for any low-flow ECM recommendations.

6 ON-SITE GENERATION MEASURES

On-site generation measure options include both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) on-site technologies that generate power to meet all or a portion of the electric energy needs of a facility, often repurposing any waste heat where applicable. Also referred to as distributed generation, these systems contribute to Greenhouse Gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, resulting in the electric system reliability through improved transmission and distribution system utilization.

The State of New Jersey’s Energy Master Plan (EMP) encourages new distributed generation of all forms and specifically focuses on expanding use of combined heat and power (CHP) by reducing financial, regulatory and technical barriers and identifying opportunities for new entries. The EMP also outlines a goal of 70% of the State’s electrical needs to be met by renewable sources by 2050.


Preliminary screenings were performed to determine the potential that a generation project could provide a cost-effective solution for your facility. Before making a decision to implement, a feasibility study should be conducted that would take a detailed look at existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Photovoltaic

Sunlight can be converted into electricity using photovoltaics (PV) modules. Modules are racked together into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is interconnected to the facility’s electrical distribution system. The amount of unobstructed area available determines how large of a solar array can be installed. The size of the array combined with the orientation, tilt, and shading elements determines the energy produced.

In order to be cost-effective, a solar PV array needs certain minimum criteria, such as flat or south-facing rooftop or other unshaded space on which to place the PV panels. In our opinion, the facility does appear not meet these minimum criteria for cost-effective PV installation.

Figure 21 - Photovoltaic Screening

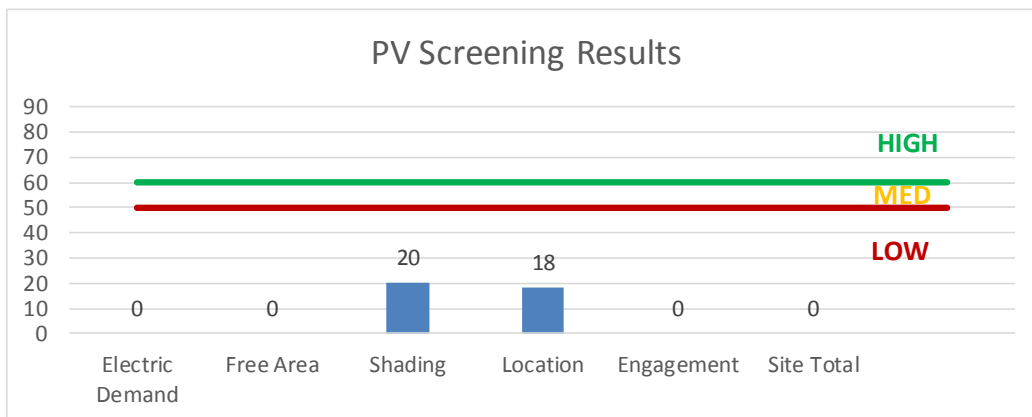

For more information on solar PV technology and commercial solar markets in New Jersey, or to find a qualified solar installer, who can provide a more detailed assessment of the specific costs and benefits of solar develop of the site, please visit the following links below:

- **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>

- **NJ Solar Market FAQs:** <http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs>
- **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) is the on-site generation of electricity along with the recovery of heat energy, which is put to beneficial use. Common technologies for CHP include reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines. Electric generation from a CHP system is typically interconnected to local power distribution systems. Heat is recovered from exhaust and ancillary cooling systems and interconnected to the existing hot water (or steam) distribution systems.


CHP systems are typically used to produce a portion of the electric power used onsite by a facility, with the balance of electric power needs supplied by grid purchases. The heat is used to supplement (or supplant) existing boilers for the purpose of space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for the purpose of space cooling. The key criteria used for screening, however, is the amount of time the system operates at full load and the facility’s ability to use the recovered heat. Facilities with continuous use for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has a low potential for installing a cost-effective CHP system.

Low or infrequent thermal load is the most significant factors contributing to the potential for CHP at the site. In our opinion, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation.

For a list of qualified firms in New Jersey specializing in commercial CHP cost assessment and installation, go to: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

Figure 22 - Combined Heat and Power Screening

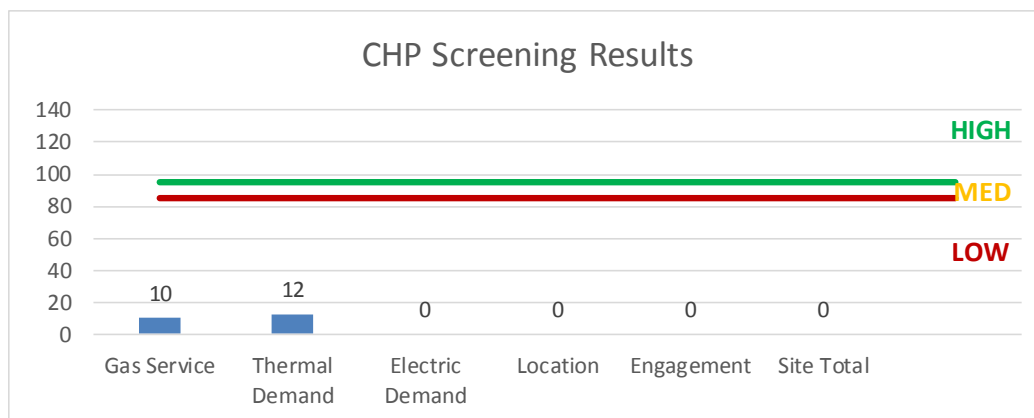

7 DEMAND RESPONSE

Demand Response (DR) is a program designed to reduce the electric load of commercial facilities when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Demand Response service providers (a.k.a. Curtailment Service Providers) are registered with PJM, the independent system operator (ISO) for mid-Atlantic state region that is charged with maintaining electric grid reliability.

By enabling grid operators to call upon Curtailment Service Providers and commercial facilities to reduce electric usage during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment Service Providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail their electric usage.

Typically an electric customer needs to be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with a greater capability to quickly curtail their demand during peak hours will receive higher payments. Customers with back-up generators onsite may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in a DR programs often find it to be a valuable source of revenue for their facility because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature set points on thermostats, so that air conditioning units run less frequently, or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, in order to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a demand response activity in most situations.

The first step toward participation in a DR program is to contact a Curtailment Service Provider. A list of these providers is available on PJM's website and it includes contact information for each company, as well as the states where they have active business (<http://www.pjm.com/markets-and-operations/demand-response/csps.aspx>). PJM also posts training materials that are developed for program members interested in specific rules and requirements regarding DR activity (<http://www.pjm.com/training/training%20material.aspx>), along with a variety of other DR program information.

Curtailment Service Providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities and may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

In our opinion, this facility is not a good candidate for DR curtailment. There is no load to be shed.

8 PROJECT FUNDING / INCENTIVES

The NJCEP is able to provide the incentive programs described below, and other benefits to ratepayers, because of the Societal Benefits Charge (SBC) Fund. The SBC was created by the State of New Jersey’s Electricity Restructuring Law (1999), which requires all customers of investor-owned electric and gas utilities to pay a surcharge on their monthly energy bills. As a customer of a state-regulated electric or gas utility and therefore a contributor to the fund your organization is eligible to participate in the LGEA program and also eligible to receive incentive payment for qualifying energy efficiency measures. Also available through the NJBPU are some alternative financing programs described later in this section. Please refer to Figure 23 for a list of the eligible programs identified for each recommended ECM.

Figure 23 - ECM Incentive Program Eligibility

Energy Conservation Measure		SmartStart Prescriptive	SmartStart Custom	Direct Install	Pay For Performance Existing Buildings	Large Energy Users Program	Combined Heat & Power and Fuel Cell
ECM 1	Install LED Fixtures	X		X			
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	X		X			
ECM 3	Retrofit Fixtures with LED Lamps	X		X			
ECM 4	Install Occupancy Sensor Lighting Controls	X		X			
ECM 5	Install Low-Flow Domestic Hot Water Devices			X			

SmartStart is generally well-suited for implementation of individual measures or small group of measures. It provides flexibility to install measures at your own pace using in-house staff or a preferred contractor. Direct Install caters to small to mid-size facilities that can bundle multiple ECMs together. This can greatly simplify participation and may lead to higher incentive amounts, but requires the use of pre-approved contractors. The Pay for Performance (P4P) program is a “whole-building” energy improvement program designed for larger facilities. It requires implementation of multiple measures meeting minimum savings thresholds, as well as use of pre-approved consultants. The Large Energy Users Program (LEUP) is available to New Jersey’s largest energy users giving them flexibility to install as little or as many measures, in a single facility or several facilities, with incentives capped based on the entity’s annual energy consumption. LEUP applicants can use in-house staff or a preferred contractor.

Generally, the incentive values provided throughout the report assume the SmartStart program is utilized because it provides a consistent basis for comparison of available incentives for various measures, though in many cases incentive amounts may be higher through participation in other programs.

Brief descriptions of all relevant financing and incentive programs are located in the sections below. Further information, including most current program availability, requirements, and incentive levels can be found at: www.njcleanenergy.com/ci.

8.1 SmartStart

Overview

The SmartStart program offers incentives for installing prescriptive and custom energy efficiency measures at your facility. Routinely the program adds, removes or modifies incentives from year to year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Most equipment sizes and types are served by this program. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades.

Incentives

The SmartStart prescriptive incentive program provides fixed incentives for specific energy efficiency measures, whereas the custom SmartStart program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentive offerings for specific devices.

Since your facility is an existing building, only the retrofit incentives have been applied in this report. Custom Measure incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings, capped at 50% of the total installed incremental project cost, or a project cost buy down to a one year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

To participate in the SmartStart program you will need to submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. Applicants may work with a contractor of their choosing and can also utilize internal personnel, which provides added flexibility to the program. Using internal personnel also helps improve the economics of the ECM by reducing the labor cost that is included in the tables in this report.

Detailed program descriptions, instructions for applying and applications can be found at: www.njcleanenergy.com/SSB.

8.2 Direct Install

Overview

Direct Install is a turnkey program available to existing small to medium-sized facilities with a peak electric demand that does not exceed 200 kW for a recent 12-month period. You will work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Direct Install participants will also be held to a fiscal year cap of \$250,000 per entity.

How to Participate

To participate in the Direct Install program you will need to contact the participating contractor who the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Since Direct Install offers a free assessment of eligible measures, Direct Install is also available to small businesses and other commercial facilities too that may not be eligible for the more detailed facility audits provided by LGEA.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

8.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) is an alternate method for New Jersey's government agencies to finance the implementation of energy conservation measures. An ESIP is a type of "performance contract," whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. This is done in a manner that ensures that annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive in year one, and every year thereafter. ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs can be leveraged to help further reduce the total project cost of eligible measures.

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an Energy Services Company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is utilized for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the Energy Savings Plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Entities should carefully consider all alternatives to develop an approach that best meets their needs. A detailed program descriptions and application can be found at:

www.njcleanenergy.com/ESIP.

Please note that ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you may utilize NJCEP incentive programs to help further reduce costs when developing the ESP. You should refer to the ESIP guidelines at the link above for further information and guidance on next steps.

9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

9.1 Retail Electric Supply Options

In 1999, New Jersey State Legislature passed the Electric Discount & Energy Competition Act (EDECA) to restructure the electric power industry in New Jersey. This law deregulated the retail electric markets, allowing all consumers to shop for service from competitive electric suppliers. The intent was to create a more competitive market for electric power supply in New Jersey. As a result, utilities were allowed to charge Cost of Service and customers were given the ability to choose a third party (i.e. non-utility) energy supplier.

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third party supplier, consider shopping for a reduced rate from third party electric suppliers. If your facility is purchasing electricity from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party electric suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey has also been deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate on a monthly basis. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier is typically dependent upon whether a customer seeks budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility is not purchasing natural gas from a third party supplier, consider shopping for a reduced rate from third party natural gas suppliers. If your facility is purchasing natural gas from a third party supplier, review and compare prices at the end of the current contract or every couple years.

A list of third party natural gas suppliers, who are licensed by the state to provide service in New Jersey, can be found online at: www.state.nj.us/bpu/commercial/shopping.html.

Appendix A: Equipment Inventory & Recommendations

Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Office 1	5	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	2,415	Relamp & Reballast	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,691	0.24	817	0.0	\$156.52	\$701.00	\$70.00	4.03
Private Office	6	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	2,415	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,691	0.33	1,108	0.0	\$212.24	\$818.00	\$80.00	3.48
Closet	1	Incandescent: Screen-in Lamp	Wall Switch	60	2,415	Relamp	No	1	LED Screw-In Lamps: Screen Lamp	Wall Switch	11	2,415	0.04	134	0.0	\$25.60	\$53.75	\$0.00	2.10
Small Hallway	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.03	90	0.0	\$17.24	\$58.50	\$10.00	2.81
Small Hallway	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Electrical Room	2	Incandescent: Screen-in Lamp	Wall Switch	60	2,415	Relamp	No	2	LED Screw-In Lamps: Screen Lamp	Wall Switch	11	2,415	0.08	267	0.0	\$51.20	\$107.51	\$0.00	2.10
Closet	1	Incandescent: Screen-in Lamp	Wall Switch	60	2,415	Relamp	No	1	LED Screw-In Lamps: Screen Lamp	Wall Switch	11	2,415	0.04	134	0.0	\$25.60	\$53.75	\$0.00	2.10
Main Office	3	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	176	2,415	Relamp & Reballast	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,691	0.33	1,108	0.0	\$212.24	\$601.50	\$80.00	2.46
Main Office	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	2,415	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.05	161	0.0	\$30.83	\$117.00	\$10.00	3.47
Main Office	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Restroom	1	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	176	2,415	Relamp & Reballast	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,415	0.10	322	0.0	\$61.65	\$161.83	\$20.00	2.30
Closet	1	Incandescent: Screen-in Lamp	Wall Switch	60	2,415	Relamp	No	1	LED Screw-In Lamps: Screen Lamp	Wall Switch	11	2,415	0.04	134	0.0	\$25.60	\$53.75	\$0.00	2.10
Office 2	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,691	0.07	228	0.0	\$43.58	\$233.00	\$20.00	4.89
Office 2	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	2,415	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.05	161	0.0	\$30.83	\$117.00	\$10.00	3.47
Office 3	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	2,415	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,691	0.11	369	0.0	\$70.75	\$350.00	\$40.00	4.38
Stairwell 1	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,415	None	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,415	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairwell 1	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairwell 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	114	2,415	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,415	0.05	153	0.0	\$29.26	\$95.13	\$20.00	2.57
Stairwell 2	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Stairwell 2	2	Incandescent: Screen-in Lamp	Wall Switch	60	2,415	Relamp	No	2	LED Screw-In Lamps: Screen Lamp	Wall Switch	11	2,415	0.08	267	0.0	\$51.20	\$107.51	\$0.00	2.10
1st Floor - Break Room	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,691	0.27	910	0.0	\$174.30	\$584.00	\$100.00	2.78
1st Floor - Break Room	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	2,415	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.10	322	0.0	\$61.65	\$234.00	\$20.00	3.47
Women's Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.03	90	0.0	\$17.24	\$58.50	\$10.00	2.81
Men's Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.03	90	0.0	\$17.24	\$58.50	\$10.00	2.81
Mechanical Room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.05	180	0.0	\$34.48	\$117.00	\$20.00	2.81

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Bus Garage - Main Bay Area	16	Linear Fluorescent - T5HO: 4' T5HO (54W) - 4L	Wall Switch	234	2,415	Relamp	No	16	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,415	2.29	7,685	0.0	\$1,471.33	\$1,522.13	\$0.00	1.03
Bus Garage - Main Bay Area	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	88	2,415	Relamp & Reballast	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.10	322	0.0	\$61.65	\$234.00	\$20.00	3.47
Bus Garage - Main Bay Area	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.08	270	0.0	\$51.73	\$175.50	\$30.00	2.81
Bus Garage - Main Bay Area	1	Metal Halide: (1) 250W Lamp	Wall Switch	295	2,415	Fixture Replacement	No	1	LED - Fixtures: Downlight Pendant	Wall Switch	125	2,415	0.14	464	0.0	\$88.82	\$608.58	\$5.00	6.80
Bus Garage - Main Bay Area	1	Metal Halide: (1) 400W Lamp	Wall Switch	458	2,415	Fixture Replacement	No	1	LED - Fixtures: Downlight Pendant	Wall Switch	145	2,415	0.25	854	0.0	\$163.54	\$608.58	\$5.00	3.69
Storage Room - Uplstairs	3	Linear Fluorescent - T12: 8' T12 (75W) - 2L	Wall Switch	158	2,415	Relamp & Reballast	No	3	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	2,415	0.21	704	0.0	\$134.80	\$606.00	\$0.00	4.50
Storage Room - Uplstairs	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Locker Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.03	90	0.0	\$17.24	\$58.50	\$10.00	2.81
Shop Office	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,691	0.10	341	0.0	\$65.36	\$291.50	\$50.00	3.69
Part Storage Room	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	62	2,415	Relamp	No	9	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,415	0.24	810	0.0	\$155.18	\$526.50	\$90.00	2.81
Closet	1	Incandescent: Screen-in Lamp	Wall Switch	60	2,415	Relamp	No	1	LED Screw-In Lamps: Screen Lamp	Wall Switch	11	2,415	0.04	134	0.0	\$25.60	\$53.75	\$0.00	2.10
Exterior Fuel Canopy	2	Metal Halide: (1) 250W Lamp	Daylight Dimming	295	1,668	Fixture Replacement	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Daylight Dimming	125	1,668	0.28	641	0.0	\$122.66	\$781.35	\$200.00	4.74
Exterior Fuel Canopy	1	High-Pressure Sodium: (1) 400W Lamp	Daylight Dimming	465	1,668	Fixture Replacement	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Daylight Dimming	145	1,668	0.26	603	0.0	\$115.45	\$390.68	\$100.00	2.52
Exterior Fuel Canopy	2	Halogen Incandescent: 90-W PAR38 Surface Lmap	Daylight Dimming	90	1,668	Relamp	No	2	LED Screw-In Lamps: Screen Lamp	Daylight Dimming	15	1,668	0.12	283	0.0	\$54.12	\$107.51	\$0.00	1.99
Garage Exterior	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Daylight Dimming	100	1,668	None	No	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Daylight Dimming	100	1,668	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage Exterior	2	Metal Halide: (1) 250W Lamp	Daylight Dimming	295	1,668	Fixture Replacement	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Daylight Dimming	125	1,668	0.28	641	0.0	\$122.66	\$781.35	\$200.00	4.74
Parking Lot	6	LED - Fixtures: Parking Garage Fixture	Daylight Dimming	100	1,668	None	No	6	LED - Fixtures: Parking Garage Fixture	Daylight Dimming	100	1,668	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Annual Operating Hours	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Garage	Bench Grinder	1	Other	1.0	84.5%	No	690	No	84.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage	Garage	1	Exhaust Fan	3.0	88.7%	No	1,380	No	88.7%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage	Air Compressor	1	Air Compressor	5.0	88.7%	No	920	No	88.7%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage	Drill Press	1	Other	1.5	82.5%	No	690	No	82.5%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage	Machine Lathes	2	Other	0.8	78.0%	No	690	No	78.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Locker Room	Locker Room	1	Exhaust Fan	0.3	78.0%	No	1,380	No	78.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Second Floor	Goodman Air Handler	1	Supply Fan	1.5	84.0%	No	1,380	No	84.0%	No		0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis							
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Install Dual Enthalpy Economizer?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Shop Office	Shop Office	1	Split-System AC	2.00		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Rooftop	Second Floor	1	Split-System AC	7.50		No							No	0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Output Capacity per Unit (MBh)	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Garage	Garage	1	Warm Air Unit Heater	207.50	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage	Garage	1	Warm Air Unit Heater	100.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage	Garage	1	Warm Air Unit Heater	160.00	Yes	1	Warm Air Unit Heater	160.00	93.00%	Et	0.00	0	23.3	\$245.93	\$4,675.37	\$0.00	19.01
Second Floor	Second Floor	1	Furnace	280.00	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions		Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Closet - Storage Room	Transportation Building	1	Storage Tank Water Heater (≤ 50 Gal)	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00
Garage	Garage Area Service Sink	1	Storage Tank Water Heater (> 50 Gal)	No						0.00	0	0.0	\$0.00	\$0.00	\$0.00	0.00

Low-Flow Device Recommendations

Location	Recommendation Inputs				Energy Impact & Financial Analysis						
	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Transportation Building	2	Faucet Aerator (Lavatory)	2.50	1.00	0.00	0	3.2	\$34.18	\$14.34	\$0.00	0.42
Transportation Building	2	Faucet Aerator (Lavatory)	2.50	1.00	0.00	798	0.0	\$152.73	\$14.34	\$0.00	0.09


Vending Machine

Location	Existing Conditions		Proposed Conditions	Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Break Room	1	Refrigerated	Yes	0.00	1,612	0.0	\$308.61	\$230.00	\$0.00	0.75
Break Room	1	Non-Refrigerated	No	0.00	0	0.0	\$0.00	\$230.00	\$0.00	0.00

Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Transportation Building	8	Desktop with LCD Monitors	191.0	Yes
Transportation Building	3	Microwave	1,000.0	No
Transportation Building	1	Copy Machine	650.0	Yes
Transportation Building	2	Water Cooler	270.0	Yes
Transportation Building	1	TV	124.0	Yes
Transportation Building	2	Refrigerators	127.0	Yes
Transportation Building	1	Dehumidifier	155.0	Yes
Transportation Building	2	Coffe Makers	850.0	No
Transportation Building	1	Electric Space Heater	250.0	Yes
Transportation Building	1	Electric Range	1,200.0	No
Transportation Building	1	Washing Machine	1,200.0	No

Appendix B: ENERGY STAR® Statement of Energy Performance



ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

N/A

Brick Township High School Transportation Building

Primary Property Type: Repair Services (Vehicle, Shoe, Locksmith, etc.)
 Gross Floor Area (ft²): 6,900
 Built: 1976

ENERGY STAR®
 Score¹

For Year Ending: February 29, 2016
 Date Generated: January 22, 2018

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information

Property Address
 Brick Township High School
 Transportation Building
 349 Chambersbridge Road
 Brick, New Jersey 08723

Property Owner
 Brick Township Board of Education
 101 Hendrickson Avenue
 Brick, NJ 08724
 (732) 785-3000

Primary Contact
 James Edwards
 101 Hendrickson Avenue
 Brick, NJ 08724
 (732) 785-3000
jedwards@brickschools.org

Property ID: 6205628

Energy Consumption and Energy Use Intensity (EUI)

Site EUI	Annual Energy by Fuel	National Median Comparison
184.1 kBtu/ft ²	Natural Gas (kBtu) 1,089,213 (88%) Electric - Grid (kBtu) 181,374 (14%)	National Median Site EUI (kBtu/ft ²) 74.5 National Median Source EUI (kBtu/ft ²) 100.4 % Diff from National Median Source EUI 147%
Source EUI 248.3 kBtu/ft ²		Annual Emissions Greenhouse Gas Emissions (Metric Tons CO ₂ e/year) 78

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

 () - _____



Professional Engineer Stamp