



LOCAL GOVERNMENT ENERGY AUDIT PROGRAM: ENERGY AUDIT REPORT

PREPARED FOR:

MONTGOMERY TOWNSHIP

SCHOOLS

1014 ROUTE 601

SKILLMAN, NJ 08558

**ATTN: MR. THOMAS VENANZI,
SCHOOL BUSINESS ADMINISTRATOR /
BOARD SECRETARY**

PREPARED BY:

CONCORD ENGINEERING GROUP

520 S. BURNT MILL ROAD

VOORHEES, NJ 08043

TELEPHONE: (856) 427-0200

FACSIMILE: (856) 427-6529



[WWW.CONCORD-](http://WWW.CONCORD-ENGINEERING.COM)

[ENGINEERING.COM](http://WWW.CONCORD-ENGINEERING.COM)

CEG CONTACT:

**JOHN MARCHIAFAVA, PE, CEM, CGD
ENGINEERING MANAGER, COMMERCIAL
EMAIL: [JMARCHIAFAVA@CONCORD-
ENGINEERING.COM](mailto:JMARCHIAFAVA@CONCORD-ENGINEERING.COM)**

REPORT ISSUANCE: FINAL, MARCH 14, 2012

PROJECT NO: 9C11058

TABLE OF CONTENTS

I. EXECUTIVE SUMMARY 3

II. INTRODUCTION 10

III. METHOD OF ANALYSIS..... 12

IV. HISTORIC ENERGY CONSUMPTION/COST..... 14

 A. ENERGY USAGE 14

 B. ENERGY USE INDEX (EUI)..... 16

 C. EPA ENERGY BENCHMARKING SYSTEM..... 19

V. RENEWABLE/DISTRIBUTED ENERGY MEASURES 21

VI. ENERGY PURCHASING AND PROCUREMENT STRATEGY 25

VII. INSTALLATION FUNDING OPTIONS..... 25

 A. INCENTIVE PROGRAMS..... 32

 B. FINANCING OPTIONS 35

VIII. ENERGY AUDIT ASSUMPTIONS 37

Enclosures:

- Document 1 – Montgomery High School & Board of Education Admin Bldg. Energy Report
- Document 2 – Upper Montgomery Middle School Energy Report
- Document 3 – Lower Montgomery Middle School Energy Report
- Document 4 – Orchard Hill ElementarySchool Energy Report
- Document 5 – Village ElementarySchool Energy Report

REPORT DISCLAIMER

The information contained within this report, including any attachment(s), is intended solely for use by the named addressee(s). If you are not the intended recipient, or a person designated as responsible for delivering such messages to the intended recipient, you are not authorized to disclose, copy, distribute or retain this report, in whole or in part, without written authorization from Concord Engineering Group, Inc., 520 S. Burnt Mill Road, Voorhees, NJ 08043.

This report may contain proprietary, confidential or privileged information. If you have received this report in error, please notify the sender immediately. Thank you for your anticipated cooperation.

I. EXECUTIVE SUMMARY

This report presents the findings of the energy audit conducted for:

Entity: Montgomery Township Schools

Facilities: Montgomery High School & Board of Education Admin Bldg.
Upper Montgomery Middle School
Lower Montgomery Middle School
Orchard Hill Elementary School
Village Elementary School

Municipal Contact Person: Thomas Venanzi, Business Administrator/Board Secretary

Facility Contact Person: Robert Austin, Township Facilities Director

This audit is performed in connection with the New Jersey Clean Energy - Local Government Energy Audit Program for Montgomery Township School District. The purpose of this analysis is to provide the School District insight into the energy savings potential that exists within facilities at Montgomery Township School District. Energy Efficiency changes and upgrades require support from the building occupants, operations personnel and the administrators of the School District in order to maximize the savings and overall benefit. The efficiency improvement of public buildings provides a benefit for the environment and the residents of New Jersey. Throughout this report it has been demonstrated that there is a great potential for energy savings and infrastructure improvements at Montgomery Township School District.

The Energy Conservation Measures (ECMs) identified within the report represents the potential annual savings at the facilities. It is recommended to consider all ECMs as part of the District's initiative to save energy, reduce emissions, and lower operating costs. Concord Engineering Group (CEG) recommends proceeding with the implementation of all ECM's that provide a calculated simple payback at or under ten (10) years. All of the ECM's presented in this report have been categorized into three groups defined as Short-term (or Fast) Paybacks ranging from 0 to 5 years, Medium-term Paybacks ranging from 5 to 10 years, and Long-term Paybacks of over 10 years to assist the District in prioritizing projects.

Short-term Payback Energy Conservation Measures:

The Energy Conservation Measures (ECMs) identified with a simple payback of 0 to 5 years are considered very cost effective and should be considered a high priority for the District. It should be noted that in many cases ECM's lying in this range can be performed utilizing qualified "in house" staff that can further reduce the payback period. It is recommended if the District proceeds with "in house" installation they review equipment being purchased to ensure the energy efficiency equipment standards outlined in this report are met or exceeded.

Medium-term Payback Energy Conservation Measures:

The Energy Conservation Measures (ECMs) identified with a simple payback of 5 to 10 years are considered cost effective and should be considered by the District. In many cases these measures can provide significant savings, however the costs to implement are higher, stretching the payback beyond five years.

Long-term Payback Energy Conservation Measures:

The Energy Conservation Measures (ECMs) identified with a simple payback of over 10 years. The ECMs that have much longer paybacks are considered capital improvement ECMs. These typically have high installation costs that are more difficult to justify based solely on the energy savings associated with the improvement. Despite the long paybacks, these ECMs in many cases provide valuable and much needed infrastructure improvements for the facility. These ECMs include boiler upgrades, HVAC equipment upgrades, etc. It should also be noted that projects under a 15 year payback should be reviewed in the event the District wishes to move forward with an Energy Savings Improvement Program where these projects could be included that program.

The following table outlines the District’s Short, Medium, and Long Term payback Energy Conservation Measures.

MONTGOMERY TOWNSHIP SCHOOLS					
ENERGY CONSERVATION MEASURES LIST	<i>High School & Admin</i>	<i>Upper Middle School</i>	<i>Lower Middle School</i>	<i>Orchard Hill Elementary</i>	<i>Village Elementary</i>
Lighting Upgrade	S	S	S	S	S
Other Indoor Lighting Upgrades	S	M	S	S	S
Exterior Lighting Upgrades					
Lighting Controls Upgrade		S	S	S	S
Daylighting Controls Upgrade	S				
Domestic Hot Water Heater Upgrade	S		L		L
Split System Replacement		L			L
Packaged Rooftop Unit Replacement		L			L
VFD on Hot Water Pumps		L	L	L	
VFD on Chilled Water Pumps			L	L	
NEMA Premium Motor Replacement		L			
Boiler Upgrade			L	L	L
Chiller Replacement			L		
Solar Photovoltaic System			M		M
TOTAL	4	7	9	6	8
COMMENTS	1) ECM's are categorized into Short Term (0 - 5 yrs) designated "S", Medium Term (5 - 10 yrs) designated "M", and Long Term (10+ yrs) designated "L" to assist in prioritizing projects for implementation. 2) Grey ECM boxes indicate that the ECM is included in the ESIP summary.				

Renewable Energy Conservation Measures:

Currently Montgomery Township School District purchases solar electric panels through a PPA provider for three of the current five schools in the District. Montgomery High School and administration building, Upper Middle School and Orchard Elementary School currently hold 1,061 KWDC, 484 KWDC and 780 KWDC of panels, respectively.

In addition to the three schools already under a solar PPA, the remaining two schools were also reviewed for implementation of Renewable Energy Measures (REM). CEG utilized a combination of roof mounted solar arrays and canopy style parking lot solar arrays to house PV systems for Lower Middle School and Village Elementary School. The remaining facilities have a total estimated solar system potential of 835 kW DC that could generate 985,014 kilowatt-hours annually offsetting 9% of the total energy purchased from the grid. The system's calculated simple payback of 9.49 years is within the standard 10 year simple payback threshold; however, with alternative funding this payback could be lessened. CEG recommends the Owner review all funding options available with the implementation of this renewable energy measure.

Energy Procurement Recommendations:

The District is currently contracted with a third party supplier for electric and gas, CEG recommends they continue to purchase their electric and gas commodity through a third party supplier once the current contract has expired. Further recommendations are outlined in the Energy Procurement Section of this report that could assist the District in finding additional savings through their utility bills.

Maintenance and Operational Recommendations:

In addition to the ECMs and REMs, there are maintenance and operational measures that can provide significant energy savings and provide immediate benefit. The ECMs listed above represent investments that can be made to the facility which are justified by the savings seen over time. However, the maintenance items and small operational improvements below are typically achievable with on site staff or maintenance contractors and in turn have the potential to provide substantial operational savings compared to the costs associated. The following are recommendations which should be considered a priority in achieving an energy efficient building, further recommendations per building are provided in the building reports:

1. Chemically clean the condenser and evaporator coils periodically to optimize efficiency. Poorly maintained heat transfer surfaces can reduce efficiency 5-10%.
2. Maintain all weather stripping on windows and doors.
3. Clean all light fixtures to maximize light output.
4. Provide more frequent air filter changes to decrease overall system power usage and maintain better IAQ.
5. Verify all control systems are utilizing setback and scheduling capabilities.
6. Educate staff and students on awareness of wasteful energy practices such as leaving lights on unnecessarily, leaving on of non-essential computer and/or equipment at the

end of the day, leaving of outside doors/windows open as a means to control room temperature, etc.

Concord Engineering, based on our review of the Montgomery Township High School facility with the District Staff recommends retro-commissioning of the High School HVAC control systems to aid in identifying solutions to recognized HVAC control issues and to optimize the energy usage of the HVAC systems throughout the facility. To the District's credit they are currently working with their Commissioning Agent from the original project to remedy the known issues prior to engaging additional support. In brief, the Retro – Commissioning (RCx) process systematically analyzes and fine tunes an existing building's individual systems as well as operation and maintenance procedures. Although RCx cannot fix all deficiencies from original construction, it can often resolve problems that have developed since the building has initially been put into operation.

The process would begin with review of all available documentation including as-built drawings and specs, TAB report, control drawings, points lists, maintenance records and recent repairs. These documents would be used to develop the diagnostic and functional test plans that will be required to verify the installed equipment performance. Once a plan is in place, "hands on" testing of equipment and systems take place to get an accurate baseline. Problems are identified and specific solutions that make the school operate more efficiently and effectively are recommended.

Implementation Strategy Moving Forward:

It is recommended the District strongly consider all projects with a simple payback of ten years and under for implementation. However consideration should be taken on projects over ten years as they may be necessary capital improvements. The District should also consider pursuing any and all additional NJ Clean Energy Programs in order to receive the maximum incentives available.

Furthermore, although individual projects with a simple payback of 10 years and less are considered financially self sustaining, it is important to consider how multiple projects can be combined together. When ECMs are aggregated into a single project, the lower cost ECMs provides valuable savings to offset the higher cost ECMs. Likewise when multiple facilities are aggregated together into a single entity energy efficiency project, the same benefits are seen on a larger scale.

The Energy Savings Improvement Program (ESIP) allows for financing of any combination of energy efficiency projects across multiple facilities into one large project. The term of the financing must be under 15 years and the savings provides the revenue for the financing cost. The combination of all facilities into one large energy efficiency project provides the District with the opportunity to implement many of the ECMs identified within this report with an overall simple payback of 12.2 years. (See grey highlighted entries in ECM table above for included recommendations) The program financing allows for the implementation with little to no upfront cost for the District. Implementation of an ESIP provides significant benefits and should be strongly considered. The District should also keep in mind that interest in utilizing the

ESIP program should be combined with incentive programs such as NJ Smart Start and Direct Install in order to help offset the total project costs with incentives in order to try and include longer payback (or “capital”) improvements that could not otherwise be performed. The Total Entity Project Summary table below shows the savings, costs, incentives and paybacks for all ECMs at each facility. (Note: Renewable Energy Measures are not included in this summary table). It is recommended the District review all Facility ECM’s to achieve the most effective ESIP plan moving forward.)

**Table 1
ESIP -Total Entity Project Summary**

ENERGY SAVINGS IMPROVEMENT PROGRAM - POTENTIAL ENERGY EFFICIENCY PROJECT					
FACILITY ENERGY EFFICIENCY PROJECTS	ANNUAL ENERGY SAVINGS (\$)	PROJECT COST (\$)	SMART START INCENTIVES	CUSTOMER COST	SIMPLE PAYBACK
Montgomery High School & Board of Education	\$10,987	\$55,488	\$12,598	\$42,890	3.9
Upper Montgomery Middle School	\$28,323	\$422,096	\$15,786	\$406,310	14.3
Lower Montgomery Middle School	\$28,925	\$398,263	\$14,690	\$383,573	13.3
Orchard Hill Elementary School	\$22,018	\$178,271	\$9,405	\$168,866	7.7
Village Elementary School	\$40,184	\$554,011	\$27,430	\$526,581	13.7
Total Entity Project	\$130,438	\$1,608,129	\$79,909	\$1,528,220	11.7
Total Entity Energy Costs:			\$2,014,659		
Est. Total Entity Energy Savings:			\$130,438		
Overall Entity Percent Reduction:			6.5%		

Overall Assessment:

Based on the analysis conducted, the Montgomery Township BOE facilities have average operating costs (utility) when compared to facilities of similar occupancy and use. Through the energy audit surveys and creation of the major equipment list by facility some of the typical reasons that energy costs can be average or above are operational deficiencies due to equipment exceeding its service life and not operating at 100% or not being optimally controlled. The District, through its referendum work, is currently attempting to lessen their energy costs with the installation of new energy efficient equipment, new direct digital controls and complete testing, balancing and commissioning of the new systems. With this being said, the District can continue their push towards energy efficiency by reviewing the future implementation of the recommended ECMs noted in this report. The implementation of the recommended measures will further reduce energy use, save on the overall facilities’ operating costs and replace much needed major equipment exceeding its useful life that was not covered under the current work

undertaken by the District. The total energy cost of \$2,016,210 could be reduced by approximately 6.5% through the implementation of the ECMs recommended in this audit utilizing the combined approach detailed in the **ESIP - Total Entity Project Summary** table. Since the total project is capable of being funded through the savings, CEG highly recommends the District take advantage of this opportunity and utilize one of the recommended funding options. The District should also review additional conventional funding opportunities for these projects and determine which option fits the District's budget most positively in the short term and the future.

A sampling of the large capital projects noted in the combined project approach consists of the rooftop unit replacements at Upper Middle School and Village Elementary School. In addition, boiler replacements for Village Elementary School, Orchard Elementary School and Lower Middle School can be included in the combined project. However, CEG cautions the District review the replacement of the boilers versus their remaining useful life. Other projects that are included in the combined project are:

- Lighting and Lighting Controls Upgrades
- Hot Water Pump Variable Frequency Drives
- Domestic Hot Water Heater Replacements

On the whole, CEG recommends the implementation and further review of the above-noted projects contained in the combined project approach by the District. With the implementation of the projects, the District can continue towards its goal of gaining energy efficiency and providing suitable learning environments for its students.

II. INTRODUCTION

The comprehensive energy audit covers the following buildings in Montgomery Township School District:

- Montgomery High School & Board of Education Admin Bldg.
- Upper Montgomery Middle School
- Lower Montgomery Middle School
- Orchard Hill Elementary School
- Village Elementary School

This audit is performed in connection with the New Jersey Clean Energy - Local Government Energy Audit Program. The energy audit is conducted to promote the mission of the office of Clean Energy, which is to use innovation and technology to solve energy and environmental problems in a way that improves the State's economy. This can be achieved through the wiser and more efficient use of energy.

Electrical and natural gas utility information is collected and analyzed for one full year's energy use of each building. The utility information allows for analysis of the building's operational characteristics; calculate energy benchmarks for comparison to industry averages, estimated savings potential, and baseline usage/cost to monitor the effectiveness of implemented measures. A computer spreadsheet is used to calculate benchmarks and to graph utility information (see the utility profiles below).

The Energy Use Index (EUI) is established for the building. Energy Use Index (EUI) is expressed in British Thermal Units/square foot/year (BTU/ft²/yr), which is used to compare energy consumption to similar building types or to track consumption from year to year in the same building. The EUI is calculated by converting the annual consumption of all energy sources to BTU's and dividing by the area (gross square footage) of the building. Blueprints (where available) are utilized to verify the gross area of the facility. The EUI is a good indicator of the relative potential for energy savings. A low EUI indicates less potential for energy savings, while a high EUI indicates poor building performance therefore a high potential for energy savings.

Existing building architectural and engineering drawings (where available) are utilized for additional background information. The building envelope, lighting systems, HVAC equipment, and controls information gathered from building drawings allow for a more accurate and detailed review of the building. The information is compared to the energy usage profiles developed from utility data. Through the review of the architectural and engineering drawings a building profile can be defined that documents building age, type, usage, major energy consuming equipment or systems, etc.

The preliminary audit information is gathered in preparation for the site survey. The site survey provides critical information in deciphering where energy is spent and opportunities exist within a facility. The entire site is surveyed to inventory the following to gain an understanding of how each facility operates:

- Building envelope (roof, windows, etc.)
- Heating, ventilation, and air conditioning equipment (HVAC)
- Lighting systems and controls
- Facility-specific equipment

The building site visit is performed to survey all major building components and systems. The site visit includes detailed inspection of energy consuming components. Summary of building occupancy schedules, operating and maintenance practices, and energy management programs provided by the building manager are collected along with the system and components to determine a more accurate impact on energy consumption.

III. METHOD OF ANALYSIS

This audit is consistent with an ASHRAE level 2 audit. The cost and savings for each measure is $\pm 20\%$. The evaluations are based on engineering estimations and industry standard calculation methods. More detailed analyses would require engineering simulation models, hard equipment specifications, and contractor bid pricing.

Post site visit work includes evaluation of the information gathered, researching possible conservation opportunities, organizing the audit into a comprehensive report, and making recommendations on HVAC, lighting and building envelope improvements. Data collected is processed using energy engineering calculations to anticipate energy usage for each of the proposed energy conservation measures (ECMs). The actual building's energy usage is entered directly from the utility bills provided by the owner. The anticipated energy usage is compared to the historical data to determine energy savings for the proposed ECMs.

It is pertinent to note, that the savings noted in this report are not additive. The savings for each recommendation is calculated as standalone energy conservation measures. Implementation of more than one ECM may in some cases affect the savings of each ECM. The savings may in some cases be relatively higher if an individual ECM is implemented in lieu of multiple recommended ECMs. For example implementing reduced operating schedules for inefficient lighting will result in a greater relative savings. Implementing reduced operating schedules for newly installed efficient lighting will result in a lower relative savings, because there is less energy to be saved.

The project / Entity summary tables are based on the implementation of multiple measures. The analysis is reviewed and determined if the nature of the ECMs will cause a major conflict of the overall savings. When additive measures do not cause a major effect on the overall savings the ECMs are included. Where a major conflict is identified, the combined savings is evaluated appropriately to ensure the overall estimates are $\pm 20\%$.

ECMs are determined by identifying the building's unique properties and deciphering the most beneficial energy saving measures available that meet the specific needs of the facility. The building construction type, function, operational schedule, existing conditions, and foreseen future plans are critical in the evaluation and final recommendations. Energy savings are calculated based on industry standard methods and engineering estimations. Energy consumption is calculated based on manufacturer's cataloged information when new equipment is proposed.

Cost savings are calculated based on the actual historical energy costs for the facility. Installation costs include labor and equipment costs to estimate the full up-front investment required to implement a change. Costs are derived from Means Cost Data, industry publications, and local contractors and equipment suppliers. The NJ Smart Start Building® program incentives savings (where applicable) are included for the appropriate ECM's and subtracted from the installed cost. Maintenance savings are calculated where applicable and added to the energy savings for each ECM. The life-time for each ECM is estimated based on the typical life of the equipment being replaced or altered. The costs and savings are applied and a simple payback, simple lifetime savings, and simple return on investment are calculated. See below for calculation methods:

ECM Calculation Equations:

$$\text{Simple Payback} = \left(\frac{\text{Net Cost}}{\text{Yearly Savings}} \right)$$

$$\text{Simple Lifetime Savings} = (\text{Yearly Savings} \times \text{ECM Lifetime})$$

$$\text{Simple Lifetime ROI} = \frac{(\text{Simple Lifetime Savings} - \text{Net Cost})}{\text{Net Cost}}$$

$$\text{Lifetime Maintenance Savings} = (\text{Yearly Maintenance Savings} \times \text{ECM Lifetime})$$

$$\text{Internal Rate of Return} = \sum_{n=0}^N \left(\frac{\text{Cash Flow of Period}}{(1 + \text{IRR})^n} \right)$$

$$\text{Net Present Value} = \sum_{n=0}^N \left(\frac{\text{Cash Flow of Period}}{(1 + \text{DR})^n} \right)$$

Net Present Value calculations based on Interest Rate of 3%.

IV. HISTORIC ENERGY CONSUMPTION/COST**A. Energy Usage**

The energy usage for the facilities is tabulated and plotted in graph form as depicted within each facility report (see the individual facility energy audit reports for details). Each energy source has been identified and monthly consumption and cost noted per the information provided by the Owner. The electric and natural gas utilities are shown below in Table 2&3 for all facilities:

**Table 2
Electric Utility Summary**

ELECTRIC UTILITY USAGE PER FACILITY			
FACILITY	ANNUAL ELECTRIC UTILITY		
DESCRIPTION	USAGE (KWH)	COST (\$)	AVE RATE (\$/KWH)
Montgomery High School & Board of Education	6,363,626	\$756,309	\$0.12
Upper Montgomery Middle School	1,050,726	\$160,267	\$0.15
Lower Montgomery Middle School	1,607,239	\$235,125	\$0.15
Orchard Hill Elementary School	1,412,785	\$195,961	\$0.14
Village Elementary School	933,778	\$148,145	\$0.16
Total	11,368,154	\$1,495,806	\$0.13

**Table 3
Natural Gas Summary**

NATURAL GAS UTILITY USAGE PER FACILITY			
FACILITY	ANNUAL NATURAL GAS UTILITY		
DESCRIPTION	USAGE (THERMS)	COST (\$)	AVE RATE (\$/THERM)
Montgomery High School & Board of Education	304,154	\$262,210	\$0.86
Upper Montgomery Middle School	75,484	\$71,155	\$0.94
Lower Montgomery Middle School	53,291	\$49,941	\$0.94
Orchard Hill Elementary School	81,164	\$80,080	\$0.99
Village Elementary School	64,194	\$55,467	\$0.86
Total	578,287	\$518,853	\$0.90

B. Energy Use Index (EUI)

Energy Use Index (EUI) is a measure of a building's annual energy utilization per square foot of building. This calculation is completed by converting all utility usage consumed by a building for one year, to British Thermal Units (BTU) and dividing this number by the building square footage. EUI is a good measure of a building's energy use and is utilized regularly for comparison of energy performance for similar building types. The Oak Ridge National Laboratory (ORNL) Buildings Technology Center under a contract with the U.S. Department of Energy maintains a Benchmarking Building Energy Performance Program. The ORNL website determines how a building's energy use compares with similar facilities throughout the U.S. and in a specific region or state.

Source use differs from site usage when comparing a building's energy consumption with the national average. Site energy use is the energy consumed by the building at the building site only. Source energy use includes the site energy use as well as all of the losses to create and distribute the energy to the building. Source energy represents the total amount of raw fuel that is required to operate the building. It incorporates all transmission, delivery, and production losses, which allows for a complete assessment of energy efficiency in a building. The type of utility purchased has a substantial impact on the source energy use of a building. The EPA has determined that source energy is the most comparable unit for evaluation purposes and overall global impact. Both the site and source EUI ratings for the building are provided to understand and compare the differences in energy use.

The site and source EUI for this facility is calculated as follows:

$$\text{Building Site EUI} = \frac{(\text{Electric Usage in kBtu} + \text{Gas Usage in kBtu})}{\text{Building Square Footage}}$$

$$\text{Building Source EUI} = \frac{(\text{Electric Usage in kBtu} \times \text{SS Ratio} + \text{Gas Usage in kBtu} \times \text{SS Ratio})}{\text{Building Square Footage}}$$

**Table 4
Energy Use Index Summary**

ENERGY USE INDEX PER FACILITY				
FACILITY	BUILDING AREA	ENERGY USE INDEX		
DESCRIPTION	(SF)	SITE (KBTU/SF/YR)	SOURCE (KBTU/SF/YR)	ELECTRIC (KWH/SF/YR)
Montgomery High School & Board of Education	450,000	115.87	232.02	14.1
Upper Montgomery Middle School	142,000	78.42	140.03	7.4
Lower Montgomery Middle School	127,300	84.97	187.80	12.6
Orchard Hill Elementary School	130,000	99.54	189.29	10.9
Village Elementary School	89,900	106.87	193.20	10.4

Figures 1 and 2 below depict a national EUI grading for the source energy use of various building types similar to the buildings at Montgomery Township Board of Education.

Concord Engineering cautions that the information shown below in the charts cannot be verified to the inclusion of air-conditioned environments as provided in the majority of the Montgomery Township facilities. The use of air-conditioning and extra-curricular activities at the facilities will result in higher EUI's. Concord Engineering has compared the data above to facilities in New Jersey that we have audited and there is room for improvement, however, we would consider the facilities to be operating in the average range for facilities of their type. The high school is a bit of an anomaly due to its large square footage and the aquatic area, etc.

Figure 1
Source Energy Use Intensity Distributions: Elementary School


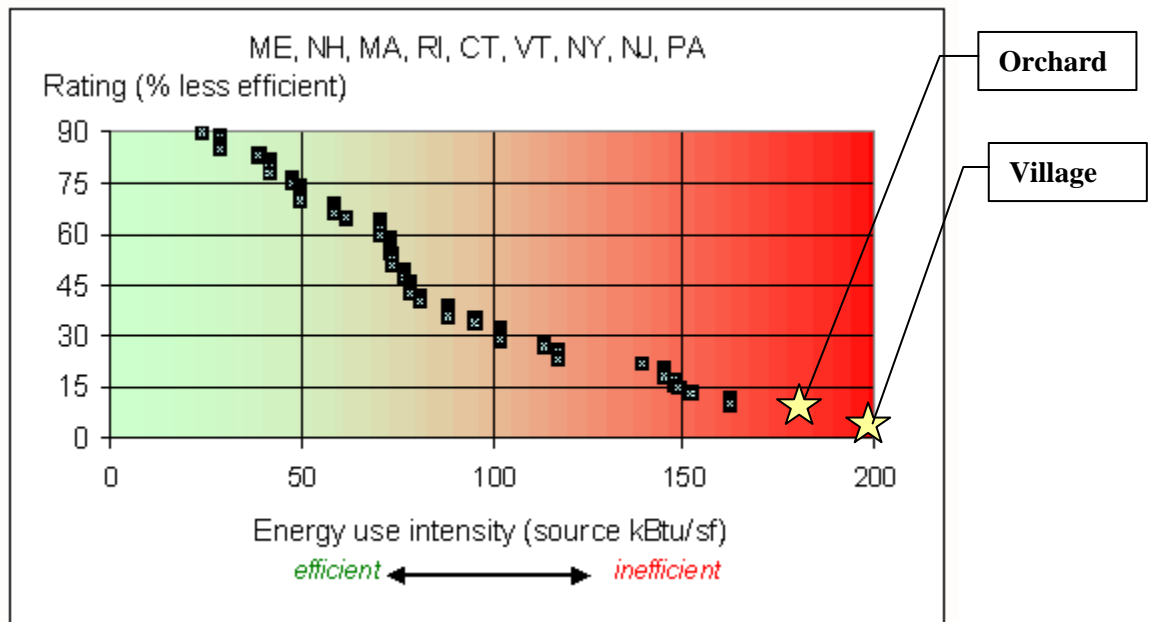


Figure 2
Source Energy Use Intensity Distributions: High School & Middle School

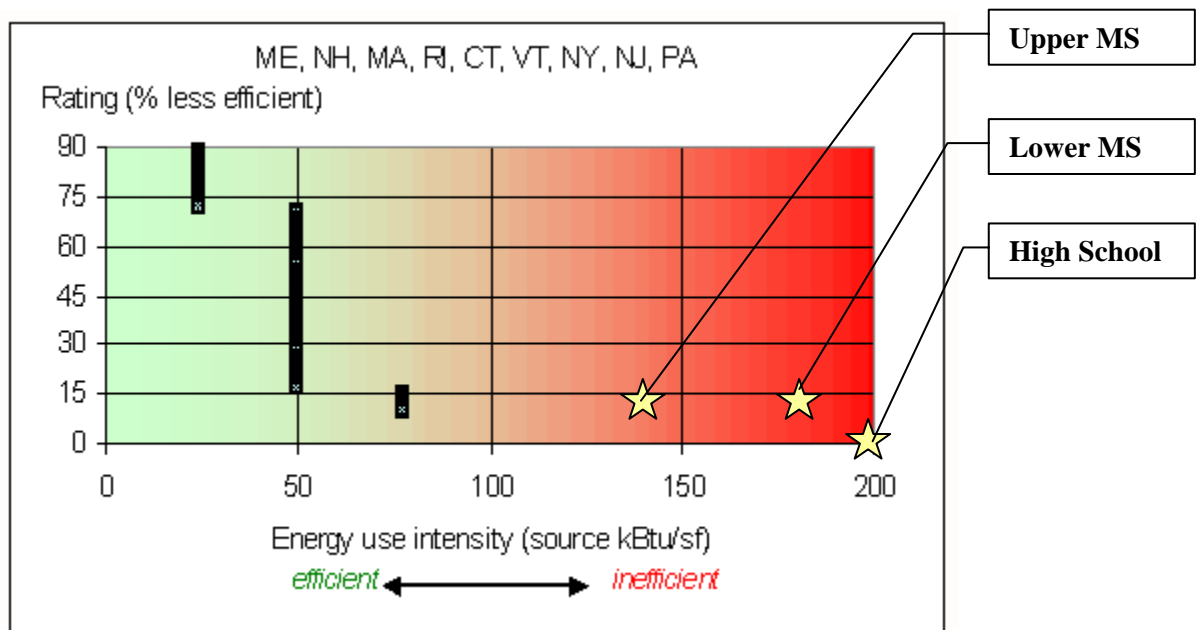

C. EPA Energy Benchmarking System

The United States Environmental Protection Agency (EPA) in an effort to promote energy management has created a system for benchmarking energy use amongst various end users. The benchmarking tool utilized for this analysis is entitled Portfolio Manager. The Portfolio Manager tool allows tracking and assessment of energy consumption via the template forms located on the ENERGY STAR website (www.energystar.gov). The importance of benchmarking for local government municipalities is becoming more important as utility costs continue to increase and emphasis is being placed on carbon reduction, greenhouse gas emissions and other environmental impacts.

Based on information gathered from the ENERGY STAR website, Government agencies spend more than \$10 billion a year on energy to provide public services and meet constituent needs. Furthermore, energy use in commercial buildings and industrial facilities is responsible for more than 50 percent of U.S. carbon dioxide emissions. It is vital that local government municipalities assess facility energy usage, benchmark energy usage utilizing Portfolio Manager, set priorities and goals to lessen energy usage and move forward with priorities and goals.

In accordance with the Local Government Energy Audit Program, CEG has created an ENERGY STAR account for the municipality to access and monitor the facility's yearly energy usage as it compares to facilities of similar type. The login page for the account can be accessed at the following web address; the username and password are also listed below:

<https://www.energystar.gov/istar/pmpam/index.cfm?fuseaction=login.login>

[REDACTED]

The utility bills and other information gathered during the energy audit process are entered into the Portfolio Manager in addition to the portfolio manager being kept by the school district. The following is a summary of the results for the facility:

**Table 5
Energy Star Performance Summary**

ENERGY STAR PERFORMANCE RATING PER FACILITY			
FACILITY	ENERGY STAR PERFORMANCE RATING		
DESCRIPTION	SCORE	AVERAGE	POTENTIAL CERTIFICATIONS
Montgomery High School & Board of Education	24	50	N/A
Upper Montgomery Middle School	71	50	N/A
Lower Montgomery Middle School	53	50	N/A
Orchard Hill Elementary School	50	50	N/A
Village Elementary School	36	50	N/A
See the Appendix C - Statement of Energy Performance for comparative facilities Score: "N/A" represents facility that could not receive a rating. See Energy Star website for details.			

Refer to the individual reports **Statement of Energy Performance Appendix** for the detailed energy summary for each facility.

V. RENEWABLE/DISTRIBUTED ENERGY MEASURES

Globally, renewable energy has become a priority affecting international and domestic energy policy. The State of New Jersey has taken a proactive approach, and has recently adopted in its Energy Master Plan a goal of 30% renewable energy by 2020. To help reach this goal New Jersey created the Office of Clean Energy under the direction of the Board of Public Utilities and instituted a Renewable Energy Incentive Program to provide additional funding to private and public entities for installing qualified renewable technologies. A renewable energy source can greatly reduce a building's operating expenses while producing clean environmentally friendly energy. CEG has assessed the feasibility of installing renewable energy measures (REM) for the municipality utilizing renewable technologies and concluded that there is potential for solar energy generation.

Solar Generation

Solar energy produces clean energy and reduces a building's carbon footprint. This is accomplished via photovoltaic panels which are mounted on all south and southwestern facades of the building. Flat roof, as well as sloped areas can be utilized; flat areas will have the panels turned to an optimum solar absorbing angle. (A structural survey of the roof would be necessary before the installation of PV panels is considered). Parking lots can also be utilized for the installation of a solar array. A truss system can be installed that is high enough to park vehicles under the array and no parking lot area is lost.

The state of NJ has instituted a program in which one Solar Renewable Energy Certificate (SREC) is given to the Owner for every 1000 kWh of generation. SREC's can be sold anytime on the market at their current market value. The value of the credit varies upon the current need of the power companies. The average value per credit used in our financial calculations is \$350 per MWH. This equates to \$0.35 per kWh generated.

Montgomery Township has previously installed photovoltaic solar panels on three of the following facilities:

- High School & Administration Building (1,061 KWDC)
- Upper Middle School (484 KWDC)
- Orchard Elementary School (780 KW DC)

CEG has reviewed the existing roof area and parking lot canopy area potential of the remaining facilities being audited for the purposes of determining a potential for a photovoltaic system. Roof mounted PV designs were considered for both Village Elementary School and Lower Middle School as well as a parking lot canopy system for Lower Middle School. A depiction of the area utilized at each facility is shown in **Renewable / Distributed Energy Measures Calculation Appendix**. The system sizes are shown below for each building where installation of a solar PV system is feasible. The total KWH production for all facilities combined is 985,014 kWh annually, reducing the overall utility bill for the school district by approximately 9% percent. (This does not include the system currently installed on the High School, Upper Middle School and Orchard Elementary School which are currently producing electricity since October

2011). A detailed financial analysis can be found in the **Renewable / Distributed Energy Measures Calculation Appendix** within each facility report. This analysis illustrates the payback of the system over a 15 year period. The eventual degradation of the solar panels and the price of accumulated SREC's are factored into the payback.

Table 6
Renewable Energy Summary

POWER PRODUCTION SUMMARY - PHOTOVOLTAIC SYSTEM PER FACILITY			
FACILITY	PRODUCTION SUMMARY		
DESCRIPTION	ELECTRIC PRODUCTION (KWH)	TOTAL FACILITY USE (KWH)	% REDUCTION
Montgomery High School & Board of Education	N/A	6,363,626	N/A
Upper Montgomery Middle School	N/A	1,050,726	N/A
Lower Montgomery Middle School	855,180	1,607,239	53%
Orchard Hill Elementary School	N/A	1,412,785	N/A
Village Elementary School	129,834	933,778	14%
Total	985,014	11,368,154	9%

The proposed photovoltaic array layout is designed based on the specifications for the SharpNU-U235F2 panel. This panel has a "DC" rated full load output of 235 watts, and has a total panel conversion efficiency of 14.4%. Although panels rated at higher wattages are available through Sharp and other various manufacturers, in general most manufacturers who produce commercially available solar panels produce a similar panel in the 200 to 250 watt range. This provides more manufacturer options to the public entity if they wish to pursue the proposed solar recommendation without losing significant system capacity.

The array system capacity was sized based on available roof space or canopy style system area available at each existing facility. Estimated solar array generation is calculated based on the National Renewable Energy Laboratory PVWatts Version 1.0 Calculator. In order to calculate the array generation an appropriate location with solar data on file must be selected. In addition the system DC rated kilowatt (kW) capacity must be inputted, a DC to AC de-rate factor, panel tilt angle, and array azimuth angle. The DC to AC de-rate factor is based on the panel nameplate DC rating, inverter and transformer efficiencies (95%), mismatch factor (98%), diodes and

connections (100%), dc and ac wiring(98%, 99%), soiling, (95%), system availability (95%), shading (if applicable), and age(new/100%). The overall DC to AC de-rate factor has been calculated at an overall rating of 81%. The PVWatts Calculator program then calculates estimated system generation based on average monthly solar irradiance and user provided inputs. The monthly energy generation and offset electric costs from the PVWatts calculator is shown in the **Renewable/Distributed Energy Measures Calculation Appendix**.

The proposed solar array for each facility is qualified by the New Jersey Board of Public Utilities Net Metering Guidelines as a Class I Renewable Energy Source. These guidelines allow onsite customer generation using renewable energy sources such as solar and wind with a capacity of 2 megawatts (MW) or less. This limits a customer system design capacity to being a net user and not a net generator of electricity on an annual basis. Although these guidelines state that if a customer does net generate (produce more electricity than they use), the customer will be credited those kilowatt-hours generated to be carried over for future usage on a month to month basis. Then, on an annual basis if the customer is a net generator the customer will then be compensated by the utility the average annual PJM Grid LMP price per kilowatt-hour for the over generation. Due to the aforementioned legislation, the customer is at limited risk if they generate more than they use at times throughout the year. With the inefficiency of today's energy storage systems, such as batteries, the added cost of storage systems is not warranted and was not considered in the proposed design.

Direct purchase involves Montgomery Township School District to pay for 100% of the total project cost upfront in lieu of one of the methods noted in the Installation Funding Options section below. Calculations include a utility inflation rate as well as the degradation of the solar panels over time. The financial summary per facility is as follows:

**Table 7
Renewable Financial Summary**

FINANCIAL SUMMARY - PHOTOVOLTAIC SYSTEM PER FACILITY			
FACILITY	DIRECT PURCHASE FINANCIAL SUMMARY		
DESCRIPTION	INSTALATION COST (\$)	TOTAL SAVINGS (\$)	INTERNAL RATE OF RETURN
Montgomery High School & Board of Education	N/A	N/A	N/A
Upper Montgomery Middle School	N/A	N/A	N/A
Lower Montgomery Middle School	\$4,312,395	\$454,618	6.4%
Orchard Hill Elementary School	N/A	N/A	N/A
Village Elementary School	\$664,542	\$70,059	6.4%
Total	\$4,976,937	\$524,677	

CEG recommends Montgomery Township School District to review all options available for installation of solar PV systems at their facilities including a Power Purchase Agreement (PPA). This option utilizes providers who will own, operate, and maintain the system for a period of 15 years. During this time the PPA Provider would sell all of the electric generated by Solar Arrays to the District at a reduced rate compared to their existing electric rate.

Wind Generation

In addition to the Solar Analysis, CEG also conducted a review of the applicability of wind energy for the District. Wind energy production is another option available through the Renewable Energy Incentive Program. Wind turbines of various types can be utilized to produce clean energy on a per building basis. Cash incentives are available per kWh of electric usage. Based on CEG's review of the applicability of wind energy for the facility, it was determined that the average wind speed of 5.0 m/s is not adequate enough to make wind an economically viable option for the District to pursue.

VI. ENERGY PURCHASING AND PROCUREMENT STRATEGY

Load Profile:

Load Profile analysis was performed to determine the seasonal energy usage of each of the schools included in the audit. Irregularities in the load profile will indicate potential problems within the facilities. Consequently based on the profile a recommendation will be made to remedy the irregularity in energy usage. For this report, the facilities' energy consumption data was gathered in table format and plotted in graph form to create the load profile. Refer to The Electric and Natural Gas Usage Profiles included within this report to reference the respective electricity and natural gas usage load profiles.

Electricity:

The electricity usage profile demonstrates both a summer cooling and winter heating load profile. Historical usage is relatively steady throughout the year with an average monthly usage of 947,346 kWh across all five schools. The average summer (June - Sept) consumption is 1,145,036 kWh and the average winter (Oct – May) consumption is 848,501 kWh. The largest consumption months were September, May, June and July.

The historical usage profile is very beneficial and will allow for more competitive energy prices when shopping for alternative suppliers mainly due to the relatively steady year-long load profile. Third Party Supplier (TPS) electric commodity contracts that offer's a firm, fixed price for 100% of the facilities electric requirements and are lower than the PSE&G's BGS-FP default rate are recommended.

Natural Gas:

The Natural Gas Usage Profile demonstrates a typical natural gas (heat load) profile. The average winter (Nov-Mar) consumption is 81,873 therms and the average summer (Apr-Oct) consumption is 24,132 therms. The largest consumption months were December, January, and February.

This load profile will yield less favorable natural gas pricing when shopping for alternative suppliers. This is because the higher winter month consumption will yield higher pricing which will not be offset by similar summer month consumption. Nymex commodity pricing is generally higher in the winter months of November – March and lower in the summer months of April – October. Obtaining a flat load profile, (usage is similar each month), will yield optimum natural gas pricing when shopping for alternative suppliers.

Tariff Analysis:

Electricity:

The facilities receive electric distribution service through Public Service Electric & Gas Company (PSE&G) on a Large Power and Light Service rate schedule of LPLP and LPLS. All

facilities are currently contracted with a Third Party Supplier (TPS), South Jersey Energy Company to provide electric commodity service. For electric supply (generation) service, the client has a choice to either use PSE&G's default service rate BGS-FP or contract with a Third Party Supplier (TPS) to supply electric.

Each year since 2002, the four New Jersey Electric Distribution Companies (EDCs) - Public Service Gas & Electric Company (PSE&G), Atlantic City Electric Company (ACE), Jersey Central Power & Light Company (JCP&L), and Rockland Electric Company (RECO) - have procured several billion dollars of electric supply to serve their Basic Generation Service (BGS) customers through a statewide auction process held in February.

BGS refers to the service of customers who are not served by a third party supplier or competitive retailer. This service is sometimes known as Standard Offer Service, Default Service, or Provider of Last Resort Service.

The Auction Process has consisted of two auctions that are held concurrently, one for larger customers on an hourly price plan (BGS-CIEP) and one for smaller commercial and residential customers on a fixed-price plan (BGS-FP). This facility's rate structure is based on the fixed-price plan (BGS-FP).

The utility, PSE&G will continue to be responsible for maintaining the existing network of wires, pipes and poles that make up the delivery system, which will serve all consumers, regardless of whom they choose to purchase their electricity or natural gas from. PSE&G's delivery service rate includes the following charges: Customer Service Charge, Distribution Charge (kWh and Demand), Societal Benefits Charge (SBC), and Securitization Transition Charge.

Natural Gas:

All facilities currently receive natural gas distribution service through PSE&G on rate schedule LVG (Large Volume General Service). All facilities are currently receiving natural gas commodity supply from Hess Energy, a Third Party Supplier.

PSE&G provides basic gas supply service (BGSS) to customers who choose not to shop from a Third Party Supplier (TPS) for natural gas commodity. The option is essential to protect the reliability of service to consumers as well as protecting consumers if a third party supplier defaults or fails to provide commodity service. Please refer to the link below for a recap of natural gas BGSS charges from PSE&G for rate schedule LVG. <http://www.pseg.com/companies/pseandg/schedules/pdf/commodity.pdf>


The utility, PSE&G is responsible for maintaining the existing network of wires, pipes and poles that make up the delivery system, which will serve all consumers, regardless of whom they choose to purchase their electricity or natural gas from. PSE&G's delivery service rate includes the following charges: Customer Service Charge, Distribution Charge, & Societal Benefits Charge (SBC).

Electric and Natural Gas Commodities Market Overview:

Current electricity and natural gas market pricing has remained relatively stable over the last year. Commodity pricing in 2008 marked historical highs in both natural gas and electricity commodity. Commodity pricing commencing spring of 2009 continuing through 2011, has decreased dramatically over 2008 historic highs and continues to be favorable for locking in long term (2-5 year) contracts with 3rd Party Supplier's for both natural gas and electricity supply requirements.

It is important to note that both natural gas and electric commodity market prices are moved by supply and demand, political conditions, market technicals and trader sentiment. This market is continuously changing. Energy commodity pricing is also correlated to weather forecasts. Because weather forecasts are dependable only in the short-term, prolonged temperature extremes can really cause extreme price swings.

**U.S. Summer Cooling Degree-Days
(population-weighted)**

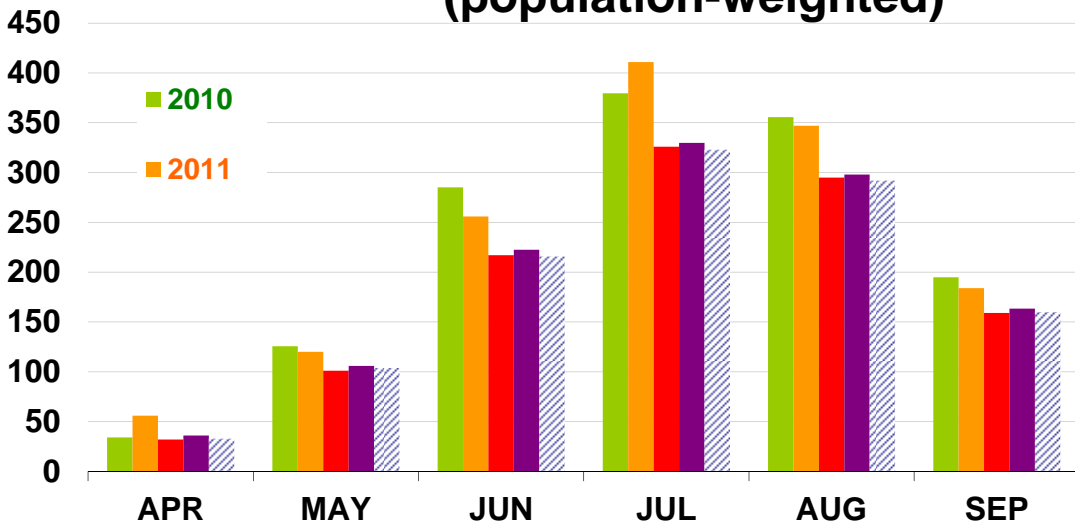


Data source: National Oceanic and Atmospheric Administration,

Source: Short-Term Energy Outlook,



U.S. Winter Heating Degree-Days (population-weighted)

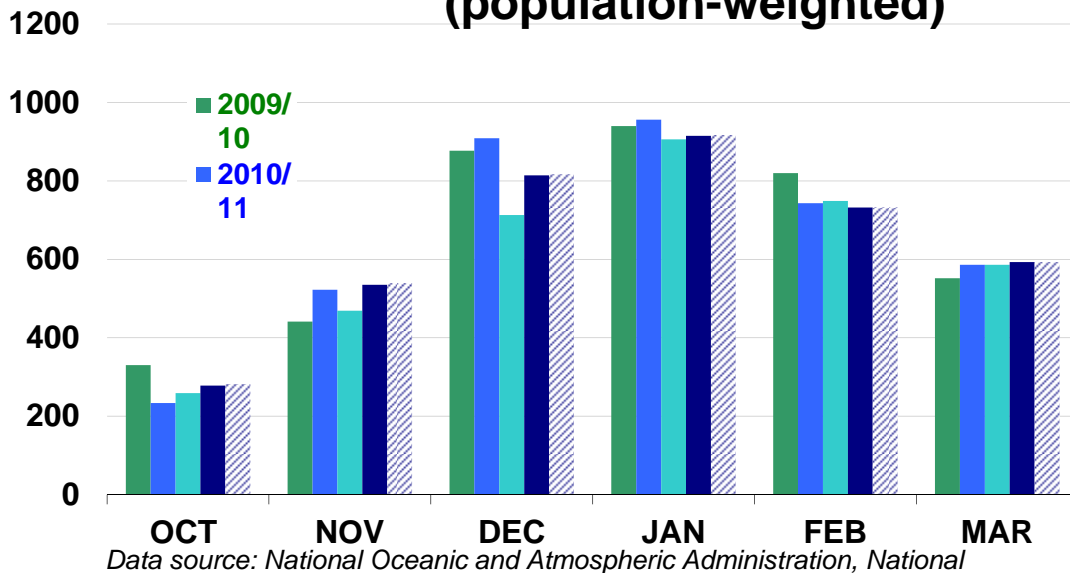



Source: Short-Term Energy Outlook,



Short Term Energy Outlook - US Energy Information Administration (1/10/2012):

U.S. Natural Gas Prices. At this time last year, EIA had projected that the Henry Hub natural gas spot price would average \$4.02 per MMBtu in 2011, rising to an average \$4.50 per MMBtu in 2012. The final average Henry Hub spot price for 2011 was \$4.00 per MMBtu. The current forecast for 2012 natural gas prices is significantly lower than at this time last year, as continued growth in production and a very warm start to the winter have contributed to record-high natural gas inventories. EIA now expects the Henry Hub spot price will average \$3.53 per MMBTU in 2012. In 2013, the forecast spot price rises to an average of \$4.14 per MMBtu. Natural gas futures prices for March 2012 delivery (for the 5-day period ending January 5, 2012) averaged \$3.05 per MMBtu, and the average implied volatility was 40 percent. The lower and upper bounds for the 95-percent confidence interval for March 2012 contracts are \$2.29 per MMBtu and \$4.06 per MMBtu. At this time last year, the March 2011 natural gas futures contract averaged \$4.39 per MMBtu and implied volatility averaged 43 percent. The corresponding lower and upper limits of the 95-percent confidence interval were \$3.21 per MMBtu and \$6.02 per MMBtu.

U.S. Electricity Retail Prices. After having risen by 2.1 percent between 2010 and 2011, EIA expects average U.S. residential electricity prices to rise only 0.6 percent in 2012 and then stay flat in 2013.

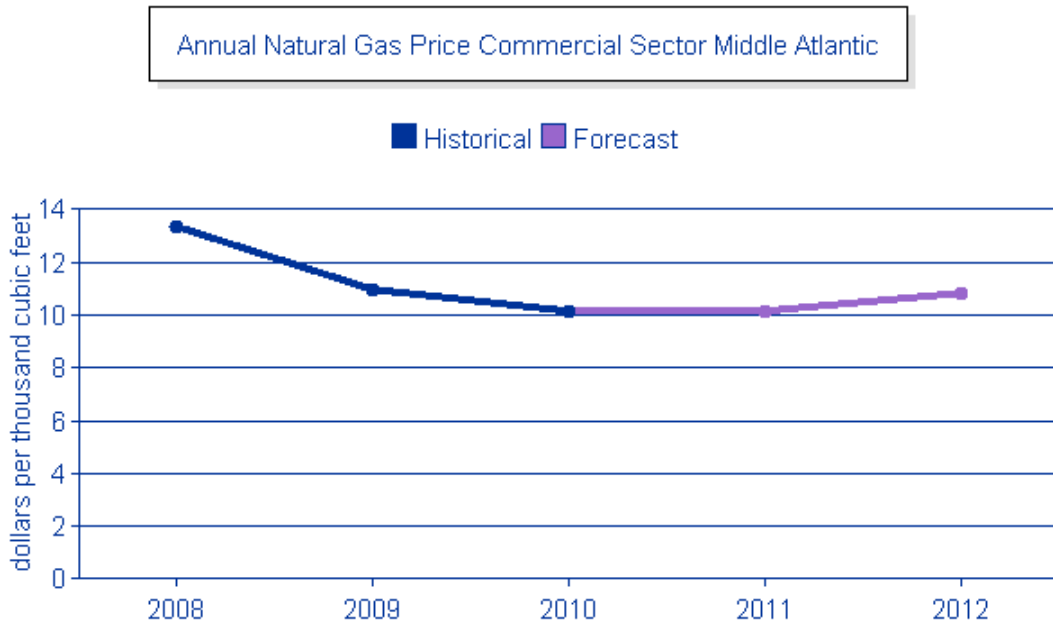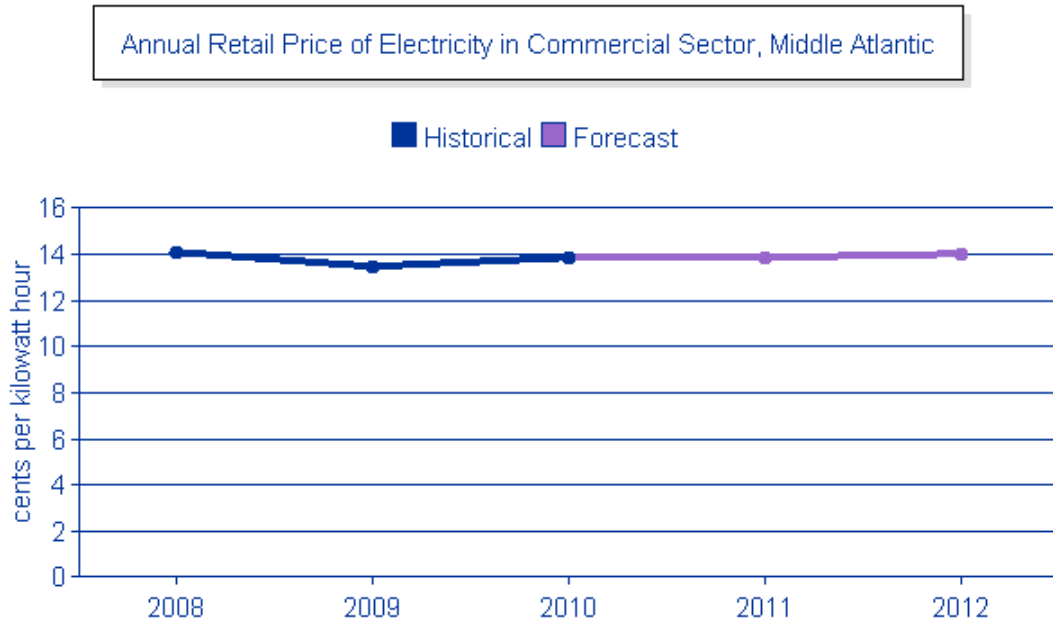

Pricing in the chart above includes both utility distribution and energy commodity charges.

Recommendations:

1. Concord Engineering recommends a continued account aggregation approach for 3rd party commodity supply procurement strategies for electric supply service as well as natural gas commodity supply service options. Aggregating the usage of all District facilities for electricity and natural gas supply service allows the District to achieve the most beneficial reduction in commodity supply costs. Energy commodities are among the most volatile of all commodities, however at this point and time, energy is extremely competitive and contract terms longer than 12 months are desirable. Contracts due to expire in the near term would continue to yield favorable pricing.
2. Concord Engineering recommends exploring new electricity pricing options that would either extend the existing electric supply contract beyond their current expiration date, or have a new contract price commence upon the expiration date. Concord Engineering also recommends exploring new natural gas pricing options or have a new contract price commence prior to the current contract's expiration date.
3. After review of the utility consumption, billing, third party supply contracts and current commodity pricing outlook, Concord Engineering recommends that Montgomery Township BOE continue their use of their third party billing review. However, the BOE should explore the utilization and advisement of a 3rd party unbiased Energy Consulting Firm experienced in the procurement of commodities, New Jersey procurement laws, aggregation of facilities and energy supply risk and commodity management if they wish to explore further utility cost savings opportunities. This firm should be able to provide full service advisement over the term of the contract, provide market watch opportunities and identify any additional opportunities that may further reduce costs. Many of these opportunities may include: energy rates; utility bill auditing; energy data analytics; and efficiency improvements.

It is important that a rational, defensible strategy for purchasing commodity in volatile markets is incorporated. Examples include:

- Budgets that reflect sound market intelligence
 - An understanding of utility and market historical prices and trends
 - Awareness of seasonal opportunities (e.g. shoulder months)
 - Negotiation of fair contractual terms
 - An aggressive, market based price
 -
4. CEG recommends that Montgomery Township BOE explore an aggregated Demand Response Program that may be available in for its facilities. Demand response is the action of end users lowering their demand for electric (reducing consumption) in order to help balance supply and demand on the electric grid and ensure stability. The greatest need for demand response typically occurs during times of peak electricity demand, between the hours of 11 am and 6 pm, when extra strain is placed on the grid from situations such as increased air conditioning use on hot days or downed power lines

resulting from a storm. Significant incentives are available for clients enrolled in demand response programs. It is strongly recommended that Montgomery Township BOE utilize an experienced 3rd party unbiased energy consulting firm prior to initiating any demand response programs. This is recommended due to the potential conflicts with existing and/or future electric supply service agreements and transparency created by the evaluation of current programs and incentives available.

The recommendations and projected savings presented by Concord Engineering are based on current information provided by the Montgomery Township BOE for its facilities utility usage. Any projected savings presented with these recommendations are estimates only based on that information. It is recommended that further analysis and review of more recent utility data and actual Third Party Supplier invoices be performed prior to performing any of the presented recommendations.

VII. INSTALLATION FUNDING OPTIONS

CEG has reviewed various funding options for the facility owner to utilize in subsidizing the costs for installing the energy conservation measures noted within this report. Below are a few alternative funding methods:

A. Incentive Programs:

Pay For Performance

The New Jersey Smart Start Pay for Performance program includes incentives based on savings resulted from implemented ECMs. The program is available for all buildings that were audited as part of the NJ Clean Energy's Local Government Energy Audit Program. The facility's participation in the program is assisted by an approved program partner. An "Energy Reduction Plan" is created with the facility and approved partner to show at least 15% reduction in the building's current energy use. Multiple energy conservation measures implemented together are applicable toward the total savings of at least 15%. No more than 50% of the total energy savings can result from lighting upgrades / changes.

Total incentive is capped at 50% of the project cost. The program savings is broken down into three benchmarks; Energy Reduction Plan, Project Implementation, and Measurement and Verification. Each step provides additional incentives as the energy reduction project continues. The benchmark incentives are as follows:

1. Energy Reduction Plan – Upon completion of an energy reduction plan by an approved program partner, the incentive will grant \$0.10 per square foot between \$5,000 and \$50,000, and not to exceed 50% of the facility's annual energy expense. (Benchmark #1 is not provided in addition to the local government energy audit program incentive.)
2. Project Implementation – Upon installation of the recommended measures along with the "Substantial Completion Construction Report," the incentive will grant savings per KWH or Therm based on the program's rates. Minimum saving must be 15%. (Example \$0.11 / kWh for 15% savings, \$0.12/ kWh for 17% savings, ... and \$1.10 / Therm for 15% savings, \$1.20 / Therm for 17% saving, ...) Increased incentives result from projected savings above 15%.
3. Measurement and Verification – Upon verification 12 months after implementation of all recommended measures, that actual savings have been achieved, based on a completed verification report, the incentive will grant additional savings per kWh or Therm based on the program's rates. Minimum savings must be 15%. (Example \$0.07 / kWh for 15% savings, \$0.08/ kWh for 17% savings, ... and

\$0.70 / Therm for 15% savings, \$0.80 / Therm for 17% saving, ...)
Increased incentives result from verified savings above 15%.

Direct Install Program

The New Jersey Clean Energy's Direct Install Program is a state funded program that targets small commercial and industrial facilities with peak demand of less than 100 kW. This turnkey program is aimed at providing owners a seamless, comprehensive process for analysis, equipment replacement and financial incentives to reduce consumption, lower utility costs and improve profitability. The program covers up to 60% of the cost for eligible upgrades including lighting, lighting controls, refrigeration, HVAC, motors, variable speed drives, natural gas and food service. Participating contractors (refer to www.njcleanenergy.com) conduct energy assessments in addition to your standard local government energy audit and install the cost-effective measures. The following measures are potential candidates for Direct Install:

- Lighting Upgrade – All Facilities
- Lighting Controls – All Facilities

Smart Start Program

Prescriptive Measures - The New Jersey Clean Energy's Smart Start prescriptive measures incentives include unit pricing incentives for installation of energy efficient equipment and controls. Proposed equipment and controls must meet the minimum efficiency requirements as well as other application requirements. The Smart Start prescriptive incentives applicable for new construction, renovations, remodeling and equipment replacements, for a wide range of equipment including:

- Electric Chillers
- Gas Cooling
- Electric Unitary HVAC
- Ground Source Heat Pumps
- Gas Heating
- Variable Frequency Drives
- Gas Water Heating
- Premium Motors
- Prescriptive Lighting
- Lighting Controls
- Technical Studies

Custom Measures - The New Jersey Clean Energy's Smart Start prescriptive measures incentives include all measures not identified in the prescriptive measures category or measures that must have savings verified through additional analysis such as energy model simulations. Custom measures are intended to include savings as a result of unique energy efficiency measures, which are typically facility specific such as waste heat recovery. Custom incentives are provided based on the amount of energy saved and minimum internal rate of return in order to be eligible.

The incentive programs listed above have varied applicability for the Montgomery Township School District facilities energy projects. These incentives were not included in the financial calculations in the report and should be further analyzed by the BOE if they are looking to utilize this funding option. Additionally, the Smart Start Program is an incentive program based on prescriptive or custom measures and is applicable for all facility projects recommended within the District barring they are not receiving offset funding through the Pay for Performance Program. CEG recommends the Owner review the use of the above-listed funding options in addition to utilizing their standard method of financing for facilities upgrades in order to fund the proposed energy conservation measures. A brief listing of available financing options is noted below in section “B.”

B. Financing Options:Municipal Bonds

Municipal bonds are a bond issued by a city or other local government, or their agencies. Potential issuers of municipal bonds include cities, counties, redevelopment agencies, school districts, publicly owned airports and seaports, and any other governmental entity (or group of governments) below the state level. Municipal bonds may be general obligations of the issuer or secured by specified revenues. Interest income received by holders of municipal bonds is often exempt from the federal income tax and from the income tax of the state in which they are issued, although municipal bonds issued for certain purposes may not be tax exempt.

Power Purchase Agreement

Public Law 2008, Chapter 3 authorizes contracts of up to fifteen (15) years for energy purchase contracts commonly known as “power purchase agreements.” These are programs where the contracting unit (Owner) procures a contract for, in most cases, a third party to install, maintain, and own a renewable energy system. These renewable energy systems are typically solar panels, windmills or other systems that create renewable energy. In exchange for the third party’s work of installing, maintaining and owning the renewable energy system, the contracting unit (Owner) agrees to purchase the power generated by the renewable energy system from the third party at agreed upon energy rates.

Energy Savings Improvement Program (ESIP):

Public Law 2009, Chapter 4 authorizes government entities to make energy related improvements to their facilities and pay for the costs using the value of energy savings that result from the improvements. The “Energy Savings Improvement Program (ESIP)” law provides a flexible approach that can allow all government agencies in New Jersey to improve and reduce energy usage with minimal expenditure of new financial resources. This program provides public entities to make valuable facility infrastructure improvements that are associated with energy savings. All energy savings projects are eligible as long as the financing period does not extend beyond 15 years. The financing can be utilized for all aspects of energy efficiency project implementation including, energy savings plan development, engineering, construction management, construction management, commissioning, and measurement and verification.

This program provides the much needed financing for energy efficiency projects without the burden of increased debt. The program allows for procurement of financing without voter approval or extending existing debt. The program requires evaluation to ensure a positive cash-flow through the entire 15 year financing period. The first phase of implementing an ESIP is the development of an Energy Savings Plan (ESP) to verify the energy savings, construction costs, and overall financial model.

The underlining program requirement is the limitation of the project term to 15 years. The ESIP project size is open for multiple buildings to be included within one project. In addition all applicable incentive programs can also be utilized to help reduce the overall construction cost.

The following breakdown is an estimated project scope with the potential to qualify for the ESIP. An ESP is required to verify the costs and savings as part of an ESIP project.

**Table 8
ESIP -Total Entity Project Summary**

ENERGY SAVINGS IMPROVEMENT PROGRAM - POTENTIAL ENERGY EFFICIENCY PROJECT					
FACILITY ENERGY EFFICIENCY PROJECTS	ANNUAL ENERGY SAVINGS (\$)	PROJECT COST (\$)	SMART START INCENTIVES	CUSTOMER COST	SIMPLE PAYBACK
Montgomery High School & Board of Education	\$10,987	\$55,488	\$12,598	\$42,890	3.9
Upper Montgomery Middle School	\$28,323	\$422,096	\$15,786	\$406,310	14.3
Lower Montgomery Middle School	\$28,925	\$398,263	\$14,690	\$383,573	13.3
Orchard Hill Elementary School	\$22,018	\$178,271	\$9,405	\$168,866	7.7
Village Elementary School	\$40,184	\$554,011	\$27,430	\$526,581	13.7
Total Entity Project	\$130,438	\$1,608,129	\$79,909	\$1,528,220	11.7
Total Entity Energy Costs:			\$2,014,659		
Est. Total Entity Energy Savings:			\$130,438		
Overall Entity Percent Reduction:			6.5%		

VIII. ENERGY AUDIT ASSUMPTIONS

The assumptions utilized in this energy audit include but are not limited to following:

- A. Cost Estimates noted within this report are based on industry accepted costing data such as RS MeansTM Cost Data, contractor pricing and engineering estimates. All cost estimates for this level of auditing are +/- 20%. Prevailing wage rates for the specified region has been utilized to calculate installation costs. The cost estimates indicated within this audit should be utilized by the owner for prioritizing further project development post the energy audit. Project development would include investment grade auditing and detailed engineering.
- B. Energy savings noted within this audit are calculated utilizing industry standard procedures and accepted engineering assumptions. For this level of auditing, energy savings are not guaranteed.
- C. Information gathering for each facility is strongly based on interviews with operations personnel. Information dependent on verbal feedback is used for calculation assumptions including but not limited to the following:
 - a. operating hours
 - b. equipment type
 - c. control strategies
 - d. scheduling
- D. Information contained within the major equipment list is based on the existing owner documentation where available (drawings, O&M manuals, etc.). If existing owner documentation is not available, catalog information is utilized to populate the required information.
- E. Equipment incentives and energy credits are based on current pricing and status of rebate programs. Rebate availability is dependent on the individual program funding and applicability.
- F. Equipment (HVAC, Plumbing, Electrical, & Lighting) noted within an ECM recommendation is strictly noted as a **basis for calculation** of energy savings. The owner should use this equipment information as a benchmark when pursuing further investment grade project development and detailed engineering for specific energy conservation measures.
- G. Utility bill annual averages are utilized for calculation of all energy costs unless otherwise noted. Accuracy of the utility energy usage and costs are based on the information provided. Utility information including usage and costs is estimated where incomplete data is provided.