



Local Government Energy Audit Report

Health Professions

March 11, 2020

Prepared for:

Bergen Community College
400 Paramus Road
Paramus, NJ 07652

Prepared by:

TRC
900 Route 9 North
Woodbridge, NJ 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. Cost estimates include material and labor pricing associated with installation of primary recommended equipment only. Cost estimates do not include demolition or removal of hazardous waste. We encourage the owner of the facility to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2020 TRC Companies, Inc. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents

1	Executive Summary.....	1
1.1	Planning Your Project	4
	Pick Your Installation Approach	4
	More Options from Around the State	6
2	Existing Conditions.....	7
2.1	Site Overview.....	7
2.2	Building Occupancy	7
2.3	Building Envelope	8
2.4	Lighting Systems.....	9
2.5	Air Handling Systems.....	10
	Building Exhaust.....	10
	Packaged Units	10
	Unitary HVAC Equipment	11
2.6	Heating Hot Water System.....	11
2.7	Building Energy Management Systems (EMS)	12
2.8	Domestic Hot Water	12
2.9	Plug Load & Vending Machines.....	13
2.10	Water-Using Systems	13
3	Energy Use and Costs	14
3.1	Electricity	15
3.2	Natural Gas	16
3.3	Benchmarking.....	17
	Tracking Your Energy Performance	18
4	Energy Conservation Measures	19
4.1	Lighting	21
	ECM 1: Retrofit Fixtures with LED Lamps.....	21
4.2	Lighting Controls.....	22
	ECM 2: Install Occupancy Sensor Lighting Controls	22
	ECM 3: Install High/Low Lighting Controls	22
5	Energy Efficient Best Practices.....	23
	Energy Tracking with ENERGY STAR® Portfolio Manager®	23
	Lighting Maintenance.....	23
	Motor Maintenance	23
	Economizer Maintenance	23
	AC System Evaporator/Condenser Coil Cleaning	24
	HVAC Filter Cleaning and Replacement	24
	Boiler Maintenance.....	24
	Furnace Maintenance	24
	Plug Load Controls.....	24
	Water Conservation	25

Procurement Strategies	25
6 On-site Generation	26
6.1 Solar Photovoltaic	27
6.2 Combined Heat and Power	28
7 Project Funding and Incentives.....	29
7.1 SmartStart	30
7.2 Direct Install	31
7.3 Pay for Performance - Existing Buildings.....	32
7.4 Combined Heat and Power	33
7.5 Energy Savings Improvement Program.....	34
7.6 SREC Registration Program.....	35
8 Energy Purchasing and Procurement Strategies	36
8.1 Retail Electric Supply Options.....	36
8.2 Retail Natural Gas Supply Options	36
Appendix A: Equipment Inventory & Recommendations	A-1
Appendix B: ENERGY STAR® Statement of Energy Performance.....	B-1
Appendix C: Glossary	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPB) has sponsored this Local Government Energy Audit (LGEA) report for Health Professions building. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT




Annual Utilities

Costs: \$142,028

Electricity:
1,079,575 kWh

Natural Gas:
24,709 Therms

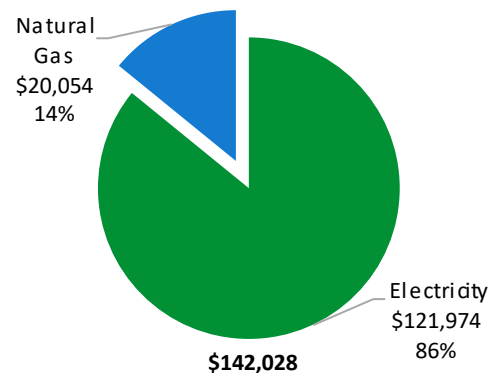

ENERGY STAR®
Benchmarking Score

N/A
(1-100 scale)

A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs.

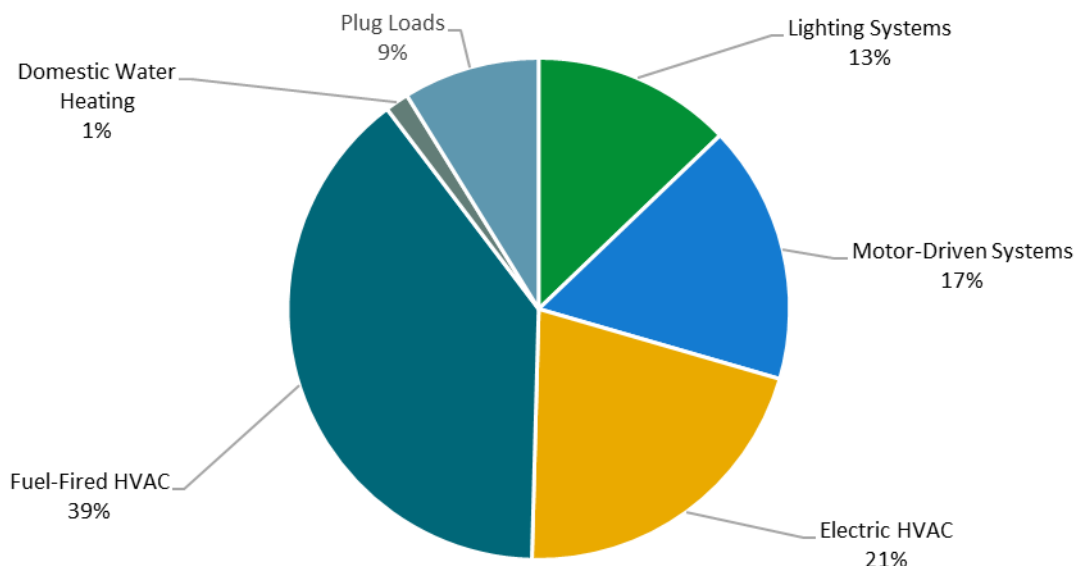


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$58,860
Potential Rebates & Incentives ¹	\$14,006
Annual Cost Savings	\$9,679
Annual Energy Savings	Electricity: 86,973 kWh
Greenhouse Gas Emission Savings	43 Tons
Simple Payback	4.6 Years
Site Energy Savings (all utilities)	5%

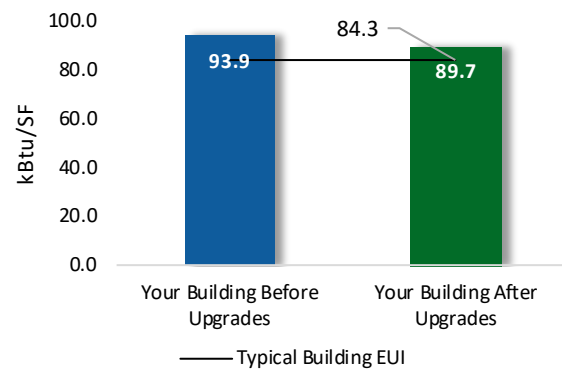

Scenario 2: Cost Effective Package²

Installation Cost	\$58,860
Potential Rebates & Incentives	\$14,006
Annual Cost Savings	\$9,679
Annual Energy Savings	Electricity: 86,973 kWh
Greenhouse Gas Emission Savings	43 Tons
Simple Payback	4.6 Years
Site Energy Savings (all utilities)	5%

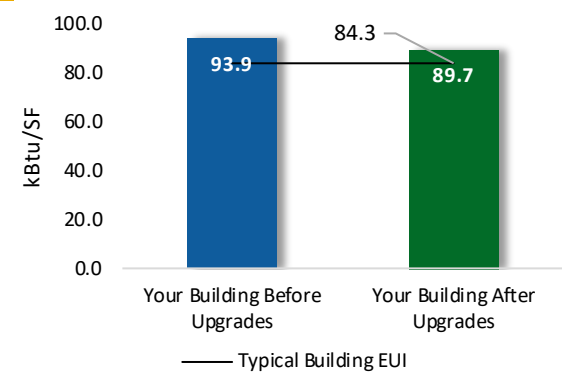

On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other Program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304
ECM 1	Retrofit Fixtures with LED Lamps	Yes	68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304
Lighting Control Measures			18,474	1.4	-4	\$2,056	\$10,395	\$7,210	\$3,185	1.5	18,151
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	605	0.1	0	\$67	\$270	\$0	\$270	4.0	594
ECM 3	Install High/Low Lighting Controls	Yes	17,869	1.3	-4	\$1,989	\$10,125	\$7,210	\$2,915	1.5	17,557
TOTALS (COST EFFECTIVE MEASURES)			86,973	15.7	-18	\$9,679	\$58,860	\$14,006	\$44,854	4.6	85,454
TOTALS (ALL MEASURES)			86,973	15.7	-18	\$9,679	\$58,860	\$14,006	\$44,854	4.6	85,454

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey's Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Retrofit Fixtures with LED Lamps	X		X
ECM 2	Install Occupancy Sensor Lighting Controls			X
ECM 3	Install High/Low Lighting Controls	X		X

Figure 3 – Funding Options



New Jersey's Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.

Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for the Health Professions building. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On October 16, 2019, TRC performed an energy audit at the Health Professions building located at Bergen County Community College in Paramus, New Jersey. TRC met with Pascal Ricatto to review the facility operations and help focus our investigation on specific energy-using systems.

The Health Professions building is a three-story, 65,525 square foot building built in 2016. Spaces include: classrooms, clinics, offices, conference rooms, electrical and mechanical closets, hallways, stairwells, corridors, locker rooms, labs, x-ray room, dental lab, prep room, storage rooms. The building is 100% heated and cooled.

2.2 Building Occupancy

The facility is occupied year-round, with typical weekday occupancy of 8:00 AM to 10:00 PM, Monday through Thursday and Saturday. This building is closed on Fridays and Sundays, although the custodial staff is there every day 24/7. Typical weekday occupancy is 46 staff and 612 students.

Summer occupancy includes summer classes, Monday through Thursday from 8:00 AM to 10:00 PM, and continuing maintenance activities.

Building Name	Weekday/Weekend	Operating Schedule
Health Professions	Monday - Thursday	8:00 AM - 10:00 PM
	Friday	Closed
	Saturday	8:00 AM - 10:00 PM
	Sunday	Closed
Summer Schedule	Monday - Thursday	8:00 AM - 10:00 PM
	Friday - Sunday	No Use
Custodial Activities	Everyday	24/7

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are constructed with a brick veneer and large windows in some areas. There are also metal fins that protrude from the front of the building and shield some natural light and heat from entering the space. The roof is flat and covered with black membrane and is in good condition.

Most of the windows are fixed, double pane with metal frames and some have internal shading. The glass-to-frame seals are in good condition. Exterior doors are glass with metal frames and are in good condition with worn door seals. Degraded window and door seals increase drafts and outside air infiltration.



Building Envelope



Roof Material



Exterior Door



Exterior Window


2.4 Lighting Systems

The primary interior lighting system uses 32-Watt U-bend and linear fluorescent T8 and LED lamps. Additionally, there are some compact fluorescent lamps (CFL), halogen incandescent, and LED general purpose lamps.


Fixture types include 1-lamp or 2-lamp, 2-foot or 4-foot long recessed troffer fixtures and 2-foot fixtures with U-bend tube lamps. There are also several halogen incandescent dental lights and recessed can fixtures are used throughout the facility. Some other fixture types include: surface mount, ceiling mount, decorative pendent mount, decorative wall mount, task lighting fixtures, cove lighting fixtures, and direct/indirect fixtures.

Most fixtures are in good condition. Interior lighting levels were generally sufficient.

All exit signs are LED.



U-Bend Lamps



Cove Type Lighting




*Decorative Wall-Mount
Fixture*



Wall-Mount Fixture

Most lighting fixtures are controlled by occupancy sensors and the remainder by wall switches. Storage room lighting is controlled by time switches.



*Ceiling Mount Occupancy
Sensor*



*Wall Mount Occupancy
Sensor*



Time Switch



Wall Switch

Exterior fixtures include wall packs and recessed can fixtures with compact fluorescent (CFL) and LED lamps.

Exterior light fixtures are controlled by a time clock.



Exterior Recessed Can Fixture



LED Wall Pack

2.5 Air Handling Systems

Building Exhaust

The building has fractional horsepower, general exhaust fans. These are all in good condition and are standard efficiency.

Packaged Units

Heating and cooling is provided to classrooms and central building areas by packaged roof top units (RTUs), the majority of which are 50 tons in cooling capacity and have an estimated efficiency of 10.0 EER. EER is the energy efficiency ratio with higher values indicating higher efficiencies. These RTUs are equipped with a DX Coil for cooling and a gas-fired burner for heating. Each unit has a heating capacity of 283.5 Mbh and a heating efficiency of about 81%. Packaged units are equipped with economizers which are in fair operating condition.

Each unit has a 20 hp standard efficiency, variable frequency drive (VFD) driven supply fan motor and 1.5 hp standard efficiency, VFD driven exhaust fan. The RTUs are within their useful life and in good condition. Each of these units are variable air volume (VAV) and are controlled by the building energy management system (BMS).

Unit	Cooling Capacity (Tons)	Cooling Efficiency (EER)	Heating Capacity (MBH)	Heating Efficiency (AFUE)
RTU-1E	50.00	10.0	283.50	81%
RTU-2E	50.00	10.0	283.50	81%
RTU-3E	50.00	10.0	283.50	81%
RTU-1W	50.00	10.0	283.50	81%
RTU-2W	50.00	10.0	283.50	81%
RTU-3W	50.00	10.0	283.50	81%

Refer to Appendix A for detailed information about each unit.




Roof Top Unit



Roof Top Units

Unitary HVAC Equipment

There are three, 2-ton, high efficiency split air-conditioning (AC) systems, AC-1, AC-2, and AC-3. They serve IDF closets. Split AC systems are controlled by programmable thermostats in the space. There are electric resistance heaters in the stairwells of the building. This unitary electric HVAC equipment is in good condition.

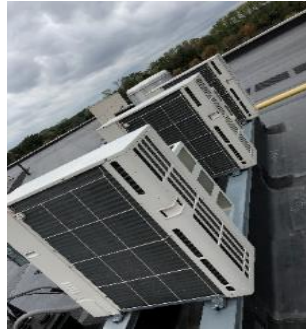

Split AC Systems – Outdoor Condensing Units



Split AC Systems – Indoor Units

2.6 Heating Hot Water System

Two Lochinvar 1,380 Mbh high efficiency condensing hot water boilers serve the building VAV boxes for reheat purposes. The burners are fully modulating with a nominal efficiency of 92%. The boilers are configured in an automated control scheme. Both boilers are required under high load conditions. Installed in 2016, they are in good condition.

The hydronic distribution system is a two-pipe, heating-only system. The boilers serve a primary-only distribution system with two VFD controlled 7.5 HP heating hot water pumps operating in lead/lag fashion. There are two VFD controlled 1.5 hp boiler water feed pumps. The hot water piping is insulated, and the insulation is in good condition.

Hot water is supplied at 186°F when the outside air temperature is low, and the setpoint is reduced linearly based on outdoor air temperature. The hot water return temperature is typically 157°F. The system is locked out at an outside temperature of 66°F. The boilers are controlled by the Trane EMS. The graphic interface is assumed to be a read out and override.




Condensing Hot Water Boiler




Hot Water Pumps and VFDs

2.7 Building Energy Management Systems (EMS)


A Trane building energy management system (EMS) controls the roof top equipment, hot water loop pumps, and boiler operation. The EMS provides equipment scheduling control, monitors and controls space temperatures, supply air temperatures and humidity. On the day of the audit, the active setpoints were on average set for 70°F and were in occupied heating mode. Occupied mode is set for 6:00 AM to 10:00 PM, Monday through Saturday with optimal start at 4:00 AM. Temperature sensors in each space allow for viewing current space temperatures, heating/cooling mode and adjusting active set points as needed.

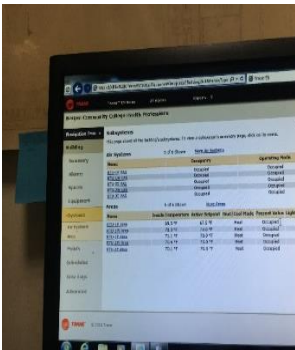


Systems Graphic

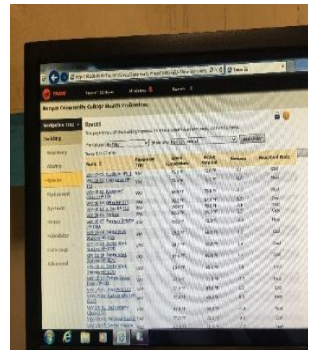

Spaces Graphic

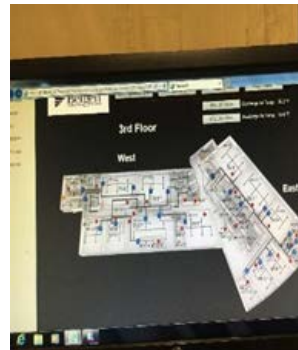

3rd Floor Graphic

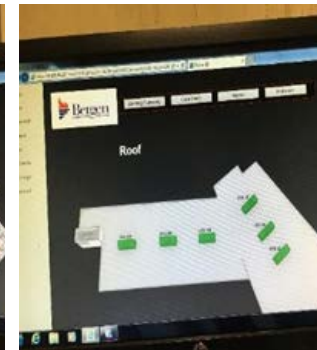

Roof Graphic

2.8 Domestic Hot Water

Hot water is produced with a 119 gallon, 400 MBh gas-fired, condensing storage tank water heater with a 95% efficiency. At the time of the site visit, the domestic water heaters were set at 114°F. Fractional hp circulation pumps distribute water to end uses. The domestic hot water pipes are insulated and the insulation is in good condition.



Storage Tank Water Heater



Display

2.9 Plug Load & Vending Machines

You may wish to consider paying attention to minimizing your plug load usage. This report makes suggestions for ECMs in this area as well as Energy Efficient Best Practices.

There are 268 computer work stations throughout the facility. Plug loads throughout the building include general classroom and office equipment. There are also large loads due to the various miscellaneous medical equipment in the building such as x-ray machines and hospital beds. There are classroom and office typical loads such as smart boards, printers, coffee machines, microwaves, mini fridges, projectors, and TVs. We did not note any refrigerated beverage or non-refrigerated vending machines.



Hospital Bed



Office Typical Loads



TV



Miscellaneous Medical Equipment

2.10 Water-Using Systems

There are 14 restrooms with toilets, urinals, and sinks. Faucet flow rates are at 1.0 gallons per minute (gpm) or higher.




Low Flow Aerator

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	1,079,575 kWh	\$121,974
Natural Gas	24,709 Therms	\$20,054
Total		\$142,028

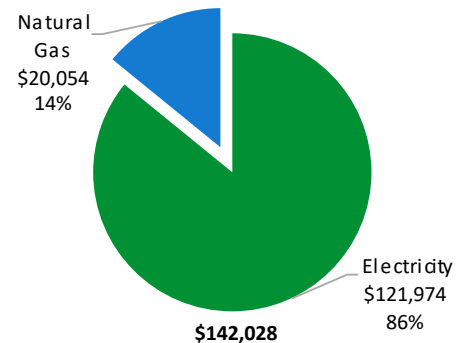

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.

Campus buildings are served by a main electrical meter, therefore, the historical use for this building was apportioned. Please see the following sections, "Electricity" for further discussion. This facility is served by a separate gas meter and therefore the historical gas use for this building is based directly on the bills provided.


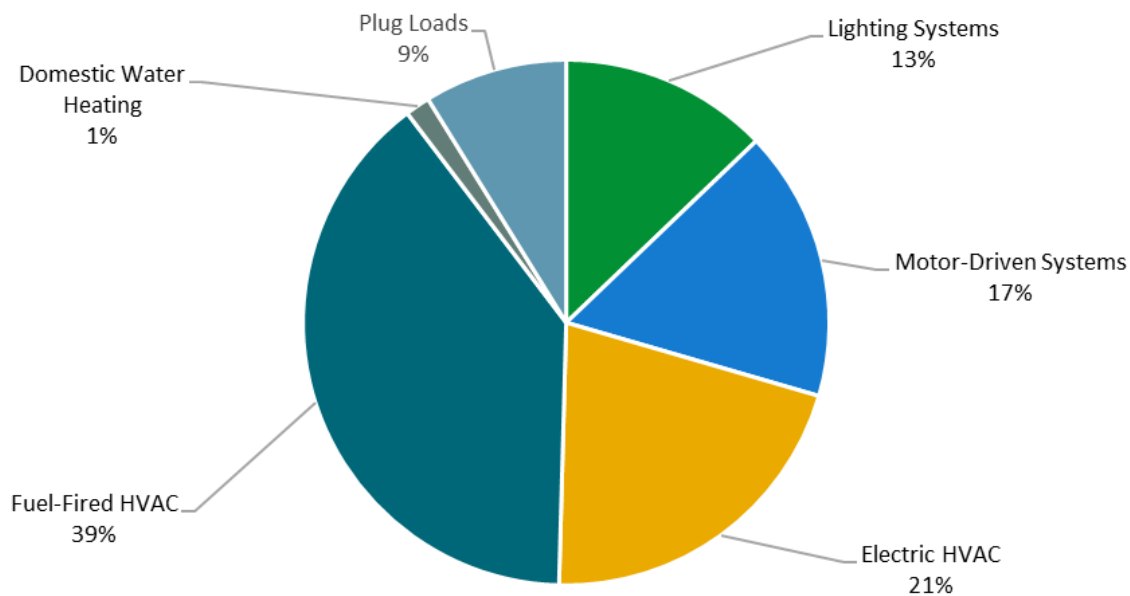


Figure 5 - Energy Balance

3.1 Electricity

PSE&G delivers electricity under rate class LPLS, with electric production provided by Constellation, a third-party supplier.

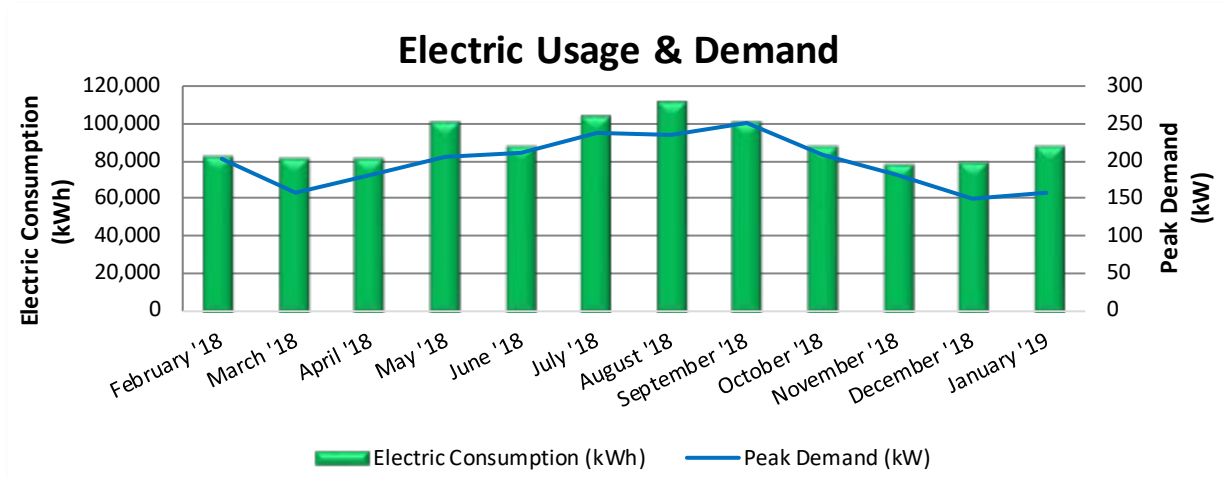


Electric Billing Data						
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost	TRC Estimated Usage?
2/28/18	28	82,163	203	\$788	\$9,283	Yes
3/31/18	31	81,280	158	\$614	\$9,183	Yes
4/30/18	30	81,105	180	\$699	\$9,163	Yes
5/31/18	31	100,413	206	\$799	\$11,345	Yes
6/30/18	30	87,933	211	\$819	\$9,935	Yes
7/31/18	31	103,184	237	\$918	\$11,658	Yes
8/31/18	31	110,860	234	\$907	\$12,525	Yes
9/30/18	30	100,266	251	\$972	\$11,328	Yes
10/31/18	31	87,356	208	\$805	\$9,870	Yes
11/30/18	30	78,080	181	\$703	\$8,822	Yes
12/31/18	31	78,943	151	\$584	\$8,919	Yes
1/31/19	31	87,991	156	\$606	\$9,942	Yes
Totals	365	1,079,575	251	\$9,212	\$121,974	
Annual	365	1,079,575	251	\$9,212	\$121,974	

Notes:

- Peak demand of 251 kW occurred in September 2018.
- Average demand over the past 12 months was 198 kW.
- The average electric cost over the past 12 months was \$0.113/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- For the purposes of this report, the baseline data has been estimated based on the main meter for the campus, equipment at this building and the square footage of the building in comparison to the campus.

3.2 Natural Gas

PSE&G delivers natural gas under rate class LVG, with natural gas supply provided by Direct Energy, a third-party supplier.

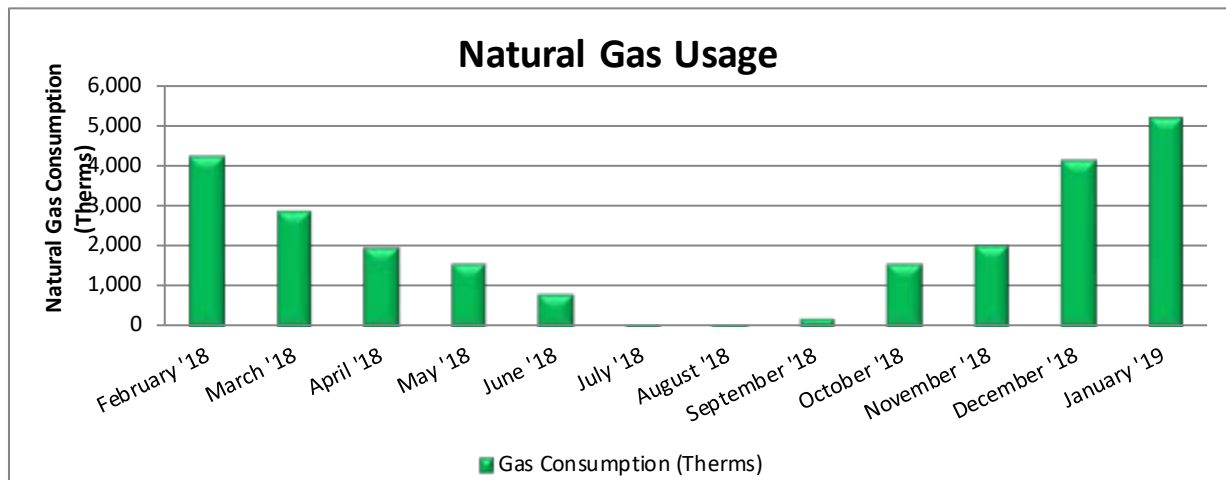

Gas Billing Data				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
2/27/18	28	4,247	\$3,467	Yes
3/28/18	31	2,895	\$2,584	Yes
4/27/18	30	1,960	\$1,091	Yes
5/29/18	31	1,563	\$900	Yes
6/21/18	30	817	\$525	Yes
7/30/18	31	72	\$152	No
8/28/18	31	79	\$155	No
9/28/18	30	224	\$246	No
10/26/18	31	1,549	\$1,082	No
11/28/18	30	2,037	\$2,472	Yes
12/27/18	31	4,104	\$3,363	No
1/28/19	31	5,162	\$4,016	No
Totals	365	24,709	\$20,054	
Annual	365	24,709	\$20,054	

Notes:

- The average gas cost for the past 12 months is \$0.812/therm, which is the blended rate used throughout the analysis.
- Gas service is provided to this building by a dedicated meter, separate from the main campus gas meter.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score

N/A

Due to its unique characteristics and being a part of a master metered college campus, this building is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

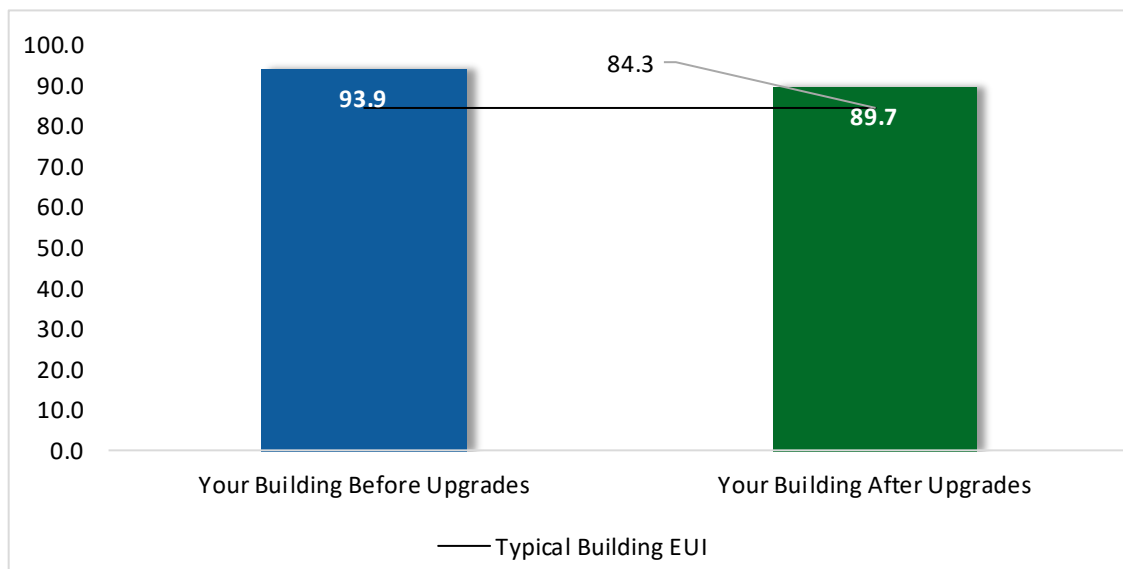


Figure 6 - Energy Use Intensity Comparison³

This building performs at, or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

³ Based on all evaluated ECMs

Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website⁴.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304
ECM 1	Retrofit Fixtures with LED Lamps	Yes	68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304
Lighting Control Measures			18,474	1.4	-4	\$2,056	\$10,395	\$7,210	\$3,185	1.5	18,151
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	605	0.1	0	\$67	\$270	\$0	\$270	4.0	594
ECM 3	Install High/Low Lighting Controls	Yes	17,869	1.3	-4	\$1,989	\$10,125	\$7,210	\$2,915	1.5	17,557
TOTALS			86,973	15.7	-18	\$9,679	\$58,860	\$14,006	\$44,854	4.6	85,454

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304
ECM 1	Retrofit Fixtures with LED Lamps	68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304
Lighting Control Measures		18,474	1.4	-4	\$2,056	\$10,395	\$7,210	\$3,185	1.5	18,151
ECM 2	Install Occupancy Sensor Lighting Controls	605	0.1	0	\$67	\$270	\$0	\$270	4.0	594
ECM 3	Install High/Low Lighting Controls	17,869	1.3	-4	\$1,989	\$10,125	\$7,210	\$2,915	1.5	17,557
TOTALS		86,973	15.7	-18	\$9,679	\$58,860	\$14,006	\$44,854	4.6	85,454

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304
ECM 1	Retrofit Fixtures with LED Lamps	68,499	14.3	-14	\$7,623	\$48,465	\$6,796	\$41,669	5.5	67,304

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Retrofit Fixtures with LED Lamps

Replace compact fluorescent, linear fluorescent, and U-bend fluorescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected building areas: exterior lighting fixtures, the vestibule, third floor hallway, classroom HP211, and all areas with fluorescent fixtures with T8 tubes.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		18,474	1.4	-4	\$2,056	\$10,395	\$7,210	\$3,185	1.5	18,151
ECM 2	Install Occupancy Sensor Lighting Controls	605	0.1	0	\$67	\$270	\$0	\$270	4.0	594
ECM 3	Install High/Low Lighting Controls	17,869	1.3	-4	\$1,989	\$10,125	\$7,210	\$2,915	1.5	17,557

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 2: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected building areas: mechanical closet HP130.

ECM 3: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be taken into account when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected building areas: hallways.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as an occupant approaches.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁵. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Lighting Maintenance



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control, or dampers that are stuck or improperly adjusted.

⁵ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.


Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the water side or fire side of the boiler.

Furnace Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

Plug Load Controls



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips⁶. Your local utility may offer incentives or rebates for this equipment.

⁶ For additional information refer to "Assessing and Reducing Plug and Process Loads in Office Buildings" <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense® website⁷ or download a copy of EPA's "WaterSense® at Work: Best Management Practices for Commercial and Institutional Facilities"⁸ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense® products where available.

⁷ <https://www.epa.gov/watersense>.

⁸ <https://www.epa.gov/watersense/watersense-work-0>.

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has **high** potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the **high** potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

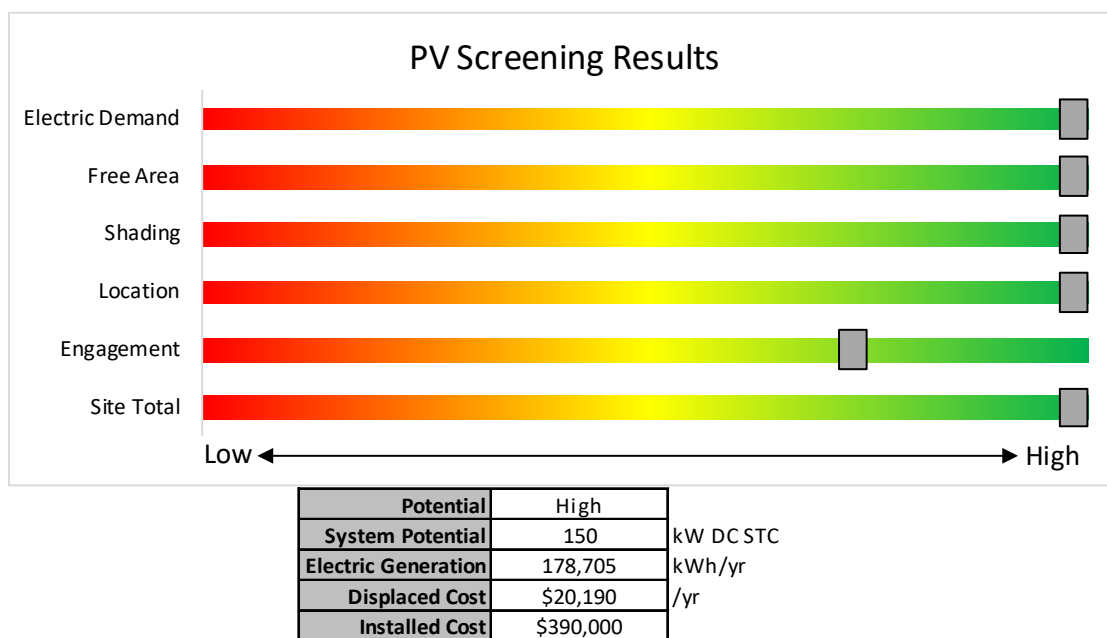


Figure 9 - Photovoltaic Screening

Solar Renewable Energy Certificate (SREC) Registration Program (SRP)

Rebates are not available for solar projects, but owners of solar projects **MUST** register their projects in the SREC Registration Program before starting construction. Once your PV system is up and running, you periodically earn credits, which can then be sold on the open market for up to 15 years.

If you are considering installing solar photovoltaics on your building, visit www.njcleanenergy.com/srec for more information about the SREC Registration Program.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- **Basic Info on Solar PV in NJ:** www.njcleanenergy.com/whysolar.
- **NJ Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs.
- **Approved Solar Installers in the NJ Market:** www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1.

6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has **no** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does **not** appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

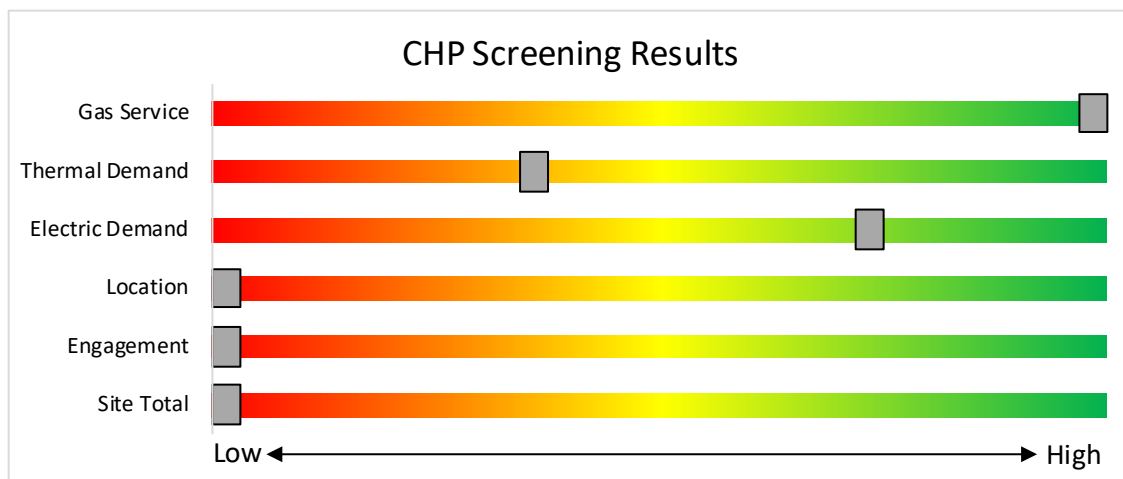


Figure 10 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation:
http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/.

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			

7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficient equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

*Electric Chillers
Electric Unitary HVAC
Gas Cooling
Gas Heating
Gas Water Heating
Ground Source Heat Pumps
Lighting*

*Lighting Controls
Refrigeration Doors
Refrigeration Controls
Refrigerator/Freezer Motors
Food Service Equipment
Variable Frequency Drives*

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.

7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Based on the master metering situation for the campus, the work proposed by this energy audit report would not be eligible for the DI program.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Pay for Performance - Existing Buildings



Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures that results in at least 15% source energy savings, and lighting cannot make up the majority of the savings. P4P is a generally a good option for medium-to-large sized facilities looking to implement as many

measures as possible under a single project to achieve deep energy savings. This program has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program.

Incentives

Incentives are based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

Contact one of the pre-approved consultants and contractors ("Partners"). Under direct contract to you, they will help further evaluate the measures identified in this report through development of the energy reduction plan), assist you in implementing selected measures, and verify actual savings one year after the installation. Your Partner will also help you apply for incentives.

Approval of the final scope of work is required by the program prior to installation. Installation can be done by the contractor of your choice (some P4P Partners are also contractors) or by internal staff, but the Partner remains involved throughout construction to ensure compliance with the program requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: www.njcleanenergy.com/P4P.

7.4 Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

Incentives

Eligible Technologies	Size (Installed Rated Capacity) ¹	Incentive (\$/kW)	% of Total Cost Cap per Project ³	\$ Cap per Project ³		
Powered by non-renewable or renewable fuel source ⁴	≤500 kW	\$2,000	30-40% ²	\$2 million		
Gas Internal Combustion Engine	>500 kW - 1 MW	\$1,000				
Gas Combustion Turbine	> 1 MW - 3 MW	\$550	30%	\$3 million		
Microturbine	>3 MW	\$350				
Fuel Cells with Heat Recovery						
Waste Heat to Power*	<1 MW	\$1,000	30%	\$2 million		
	> 1MW	\$500		\$3 million		

*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

How to Participate

You work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at: www.njcleanenergy.com/CHP.

7.5 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program description and application can be found at: www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

7.6 SREC Registration Program

The SREC (Solar Renewable Energy Certificate) Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey SRECs. SRECs are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SRECs to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar Renewable Portfolio Standard. Purchasing SRECs can help them meet those requirements. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period fluctuates depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.

8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁹.

8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹⁰.

⁹ www.state.nj.us/bpu/commercial/shopping.html.

¹⁰ www.state.nj.us/bpu/commercial/shopping.html.

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Front of Building	3	Compact Fluorescent: (1) 18W Plug-In Lamp	Timeclock		18	5,096	1	Relamp	No	3	LED Lamps: (1) 12W Plug-In Lamp	Timeclock	12	5,096	0.0	92	0	\$10	\$38	\$3	3.3
Vestibule	1	Compact Fluorescent: (1) 18W Plug-In Lamp	None		18	8,760	1	Relamp	No	1	LED Lamps: (1) 12W Plug-In Lamp	None	12	8,760	0.0	58	0	\$6	\$13	\$1	1.8
Vestibule	1	LED Lamps: (1) 40W LED Corn Bulb	None		40	8,760		None	No	1	LED Lamps: (1) 40W LED Corn Bulb	None	40	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Building	70	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	70	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Third Floor Hallway	4	LED Lamps: (1) 40W LED Corn Bulb	None	S	40	8,760	3	None	Yes	4	LED Lamps: (1) 40W LED Corn Bulb	High/Low Control	40	6,044	0.0	478	0	\$53	\$0	\$0	0.0
Third Floor Hallway	9	Compact Fluorescent: (1) 18W Plug-In Lamp	None	S	18	8,760	1, 3	Relamp	Yes	9	LED Lamps: (1) 12W Plug-In Lamp	High/Low Control	12	6,044	0.1	843	0	\$94	\$113	\$9	1.1
Third Floor Hallway	10	LED - Linear Tubes: (2) 4' Lamps	None	S	29	8,760	3	None	Yes	10	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,044	0.1	866	0	\$96	\$450	\$350	1.0
Third Floor Hallway	12	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760	3	None	Yes	12	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.1	1,183	0	\$132	\$450	\$420	0.2
Classroom HP302	20	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	20	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,923	0	\$214	\$1,449	\$200	5.8
Classroom HP303	5	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	5	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	481	0	\$53	\$362	\$50	5.8
Office HP305	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Classroom HP304	20	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	20	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,923	0	\$214	\$1,449	\$200	5.8
Office HP306	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP307	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP308	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Classroom HP309	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	12	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,154	0	\$128	\$870	\$120	5.8
Office HP310	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP310B	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP310C	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP310A	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Conference Room HP311	8	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	769	0	\$86	\$580	\$80	5.8
Office HP312	8	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	769	0	\$86	\$580	\$80	5.8
Office HP312A	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	577	0	\$64	\$435	\$60	5.8
Stair A	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	S	29	3,014		None	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Hallway	3	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760	3	None	Yes	3	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.0	296	0	\$33	\$225	\$105	3.6

	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis								
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years		
Hallway	9	LED Lamps: (1) 40W LED Corn Bulb	None	S	40	8,760	3	None	Yes	9	LED Lamps: (1) 40W LED Corn Bulb	High/Low Control	40	6,044	0.1	1,075	0	\$120	\$450	\$315	1.1		
Hallway	4	LED Lamps: (1) 12W Plug-In Lamp	None	S	12	8,760	3	None	Yes	4	LED Lamps: (1) 12W Plug-In Lamp	High/Low Control	12	6,044	0.0	143	0	\$16	\$225	\$140	5.3		
Office HP313	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8		
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8		
Rest Room	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8		
Rest Room	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Hallway	2	LED - Fixtures: Decorative: Other	None	S	20	8,760	3	None	Yes	2	LED - Fixtures: Decorative: Other	High/Low Control	20	6,044	0.0	119	0	\$13	\$225	\$70	11.7		
Hallway	7	LED - Linear Tubes: (1) 4' Lamp	None	S	15	8,760	3	None	Yes	7	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,044	0.0	303	0	\$34	\$450	\$245	6.1		
Copy Room HP316	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8		
IDF Closet HP318	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,368	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,368	0.0	317	0	\$35	\$73	\$20	1.5		
Hallway	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	None	S	62	8,760	1, 3	Relamp	Yes	15	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.4	5,670	-1	\$631	\$1,762	\$675	1.7		
HP319	18	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	18	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,731	0	\$193	\$1,304	\$180	5.8		
Rest Room	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	S	33	3,014		None	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Rest Room	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Office HP322	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8		
Classroom Lab HP324	12	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	S	17	3,014		None	No	12	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Classroom Lab HP324	11	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	11	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	1,058	0	\$118	\$797	\$110	5.8		
Control Room HP324B	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	288	0	\$32	\$217	\$30	5.8		
Storage HP324A	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	40	0	\$4	\$145	\$20	28.2		
Classroom HP323	18	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	18	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,731	0	\$193	\$1,304	\$180	5.8		
Classroom HP325	18	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	18	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,731	0	\$193	\$1,304	\$180	5.8		
Classroom HP326	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	12	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,154	0	\$128	\$870	\$120	5.8		
Conference Room HP327	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	12	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,154	0	\$128	\$870	\$120	5.8		
Third Floor Hallway	5	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760	3	None	Yes	5	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.0	493	0	\$55	\$225	\$175	0.9		

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8
Rest Room	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Storage HP329	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	20	0	\$2	\$72	\$10	28.2
Office HP330	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Office HP331	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Office HP332	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Office HP333	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Electrical Closet HP334	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,368	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,368	0.0	317	0	\$35	\$73	\$20	1.5
Stair C	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	S	29	3,014		None	No	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Second Floor Hallway	7	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760	3	None	Yes	7	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.1	690	0	\$77	\$450	\$245	2.7
Office HP234	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Office HP233	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	20	0	\$2	\$72	\$10	28.2
Office HP235	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Office HP236	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Office HP237	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP238	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Electrical Closet HP239	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,368	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,368	0.0	317	0	\$35	\$73	\$20	1.5
Storage HP231	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.1	80	0	\$9	\$290	\$40	28.2
Hallway	16	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760	3	None	Yes	16	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.1	1,577	0	\$176	\$675	\$560	0.7
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8
Rest Room	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Classroom HP230	19	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	19	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,827	0	\$203	\$1,377	\$190	5.8
Storage	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	40	0	\$4	\$145	\$20	28.2
Classroom HP228	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	12	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,154	0	\$128	\$870	\$120	5.8
Classroom HP227	18	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	18	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,731	0	\$193	\$1,304	\$180	5.8

	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis								
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Lab HP226	10	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	10	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	961	0	\$107	\$725	\$100	5.8	
Lab HP226	4	LED - Fixtures: Shelf-Mounted Display and Task Lights	Wall Switch	S	200	200		None	No	4	LED - Fixtures: Shelf-Mounted Display and Task Lights	Wall Switch	200	200	0.0	0	0	\$0	\$0	\$0	0.0	
Prep Room HP225	8	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	769	0	\$86	\$580	\$80	5.8	
Storage HP224	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.1	80	0	\$9	\$290	\$40	28.2	
Rest Room	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	S	33	3,014		None	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	0	0	\$0	\$0	\$0	0.0	
Rest Room	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0	
Rest Room	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	S	33	3,014		None	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	0	0	\$0	\$0	\$0	0.0	
Rest Room	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0	
Classroom HP221	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	15	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,442	0	\$160	\$1,087	\$150	5.8	
Classroom HP220	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	15	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,442	0	\$160	\$1,087	\$150	5.8	
IDF Closet HP219	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,368	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,368	0.0	317	0	\$35	\$73	\$20	1.5	
Hallway	15	LED Lamps: (1) 40W LED Corn Bulb	None	S	40	8,760	3	None	Yes	15	LED Lamps: (1) 40W LED Corn Bulb	High/Low Control	40	6,044	0.1	1,792	0	\$199	\$675	\$525	0.8	
Hallway	3	LED - Fixtures: Decorative: Other	None	S	50	8,760	3	None	Yes	3	LED - Fixtures: Decorative: Other	High/Low Control	50	6,044	0.0	448	0	\$50	\$225	\$105	2.4	
Hallway	2	LED - Fixtures: Decorative: Other	None	S	20	8,760	3	None	Yes	2	LED - Fixtures: Decorative: Other	High/Low Control	20	6,044	0.0	119	0	\$13	\$225	\$70	11.7	
Hallway	17	LED - Linear Tubes: (1) 4' Lamp	None	S	15	8,760	3	None	Yes	17	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,044	0.1	736	0	\$82	\$675	\$595	1.0	
Closet HP218	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8	
Office HP217	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8	
Copy Room HP216	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8	
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8	
Rest Room	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0	
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8	
Rest Room	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0	
Office HP213	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8	
Office HP212	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8	
Office HP212A	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	577	0	\$64	\$435	\$60	5.8	

Existing Conditions														Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Office	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Second Floor Hallway	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	None	S	62	8,760	1, 3	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.1	1,512	0	\$168	\$515	\$180	2.0
Classroom HP211	16	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	16	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,538	0	\$171	\$1,159	\$160	5.8
Classroom HP211	3	Compact Fluorescent: (1) 18W Plug-In Lamp	Occupancy Sensor	S	18	3,014	1	Relamp	No	3	LED Lamps: (1) 12W Plug-In Lamp	Occupancy Sensor	12	3,014	0.0	60	0	\$7	\$38	\$3	5.2
Lab HP210	20	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	20	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,923	0	\$214	\$1,449	\$200	5.8
Second Floor Hallway	11	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760	3	None	Yes	11	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.1	1,084	0	\$121	\$450	\$385	0.5
Office HP208	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP206	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Lab HP207	22	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	22	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.5	2,115	0	\$235	\$1,594	\$220	5.8
Office HP207A	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8
Office HP205	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP204	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Office HP203	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	288	0	\$32	\$217	\$30	5.8
Lab HP202	22	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	22	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.5	2,115	0	\$235	\$1,594	\$220	5.8
Stair B	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor		29	3,014		None	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,014	0.0	0	0	\$0	\$0	\$0	0.0
First Floor Hallway	7	LED Lamps: (1) 12W Plug-In Lamp	None	S	12	8,760	3	None	Yes	7	LED Lamps: (1) 12W Plug-In Lamp	High/Low Control	12	6,044	0.0	251	0	\$28	\$450	\$245	7.3
First Floor Hallway	4	LED Lamps: (1) 40W LED Corn Bulb	None	S	40	8,760	3	None	Yes	4	LED Lamps: (1) 40W LED Corn Bulb	High/Low Control	40	6,044	0.0	478	0	\$53	\$225	\$140	1.6
First Floor Hallway	18	LED - Linear Tubes: (1) 4' Lamp	None	S	15	8,760	3	None	Yes	18	LED - Linear Tubes: (1) 4' Lamp	High/Low Control	15	6,044	0.1	780	0	\$87	\$675	\$630	0.5
Vestibule	5	LED Lamps: (1) 12W Plug-In Lamp	None	S	12	8,760		None	No	5	LED Lamps: (1) 12W Plug-In Lamp	None	12	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Vestibule	1	LED Lamps: (1) 40W LED Corn Bulb	None	S	40	8,760		None	No	1	LED Lamps: (1) 40W LED Corn Bulb	None	40	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Exterior Front	6	LED Lamps: (1) 12W Plug-In Lamp	Timeclock		12	5,096		None	No	6	LED Lamps: (1) 12W Plug-In Lamp	Timeclock	12	5,096	0.0	0	0	\$0	\$0	\$0	0.0
Waiting Area HP103	8	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	769	0	\$86	\$580	\$80	5.8
Waiting Area HP103	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	S	33	3,014		None	No	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Office HP105	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Clinic HP104	2	LED Lamps: (1) 12W Plug-In Lamp	Occupancy Sensor	S	12	3,014		None	No	2	LED Lamps: (1) 12W Plug-In Lamp	Occupancy Sensor	12	3,014	0.0	0	0	\$0	\$0	\$0	0.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Office HP106	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Office HP106A	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	385	0	\$43	\$290	\$40	5.8
Hallway	13	LED Lamps: (1) 12W Plug-In Lamp	None	S	12	8,760	3	None	Yes	13	LED Lamps: (1) 12W Plug-In Lamp	High/Low Control	12	6,044	0.0	466	0	\$52	\$675	\$455	4.2
Hallway	4	LED - Fixtures: Decorative Pendant	None	S	50	8,760	3	None	Yes	4	LED - Fixtures: Decorative Pendant	High/Low Control	50	6,044	0.0	597	0	\$66	\$225	\$140	1.3
Classroom HP107A	12	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	S	17	3,014		None	No	12	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Classroom HP107A	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0
Office HP108	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Classroom HP107B	9	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	S	17	3,014		None	No	9	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Classroom HP107B	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8
Office HP110	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	577	0	\$64	\$435	\$60	5.8
Office HP111	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.1	577	0	\$64	\$435	\$60	5.8
Classroom H107C	9	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	S	17	3,014		None	No	9	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Classroom H107C	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0
Classroom H107D	9	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	S	17	3,014		None	No	9	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,014	0.0	0	0	\$0	\$0	\$0	0.0
Classroom H107D	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	6	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0
Storage HP117	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.1	80	0	\$9	\$290	\$40	28.2
Locker Room HP118	9	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	9	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	865	0	\$96	\$652	\$90	5.8
Locker Room HP119	9	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	9	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	865	0	\$96	\$652	\$90	5.8
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8
Supply Room HP112	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
X-Ray Room HP113	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
X-Ray Room HP114	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
X-Ray Room HP115	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Storage HP115	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	40	0	\$4	\$145	\$20	28.2

	Existing Conditions						Proposed Conditions									Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years		
Storage HP102	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	3	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.1	60	0	\$7	\$217	\$30	28.2		
Hallway	2	LED - Fixtures: Decorative: Other	None	S	20	8,760	3	None	Yes	2	LED - Fixtures: Decorative: Other	High/Low Control	20	6,044	0.0	119	0	\$13	\$225	\$70	11.7		
Hallway	16	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760	3	None	Yes	16	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.1	1,577	0	\$176	\$675	\$560	0.7		
Lab HP120	22	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	22	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.5	2,115	0	\$235	\$1,594	\$220	5.8		
Storage HP120B	5	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	5	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.1	100	0	\$11	\$362	\$50	28.2		
Rest Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	96	0	\$11	\$72	\$10	5.8		
Rest Room	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
MDF Closet HP121	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,368	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,368	0.0	317	0	\$35	\$73	\$20	1.5		
Rest Room	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	S	33	3,014		None	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Rest Room	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Rest Room	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	S	33	3,014		None	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Rest Room	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	S	9	3,014		None	No	6	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Classroom HP124	18	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	18	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.4	1,731	0	\$193	\$1,304	\$180	5.8		
Lab HP125	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	15	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,442	0	\$160	\$1,087	\$150	5.8		
Classroom HP126	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	15	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.3	1,442	0	\$160	\$1,087	\$150	5.8		
Storage HP128	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	20	0	\$2	\$72	\$10	28.2		
Lab HP127	11	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	11	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.2	1,058	0	\$118	\$797	\$110	5.8		
X-Ray Room HP127D	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	4,368	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	4,368	0.0	139	0	\$16	\$72	\$10	4.0		
Storage HP127C	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	20	0	\$2	\$72	\$10	28.2		
X-Ray Room HP127B	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8		
X-Ray Room HP127A	17	LED Lamps: (1) 40W LED Corn Bulb	Wall Switch	S	40	4,368		None	No	17	LED Lamps: (1) 40W LED Corn Bulb	Wall Switch	40	4,368	0.0	0	0	\$0	\$0	\$0	0.0		
Lab HP129	7	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	S	17	3,014		None	No	7	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,014	0.0	0	0	\$0	\$0	\$0	0.0		
Lab HP129C	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8		
Lab HP129C	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0		
Lab HP129D	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8		

	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Lab HP129D	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0
Lab HP129B	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Lab HP129B	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0
Lab HP129A	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	3,014	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,014	0.0	192	0	\$21	\$145	\$20	5.8
Lab HP129A	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch		250	4,368		None	No	1	Halogen Incandescent: 50W Halogen Dental Light	Wall Switch	250	4,368	0.0	0	0	\$0	\$0	\$0	0.0
Storage HP131	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Time Switch	S	62	624	1	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Time Switch	33	624	0.0	40	0	\$4	\$145	\$20	28.2
First Floor Hallway	1	LED - Linear Tubes: (2) U-Lamp	None	S	33	8,760		None	No	1	LED - Linear Tubes: (2) U-Lamp	None	33	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Closet HP130	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,368	1, 2	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,014	0.4	2,825	-1	\$314	\$781	\$140	2.0
Exterior	6	LED Lamps: (1) 12W Plug-In Lamp	Timeclock		12	5,096		None	No	6	LED Lamps: (1) 12W Plug-In Lamp	Timeclock	12	5,096	0.0	0	0	\$0	\$0	\$0	0.0
Exterior	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Timeclock		50	5,096		None	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Timeclock	50	5,096	0.0	0	0	\$0	\$0	\$0	0.0

Motor Inventory & Recommendations

		Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	RTU-1E	1	Supply Fan	20.0	93.0%	Yes	W	4,300		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2E	1	Supply Fan	20.0	93.0%	Yes	W	4,300		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3E	1	Supply Fan	20.0	93.0%	Yes	W	4,300		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-1W	1	Supply Fan	20.0	93.0%	Yes	W	4,300		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2W	1	Supply Fan	20.0	93.0%	Yes	W	4,300		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3W	1	Supply Fan	20.0	93.0%	Yes	W	4,300		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-1E	1	Exhaust Fan	1.5	86.5%	Yes	W	4,300		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2E	1	Exhaust Fan	1.5	86.5%	Yes	W	4,300		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3E	1	Exhaust Fan	1.5	86.5%	Yes	W	4,300		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-1W	1	Exhaust Fan	1.5	86.5%	Yes	W	4,300		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2W	1	Exhaust Fan	1.5	86.5%	Yes	W	4,300		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3W	1	Exhaust Fan	1.5	86.5%	Yes	W	4,300		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room	Hot Water Pumps	2	Heating Hot Water Pump	7.5	91.7%	Yes	W	1,696		No	91.7%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room	Hot Water Pumps	2	Boiler Feed Water Pump	1.5	86.5%	Yes	W	1,696		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	General Buidling Exhaust	1	Exhaust Fan	0.3	74.0%	No	W	4,300		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	General Buidling Exhaust	2	Exhaust Fan	0.5	74.0%	No	W	4,300		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Elevator Machine Room	Elevator	2	Other	30.0	74.0%	No	W	146		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	RTU-1E	1	Packaged AC	50.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2E	1	Packaged AC	50.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3E	1	Packaged AC	50.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-1W	1	Packaged AC	50.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2W	1	Packaged AC	50.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3W	1	Packaged AC	50.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	Split AC Systems (AC-1, AC-2, AC-3)	3	Split-System AC	2.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Stairwells	Cabinet Unit Heaters	24	Electric Resistance Heat		17.07	W		No							0.0	0	0	\$0	\$0	\$0	0.0

Fuel Heating Inventory & Recommendations

		Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	VAV Reheat	2	Condensing Hot Water Boiler	#####	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-1E	1	Furnace	283.50	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2E	1	Furnace	283.50	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3E	1	Furnace	283.50	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-1W	1	Furnace	283.50	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-2W	1	Furnace	283.50	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU-3W	1	Furnace	283.50	W		No						0.0	0	0	\$0	\$0	\$0	0.0

DHW Inventory & Recommendations


Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions						Energy Impact & Financial Analysis							
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Domestic Hot Water System	1	Storage Tank Water Heater (> 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?
Building	268	Computer	90.0	
Building	6	Laptop	35.0	
Building	13	TV	55.0	
Building	21	Smart Board/ Projector	1.5	
Building	26	Small Printer	30.0	
Building	4	Large Printer	300.0	
Building	5	Coffee Machine	800.0	
Building	7	Microwave	700.0	
Building	6	Mini Fridge	260.0	
Building	57	Hospital Bed	300.0	
Building	2	X-Ray Machine	800.0	
Building	10	Misc. Medical Equipment	2,500.0	

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



ENERGY STAR® Statement of Energy Performance

N/A

Bergen Community College - Campus

Primary Property Type: College/University
Gross Floor Area (ft²): 867,229
Built: 1987

ENERGY STAR®
Score¹

For Year Ending: January 31, 2019
Date Generated: July 12, 2019

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
Property Address Bergen Community College - Campus 400 Paramus Road Paramus, New Jersey 07652	Property Owner Bergen Community College 400 Paramus Road Paramus, NJ 07652 (201) 879-8921	Primary Contact Victor Anaya 400 Paramus Road Paramus, NJ 07652 (201) 879-8921 vanaya@bergen.edu	
Property ID: 7384792			

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI	Annual Energy by Fuel		National Median Comparison
101.5 kBtu/ft²	Natural Gas (kBtu)	37,546,840 (43%)	National Median Site EUI (kBtu/ft²)
	Electric - Grid (kBtu)	50,490,655 (57%)	National Median Source EUI (kBtu/ft²)
			% Diff from National Median Source EUI
Source EUI			Annual Emissions
208.5 kBtu/ft²			Greenhouse Gas Emissions (Metric Tons CO2e/year)
			7,110

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

 () - _____



Professional Engineer Stamp
(If applicable)

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR®	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> : gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge:</i> high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium:</i> a type of HID lamp
HSPF	<i>Heating seasonal performance factor:</i> a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value:</i> a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt:</i> equal to 1,000 Watts.
kWh	<i>Kilowatt-hour:</i> 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode:</i> a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide:</i> a type of HID lamp
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor:</i> a type of HID lamp
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program:</i> NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.
psig	<i>Pounds per square inch gauge</i>
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic:</i> refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	<i>Seasonal energy efficiency ratio:</i> a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	<i>Statement of energy performance:</i> a summary document from the ENERGY STAR® Portfolio Manager®.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC	<i>Solar renewable energy credit:</i> a credit you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use
VAV	<i>Variable air volume</i>
VFD	<i>Variable frequency drive:</i> a controller used to vary the speed of an electric motor.
WaterSense®	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.