



Local Government Energy Audit Report

Johnstone Elementary School

January 3, 2020

Prepared for:

Vineland Public Schools
165 S. Brewster Road
Vineland, NJ 08360

Prepared by:

TRC
900 Route 9 North
Woodbridge, NJ 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. Cost estimates include material and labor pricing associated with installation of primary recommended equipment only. Cost estimates do not include demolition or removal of hazardous waste. We encourage the owner of the facility to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2019 TRC Companies, Inc. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.



Table of Contents

1	Executive Summary	1
1.1	Planning Your Project	4
	Pick Your Installation Approach	4
	More Options from Around the State	6
2	Existing Conditions	7
2.1	Site Overview	7
2.2	Building Occupancy	7
2.3	Building Envelope	8
2.4	Lighting Systems	9
2.5	Air Handling Systems	10
	Unit Ventilators	10
	Packaged Units	10
	Packaged Terminal Heat Pumps	10
	Air Conditioners	10
2.6	Heating Hot Water Systems	12
2.7	Chilled Water Systems	13
2.8	Building Energy Management Systems (EMS)	14
2.9	Domestic Hot Water	15
2.10	Food Service and Refrigeration Equipment	16
2.11	Plug Load & Vending Machines	17
2.12	Water-Using Systems	17
3	Energy Use and Costs	18
3.1	Electricity	20
3.2	Natural Gas	21
3.3	Benchmarking	22
	Tracking Your Energy Performance	23
4	Energy Conservation Measures	24
4.1	Lighting	27
	ECM 1: Install LED Fixtures	27
	ECM 2: Retrofit Fixtures with LED Lamps	27
4.2	Lighting Controls	28
	ECM 3: Install Occupancy Sensor Lighting Controls	28
	ECM 4: Install High/Low Lighting Controls	28
4.3	Variable Frequency Drives (VFD)	29
	ECM 5: Install VFDs on Constant Volume (CV) Fans	29
	ECM 6: Install VFDs on Chilled Water Pumps	30
	ECM 7: Install VFDs on Heating Water Pumps	30
4.4	Electric Unitary HVAC	30
	ECM 8: Install High Efficiency Air Conditioning Units	31



ECM 9: Install High Efficiency Heat Pumps.....	31
ECM 10: Install High Efficiency PTAC/PTHP.....	31
4.5 Electric Chillers.....	32
ECM 11: Install High Efficiency Chillers	32
4.6 Gas-Fired Heating.....	33
ECM 12: Install High Efficiency Hot Water Boilers.....	33
ECM 13: Install High Efficiency Furnaces.....	33
4.7 HVAC Improvements.....	34
ECM 14: Implement Demand Control Ventilation (DCV).....	34
4.8 Domestic Water Heating	35
ECM 15: Install High Efficiency Gas-Fired Water Heater	35
ECM 16: Install Low-Flow DHW Devices	35
4.9 Food Service & Refrigeration Measures	35
ECM 17: Vending Machine Control	35
5 Energy Efficient Best Practices	36
Energy Tracking with ENERGY STAR® Portfolio Manager®	36
Lighting Maintenance.....	36
Motor Maintenance	36
Thermostat Schedules and Temperature Resets	36
AC System Evaporator/Condenser Coil Cleaning	37
Boiler Maintenance	37
Furnace Maintenance.....	37
Water Heater Maintenance.....	37
Plug Load Controls.....	38
Water Conservation	38
Procurement Strategies.....	38
6 On-site Generation	39
6.1 Solar Photovoltaic	40
6.2 Combined Heat and Power	41
7 Project Funding and Incentives	42
7.1 SmartStart.....	43
7.2 Direct Install	44
7.3 Pay for Performance - Existing Buildings	45
7.4 Combined Heat and Power	46
7.5 Energy Savings Improvement Program.....	47
7.6 SREC Registration Program.....	48
8 Energy Purchasing and Procurement Strategies	49
8.1 Retail Electric Supply Options.....	49
8.2 Retail Natural Gas Supply Options.....	49
Appendix A: Equipment Inventory & Recommendations	A-1
Appendix B: ENERGY STAR® Statement of Energy Performance.....	B-1
Appendix C: Glossary	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Johnstone Elementary School. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT




Costs: \$162,687

Annual Utilities

Electricity:
746,200 kWh

Natural Gas:
30,278 Therms

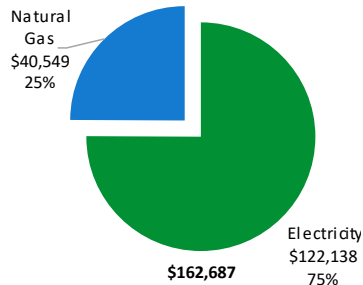

ENERGY STAR®
Benchmarking Score

12
(1-100 scale)

This building performs at or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.

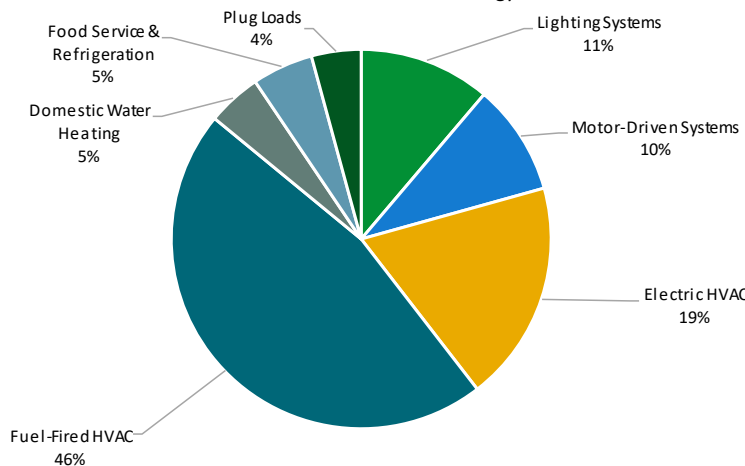


Figure 1 - Energy Use by System




POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$758,568
Potential Rebates & Incentives ¹	\$126,891
Annual Cost Savings	\$45,317
Annual Energy Savings	Electricity: 254,801 kWh Natural Gas: 2,697 Therms
Greenhouse Gas Emission Savings	144 Tons
Simple Payback	13.9 Years
Site Energy Savings (all utilities)	20%

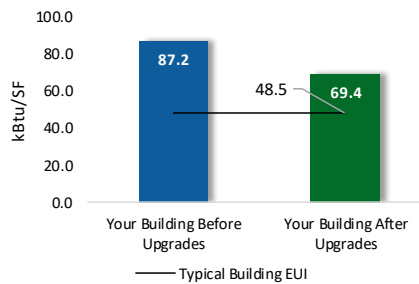

Scenario 2: Cost Effective Package²

Installation Cost	\$190,614
Potential Rebates & Incentives	\$55,823
Annual Cost Savings	\$31,142
Annual Energy Savings	Electricity: 189,867 kWh Natural Gas: 48 Therms
Greenhouse Gas Emission Savings	96 Tons
Simple Payback	4.3 Years
Site Energy Savings (all utilities)	12%

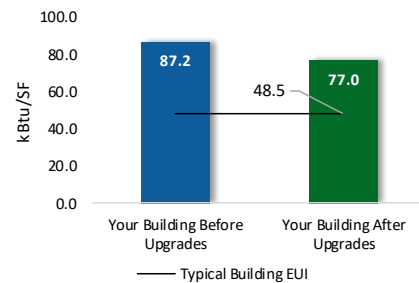

On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			106,982	25.4	-18	\$17,276	\$93,459	\$0	\$93,459	5.4	105,675
ECM 1	Install LED Fixtures	Yes	26,485	2.9	-1	\$4,325	\$56,875	\$0	\$56,875	13.1	26,586
ECM 2	Retrofit Fixtures with LED Lamps	Yes	80,497	22.5	-17	\$12,950	\$36,584	\$0	\$36,584	2.8	79,089
Lighting Control Measures			19,130	5.5	-4	\$3,078	\$22,059	\$0	\$22,059	7.2	18,795
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	17,329	5.0	-4	\$2,788	\$19,134	\$0	\$19,134	6.9	17,026
ECM 4	Install High/Low Lighting Controls	Yes	1,800	0.5	0	\$290	\$2,925	\$0	\$2,925	10.1	1,769
Variable Frequency Drive (VFD) Measures			60,831	26.8	0	\$9,957	\$70,666	\$0	\$70,666	7.1	61,256
ECM 5	Install VFDs on Constant Volume (CV) Fans	Yes	28,134	12.7	0	\$4,605	\$30,520	\$0	\$30,520	6.6	28,331
ECM 6	Install VFDs on Chilled Water Pumps	Yes	24,610	11.9	0	\$4,028	\$29,843	\$0	\$29,843	7.4	24,782
ECM 7	Install VFDs on Heating Water Pumps	Yes	8,086	2.1	0	\$1,324	\$10,303	\$0	\$10,303	7.8	8,143
Electric Unitary HVAC Measures			39,503	22.3	0	\$6,466	\$249,217	\$0	\$249,217	38.5	39,780
ECM 8	Install High Efficiency Air Conditioning Units	No	16,016	11.8	0	\$2,622	\$103,425	\$0	\$103,425	39.5	16,128
ECM 9	Install High Efficiency Heat Pumps	No	234	0.1	0	\$38	\$1,367	\$0	\$1,367	35.7	235
ECM 10	Install High Efficiency PTAC/PTHP	No	23,253	10.4	0	\$3,806	\$144,425	\$0	\$144,425	37.9	23,416
Electric Chiller Replacement			25,431	43.2	0	\$4,163	\$177,251	\$0	\$177,251	42.6	25,609
ECM 11	Install High Efficiency Chillers	No	25,431	43.2	0	\$4,163	\$177,251	\$0	\$177,251	42.6	25,609
Gas Heating (HVAC/Process) Replacement			0	0.0	242	\$3,241	\$132,646	\$20,773	\$111,873	34.5	28,339
ECM 12	Install High Efficiency Hot Water Boilers	No	0	0.0	143	\$1,922	\$96,149	\$14,373	\$81,777	42.6	16,801
ECM 13	Install High Efficiency Furnaces	No	0	0.0	99	\$1,320	\$36,496	\$6,400	\$30,096	22.8	11,538
HVAC System Improvements			1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520
ECM 14	Implement Demand Control Ventilation (DCV)	Yes	1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520
Domestic Water Heating Upgrade			0	0.0	39	\$521	\$8,963	\$1,179	\$7,784	14.9	4,559
ECM 15	Install High Efficiency Gas-Fired Water Heater	No	0	0.0	23	\$305	\$8,841	\$1,057	\$7,784	25.5	2,670
ECM 16	Install Low-Flow DHW Devices	Yes	0	0.0	16	\$216	\$122	\$122	\$0	0.0	1,889
Food Service & Refrigeration Measures			1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623
ECM 17	Vending Machine Control	Yes	1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623
TOTALS (COST EFFECTIVE MEASURES)			189,867	57.9	5	\$31,142	\$190,614	\$122	\$190,492	6.1	191,758
TOTALS (ALL MEASURES)			254,801	123.4	270	\$45,317	\$758,568	\$21,952	\$736,616	16.3	288,156

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.



1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey's Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures			
ECM 2	Retrofit Fixtures with LED Lamps			
ECM 3	Install Occupancy Sensor Lighting Controls			
ECM 4	Install High/Low Lighting Controls			
ECM 5	Install VFDs on Constant Volume (CV) Fans			
ECM 6	Install VFDs on Chilled Water Pumps			
ECM 7	Install VFDs on Heating Water Pumps			
ECM 8	Install High Efficiency Air Conditioning Units			
ECM 9	Install High Efficiency Heat Pumps			
ECM 10	Install High Efficiency PTAC/PTHP			
ECM 11	Install High Efficiency Chillers			
ECM 12	Install High Efficiency Hot Water Boilers	x		x
ECM 13	Install High Efficiency Furnaces	x		x
ECM 14	Implement Demand Control Ventilation (DCV)			
ECM 15	Install High Efficiency Gas-Fired Water Heater	x		
ECM 16	Install Low-Flow DHW Devices	x		x
ECM 17	Vending Machine Control			

Figure 3 – Funding Options



New Jersey's Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.



Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.



2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for Johnstone Elementary School. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On September 6, 2019, TRC performed an energy audit at Johnstone Elementary School located in Vineland, New Jersey. TRC met with Noel Feliciano Plumer to review the facility operations and help focus our investigation on specific energy-using systems.

Johnstone Elementary School is a 1-story, 63,890 square foot building built in 1957. Spaces include: classrooms, gymnasium, offices, cafeteria, a commercial kitchen, and mechanical space.

There were additions made to the building in 1998 and 2003. The building is a 100% heated and 90% cooled. No major envelope concerns were observed during the time of the audit.

2.2 Building Occupancy

The facility is occupied for ten months out of the year. Typical weekday occupancy is about 427 including full time staff and students.

Building Name	Weekday/Weekend	Operating Schedule
Johnstone Elementary School	Weekday	6:00 AM - 4:00 PM
	Weekend	No Operation

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are concrete block over structural steel with a brick facade. The majority of the roof is pitched with asphalt shingles. The flat portion of the roof is covered with black membrane.

The walls are made of concrete masonry units (CMUs) with concrete block and drywall interiors in the respective portions.

Most of the windows are double glazed and have aluminum frames. The glass-to-frame seals are in good condition. The operable window weather seals are also in good condition. Exterior doors have aluminum frames and are in good condition with undamaged door seals.



Facade



Windows



Exterior doors



Flat and Pitched roofs

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. There are also 16W and 42W 4-pin compact fluorescent lamps (CFL), which are mainly recessed. 65W incandescent lamp fixtures serving smaller spaces such as elevators, storage spaces, restrooms, and closets. Typically, T8 fluorescent lamps use electronic ballasts.

Fixture types include 2- or 4-foot 2-, 3- or a few 4-lamp long troffers and surface mounted fixtures and 2-foot fixtures with U-bend tube lamps. Most fixtures are in good condition.

Library, tech room and music rooms have 4-foot 1 lamp T5 high output fixtures providing lighting to the spaces. Gym is lit using 100-watt metal halide high bay fixtures.


All exit signs are 2W LED units.

All the interior fixtures in the school are controlled using wall switches. Interior lighting levels were generally sufficient.

Facility exterior lighting includes recessed fixtures with 54W LED "corn" lamps, wall packs, and pole lights with 50W, 250W and 400W metal halide fixture, as well as 120W LED wall pack fixtures. The exterior lighting is controlled using photocells.




Exit signs



Recessed interior fixtures



Exterior pole fixtures



4-foot T8 2 lamps troffer



Exterior wall pack



Recessed exterior fixtures



2.5 Air Handling Systems

The facility is serviced by a combination of heating and cooling systems. Refer to Appendix A for detailed information about each unit.

Unit Ventilators

The 1998 portion of the school contains approximately 20 pneumatically controlled unit ventilators with hot and chilled water coils and supply fan motors. This system is original to the building and appears to be in fair operating condition.

Packaged Units

Spaces such as the gym, offices, cafeteria, and the kitchen are cooled using packaged Trane units with cooling capacities ranging from 8 to 10 tons. These units have an average EER of 8.3 and were installed in 2003. The units have been evaluated for replacement.

The temperatures in these zones are monitored by an EMS with limited control capabilities. Cooling setpoint is set to 73°F.

Packaged Terminal Heat Pumps

Older sections of the building with classrooms and some offices are cooled using packaged terminal heat pumps with electric heating capacity. The heat pumps are 1.25 tons with a heating capacity of 3.5 kW. These units were installed in 2002 and all of them have been evaluated for replacement.

The temperature for these units is controlled at the unit.

Air Conditioners

Several other offices, hallways, and other areas are cooled using window AC units and ductless mini-split AC units with capacities ranging from 0.75 to 1 ton with an average SEER of 10. These units have passed their useful life and have been evaluated for replacement.

Commented [WS1]: kW or W?



Packaged terminal heat pumps



Split AC units



Packaged Trane units



Window AC unit


2.6 Heating Hot Water Systems

There are two gas-fired non-condensing HB Smith hot water boilers providing heating to the unit ventilators and the air handling units equipped with hot water coils. The output capacity of these boilers is 2764 MBh with a heating efficiency of 79%. The water from the boilers are circulated to the terminal units using two constant speed 10 hp heating hot water pumps with an efficiency of 89.5%.

These boilers were installed in 1998 and have been evaluated for replacement. The hot water pumps were observed to be in good condition.

Several other spaces in the original building including room seven, the cafeteria, library, and other spaces are heated using gas-fired Reznor furnaces equipped with supply fans. These furnaces have output capacities ranging from 132 MBh to 270 MBh with an average efficiency of 78%. All of the furnaces were installed in 1992 and have been evaluated for replacement.

Boiler and supply water temperatures and pump operation are only monitored by the EMS; the system provides a limited level of control. The heating setpoint at the school is 70°F.

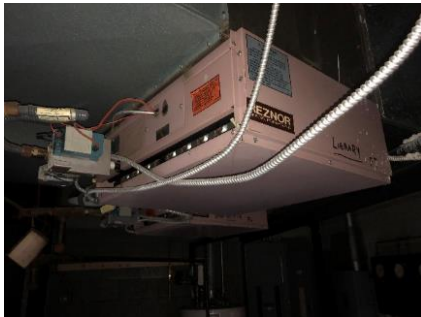

Furnaces



Non-condensing hot water boilers



Heating hot water pumps



Unit ventilators

2.7 Chilled Water Systems

Cooling in the 1998 section of the school is provided by two constant speed Trane air cooled screw-chillers with cooling capacities of 70 and 110 tons respectively. The chilled water is supplied to the unit ventilators and chilled water coils by two constant speed 5 hp pumps and two constant speed 25 hp pumps. The chillers were installed in 1998 and have been evaluated for replacement. The chiller operations and temperatures are monitored by an EMS, which has limited capabilities. The chillers are locked out during the winter months.




Trane chillers



Chilled water pump




Chilled water pump insulation

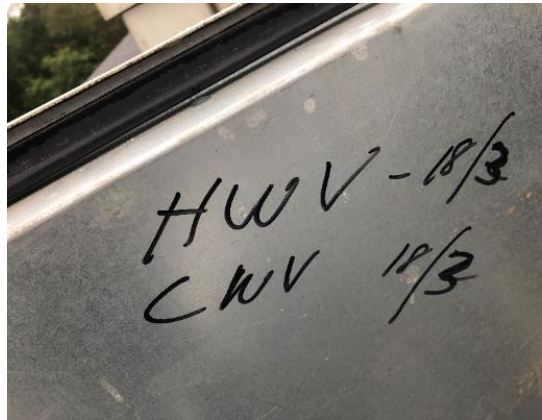


AHU with hot water and chilled water coils

2.8 Building Energy Management Systems (EMS)

A Novar EMS monitors the HVAC equipment, boilers, chillers, air handlers, unit ventilators, and the package units. The EMS has a very limited scope in controlling these units. The school should investigate advanced control system options.

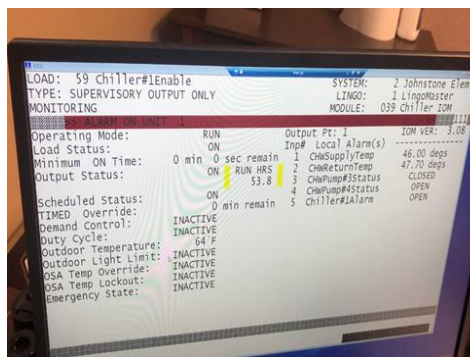

EMS

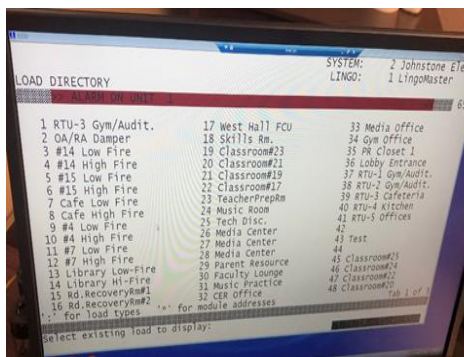

EMS

2.9 Domestic Hot Water

The facility has three gas-fired hot water heaters.

The Bradford White and the AO Smith units serve the restrooms at the facility. They have input capacities of 76 MBh and 120 MBh and tank capacities of 75 and 60 gallons respectively. Both units were installed in 2003 and have been evaluated for replacement.

The Lochinvar unit serves the kitchen with an input capacity of 75 MBh and a tank capacity of 75 gallons. This unit was installed in 2018, new and in good condition.

The AO Smith water heater was installed in 2018, new and in good condition. The other units were installed in 2003 and have been evaluated for replacement.



Lochinvar



AO Smith



Bradford White

2.10 Food Service and Refrigeration Equipment

The kitchen has a mix of gas and electric equipment that is used to prepare lunches for students. Most cooking is done using a convection oven and conventional gas-fired stove. Bulk prepared foods are held in several holding cabinets. Equipment is high efficiency and in good condition.

The dishwasher is an ENERGY STAR® high temperature, rack type unit with a 36kW electric booster.

The kitchen has several stand-up refrigerators and freezers with solid doors. There is also an energy efficient refrigerator chest. All equipment is in good condition.

The walk-in refrigerator has an estimated 0.83 ton compressor and a two-fan evaporator. The walk-in medium temperature freezer has a 1.33 ton compressor and an evaporator unit equipped with evaporator and defrost control.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Reach-in refrigerator



Walk-in refrigerator and freezer



Convection oven



Stove



2.11 Plug Load & Vending Machines

The location is doing a great job managing their electrical plug loads. This report makes additional suggestions for ECMs in this area as well as Energy Efficient Best Practices.

There are approximately 10 computer work stations and 250 laptops throughout the facility. Plug loads throughout the building include general café and office equipment. There are classroom typical loads such as smart boards, projectors, and fans. The art room has a 11 kW kiln.

There are several residential style refrigerators throughout the building that are used to store food by staff. These vary in condition and efficiency.

There is one refrigerated beverage vending machine and one non-refrigerated vending machine. Vending machines are not equipped with occupancy-based controls.


2.12 Water-Using Systems

There are 17 faucet flow rates are at 2.2 gallons per minute (gpm). Toilets are rated at 1.6 gallons per flush (gpf) and urinals are rated at 1.0 gpf.

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	746,200 kWh	\$122,138
Natural Gas	30,278 Therms	\$40,549
Total		\$162,687

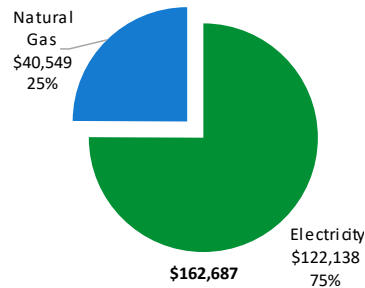

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


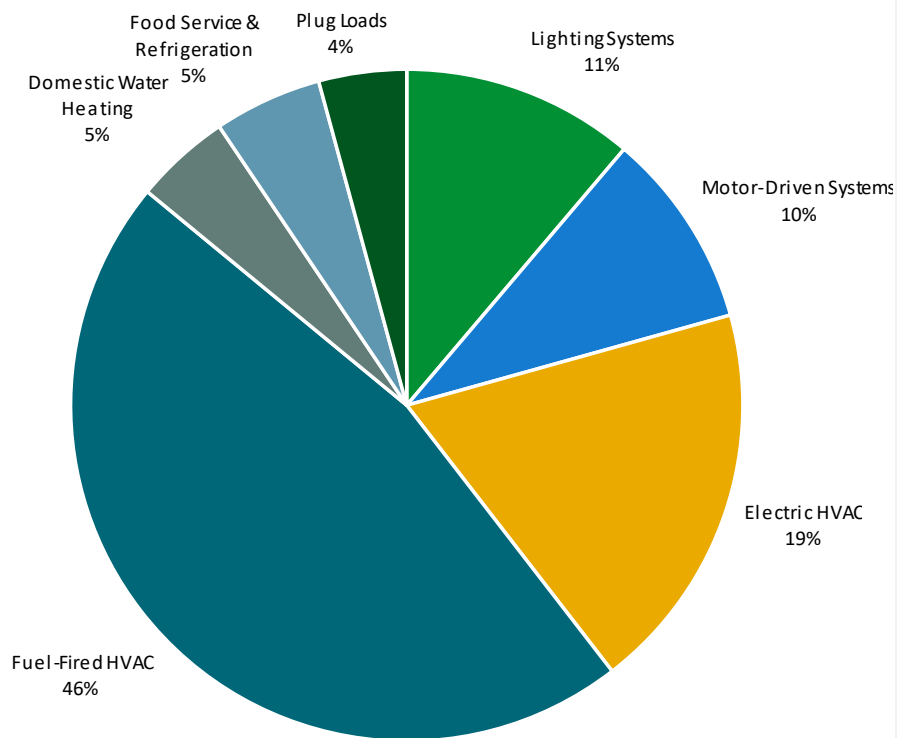


Figure 5 - Energy Balance



3.1 Electricity

City of Vineland delivers electricity under rate class Comm Service Rate GLP20.

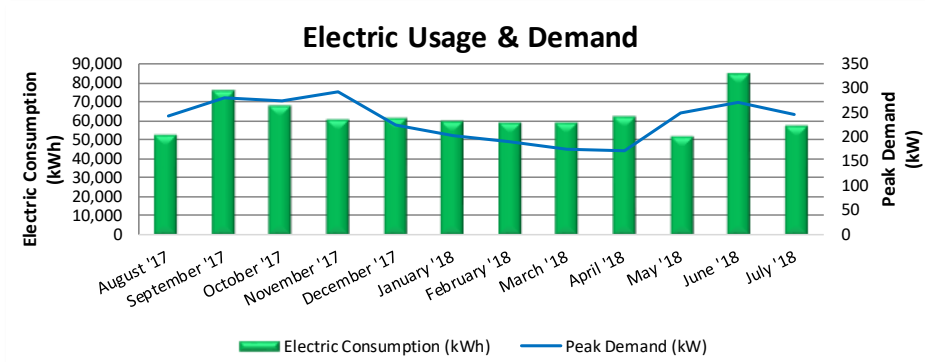

Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
8/23/17	30	52,080	243	\$2,032	\$8,275
9/25/17	33	75,480	280	\$3,169	\$12,042
10/24/17	29	67,000	275	\$2,983	\$10,658
11/27/17	34	59,720	294	\$2,793	\$9,649
12/26/17	29	61,160	223	\$2,385	\$9,405
1/26/18	31	59,480	202	\$2,162	\$9,101
2/22/18	27	58,720	190	\$2,005	\$9,047
3/23/18	29	58,800	176	\$1,919	\$9,004
4/26/18	34	61,440	172	\$2,101	\$10,073
5/18/18	22	51,160	250	\$3,024	\$9,682
6/21/18	34	84,440	271	\$3,255	\$14,438
7/24/18	33	56,720	245	\$3,234	\$10,765
Totals	365	746,200	294	\$31,061	\$122,138
Annual	365	746,200	294	\$31,061	\$122,138


Notes:

- Peak demand of 294 kW occurred in November '17.
- Average demand over the past 12 months was 235 kW.
- The average electric cost over the past 12 months was \$0.164/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.



3.2 Natural Gas

South Jersey Gas delivers natural gas under rate class General Service FT, with natural gas supply provided by South Jersey Energy, Amerigreen, Woodruff, a third-party supplier.

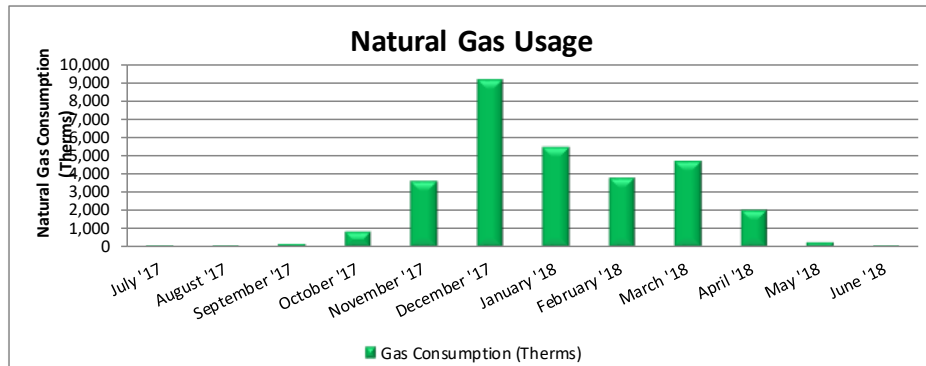

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
8/7/17	30	71	\$109
9/8/17	32	111	\$156
10/5/17	27	213	\$266
11/7/17	33	882	\$1,041
12/6/17	29	3,611	\$4,683
1/9/18	34	9,152	\$12,470
2/8/18	30	5,462	\$7,446
3/8/18	28	3,815	\$5,274
4/9/18	32	4,749	\$6,486
5/8/18	29	2,054	\$2,395
6/8/18	31	253	\$335
7/11/18	33	155	\$222
Totals	368	30,527	\$40,882
Annual	365	30,278	\$40,549

Notes:

- The average gas cost for the past 12 months is \$1.339/therm, which is the blended rate used throughout the analysis.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

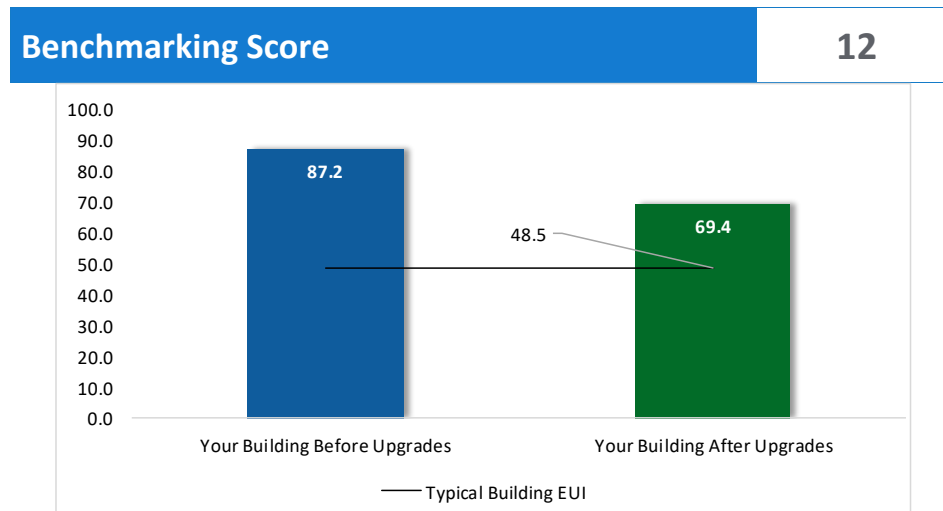


Figure 6 - Energy Use Intensity Comparison³

This building performs at, or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

³ Based on all evaluated ECMs



Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website⁴.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.



4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**



#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			106,982	25.4	-18	\$17,276	\$93,459	\$0	\$93,459	5.4	105,675
ECM 1	Install LED Fixtures	Yes	26,485	2.9	-1	\$4,325	\$56,875	\$0	\$56,875	13.1	26,586
ECM 2	Retrofit Fixtures with LED Lamps	Yes	80,497	22.5	-17	\$12,950	\$36,584	\$0	\$36,584	2.8	79,089
Lighting Control Measures			19,130	5.5	-4	\$3,078	\$22,059	\$0	\$22,059	7.2	18,795
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	17,329	5.0	-4	\$2,788	\$19,134	\$0	\$19,134	6.9	17,026
ECM 4	Install High/Low Lighting Controls	Yes	1,800	0.5	0	\$290	\$2,925	\$0	\$2,925	10.1	1,769
Variable Frequency Drive (VFD) Measures			60,831	26.8	0	\$9,957	\$70,666	\$0	\$70,666	7.1	61,256
ECM 5	Install VFDs on Constant Volume (CV) Fans	Yes	28,134	12.7	0	\$4,605	\$30,520	\$0	\$30,520	6.6	28,331
ECM 6	Install VFDs on Chilled Water Pumps	Yes	24,610	11.9	0	\$4,028	\$29,843	\$0	\$29,843	7.4	24,782
ECM 7	Install VFDs on Heating Water Pumps	Yes	8,086	2.1	0	\$1,324	\$10,303	\$0	\$10,303	7.8	8,143
Electric Unitary HVAC Measures			39,503	22.3	0	\$6,466	\$249,217	\$0	\$249,217	38.5	39,780
ECM 8	Install High Efficiency Air Conditioning Units	No	16,016	11.8	0	\$2,622	\$103,425	\$0	\$103,425	39.5	16,128
ECM 9	Install High Efficiency Heat Pumps	No	234	0.1	0	\$38	\$1,367	\$0	\$1,367	35.7	235
ECM 10	Install High Efficiency PTAC/PTHP	No	23,253	10.4	0	\$3,806	\$144,425	\$0	\$144,425	37.9	23,416
Electric Chiller Replacement			25,431	43.2	0	\$4,163	\$177,251	\$0	\$177,251	42.6	25,609
ECM 11	Install High Efficiency Chillers	No	25,431	43.2	0	\$4,163	\$177,251	\$0	\$177,251	42.6	25,609
Gas Heating (HVAC/Process) Replacement			0	0.0	242	\$3,241	\$132,646	\$20,773	\$111,873	34.5	28,339
ECM 12	Install High Efficiency Hot Water Boilers	No	0	0.0	143	\$1,922	\$96,149	\$14,373	\$81,777	42.6	16,801
ECM 13	Install High Efficiency Furnaces	No	0	0.0	99	\$1,320	\$36,496	\$6,400	\$30,096	22.8	11,538
HVAC System Improvements			1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520
ECM 14	Implement Demand Control Ventilation (DCV)	Yes	1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520
Domestic Water Heating Upgrade			0	0.0	39	\$521	\$8,963	\$1,179	\$7,784	14.9	4,559
ECM 15	Install High Efficiency Gas-Fired Water Heater	No	0	0.0	23	\$305	\$8,841	\$1,057	\$7,784	25.5	2,670
ECM 16	Install Low-Flow DHW Devices	Yes	0	0.0	16	\$216	\$122	\$122	\$0	0.0	1,889
Food Service & Refrigeration Measures			1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623
ECM 17	Vending Machine Control	Yes	1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623
TOTALS			254,801	123.4	270	\$45,317	\$758,568	\$21,952	\$736,616	16.3	288,156

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs



#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		106,982	25.4	-18	\$17,276	\$93,459	\$0	\$93,459	5.4	105,675
ECM 1	Install LED Fixtures	26,485	2.9	-1	\$4,325	\$56,875	\$0	\$56,875	13.1	26,586
ECM 2	Retrofit Fixtures with LED Lamps	80,497	22.5	-17	\$12,950	\$36,584	\$0	\$36,584	2.8	79,089
Lighting Control Measures		19,130	5.5	-4	\$3,078	\$22,059	\$0	\$22,059	7.2	18,795
ECM 3	Install Occupancy Sensor Lighting Controls	17,329	5.0	-4	\$2,788	\$19,134	\$0	\$19,134	6.9	17,026
ECM 4	Install High/Low Lighting Controls	1,800	0.5	0	\$290	\$2,925	\$0	\$2,925	10.1	1,769
Variable Frequency Drive (VFD) Measures		60,831	26.8	0	\$9,957	\$70,666	\$0	\$70,666	7.1	61,256
ECM 5	Install VFDs on Constant Volume (CV) Fans	28,134	12.7	0	\$4,605	\$30,520	\$0	\$30,520	6.6	28,331
ECM 6	Install VFDs on Chilled Water Pumps	24,610	11.9	0	\$4,028	\$29,843	\$0	\$29,843	7.4	24,782
ECM 7	Install VFDs on Heating Water Pumps	8,086	2.1	0	\$1,324	\$10,303	\$0	\$10,303	7.8	8,143
HVAC System Improvements		1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520
ECM 14	Implement Demand Control Ventilation (DCV)	1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520
Domestic Water Heating Upgrade		0	0.0	16	\$216	\$122	\$122	\$0	0.0	1,889
ECM 16	Install Low-Flow DHW Devices	0	0.0	16	\$216	\$122	\$122	\$0	0.0	1,889
Food Service & Refrigeration Measures		1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623
ECM 17	Vending Machine Control	1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623
TOTALS		189,867	57.9	5	\$31,142	\$190,614	\$122	\$190,492	6.1	191,758

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		106,982	25.4	-18	\$17,276	\$93,459	\$0	\$93,459	5.4	105,675
ECM 1	Install LED Fixtures	26,485	2.9	-1	\$4,325	\$56,875	\$0	\$56,875	13.1	26,586
ECM 2	Retrofit Fixtures with LED Lamps	80,497	22.5	-17	\$12,950	\$36,584	\$0	\$36,584	2.8	79,089

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace existing fixtures containing HID lamps with new LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

In some cases HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixture(s).

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected building areas: gym and exterior fixtures.

ECM 2: Retrofit Fixtures with LED Lamps

Replace fluorescent, CFL, or incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected building areas: all areas with fluorescent fixtures with T8 tubes, CFL or incandescent lamp fixtures.



4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		19,130	5.5	-4	\$3,078	\$22,059	\$0	\$22,059	7.2	18,795
ECM 3	Install Occupancy Sensor Lighting Controls	17,329	5.0	-4	\$2,788	\$19,134	\$0	\$19,134	6.9	17,026
ECM 4	Install High/Low Lighting Controls	1,800	0.5	0	\$290	\$2,925	\$0	\$2,925	10.1	1,769

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 3: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected building areas: offices, conference rooms, classrooms, gymnasium, library, restrooms, and storage rooms.

ECM 4: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be taken into account when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected building areas: hallways.

4.3 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures		60,831	26.8	0	\$9,957	\$70,666	\$0	\$70,666	7.1	61,256
ECM 5	Install VFDs on Constant Volume (CV) Fans	28,134	12.7	0	\$4,605	\$30,520	\$0	\$30,520	6.6	28,331
ECM 6	Install VFDs on Chilled Water Pumps	24,610	11.9	0	\$4,028	\$29,843	\$0	\$29,843	7.4	24,782
ECM 7	Install VFDs on Heating Water Pumps	8,086	2.1	0	\$1,324	\$10,303	\$0	\$10,303	7.8	8,143

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 5: Install VFDs on Constant Volume (CV) Fans

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor, if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control system programming should maintain the minimum air flow whenever the compressor is operating. Prior to implementation, verify minimum fan speed in cooling mode with the manufacturer. Note that savings will vary depending on the operating characteristics of each AHU.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

Affected air handlers: RTU 1,2,3,4.



ECM 6: Install VFDs on Chilled Water Pumps

Install VFDs to control chilled water pumps. Two-way valves must serve the chilled water coils being served and the chilled water loop must have a differential pressure sensor installed. If three-way valves or a bypass leg are used in the chilled water distribution they will need to be modified when this measure is implemented. As the chilled water valves close, the differential pressure increases, and the VFD modulates the pump speed to maintain a differential pressure setpoint.

For systems with variable chilled water flow through the chiller, the minimum flow to prevent the chiller from tripping off will need to be determined during the final project design. The control system should be programmed to maintain the minimum flow through the chiller and to prevent pump cavitation.

Energy savings result from reducing the pump motor speed (and power) as chilled water valves close. The magnitude of energy savings is based on the estimated amount of time that the system operates at reduced loads.

Affected pumps: two 5hp and two 25 hp chilled water pumps.

ECM 7: Install VFDs on Heating Water Pumps

Install variable frequency drives (VFD) to control heating water pumps. Two-way valves must serve the hot water coils and the hot water loop must have a differential pressure sensor installed. If three-way valves or a bypass leg are used in the hot water distribution they will need to be modified when this measure is implemented. As the hot water valves close, the differential pressure increases and the VFD modulates the pump speed to maintain a differential pressure setpoint.

Energy savings result from reducing pump motor speed (and power) as hot water valves close. The magnitude of energy savings is based on the estimated amount of time that the system will operate at reduced load.

Affected pumps: two 10 hp heating hot water pumps.

4.4 Electric Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Electric Unitary HVAC Measures		39,503	22.3	0	\$6,466	\$249,217	\$0	\$249,217	38.5	39,780
ECM 8	Install High Efficiency Air Conditioning Units	16,016	11.8	0	\$2,622	\$103,425	\$0	\$103,425	39.5	16,128
ECM 9	Install High Efficiency Heat Pumps	234	0.1	0	\$38	\$1,367	\$0	\$1,367	35.7	235
ECM 10	Install High Efficiency PTAC/PTHP	23,253	10.4	0	\$3,806	\$144,425	\$0	\$144,425	37.9	23,416

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units at this facility are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the split AC units and packaged terminal heat pumps are eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.



ECM 8: Install High Efficiency Air Conditioning Units

Replace standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling load, and the estimated annual operating hours.

Affected units: ductless split AC unit.

ECM 9: Install High Efficiency Heat Pumps

Replace standard efficiency heat pumps with high efficiency heat pumps. A higher EER or SEER rating indicates a more efficient cooling system and a higher HSPF rating indicates more efficient heating mode. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average heating and cooling loads, and the estimated annual operating hours.

Affected units: copy room split system air-source HP.

ECM 10: Install High Efficiency PTAC/PTHP

Replace packaged terminal air conditioners and heat pumps (PTAC and PTHP) with high efficiency units. A higher EER or SEER rating indicates a more efficient cooling system and a higher HSPF rating indicates more efficient heating mode. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average heating and cooling loads, and the estimated annual operating hours.

Affected units: older section classroom packaged terminal heat pumps.

4.5 Electric Chillers

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Electric Chiller Replacement		25,431	43.2	0	\$4,163	\$177,251	\$0	\$177,251	42.6	25,609
ECM 11	Install High Efficiency Chillers	25,431	43.2	0	\$4,163	\$177,251	\$0	\$177,251	42.6	25,609

ECM 11: Install High Efficiency Chillers

Replace older inefficient electric chillers with new high efficiency chillers. The type of chiller to be installed depends on the magnitude of the cooling load and variability of the cooling load profile, for example:

- Positive displacement chillers are usually under 600 tons of cooling capacity and centrifugal chillers generally start at 150 tons of cooling capacity.
- Constant speed chillers should be used to meet cooling loads with little or no variation while variable speed chillers are more efficient for variable cooling load profiles.
- Water cooled chillers are more efficient than air cooled chillers but require cooling towers and additional pumps to circulate the cooling water.
- In any given size range, variable speed chillers tend to have better partial load efficiency, but worse full load efficiency, than constant speed chillers.

Energy savings result from the improvement in chiller efficiency and matching the right type of chiller to the cooling load. The energy savings are calculated based on the cooling capacity of the new chiller, the improvement in efficiency compared with the base case equipment, the cooling load profile, and the estimated annual operating hours of the chiller before and after the upgrade.

For the purposes of this analysis, we evaluated the replacement of chillers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your design team to select chillers that are sized appropriately for the cooling load at this facility. In some cases, the plant energy use can be reduced by selecting multiple chillers that match the facility load profile rather than one or two large chillers. This can also improve the chiller plant reliability through increased redundancy. Energy savings are maximized by proper selection of new equipment based on the cooling load profile.

We evaluated replacing the chiller based on energy savings. This has a long pay back and may not be justifiable based simply on energy considerations. However, the chiller has reached the end of its normal useful life. Typically, the marginal cost of purchasing a high efficiency chiller can be justified by the marginal savings from the improved efficiency. When the chillers are eventually replaced, consider purchasing equipment that exceed the minimum efficiency required by building codes.

4.6 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Gas Heating (HVAC/Process) Replacement		0	0.0	242	\$3,241	\$132,646	\$20,773	\$111,873	34.5	28,339
ECM 12	Install High Efficiency Hot Water Boilers	0	0.0	143	\$1,922	\$96,149	\$14,373	\$81,777	42.6	16,801
ECM 13	Install High Efficiency Furnaces	0	0.0	99	\$1,320	\$36,496	\$6,400	\$30,096	22.8	11,538

ECM 12: Install High Efficiency Hot Water Boilers

Replace older inefficient hot water boilers with high efficiency hot water boilers. Energy savings results from improved combustion efficiency and reduced standby losses at low loads.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load at this facility. In many cases installing multiple modular boilers rather than one or two large boilers will result in higher overall plant efficiency while providing additional system redundancy.

Replacing the boilers has a long payback and may not be justifiable based simply on energy considerations. However, the boilers have reached the end of their normal useful life. Typically, the marginal cost of purchasing high efficiency boilers can be justified by the marginal savings from the improved efficiency. When the boiler is eventually replaced, consider purchasing boilers that exceed the minimum efficiency required by building codes. We also recommend working with your mechanical design team to determine whether the heating system can operate with return water temperatures below 130°F, which would allow the use of condensing boilers.

ECM 13: Install High Efficiency Furnaces

Replace standard efficiency furnaces with condensing furnaces. Improved combustion technology and heat exchanger design optimize heat recovery from the combustion gases which can significantly improve furnace efficiency. Savings result from improved system efficiency.

Note: these units produce acidic condensate that requires proper drainage.

Affected units: Reznor furnaces serving room seven, the cafeteria, the library, and rooms 8,14, and 15.



4.7 HVAC Improvements

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
HVAC System Improvements		1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520
ECM 14	Implement Demand Control Ventilation (DCV)	1,312	0.0	10	\$352	\$4,078	\$0	\$4,078	11.6	2,520

ECM 14: Implement Demand Control Ventilation (DCV)

Demand control ventilation (DCV) monitors the indoor air's carbon dioxide (CO₂) content to measure room occupancy. This data is used to regulate the amount of outdoor air provided to the space for ventilation.

Standard ventilation systems often provide outside air based on a space's estimated maximum occupancy but not actual occupancy. During low occupancy periods, the space may then be over ventilated. This wastes energy through heating and cooling the excess outside air flow. DCV reduces unnecessary outdoor air intake by regulating ventilation based on actual occupancy levels. DCV is most suited for facilities where occupancy levels vary significantly from hour to hour and day to day.

Energy savings associated with DCV are based on hours of operation, space occupancy, outside air reduction, and other factors. Energy savings results from eliminating unnecessary ventilation and space conditioning.

Affected building areas: gymnasium and cafeteria units.

4.8 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	39	\$521	\$8,963	\$1,179	\$7,784	14.9	4,559
ECM 15	Install High Efficiency Gas-Fired Water Heater	0	0.0	23	\$305	\$8,841	\$1,057	\$7,784	25.5	2,670
ECM 16	Install Low-Flow DHW Devices	0	0.0	16	\$216	\$122	\$122	\$0	0.0	1,889

ECM 15: Install High Efficiency Gas-Fired Water Heater

Replace the existing tank water heater with a high efficiency condensing tank water heater. Energy savings result from the increased efficiency of the unit, which uses less gas to heat water, and fewer operating hours to maintain the tank water temperature.

ECM 16: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

4.9 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623
ECM 17	Vending Machine Control	1,612	0.2	0	\$264	\$230	\$0	\$230	0.9	1,623

ECM 17: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and they power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁵. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Lighting Maintenance



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

⁵ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.



AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the water side or fire side of the boiler.

Furnace Maintenance


Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

Water Heater Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Plug Load Controls



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips⁶. Your local utility may offer incentives or rebates for this equipment.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense® website⁷ or download a copy of EPA's "WaterSense® at Work: Best Management Practices for Commercial and Institutional Facilities"⁸ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense® products where available.

⁶ For additional information refer to "Assessing and Reducing Plug and Process Loads in Office Buildings" <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

⁷ <https://www.epa.gov/watersense>.

⁸ <https://www.epa.gov/watersense/watersense-work-0>.



6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has high potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the high potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

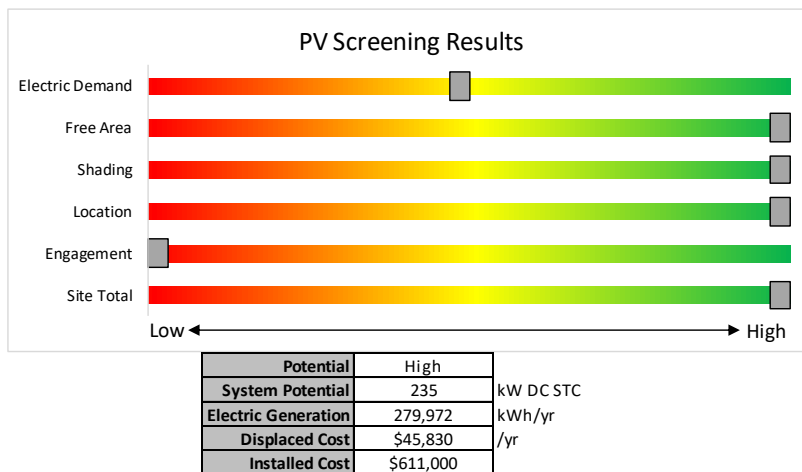


Figure 9 - Photovoltaic Screening

Solar Renewable Energy Certificate (SREC) Registration Program (SRP)

Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SREC Registration Program before starting construction. Once your PV system is up and running, you periodically earn credits, which can then be sold on the open market for up to 15 years.

If you are considering installing solar photovoltaics on your building, visit www.njcleanenergy.com/srec for more information about the SREC Registration Program.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- **Basic Info on Solar PV in NJ:** www.njcleanenergy.com/whysolar.
- **NJ Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs.
- **Approved Solar Installers in the NJ Market:** www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1.

6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

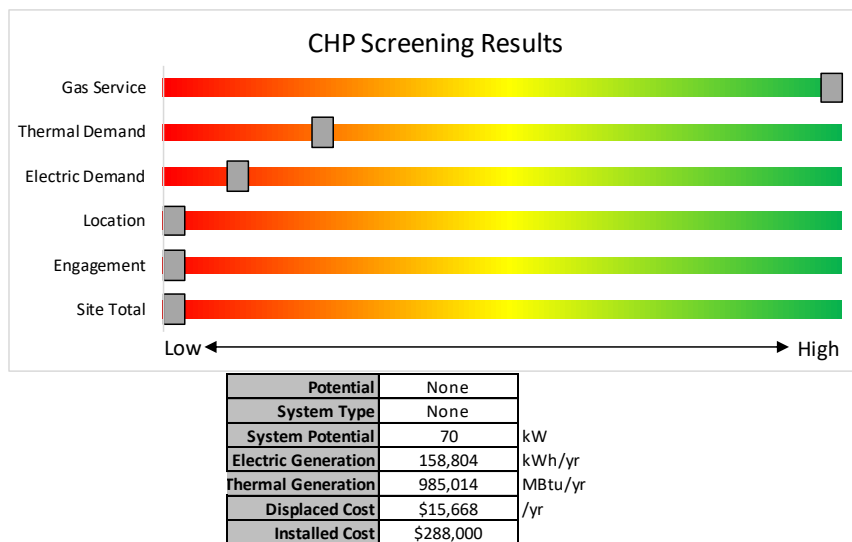


Figure 10 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation:
http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/.

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey's Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			



7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficient equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

*Electric Chillers
Electric Unitary HVAC
Gas Cooling
Gas Heating
Gas Water Heating
Ground Source Heat Pumps
Lighting*

*Lighting Controls
Refrigeration Doors
Refrigeration Controls
Refrigerator/Freezer Motors
Food Service Equipment
Variable Frequency Drives*

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.



7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Pay for Performance - Existing Buildings



Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures that results in at least 15% source energy savings, and lighting cannot make up the majority of the savings. P4P is a generally a good option for

medium-to-large sized facilities looking to implement as many measures as possible under a single project to achieve deep energy savings. This program has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program.

Incentives

Incentives are based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

Contact one of the pre-approved consultants and contractors ("Partners"). Under direct contract to you, they will help further evaluate the measures identified in this report through development of the energy reduction plan), assist you in implementing selected measures, and verify actual savings one year after the installation. Your Partner will also help you apply for incentives.

Approval of the final scope of work is required by the program prior to installation. Installation can be done by the contractor of your choice (some P4P Partners are also contractors) or by internal staff, but the Partner remains involved throughout construction to ensure compliance with the program requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: www.njcleanenergy.com/P4P.

7.4 Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

Incentives

Eligible Technologies	Size (Installed Rated Capacity) ¹	Incentive (\$/kW)	% of Total Cost Cap per Project ³	\$ Cap per Project ³
Powered by non-renewable or renewable fuel source ⁴	≤500 kW	\$2,000	30-40% ²	\$2 million
Gas Internal Combustion Engine	>500 kW - 1 MW	\$1,000		
Gas Combustion Turbine	> 1 MW - 3 MW	\$550	30%	\$3 million
Microturbine	>3 MW	\$350		
Fuel Cells with Heat Recovery	>3 MW	\$350		
Waste Heat to Power*	<1 MW	\$1,000	30%	\$2 million
	> 1MW	\$500		\$3 million

*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

How to Participate

You work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at: www.njcleanenergy.com/CHP.



7.5 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.



7.6 SREC Registration Program

The SREC (Solar Renewable Energy Certificate) Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey SRECs. SREC's are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SREC's to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar Renewable Portfolio Standard. Purchasing SRECs can help them meet those requirements. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period fluctuates depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.



8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁹.

8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹⁰.

⁹ www.state.nj.us/bpu/commercial/shopping.html.

¹⁰ www.state.nj.us/bpu/commercial/shopping.html.



APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mech room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	5	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Boiler room	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	5	62	2,400	2	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.1	523	0	\$84	\$219	\$0	2.6
Boiler room	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Electrical room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	5	62	1,240	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	90	0	\$14	\$73	\$0	5.0
Storage room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	5	62	1,240	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	856	0.1	115	0	\$18	\$189	\$0	10.3
Stage	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	5	62	2,400	2	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.2	610	0	\$98	\$256	\$0	2.6
Stage	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Gym	24	Compact Fluorescent: 4 pin - 4 lamps	Wall Switch	5	16	2,400	2, 3	Relamp	Yes	24	LED Lamps: 4 pin - 4 lamps	Occupancy Sensor	11	1,656	0.1	524	0	\$84	\$2,609	\$0	30.9
Gym	45	Metal Halide: (1) 100W Lamp	Wall Switch	5	128	780	1, 3	Fixture Replacement	Yes	45	LED - Fixtures: High-Bay	Occupancy Sensor	38	538	3.3	3,919	-1	\$630	\$35,950	\$0	57.0
Gym	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Gym entrance	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	5	62	2,400	2	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.1	261	0	\$42	\$110	\$0	2.6
Gym entrance	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Storage room 1	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	5	33	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	1,240	0.0	22	0	\$4	\$33	\$0	9.3
Storage room 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	5	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Gym elevator	1	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	5	32	2,400	2	Relamp	No	1	LED Lamps: 4 pin - 1 lamp	Wall Switch	22	2,400	0.0	25	0	\$4	\$27	\$0	6.7
Wall pack	15	LED Lamps: Corn bulb - 1 lamp	Photocell		54	4,380		None	No	15	LED Lamps: Corn bulb - 1 lamp	Photocell	54	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Recessed	16	Metal Halide: (1) 50W Lamp	Photocell		72	4,380	1	Fixture Replacement	No	16	LED - Fixtures: Downlight Recessed	Photocell	22	4,380	0.0	3,532	0	\$578	\$2,428	\$0	4.2
Pole light	20	Metal Halide: (1) 250W Lamp	Photocell		295	4,380	1	Fixture Replacement	No	20	LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture	Photocell	89	4,380	0.0	18,089	0	\$2,961	\$18,611	\$0	6.3
Wall pack	1	Metal Halide: (1) 400W Lamp	Photocell		458	4,380	1	Fixture Replacement	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	137	4,380	0.0	1,404	0	\$230	\$966	\$0	4.2
Pole light	1	LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture	Photocell		120	4,380		None	No	1	LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture	Photocell	120	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Wall pack	6	LED Lamps: Screw-in 1 lamp	Photocell		9	4,380		None	No	6	LED Lamps: Screw-in 1 lamp	Photocell	9	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Cafeteria	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	5	93	2,400	2, 3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$1,467	\$0	4.6
Cafeteria	13	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	5	42	2,400	2, 3	Relamp	Yes	13	LED Lamps: 4 pin - 1 lamp	Occupancy Sensor	29	1,656	0.2	745	0	\$120	\$353	\$0	2.9
Cafeteria	4	Compact Fluorescent: 4 pin - 4 lamps	Wall Switch	5	104	2,400	2, 3	Relamp	Yes	4	LED Lamps: 4 pin - 4 lamps	Occupancy Sensor	73	1,656	0.2	568	0	\$91	\$435	\$0	4.8
Cafeteria	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	19	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	19	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.6	2,106	0	\$339	\$1,234	\$0	3.6
Kitchen	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	856	0.1	115	0	\$18	\$189	\$0	10.3
Laundry room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Dishwasher	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	90	0	\$14	\$73	\$0	5.0
Kitchen hood	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.1	348	0	\$56	\$146	\$0	2.6
Copy room	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$416	\$0	5.8
Staff lounge	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Staff lounge	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2, 3	Relamp	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	56	0	\$9	\$303	\$0	33.5
Restroom #4	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Restroom #3	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Library	40	Linear Fluorescent - T5HO: 4' T5HO (54W) - 1L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	40	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,656	1.5	5,491	-1	\$883	\$1,810	\$0	2.0
Library	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Tech room	21	Linear Fluorescent - T5HO: 4' T5HO (54W) - 1L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	21	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,656	0.8	2,883	-1	\$464	\$923	\$0	2.0
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.1	333	0	\$54	\$226	\$0	4.2
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Library hallway	16	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 4	Relamp	Yes	16	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	1,656	0.5	1,774	0	\$285	\$1,484	\$0	5.2
Library hallway	4	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	42	2,400	2, 4	Relamp	Yes	4	LED Lamps: 4 pin - 1 lamp	High/Low Control	29	1,656	0.1	229	0	\$37	\$109	\$0	2.9
Library hallway	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	174	0	\$28	\$73	\$0	2.6
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Restroom	1	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	42	2,400	2	Relamp	No	1	LED Lamps: 4 pin - 1 lamp	Wall Switch	29	2,400	0.0	33	0	\$5	\$27	\$0	5.1



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Music room	24	Linear Fluorescent - TSHO: 4' TSHO (54W) - 1L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	24	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,656	0.9	3,294	-1	\$530	\$978	\$0	1.8
Music room	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Music room	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.0	166	0	\$27	\$55	\$0	2.0
Janitorial	1	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	42	1,240	2	Relamp	No	1	LED Lamps: 4 pin - 1 lamp	Wall Switch	29	1,240	0.0	17	0	\$3	\$27	\$0	9.8
Restroom #6	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Restroom #5	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Boys gym office	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.1	499	0	\$80	\$434	\$0	5.4
Girls gym office	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.1	333	0	\$54	\$380	\$0	7.1
SGA	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$416	\$0	5.8
Science lab	15	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	15	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.7	2,494	-1	\$401	\$1,092	\$0	2.7
Science lab	3	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	168	0	\$27	\$98	\$0	3.6
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Break room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	222	0	\$36	\$189	\$0	5.3
HS wing hallway	8	Compact Fluorescent: 4 pin - 4 lamps	Wall Switch	S	104	2,400	2, 4	Relamp	Yes	8	LED Lamps: 4 pin - 4 lamps	High/Low Control	73	1,656	0.3	1,136	0	\$183	\$1,095	\$0	6.0
HS wing hallway	10	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	32	2,400	2, 4	Relamp	Yes	10	LED Lamps: 4 pin - 1 lamp	High/Low Control	22	1,656	0.1	437	0	\$70	\$722	\$0	10.3
HS wing hallway	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Exit 11	1	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	32	2,400	2	Relamp	No	1	LED Lamps: 4 pin - 1 lamp	Wall Switch	22	2,400	0.0	25	0	\$4	\$27	\$0	6.7
Room 16	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 16	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Room 16	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0
Room 16 storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Room 16 restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Room 17	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2, 3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 17	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Room 17	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Room 18	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 18	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Room 18	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Room 19	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 19	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Room 20	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 20	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Room 20	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0
Room 19	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	5.8
Room 21	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 21	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0
Room 21	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Room 22	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 22	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Room 22	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0
Room 22	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.0	111	0	\$18	\$37	\$0	2.0



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Room 23	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 23	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Room 23	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0
Room 23	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.0	111	0	\$18	\$37	\$0	2.0
Room 23	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	56	0	\$9	\$33	\$0	3.6
Room 24	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Room 24	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	112	0	\$18	\$65	\$0	3.6
Room 24	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$146	\$0	2.0
Room 24	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.0	111	0	\$18	\$37	\$0	2.0
Room 24	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2,3	Relamp	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	56	0	\$9	\$33	\$0	3.6
Science office	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.1	333	0	\$54	\$110	\$0	2.0
Room 25	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Math office	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.1	333	0	\$54	\$380	\$0	7.1
Arts office	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,400	2,3	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,656	0.1	333	0	\$54	\$380	\$0	7.1
Room 26	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Boys restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Girls restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Common room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Room 1	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.5	1,995	0	\$321	\$927	\$0	2.9
Storage	1	Incandescent: Screw-in 1 lamp	Wall Switch	S	65	1,240	2	Relamp	No	1	LED Lamps: Screw-in 1 lamp	Wall Switch	10	1,240	0.0	75	0	\$12	\$17	\$0	1.4
MS wing hallway	20	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,4	Relamp	Yes	20	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	1,656	0.6	2,217	0	\$357	\$1,630	\$0	4.6
MS wing hallway	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 2	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 3	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2,3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Room 4	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 5	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 6	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 7	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 8	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Girls restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	222	0	\$36	\$189	\$0	5.3
Storage	1	Incandescent: Screw-in 1 lamp	Wall Switch	S	65	1,240	2	Relamp	No	1	LED Lamps: Screw-in 1 lamp	Wall Switch	10	1,240	0.0	75	0	\$12	\$17	\$0	1.4
Nurse's office	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$416	\$0	5.8
Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Janitorial	1	Incandescent: Screw-in 1 lamp	Wall Switch	S	65	1,240	2	Relamp	No	1	LED Lamps: Screw-in 1 lamp	Wall Switch	10	1,240	0.0	75	0	\$12	\$17	\$0	1.4
Boys restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	222	0	\$36	\$343	\$0	9.6
Maintenance office	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	222	0	\$36	\$343	\$0	9.6
Maintenance office	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,400	0.0	77	0	\$12	\$72	\$0	5.9
Server closet	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	1,240	0.0	40	0	\$6	\$72	\$0	11.4
Office	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	222	0	\$36	\$343	\$0	9.6
Main office	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.2	665	0	\$107	\$489	\$0	4.6
Main office	1	Incandescent: Screw-in 1 lamp	Wall Switch	S	65	2,400	2	Relamp	No	1	LED Lamps: Screw-in 1 lamp	Wall Switch	10	2,400	0.0	146	0	\$23	\$17	\$0	0.7
Restroom	1	Incandescent: Screw-in 1 lamp	Wall Switch	S	65	2,400	2	Relamp	No	1	LED Lamps: Screw-in 1 lamp	Wall Switch	10	2,400	0.0	146	0	\$23	\$17	\$0	0.7
Principal office	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	443	0	\$71	\$416	\$0	5.8
Closet 1	1	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	32	1,240	2	Relamp	No	1	LED Lamps: 4 pin - 1 lamp	Wall Switch	22	1,240	0.0	13	0	\$2	\$27	\$0	12.9
Closet 2	1	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	32	1,240	2	Relamp	No	1	LED Lamps: 4 pin - 1 lamp	Wall Switch	22	1,240	0.0	13	0	\$2	\$27	\$0	12.9
Exit 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
ES wing hallway	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
ES wing hallway	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 15	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Room 14	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 13	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	222	0	\$36	\$343	\$0	9.6
Room 13	6	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,400	2, 3	Relamp	Yes	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,656	0.3	1,172	0	\$189	\$708	\$0	3.8
Room 12	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 11	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Room 10	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.3	1,109	0	\$178	\$635	\$0	3.6
Room 9	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.4	1,552	0	\$250	\$781	\$0	3.1
Storage room 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	856	0.1	115	0	\$18	\$189	\$0	10.3
Storage room 2	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	856	0.1	115	0	\$18	\$189	\$0	10.3
Storage room 3	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2, 3	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	856	0.3	515	0	\$83	\$445	\$0	5.4
Storage room 4	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	856	0.1	172	0	\$28	\$226	\$0	8.2
Storage	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Old Auditorium	25	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,400	2	Relamp	No	25	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,400	1.0	3,696	-1	\$595	\$1,826	\$0	3.1
Old Auditorium	4	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Storage room	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,240	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	1,240	0.0	76	0	\$12	\$73	\$0	5.9
Stage 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,400	2	Relamp	No	3	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,400	0.1	444	0	\$71	\$219	\$0	3.1
Stage 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Councilor office	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.3	998	0	\$161	\$599	\$0	3.7
Storage	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Gym lobby	1	Compact Fluorescent: 4 pin - 4 lamps	Wall Switch	S	104	2,400	2	Relamp	No	1	LED Lamps: 4 pin - 4 lamps	Wall Switch	73	2,400	0.0	82	0	\$13	\$109	\$0	8.2
Gym lobby	10	Compact Fluorescent: 4 pin - 1 lamp	Wall Switch	S	32	2,400	2, 3	Relamp	Yes	10	LED Lamps: 4 pin - 1 lamp	Occupancy Sensor	22	1,656	0.1	437	0	\$70	\$542	\$0	7.7
Gym lobby	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Gym lobby	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,400	0.0	87	0	\$14	\$37	\$0	2.6
Janitorial	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0



	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Electrical room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,240	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,240	0.0	45	0	\$7	\$37	\$0	5.0
Girls restroom	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	333	0	\$54	\$380	\$0	7.1
Girls restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2, 3	Relamp	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	56	0	\$9	\$303	\$0	33.5
Boys restroom	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,656	0.1	333	0	\$54	\$380	\$0	7.1
Boys restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2, 3	Relamp	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,656	0.0	56	0	\$9	\$303	\$0	33.5
Restroom #1	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Restroom #2	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,400	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,400	0.0	42	0	\$7	\$33	\$0	4.8
Gym hallway	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,400	2, 4	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	1,656	0.2	887	0	\$143	\$742	\$0	5.2
Gym hallway	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0



Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mech room	Air Compressor	1	Air Compressor	0.8	60.0%	No	W	1,240		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mech room	Air Compressor	1	Air Compressor	0.5	60.0%	No	W	1,240		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mech room	AHU	1	Supply Fan	7.5	91.7%	No	W	2,000	5	No	91.7%	Yes	1	2.1	4,576	0	\$749	\$4,738	\$0	6.3
Boiler room	CHW	2	Chilled Water Pump	25.0	90.2%	No	W	1,240	6	No	93.6%	Yes	2	10.0	20,486	0	\$3,353	\$21,690	\$0	6.5
Boiler room	CHW	2	Chilled Water Pump	5.0	87.5%	No	W	1,240	6	No	89.5%	Yes	2	1.9	4,124	0	\$675	\$8,152	\$0	12.1
Boiler room	Air Combustion	2	Combustion Air Fan	1.5	84.0%	No	W	2,745		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler room	Boiler	2	Heating Hot Water Pump	10.0	89.5%	No	W	1,240	7	No	91.7%	Yes	2	2.1	8,086	0	\$1,324	\$10,303	\$0	7.8
Roof	Various spaces	3	Exhaust Fan	0.8	60.0%	No	W	2,745		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU 2	1	Supply Fan	5.0	87.5%	No	W	2,000	5	No	89.5%	Yes	1	1.5	3,326	0	\$544	\$4,076	\$0	7.5
Roof	RTU 2	1	Return Fan	5.0	87.5%	No	W	2,000	5	No	89.5%	Yes	1	1.5	3,326	0	\$544	\$4,076	\$0	7.5
Roof	RTU 5	1	Supply Fan	5.0	87.5%	Yes	W	2,000		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU 5	1	Return Fan	3.0	86.5%	Yes	W	2,000		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	RTU 1	1	Supply Fan	5.0	87.5%	No	W	2,000	5	No	89.5%	Yes	1	1.5	3,326	0	\$544	\$4,076	\$0	7.5
Roof	RTU 1	1	Return Fan	5.0	87.5%	No	W	2,000	5	No	89.5%	Yes	1	1.5	3,326	0	\$544	\$4,076	\$0	7.5
Roof	RTU 3	1	Supply Fan	7.5	87.5%	No	W	2,000	5	No	91.0%	Yes	1	2.3	5,128	0	\$839	\$4,738	\$0	5.6
Roof	RTU 4	1	Supply Fan	7.5	87.5%	No	W	2,000	5	No	91.0%	Yes	1	2.3	5,128	0	\$839	\$4,738	\$0	5.6
Roof	EF2 Kitchen	1	Exhaust Fan	0.3	60.0%	No	W	2,745		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	EF1 Kitchen hood	1	Kitchen Hood Exhaust Fan	0.5	60.0%	No	W	1,680		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Kitchen	1	Exhaust Fan	0.3	60.0%	No	W	2,745		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom	Unitvents	20	Supply Fan	0.3	60.0%	No	W	2,745		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



Electric HVAC Inventory & Recommendations

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Unknown	3	Ductless Mini-Split AC	0.75		B	8	Yes	3	Ductless Mini-Split AC	0.75		18.00		0.7	980	0	\$160	\$6,164	\$0	38.4
Roof	Unknown	3	Ductless Mini-Split AC	0.75		B	8	Yes	3	Ductless Mini-Split AC	0.75		18.00		0.7	980	0	\$160	\$6,164	\$0	38.4
Roof	Unknown	2	Ductless Mini-Split AC	1.00		B	8	Yes	2	Ductless Mini-Split AC	1.00		18.00		0.6	871	0	\$143	\$5,479	\$0	38.4
Roof	Unknown	1	Ductless Mini-Split AC	1.00		B	8	Yes	1	Ductless Mini-Split AC	1.00		18.00		0.3	436	0	\$71	\$2,739	\$0	38.4
Roof	Gym - RTU 2	1	Packaged AC	10.00		B	8	Yes	1	Packaged AC	10.00		11.50		2.0	2,653	0	\$434	\$17,821	\$0	41.0
Roof	Offices - RTU 5	1	Packaged AC	8.00		B	8	Yes	1	Packaged AC	8.00		11.50		1.6	2,123	0	\$347	\$14,257	\$0	41.0
Roof	Gym - RTU 1	1	Packaged AC	10.00		B	8	Yes	1	Packaged AC	10.00		11.50		2.0	2,653	0	\$434	\$17,821	\$0	41.0
Roof	Cafeteria - RTU 3	1	Packaged AC	8.00		B	8	Yes	1	Packaged AC	8.00		11.50		1.6	2,123	0	\$347	\$14,257	\$0	41.0
Ground floor	Unknown	1	Split-System AC	2.50		B	8	Yes	1	Split-System AC	2.50		14.00		0.7	943	0	\$154	\$3,741	\$0	24.2
Roof	Kitchen - RTU 4	1	Packaged AC	8.00		B	8	Yes	1	Packaged AC	8.00		11.50		1.6	2,123	0	\$347	\$14,257	\$0	41.0
Ground floor	Copy Room	1	Split-System Air-Source HP	0.81	9.60	B	9	Yes	1	Split-System Air-Source HP	0.81	9.60	14.00	3.80	0.1	234	0	\$38	\$1,367	\$0	35.7
School	Various spaces	7	Electric Resistance Heat		17.06	B		No							0.0	0	0	\$0	\$0	\$0	0.0
School	Classroom	19	Packaged Terminal HP	1.23	12.10	B	10	Yes	19	Packaged Terminal HP	1.23	12.10	12.00	3.30	3.2	8,995	0	\$1,472	\$44,567	\$0	30.3
School	Classroom	42	Packaged Terminal HP	1.24	14.20	B	10	Yes	42	Packaged Terminal HP	1.24	14.20	12.00	3.30	7.2	14,258	0	\$2,334	\$99,857	\$0	42.8
Nurse office	Nurse office	1	Window AC	0.67		B	8	Yes	1	Window AC	0.67		12.00		0.1	132	0	\$22	\$726	\$0	33.7
School	Classroom	2	Ductless Mini-Split HP	1.50	21.60	N		No							0.0	0	0	\$0	\$0	\$0	0.0

Electric Chiller Inventory & Recommendations

		Existing Conditions					Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Ground floor	Various spaces	1	Air-Cooled Screw Chiller	70.00	B	11	Yes	1	Air-Cooled Screw Chiller	Variable	70.00	1.24	0.74	14.1	8,283	0	\$1,356	\$68,931	\$0	50.8	
Ground floor	Various spaces	1	Air-Cooled Screw Chiller	110.00	B	11	Yes	1	Air-Cooled Screw Chiller	Variable	110.00	1.24	0.74	29.2	17,149	0	\$2,807	\$108,320	\$0	38.6	



Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions				Energy Impact & Financial Analysis									
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mech room	Room 7	1	Furnace	270.00	B	13	Yes	1	Furnace	270.00	95.00%	AFUE	0.0	0	15	\$200	\$6,117	\$800	26.6
Mech room	Room 4 Cafeteria	1	Furnace	195.00	B	13	Yes	1	Furnace	195.00	95.00%	AFUE	0.0	0	13	\$168	\$4,418	\$800	21.6
Mech room	Library	1	Furnace	195.00	B	13	Yes	1	Furnace	195.00	95.00%	AFUE	0.0	0	13	\$168	\$4,418	\$800	21.6
Room 15, Room 8, Room 14	Room 15, Room 8, Room 14	3	Furnace	132.60	B	13	Yes	3	Furnace	132.60	95.00%	AFUE	0.0	0	26	\$342	\$9,013	\$2,400	19.3
Boiler room	Heating system	2	Non-Condensing Hot Water Boiler	#####	B	12	Yes	2	Non-Condensing Hot Water Boiler	#####	85.00%	Ec	0.0	0	143	\$1,922	\$96,149	\$14,373	42.6
Roof	Kitchen	2	Furnace	276.50	B	13	Yes	2	Furnace	276.50	95.00%	AFUE	0.0	0	33	\$442	\$12,530	\$1,600	24.7

Demand Control Ventilation Recommendations

Location	Area(s)/System(s) Affected	Recommendation Inputs					Energy Impact & Financial Analysis						
		ECM #	Number of Zones	Cooling Capacity of Controlled System (Tons)	Electric Heating Capacity of Controlled System (kBtu/hr)	Output Heating Capacity of Controlled System (MBh)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Gym - RTU 1	14	1.00	10.00			0.0	254	0	\$42	\$1,359	\$0	32.7
Roof	Gym - RTU 2	14	1.00	10.00			0.0	254	0	\$42	\$1,359	\$0	32.7
Roof	Cafeteria - RTU 3	14	1.00	8.00	195.00	195.00	0.0	803	10	\$269	\$1,359	\$0	5.1



DHW Inventory & Recommendations

		Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mech room	Restrooms	1	Storage Tank Water Heater (> 50 Gal)	B	15	Yes	1	Storage Tank Water Heater (> 50 Gal)	Natural Gas	93.00%	Et	0.0	0	17	\$227	\$4,392	\$532	17.0
Boiler room	Restrooms	1	Storage Tank Water Heater (> 50 Gal)	N		No						0.0	0	0	\$0	\$0	\$0	0.0
Closet	Kitchen	1	Storage Tank Water Heater (> 50 Gal)	B	15	Yes	1	Storage Tank Water Heater (> 50 Gal)	Natural Gas	93.00%	EF	0.0	0	6	\$79	\$4,449	\$525	49.9

Low-Flow Device Recommendations

		Recommendation Inputs				Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restrooms	16	17	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	16	\$216	\$122	\$122	0.0

Walk-In Cooler/Freezer Inventory & Recommendations

		Existing Conditions		Proposed Conditions			Energy Impact & Financial Analysis						
Location	Cooler/Freezer Quantity	Case Type/Temperature	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Medium Temp Freezer (0F to 30F)		No	No	No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Cooler (35F to 55F)		No	No	No	0.0	0	0	\$0	\$0	\$0	0.0



Commercial Refrigerator/Freezer Inventory & Recommendations

Existing Conditions				Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Cafeteria	2	Refrigerator Chest	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Cafeteria	2	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

Cooking Equipment Inventory & Recommendations

Existing Conditions				Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Equipment Type	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Gas Combination Oven/Steam Cooker (<15 Pans)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Gas Convection Oven (Half Size)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Gas Steamer	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Insulated Food Holding Cabinet (1/2 Size)	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

Dishwasher Inventory & Recommendations

	Existing Conditions					Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Dishwasher Type	Water Heater Fuel Type	Booster Heater Fuel Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Payback w/ Incentives in Years
Dishwasher room	1	Single Tank Conveyor (High Temp)	Electric	Electric	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0



Plug Load Inventory

Existing Conditions				
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Johnstone ES	1	Washing machine	900.0	Yes
Johnstone ES	1	Dryer	1,500.0	Yes
Johnstone ES	1	Combo washing/dryer	1,200.0	Yes
Johnstone ES	1	Dishwasher elec booster pump	36,000.0	Yes
Johnstone ES	2	Kitchen electrical table	3,000.0	Yes
Johnstone ES	5	Microwave	900.0	Yes
Johnstone ES	2	Toaster	1,200.0	Yes
Johnstone ES	3	Coffee machine	400.0	Yes
Johnstone ES	5	Refrigerator	180.0	Yes
Johnstone ES	2	Water cooler	520.0	Yes
Johnstone ES	2	Dehumidifier	600.0	Yes
Johnstone ES	3	TV	120.0	Yes
Johnstone ES	1	Kiln	11,000.0	Yes
Johnstone ES	10	Desktop Computer	145.0	Yes
Johnstone ES	10	Printers	90.0	Yes
Johnstone ES	250	Laptops	75.0	Yes


Vending Machine Inventory & Recommendations

Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis							
Location	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Staff lounge	1	Refrigerated	17	Yes	0.2	1,612	0	\$264	\$230	\$0	0.9
Staff lounge	1	Non-Refrigerated	N/A	No	0.0	0	0	\$0	\$0	\$0	0.0



APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.


LEARN MORE AT
energystar.gov

ENERGY STAR® Statement of Energy Performance

12
ENERGY STAR®
Score¹

Johnstone Elementary School
Primary Property Type: K-12 School
Gross Floor Area (ft²): 63,890
Built: 1951
For Year Ending: June 30, 2018
Date Generated: October 21, 2019

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information

Property Address
Johnstone Elementary School
165 S. Brewster Road
Vineland, New Jersey 08360

Property Owner
Vineland Public Schools
61 W. Landis Avenue
Vineland, NJ 08360
(856) 794-6700

Primary Contact
Gene Mercoli
61 W. Landis Avenue
Vineland, NJ 08360
856-794-6700, ext. 2226
weaver@vineland.org

Property ID: 7566440

Energy Consumption and Energy Use Intensity (EUI)

Site EUI	Annual Energy by Fuel		National Median Comparison	
89.3 kBtu/ft²	Electric - Grid (kBtu)	2,652,017 (46%)	National Median Site EUI (kBtu/ft²)	58.2
	Natural Gas (kBtu)	3,051,571 (54%)	National Median Source EUI (kBtu/ft²)	108.4
			% Diff from National Median Source EUI	54%
Source EUI	Annual Emissions			
166.4 kBtu/ft²	Greenhouse Gas Emissions (Metric Tons CO2e/year)			431

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer Stamp
(if applicable)



APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR®	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>



gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge:</i> high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium:</i> a type of HID lamp
HSPF	<i>Heating seasonal performance factor:</i> a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value:</i> a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt:</i> equal to 1,000 Watts.
kWh	<i>Kilowatt-hour:</i> 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode:</i> a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide:</i> a type of HID lamp
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor:</i> a type of HID lamp
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program:</i> NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.
psig	Pounds per square inch gauge
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic:</i> refers to an electronic device capable of converting incident light directly into electricity (direct current).



SEER	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR® Portfolio Manager®.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use
VAV	<i>Variable air volume</i>
VFD	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
WaterSense®	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.