



Local Government Energy Audit Report

Biology Building

May 6, 2021

Prepared for:

The College of New Jersey
2000 Pennington Road
Ewing, New Jersey 08628

Prepared by:

TRC
900 Route 9 North
Woodbridge, New Jersey 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2021 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents

1	Executive Summary.....	1
1.1	Planning Your Project	4
	Pick Your Installation Approach	4
	More Options from Around the State	6
2	Existing Conditions.....	7
2.1	Site Overview.....	7
2.2	Building Occupancy	7
2.3	Building Envelope	8
2.4	Lighting Systems.....	9
2.5	Air Handling Systems.....	11
	Heating, Ventilation, and Air Conditioning (HVAC) System Controls.....	11
	Radiant Heating.....	11
	Unitary Electric HVAC Equipment	11
	AHUs 12	
2.6	Steam System	14
2.7	Chilled Water Systems.....	15
2.8	Building EMS.....	16
2.9	Domestic Hot Water.....	17
2.10	Refrigeration.....	18
2.11	Plug Load & Vending Machines.....	19
2.12	Water-Using Systems	20
2.13	Process Equipment	21
3	Energy Use and Costs	22
3.1	Electricity	24
3.2	Natural Gas.....	25
	CUP Natural Gas Usage	26
	Biology Building Metered Natural Gas Usage	27
3.3	Benchmarking.....	28
	Tracking Your Energy Performance	29
4	Energy Conservation Measures	30
4.1	Lighting	33
	ECM 1: Install LED Fixtures	33
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	33
	ECM 3: Retrofit Fixtures with LED Lamps.....	34
4.2	Lighting Controls.....	34
	ECM 4: Install Occupancy Sensor Lighting Controls	34
	ECM 5: Install High/Low Lighting Controls	35
4.3	Motors.....	36

ECM 6: Premium Efficiency Motors	36
4.4 VFD	37
ECM 7: Install VFD on VAV Fans	37
ECM 8: Install VFDs on Water Supply Pump	37
4.5 Unitary HVAC.....	38
ECM 9: Install High Efficiency Air Conditioning Units.....	38
4.6 Domestic Water Heating	38
ECM 10: Install Low-Flow DHW Devices.....	38
4.7 Food Service & Refrigeration Measures.....	39
ECM 11: Refrigerator/Freezer Case Electrically Commutated Motors	39
ECM 12: Refrigeration Controls.....	39
ECM 13: Vending Machine Control	39
4.8 Custom Measures.....	40
ECM 14: Retro-Commissioning Study	40
ECM 15: Sub Metering	41
5 Energy Efficient Best Practices	42
Energy Tracking with ENERGY STAR® Portfolio Manager®	42
Weatherization.....	42
Lighting Maintenance.....	42
Lighting Controls	43
Motor Short Cycling Reduction	43
Motor Maintenance	43
Thermostat Schedules and Temperature Resets	43
Economizer Maintenance	43
AC System Evaporator/Condenser Coil Cleaning	43
HVAC Filter Cleaning and Replacement	44
Steam Trap Repair and Replacement.....	44
Water Heater Maintenance	44
Compressed Air System Maintenance	45
Refrigeration Equipment Maintenance.....	45
Plug Load Controls.....	45
Computer Power Management Software	46
Water Conservation	46
Procurement Strategies	46
6 On-site Generation	47
6.1 Solar Photovoltaic	48
6.2 Combined Heat and Power	50
7 Project Funding and Incentives.....	51
7.1 SmartStart	52
7.2 Direct Install	53
7.3 Pay for Performance - Existing Buildings.....	54
7.4 Combined Heat and Power	55
7.5 Energy Savings Improvement Program.....	56
7.6 Transition Incentive (TI) Program.....	57




8	Project Development	58
9	Energy Purchasing and Procurement Strategies	59
9.1	Retail Electric Supply Options.....	59
9.2	Retail Natural Gas Supply Options	59
	Appendix A: Equipment Inventory & Recommendations	A-1
	Appendix B: ENERGY STAR® Statement of Energy Performance.....	B-1
	Appendix C: Glossary	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPB) has sponsored this Local Government Energy Audit (LGEA) report for Biology Building. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

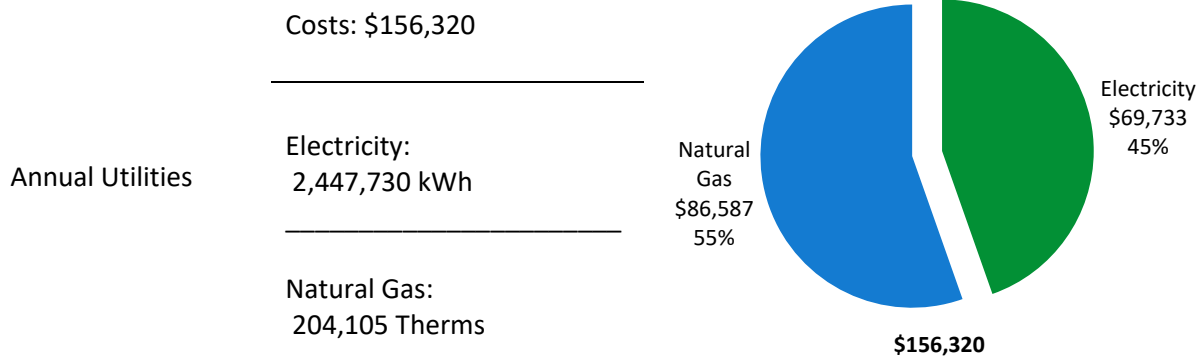

ENERGY STAR®
Benchmarking Score

N/A
(1-100 scale)

A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs.

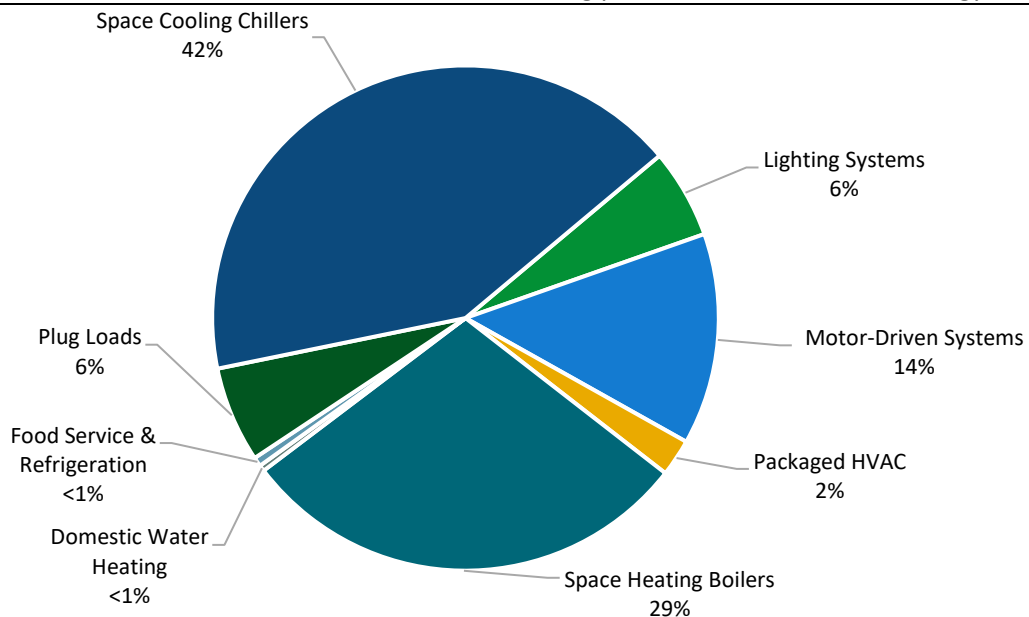


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$264,867
Potential Rebates & Incentives ¹	\$33,035
Annual Cost Savings	\$70,295
Annual Energy Savings	Electricity: 458,168 kWh Natural Gas: 6,813 Therms
Greenhouse Gas Emission Savings	271 Tons
Simple Payback	3.3 Years
Site Energy Savings (all utilities)	8%

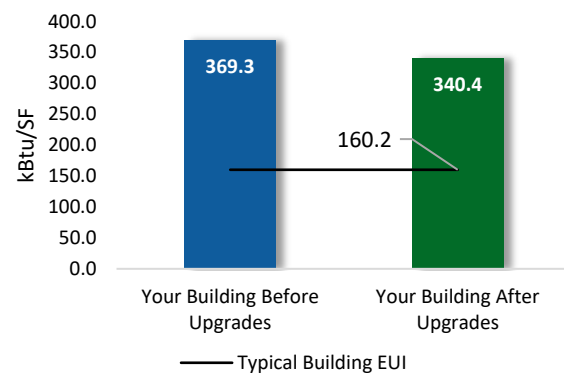

Scenario 2: Cost Effective Package²

Installation Cost	\$191,087
Potential Rebates & Incentives	\$29,260
Annual Cost Savings	\$65,439
Annual Energy Savings	Electricity: 425,159 kWh Natural Gas: 6,813 Therms
Greenhouse Gas Emission Savings	254 Tons
Simple Payback	2.5 Years
Site Energy Savings (all utilities)	7%

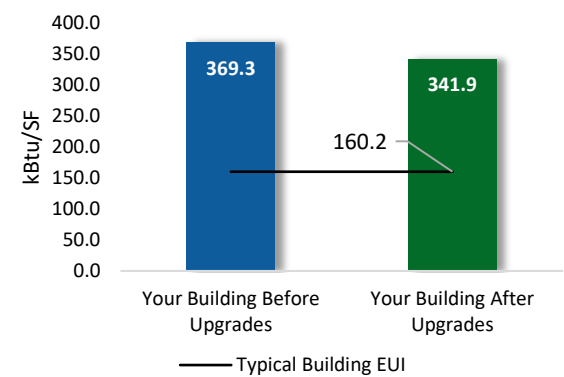

On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			225,051	21.5	-51	\$32,891	\$72,699	\$13,595	\$59,104	1.8	220,623
ECM 1	Install LED Fixtures	Yes	1,404	0.0	0	\$207	\$583	\$100	\$483	2.3	1,414
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	2,430	0.2	-1	\$355	\$528	\$80	\$448	1.3	2,382
ECM 3	Retrofit Fixtures with LED Lamps	Yes	221,217	21.3	-51	\$32,330	\$71,588	\$13,415	\$58,173	1.8	216,827
Lighting Control Measures			69,970	6.4	-16	\$10,226	\$44,424	\$9,295	\$35,129	3.4	68,575
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	60,230	5.6	-14	\$8,802	\$37,224	\$4,695	\$32,529	3.7	59,029
ECM 5	Install High/Low Lighting Controls	Yes	9,740	0.8	-2	\$1,423	\$7,200	\$4,600	\$2,600	1.8	9,546
Motor Upgrades			9,662	1.3	0	\$1,421	\$22,657	\$0	\$22,657	15.9	9,730
ECM 6	Premium Efficiency Motors	No	9,662	1.3	0	\$1,421	\$22,657	\$0	\$22,657	15.9	9,730
Variable Frequency Drive (VFD) Measures			75,963	11.4	0	\$11,175	\$29,373	\$6,000	\$23,373	2.1	76,494
ECM 7	Install VFD on Variable Air Volume (VAV) Fans	Yes	64,778	9.5	0	\$9,530	\$20,053	\$4,000	\$16,053	1.7	65,231
ECM 8	Install VFDs on Water Supply Pump	Yes	11,185	1.8	0	\$1,646	\$9,320	\$2,000	\$7,320	4.4	11,263
Unitary HVAC Measures			21,362	3.3	0	\$3,143	\$44,545	\$3,400	\$41,145	13.1	21,512
ECM 9	Install High Efficiency Air Conditioning Units	No	21,362	3.3	0	\$3,143	\$44,545	\$3,400	\$41,145	13.1	21,512
Domestic Water Heating Upgrade			0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222
ECM 10	Install Low-Flow DHW Devices	Yes	0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222
Food Service & Refrigeration Measures			5,108	0.4	0	\$751	\$8,858	\$665	\$8,193	10.9	5,144
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	Yes	1,572	0.2	0	\$231	\$1,820	\$240	\$1,580	6.8	1,583
ECM 12	Refrigeration Controls	No	1,984	0.1	0	\$292	\$6,578	\$375	\$6,203	21.2	1,998
ECM 13	Vending Machine Control	Yes	1,551	0.2	0	\$228	\$460	\$50	\$410	1.8	1,562
Custom Measures			51,053	0.0	730	\$10,606	\$42,168	\$0	\$42,168	4.0	136,845
ECM 14	Retro-Commissioning Study	Yes	26,575	0.0	406	\$5,631	\$23,368	\$0	\$23,368	4.1	74,264
ECM 15	Sub Metering	Yes	24,477	0.0	324	\$4,975	\$18,800	\$0	\$18,800	3.8	62,581
TOTALS (COST EFFECTIVE MEASURES)			425,159	39.7	681	\$65,439	\$191,087	\$29,260	\$161,827	2.5	507,904
TOTALS (ALL MEASURES)			458,168	44.3	681	\$70,295	\$264,867	\$33,035	\$231,832	3.3	541,144

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey's Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures	x		x
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	x		x
ECM 3	Retrofit Fixtures with LED Lamps	x		x
ECM 4	Install Occupancy Sensor Lighting Controls	x		x
ECM 5	Install High/Low Lighting Controls	x		x
ECM 6	Premium Efficiency Motors			x
ECM 7	Install VFD on Variable Air Volume (VAV) Fans	x		x
ECM 8	Install VFDs on Water Supply Pump	x		x
ECM 9	Install High Efficiency Air Conditioning Units	x		x
ECM 10	Install Low-Flow DHW Devices	x		x
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	x		x
ECM 12	Refrigeration Controls	x		x
ECM 13	Vending Machine Control	x		x
ECM 14	Retro-Commissioning Study			
ECM 15	Sub Metering			

Figure 3 – Funding Options



New Jersey's Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Incentives are paid out in three installments. The first installment is meant to help offset the costs of the initial engineering study. The subsequent incentives are paid based on the level of energy savings up to 50% of the total project cost. See Section 7.3 for all incentive details.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.

Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70 percent of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15 percent energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) Report for Biology Building. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On November 13, 2020, TRC performed an energy audit at The College of New Jersey's Biology Building located in Ewing, New Jersey. TRC met with Ben Paraan to review the facility operations and help focus our investigation on specific energy-using systems.

Biology Building is a three-story, 77,893 square foot building built in 2001. Spaces include classrooms, offices, laboratories, green houses, study rooms, a receiving area, copy rooms, conference rooms, corridors, hallways, vestibules, lobbies, animal room, stairwells, storage rooms, closets, rest rooms, electrical rooms, and mechanical spaces.

Facility concerns include installing utility sub-metering, which is addressed in Section 4.

2.2 Building Occupancy

The facility is typically occupied September through June. Typical weekday occupancy is 50 staff and 994 students.

This building is typically open during the school year from 6:00 AM to 10:00 PM, with varied use during the weekend and summer months.

Building Name	Weekday/Weekend	Operating Schedule
Biology Building	Weekday	6:00 AM - 10:00 PM
	Weekend	Varies
	Summer	Varies

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are concrete masonry units (CMUs) over structural steel with a brick facade. The roof is mostly flat, but some sections are pitched. The flat portion of the roof is insulated and covered with a single-ply black membrane, while the pitched portion of the roof is covered in faux slate tile roofing. Overall, the roof is in good condition.

Most of the windows are double pane, clear, fixed, and have aluminum frames with insulating glass. The glass-to-frame seals are in fair condition. There are also operable skylights with insulating glass used in the third-floor greenhouse. Exterior doors have steel frames and are in fair condition with undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration.



Building Envelope



Roof Material



2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear and U-bend fluorescent T8 lamps. There are also several 40-Watt T12 fixtures. Additionally, there are some compact fluorescent lamps (CFL), metal halide, halogen incandescent, and LED general purpose lamps. Typically, T8 fluorescent lamps use electronic ballasts and T12 fluorescent lamps use magnetic ballasts.

Fixture types include 1- 2- 3- or 6-lamp, 2- or 4-foot long troffer, recessed, and surface mounted fixtures. Additional fixture types include greenhouse lights, heat lamp fixtures, direct/indirect fixtures, wall mounted fixtures, 2x2 panel fixtures, recessed can fixtures, wall sconce fixtures, wall wash fixtures, pendant mounted fixtures, and 2-foot fixtures with U-bend tube lamps.

Most fixtures are in fair condition. Interior lighting levels were generally sufficient. All exit signs are LED.



Recessed Can Fixtures



Pendant Mounted & Wall Wash Fixtures



2 x 2 LED Panel Fixture



2 x 2 Recessed Fixture

Most lighting fixtures are controlled manually by wall switches, and the remainder are controlled by occupancy sensors.



Ceiling Mounted Occupancy Sensor

Exterior fixtures include arm-mounted fixtures, under canopy recessed can fixtures, and walkway bollard fixtures with high intensity discharge (HID), CFL, and LED lamps.

Exterior light fixtures are photocell controlled.



Bollard Fixture



Recessed Can Fixtures



Arm Mounted Fixture



Wall Mounted Fixture

2.5 Air Handling Systems

Heating, Ventilation, and Air Conditioning (HVAC) System Controls

The HVAC system is partially pneumatically controlled. A two motor, 2.0 hp air compressor located in the attic mechanical room serves the pneumatic system.

Radiant Heating

Radiant baseboard heating serves various areas of the building. Radiators are equipped with hot water coils.

Unitary Electric HVAC Equipment

A Trane condensing unit serves the direct expansion (DX) coils in air handling unit-5 (AHU), listed below. This unit has a 40.0-ton cooling capacity and a 10.67 energy efficiency rating (EER) cooling efficiency, after de-rating. De-rating shows the current efficiency of a unit while accounting for its age and condition.

There is also a Sanyo portable air conditioning (AC) serving room 113A with a cooling capacity of 0.60-ton and an estimated cooling efficiency of 11.30 EER.



Trane Split System AC



Portable AC

AHUs

A total of eight AHUs condition most building areas. The heating and ventilation units (HV-1 through HV-3) are equipped with steam coils, an outdoor air damper, and constant speed supply fan motors. Additional information is provided below:

Area Served	Unit Tag	Supply Fan Motor (HP)
Basement Mechanical Room	HV-1	7.5
Penthouse Mechanical Room North	HV-2	5.0
Penthouse Mechanical Room South	HV-3	5.0

AHU-1 through AHU-5 provide both heating and cooling. AHU-1 and AHU-2 are each equipped with steam coils, chilled water coils, a variable frequency drive (VFD) controlled supply fan motor, an outdoor air damper, and a steam humidifier. AHU-3 and AHU-4 are each equipped with hot water coils, chilled water coils, a VFD controlled supply fan motor, a VFD controlled return fan motor, an outdoor air damper, and an economizer. AHU-5 is equipped with DX coils served by an outdoor condensing unit, steam coils, a constant speed supply fan motor, an outdoor air damper, and a steam humidifier.

AHU-1 through 4 serve variable volume air (VAV) boxes throughout the building, while AHU-5 serves the animal lab rooms. These HVAC systems are controlled by the facility energy management system (EMS). Additional information about each of these AHUs is provided below:

Unit Tag	Supply Fan Motor (HP)	Return Fan Motor (HP)
AHU-1	75.0	-
AHU-2	75.0	-
AHU-3	15.0	5.0
AHU-4	15.0	5.0
AHU-5	15.0	-



HV-1



AHU-4



AHU-2



AHU-5 Steam Humidifier System

2.6 Steam System

Steam is supplied by boilers and the cogeneration heat recovery system located in the Power House/Cogen Building. Steam is used in this building to produce space heating water and domestic hot water through steam heat exchangers. Space heating water is circulated to air handling units and baseboard radiators by two VFD controlled 7.5 hp hot water pumps on a lead/lag control scheme. Energy use associated with producing steam was allocated to individual buildings served by the cogeneration system and boilers. Please see the Power House/Cogen building report for details regarding the steam system.



Heating Heat Exchanger



DHW Heat Exchanger



Hot Water Pumps



Hot Water Pump Controls

2.7 Chilled Water Systems

Chilled water is supplied by chillers located in the Power House/Cogen Building. Energy use associated with the steam engine and electric chillers used to produce chilled water was allocated to the individual buildings served by the chiller plant. Site staff indicated that since the chilled water system plant shifted from tertiary to secondary distribution, the two 25.0 hp, VFD controlled chilled water pumps at the building are not used. Chilled water is provided by the chilled water pumps located at the Power House/Cogen Building.

Please see the Power House/Cogen Building report for details regarding the chiller plant.



Chilled Water Pump




CHW Pump Controls


2.8 Building EMS

A Honeywell EMS controls the air handling units, VAV boxes, hot water system, chilled water system, exhaust fans, fume hoods, greenhouses, and hallway lighting. The EMS provides equipment scheduling control and monitors and controls space temperatures, supply air temperatures, return air temperatures, supply fan motor operation status, return fan motor operation status, exhaust fan motor operation status, motor speed, cooling and heating operation status, outdoor air damper position, economizer operation status, humidity, heating water loop temperatures, pump operation statuses, pump motor speed, lead/lag control, and chilled water loop temperatures.


The EMS also offers controls for the greenhouses' space temperatures, cooling and heating setpoint temperatures, ventilation damper positions, grow light operation statuses, exhaust fan operation statuses, watering system controls. The site staff is pleased with the current EMS, but we are recommending that a retro-commissioning study be completed, which is addressed in Section 4.

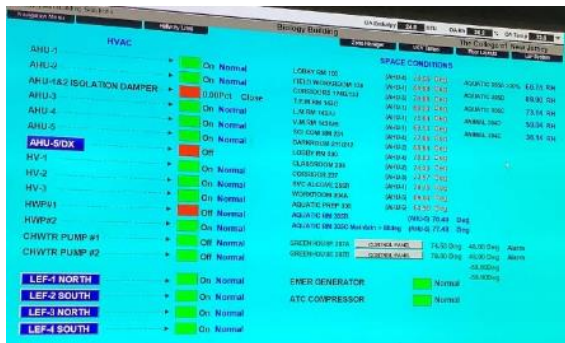


Main EMS Display

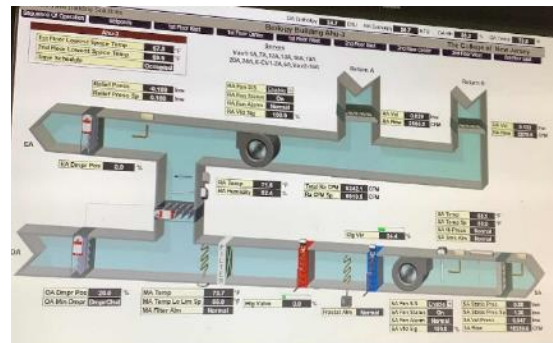

AHU-3 EMS Display

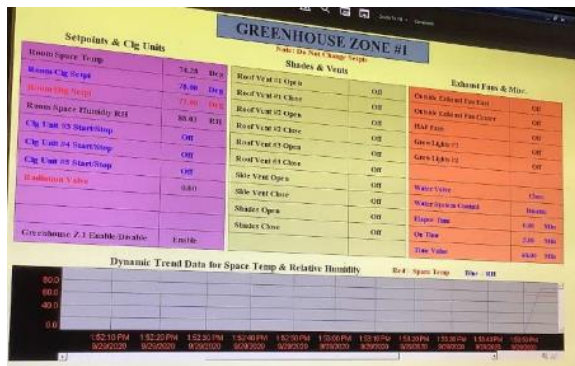

Greenhouse Zone #1 EMS Display

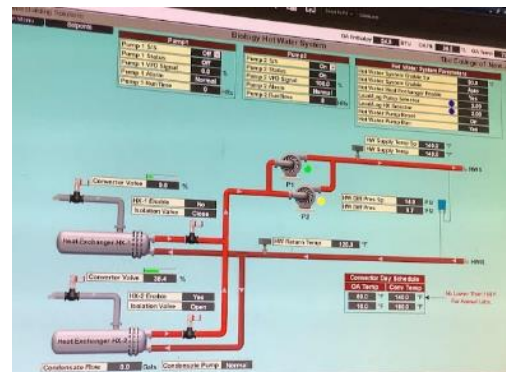

Heating Hot Water System EMS Display

2.9 Domestic Hot Water

Hot water is produced by a heat exchanger using steam from the Power House/Cogen Building's space heating boilers. There are two constant speed 7.5 hp booster water pumps on a lead/lag control scheme. The domestic hot water pipes are insulated, and the insulation is in fair condition.



DHW Heat Exchanger



Booster Water Pumps

2.10 Refrigeration

The laboratories have several stand-up refrigerators with solid doors. There are also four walk-in coolers throughout the building used for various laboratory research activities.

Two of the walk-in refrigerators each have an estimated 0.42-ton compressor located the attic mechanical space and two 1/15 hp fan evaporators. The two other walk-in refrigerators each have an estimated 0.64-ton compressor located in the attic mechanical space and two 1/15 hp fan evaporators.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Walk-In Refrigerator



Walk-In Refrigerator



Stand-Up Refrigerator

2.11 Plug Load & Vending Machines

You may wish to consider paying particular attention to minimizing your plug load usage. This report makes suggestions for ECMs in this area as well as energy efficient best practices.

There are approximately 121 computer workstations throughout the facility. Plug loads throughout the building include general classroom, laboratory, café, and office equipment. There are typical loads such as coffee machines, microwaves, paper shredders, printers, projectors, mini fridges, televisions, and a water cooler. There are also many laboratory specific miscellaneous plug loads throughout the building.

There are several residential style refrigerators throughout the building that are used to store laboratory experiments and necessities. These vary in condition and efficiency.

There is one refrigerated beverage vending machine and one non-refrigerated vending machine. Vending machines are not equipped with occupancy-based controls.



Laboratory Equipment



Large Printer/Copier



Residential Refrigerators



Vending Machines

2.12 Water-Using Systems

There are five restrooms with toilets, urinals, and sinks. Faucet flow rates are at 2.2 gallons per minute (gpm) or higher.



Rest Room Faucet

2.13 Process Equipment

A two motor, 7.5 hp air compressor and a two motor, 15.0 hp air compressor located in the basement mechanical room both serve as medical air pumps.

Additionally, there are two 2.0 hp process pumps used in the north lab and two 1.5 hp process pumps used in south lab. The pumps serving the south lab run continuously.

There are also two 2.0 hp lab waste pumps located in the basement mechanical room.



Lab Waste System



Lab Process Pumps




Medical Air Pump Air Compressor

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	2,447,730 kWh	\$69,733
Natural Gas	204,105 Therms	\$86,587
Total		\$156,320

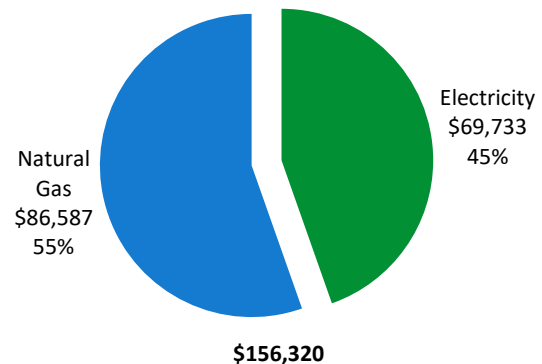

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


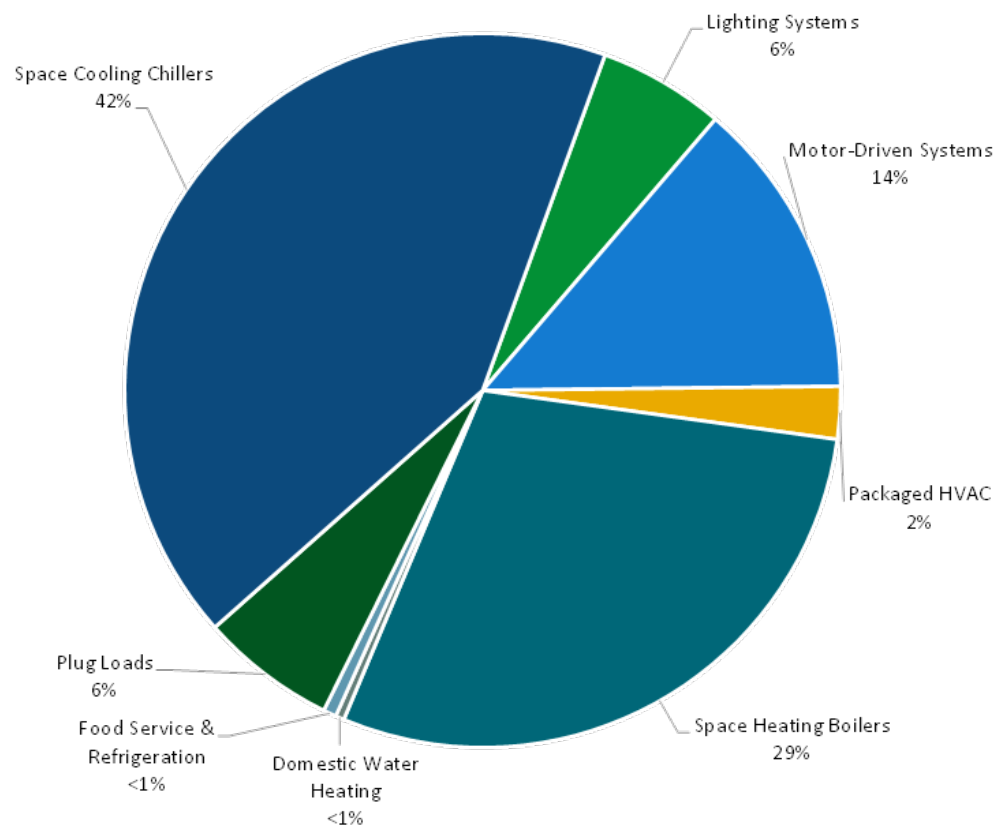


Figure 5 - Energy Balance

3.1 Electricity

PSE&G delivers electricity under rate class High Tension Service (HTS). Electricity for the building is supplemented by the cogeneration plant.

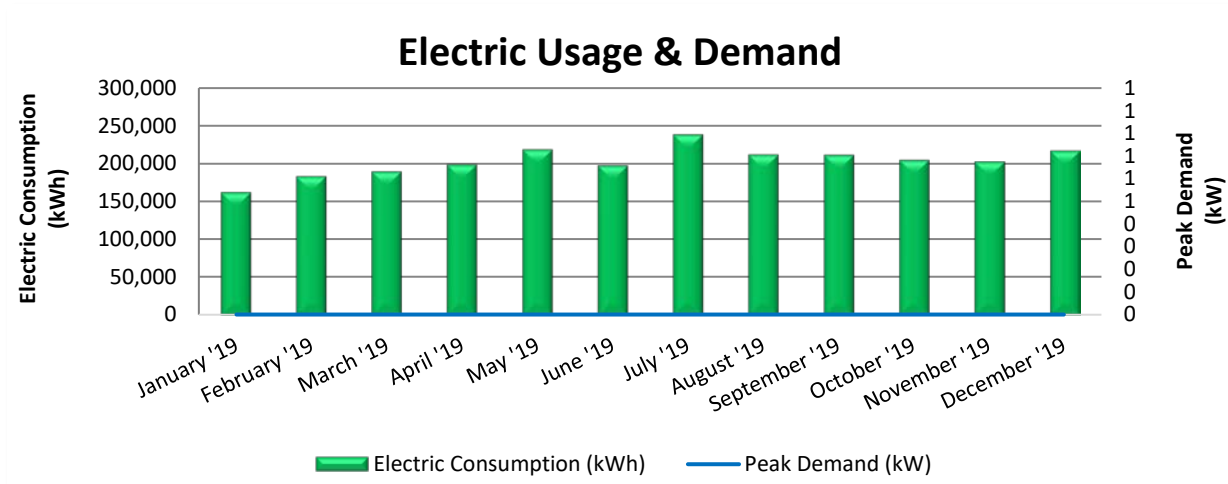


Electric Billing Data						
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost	TRC Estimated Usage?
1/28/19	31	163,024	0	\$0	\$3,558	Yes
2/28/19	31	183,999	0	\$0	\$4,527	Yes
3/28/19	28	190,344	0	\$0	\$4,138	Yes
4/28/19	31	199,986	0	\$0	\$4,501	Yes
5/29/19	31	219,635	0	\$0	\$8,099	Yes
6/27/19	29	198,458	0	\$0	\$6,307	Yes
7/29/19	32	239,615	0	\$0	\$8,637	Yes
8/27/19	29	212,831	0	\$0	\$6,042	Yes
9/26/19	30	212,716	0	\$0	\$6,617	Yes
10/25/19	29	205,559	0	\$0	\$5,705	Yes
11/25/19	31	203,607	0	\$0	\$4,920	Yes
12/11/19	33	217,956	0	\$0	\$6,683	Yes
Totals	365	2,447,730	0	\$0	\$69,733	
Annual	365	2,447,730	0	\$0	\$69,733	

Notes:

- Electric data has been estimated based on a campus wide approach and utilization of sub metered data. Please refer to the Power House/Cogen Building report for details regarding utility baseline and campus building utility desegregation.
- The peak demand for this facility was unavailable because the building is served with electricity from the master meter.
- The average purchased electric cost over the past 12 months was \$0.147/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- Effectively all of the electricity generated on-site is used on-site.

3.2 Natural Gas

The following charts provide the total estimated gas usage based on a percentage of the central plant gas use plus the usage associated with a dedicated gas meter that serves this building.

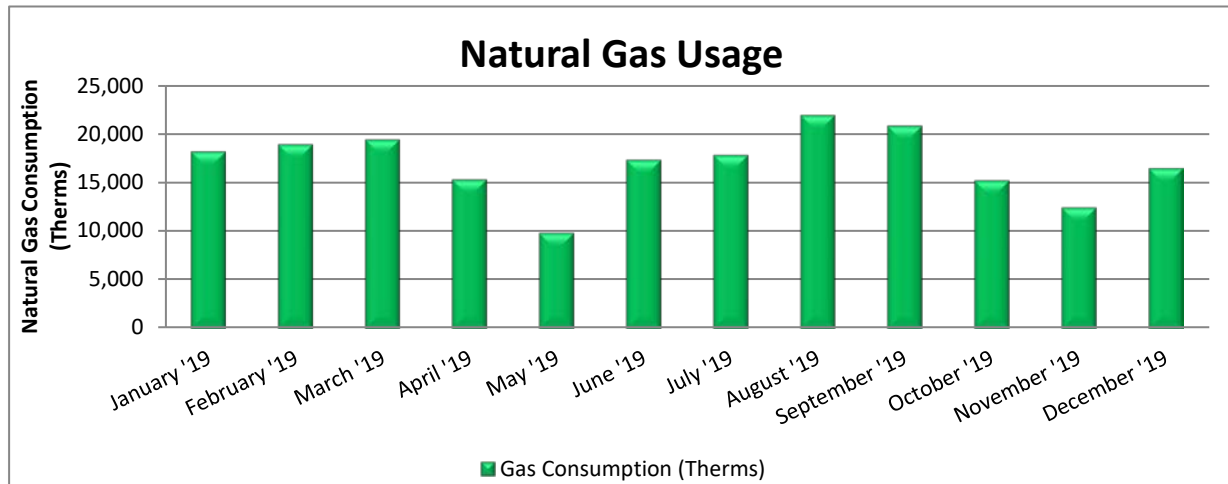


Gas Billing Data				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
1/31/19	31	18,238	\$6,859	Yes
2/28/19	28	18,967	\$9,044	Yes
3/31/19	31	19,438	\$8,746	Yes
4/30/19	30	15,342	\$6,439	Yes
5/31/19	31	9,871	\$4,286	Yes
6/30/19	30	17,352	\$7,508	Yes
7/31/19	31	17,868	\$7,245	Yes
8/31/19	31	21,980	\$8,631	Yes
9/30/19	30	20,858	\$8,377	Yes
10/31/19	31	15,239	\$6,530	Yes
11/30/19	30	12,460	\$5,490	Yes
12/31/19	31	16,492	\$7,432	Yes
Totals	365	204,105	\$86,587	
Annual	365	204,105	\$86,587	

Notes:

- The average gas cost for the past 12 months is \$0.424/therm, which is the blended rate used throughout the analysis.

CUP Natural Gas Usage

PSE&G delivers natural gas for the main boiler meter under rate class TSGNF. The following charts represent the central utility plant (CUP) natural gas usage for this building, estimated based on a campus wide approach.

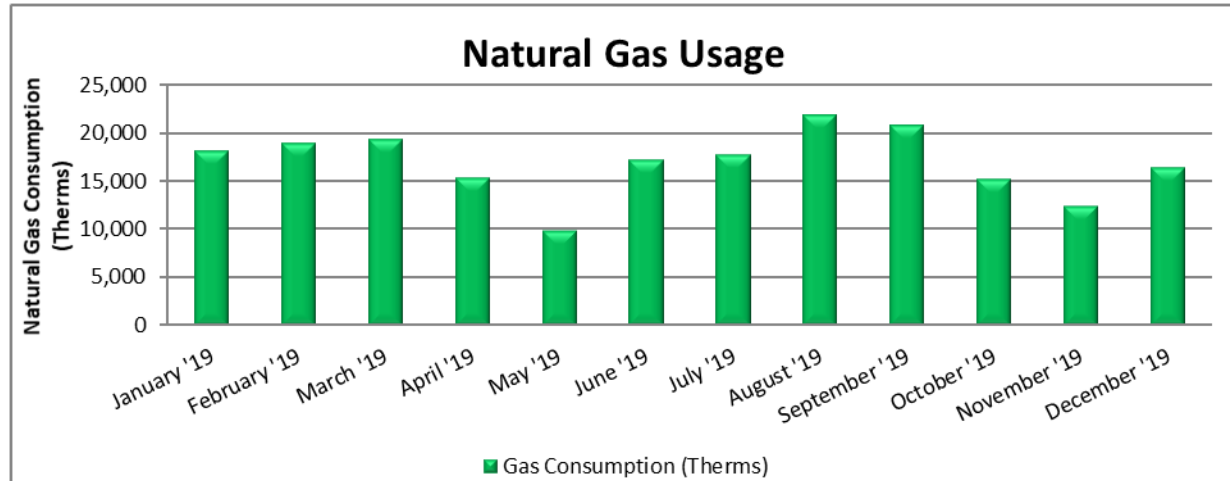


Gas Billing Data				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
1/31/19	31	18,234	\$6,840	Yes
2/28/19	28	18,958	\$9,021	Yes
3/31/19	31	19,424	\$8,719	Yes
4/30/19	30	15,339	\$6,421	Yes
5/31/19	31	9,869	\$4,269	Yes
6/30/19	30	17,330	\$7,475	Yes
7/31/19	31	17,849	\$7,215	Yes
8/31/19	31	21,958	\$8,599	Yes
9/30/19	30	20,828	\$8,338	Yes
10/31/19	31	15,219	\$6,499	Yes
11/30/19	30	12,460	\$5,484	Yes
12/31/19	31	16,491	\$7,415	Yes
Totals	365	203,959	\$86,295	
Annual	365	203,959	\$86,295	

Notes:

- Natural gas data has been estimated based on a campus wide approach. Please refer to the Power House/Cogen Building report for details regarding the utility baseline and campus building utility desegregation analysis.
- The average gas cost for the past 12 months for the CUP natural gas is \$0.423/therm.

Biology Building Metered Natural Gas Usage

This is the dedicated natural gas usage from meter 4018968 serving the Biology Building.

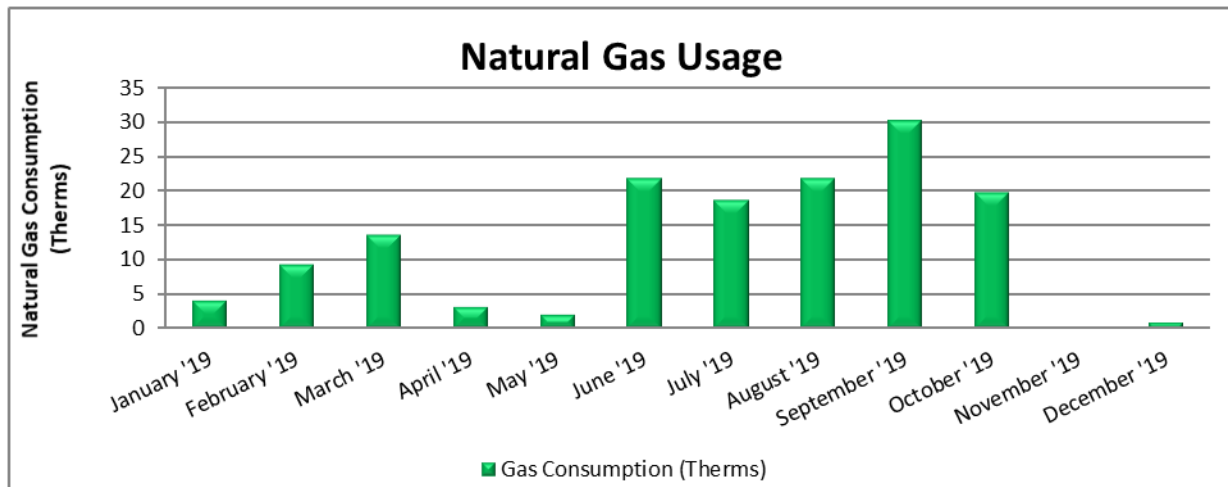

Gas Billing Data				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
1/31/19	31	4	\$19	Yes
2/28/19	28	9	\$23	Yes
3/31/19	31	14	\$27	Yes
4/30/19	30	3	\$18	Yes
5/31/19	31	2	\$17	Yes
6/30/19	30	22	\$33	Yes
7/31/19	31	19	\$30	Yes
8/31/19	31	22	\$32	Yes
9/30/19	30	30	\$39	Yes
10/31/19	31	20	\$31	Yes
11/30/19	30	0	\$6	Yes
12/31/19	31	1	\$17	Yes
Totals	365	146	\$292	
Annual	365	146	\$292	

Notes:

- The average gas cost for the past 12 months for the metered natural gas is \$1.993/therm.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score

N/A

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

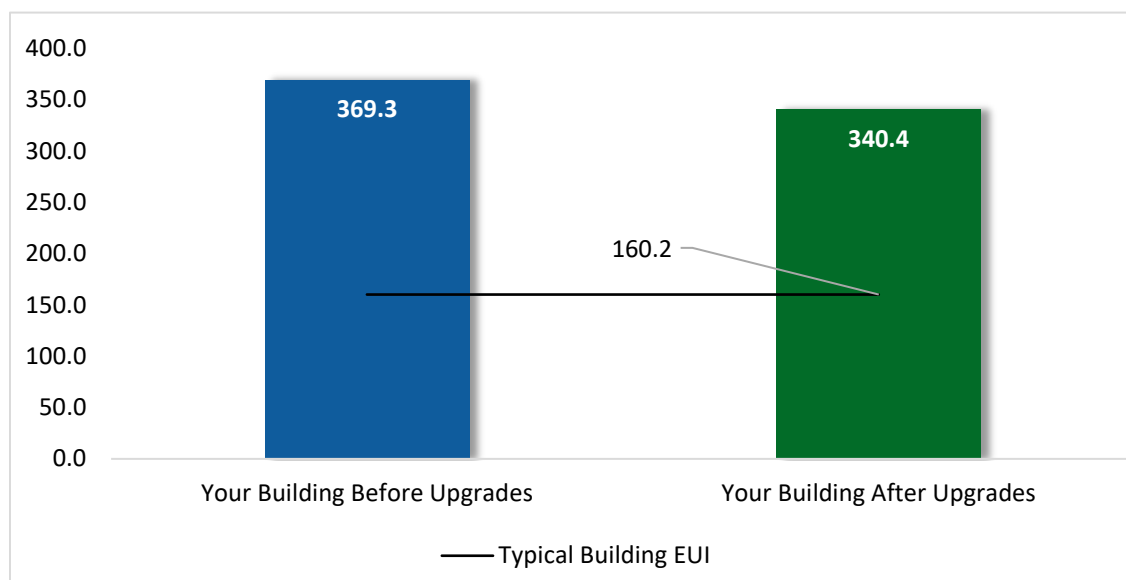


Figure 6 - Energy Use Intensity Comparison³

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

Benchmarking is provided for The College of New Jersey's campus. Please refer to the Power House/Cogen report for additional details regarding the benchmarking approach within Portfolio Manager®.

³ Based on all evaluated ECMs

Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website⁴.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			225,051	21.5	-51	\$32,891	\$72,699	\$13,595	\$59,104	1.8	220,623
ECM 1	Install LED Fixtures	Yes	1,404	0.0	0	\$207	\$583	\$100	\$483	2.3	1,414
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	2,430	0.2	-1	\$355	\$528	\$80	\$448	1.3	2,382
ECM 3	Retrofit Fixtures with LED Lamps	Yes	221,217	21.3	-51	\$32,330	\$71,588	\$13,415	\$58,173	1.8	216,827
Lighting Control Measures			69,970	6.4	-16	\$10,226	\$44,424	\$9,295	\$35,129	3.4	68,575
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	60,230	5.6	-14	\$8,802	\$37,224	\$4,695	\$32,529	3.7	59,029
ECM 5	Install High/Low Lighting Controls	Yes	9,740	0.8	-2	\$1,423	\$7,200	\$4,600	\$2,600	1.8	9,546
Motor Upgrades			9,662	1.3	0	\$1,421	\$22,657	\$0	\$22,657	15.9	9,730
ECM 6	Premium Efficiency Motors	No	9,662	1.3	0	\$1,421	\$22,657	\$0	\$22,657	15.9	9,730
Variable Frequency Drive (VFD) Measures			75,963	11.4	0	\$11,175	\$29,373	\$6,000	\$23,373	2.1	76,494
ECM 7	Install VFD on Variable Air Volume (VAV) Fans	Yes	64,778	9.5	0	\$9,530	\$20,053	\$4,000	\$16,053	1.7	65,231
ECM 8	Install VFDs on Water Supply Pump	Yes	11,185	1.8	0	\$1,646	\$9,320	\$2,000	\$7,320	4.4	11,263
Unitary HVAC Measures			21,362	3.3	0	\$3,143	\$44,545	\$3,400	\$41,145	13.1	21,512
ECM 9	Install High Efficiency Air Conditioning Units	No	21,362	3.3	0	\$3,143	\$44,545	\$3,400	\$41,145	13.1	21,512
Domestic Water Heating Upgrade			0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222
ECM 10	Install Low-Flow DHW Devices	Yes	0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222
Food Service & Refrigeration Measures			5,108	0.4	0	\$751	\$8,858	\$665	\$8,193	10.9	5,144
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	Yes	1,572	0.2	0	\$231	\$1,820	\$240	\$1,580	6.8	1,583
ECM 12	Refrigeration Controls	No	1,984	0.1	0	\$292	\$6,578	\$375	\$6,203	21.2	1,998
ECM 13	Vending Machine Control	Yes	1,551	0.2	0	\$228	\$460	\$50	\$410	1.8	1,562
Custom Measures			51,053	0.0	730	\$10,606	\$42,168	\$0	\$42,168	4.0	136,845
ECM 14	Retro-Commissioning Study	Yes	26,575	0.0	406	\$5,631	\$23,368	\$0	\$23,368	4.1	74,264
ECM 15	Sub Metering	Yes	24,477	0.0	324	\$4,975	\$18,800	\$0	\$18,800	3.8	62,581
TOTALS			458,168	44.3	681	\$70,295	\$264,867	\$33,035	\$231,832	3.3	541,144

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		225,051	21.5	-51	\$32,891	\$72,699	\$13,595	\$59,104	1.8	220,623
ECM 1	Install LED Fixtures	1,404	0.0	0	\$207	\$583	\$100	\$483	2.3	1,414
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	2,430	0.2	-1	\$355	\$528	\$80	\$448	1.3	2,382
ECM 3	Retrofit Fixtures with LED Lamps	221,217	21.3	-51	\$32,330	\$71,588	\$13,415	\$58,173	1.8	216,827
Lighting Control Measures		69,970	6.4	-16	\$10,226	\$44,424	\$9,295	\$35,129	3.4	68,575
ECM 4	Install Occupancy Sensor Lighting Controls	60,230	5.6	-14	\$8,802	\$37,224	\$4,695	\$32,529	3.7	59,029
ECM 5	Install High/Low Lighting Controls	9,740	0.8	-2	\$1,423	\$7,200	\$4,600	\$2,600	1.8	9,546
Variable Frequency Drive (VFD) Measures		75,963	11.4	0	\$11,175	\$29,373	\$6,000	\$23,373	2.1	76,494
ECM 7	Install VFD on Variable Air Volume (VAV) Fans	64,778	9.5	0	\$9,530	\$20,053	\$4,000	\$16,053	1.7	65,231
ECM 8	Install VFDs on Water Supply Pump	11,185	1.8	0	\$1,646	\$9,320	\$2,000	\$7,320	4.4	11,263
Domestic Water Heating Upgrade		0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222
ECM 10	Install Low-Flow DHW Devices	0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222
Food Service & Refrigeration Measures		3,124	0.4	0	\$460	\$2,280	\$290	\$1,990	4.3	3,145
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	1,572	0.2	0	\$231	\$1,820	\$240	\$1,580	6.8	1,583
ECM 13	Vending Machine Control	1,551	0.2	0	\$228	\$460	\$50	\$410	1.8	1,562
Custom Measures		51,053	0.0	730	\$10,606	\$42,168	\$0	\$42,168	4.0	136,845
ECM 14	Retro-Commissioning Study	26,575	0.0	406	\$5,631	\$23,368	\$0	\$23,368	4.1	74,264
ECM 15	Sub Metering	24,477	0.0	324	\$4,975	\$18,800	\$0	\$18,800	3.8	62,581
TOTALS		425,159	39.7	681	\$65,439	\$191,087	\$29,260	\$161,827	2.5	507,904

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		225,051	21.5	-51	\$32,891	\$72,699	\$13,595	\$59,104	1.8	220,623
ECM 1	Install LED Fixtures	1,404	0.0	0	\$207	\$583	\$100	\$483	2.3	1,414
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	2,430	0.2	-1	\$355	\$528	\$80	\$448	1.3	2,382
ECM 3	Retrofit Fixtures with LED Lamps	221,217	21.3	-51	\$32,330	\$71,588	\$13,415	\$58,173	1.8	216,827

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace an existing fixture containing an HID lamp with a new LED light fixture. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixtures.

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected building areas: exterior fixture with metal halide lamp.

ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Retrofit fluorescent fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and therefore do not need to be replaced as often.

Affected building areas: all areas with fluorescent fixtures with T12 tubes.

ECM 3: Retrofit Fixtures with LED Lamps

Replace fluorescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected building areas: classrooms, lobbies, entrances, the phone room, green houses, vending machine room, exterior fixtures, and all areas with fluorescent fixtures with T8 tubes.

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		69,970	6.4	-16	\$10,226	\$44,424	\$9,295	\$35,129	3.4	68,575
ECM 4	Install Occupancy Sensor Lighting Controls	60,230	5.6	-14	\$8,802	\$37,224	\$4,695	\$32,529	3.7	59,029
ECM 5	Install High/Low Lighting Controls	9,740	0.8	-2	\$1,423	\$7,200	\$4,600	\$2,600	1.8	9,546

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 4: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected building areas: storage rooms, classrooms, study rooms, offices, phone room, receiving area, rest rooms, lab rooms, copy rooms, conference rooms, greenhouses, and vending machine room.

ECM 5: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected building areas: corridors, lobbies, and stairwells.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as an occupant approaches.

4.3 Motors

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Motor Upgrades		9,662	1.3	0	\$1,421	\$22,657	\$0	\$22,657	15.9	9,730
ECM 6	Premium Efficiency Motors	9,662	1.3	0	\$1,421	\$22,657	\$0	\$22,657	15.9	9,730

ECM 6: Premium Efficiency Motors

We evaluated replacing standard efficiency motors with IHP 2014 efficiency motors. This evaluation assumes that existing motors will be replaced with motors of equivalent size and type. In some cases, additional savings may be possible by downsizing motors to better meet the motor's current load requirements.

Affected motors:

Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Additional Motor Description
Basement Mechanical Room	Heating Hot Water System	1	Heating Hot Water Pump	7.5	Hot Water Pump 1
Basement Mechanical Room	Heating Hot Water System	1	Heating Hot Water Pump	7.5	Hot Water Pump 2
Attic Mechanical Room	AHU-1	1	Supply Fan	75.0	Air Handling Unit Supply Fan Motor (AHU-1)
Attic Mechanical Room	AHU-2	1	Supply Fan	75.0	Air Handling Unit Supply Fan Motor (AHU-2)
Attic Mechanical Room	AHU-3	1	Supply Fan	15.0	Air Handling Unit Supply Fan Motor (AHU-3)
Attic Mechanical Room	AHU-4	1	Supply Fan	15.0	Air Handling Unit Supply Fan Motor (AHU-4)
Attic Mechanical Room	AHU-3	1	Return Fan	5.0	Air Handling Unit Return Fan Motor (AHU-3)

Savings are based on the difference between baseline and proposed efficiencies and the assumed annual operating hours. The base case motor energy consumption is estimated using the efficiencies found on nameplates or estimated based on the age of the motor and our best estimates of motor run hours. Efficiencies of proposed motor upgrades are obtained from the current *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*.

4.4 VFD

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures		75,963	11.4	0	\$11,175	\$29,373	\$6,000	\$23,373	2.1	76,494
ECM 7	Install VFD on Variable Air Volume (VAV) Fans	64,778	9.5	0	\$9,530	\$20,053	\$4,000	\$16,053	1.7	65,231
ECM 8	Install VFDs on Water Supply Pump	11,185	1.8	0	\$1,646	\$9,320	\$2,000	\$7,320	4.4	11,263

VFDs control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 7: Install VFD on VAV Fans

Replace existing air volume control devices on variable volume fans, such as inlet vanes and variable pitch fan blades, with VFDs. Inlet guide vanes and variable pitch fan blades are an inefficient means of controlling the air volume compared to VFDs. The existing volume control device will be removed or permanently disabled, and the control signal will be redirected to the VFD to determine proper fan motor speed.

Energy savings result from using a more efficient control device to regulate the air flow provided by the fan. Additional maintenance savings may result from this measure. VFDs are solid state electronic devices, which generally requires less maintenance than mechanical air volume control devices.

Affected air handlers: HV-1 through HV-3 and AHU-5.

ECM 8: Install VFDs on Water Supply Pump

Install VFDs to control water supply pumps. Since water supply systems become an open system whenever an end-use valve or fixture is opened the VFD will need to be controlled to maintain sufficient pressure in the distribution system to deliver water to the furthest point in the system.

Energy savings result from reducing the pump speed during low demand periods. Ensure that your control system includes the sensors and inputs required to optimize water flow in your water supply.

4.5 Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Unitary HVAC Measures		21,362	3.3	0	\$3,143	\$44,545	\$3,400	\$41,145	13.1	21,512
ECM 9	Install High Efficiency Air Conditioning Units	21,362	3.3	0	\$3,143	\$44,545	\$3,400	\$41,145	13.1	21,512

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the split system AC is eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

ECM 9: Install High Efficiency Air Conditioning Units

We evaluated replacing the standard efficiency split system air conditioning unit with a high efficiency split system air conditioning unit. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load and the estimated annual operating hours.

Affected units: 40.0-ton Trane split system AC serving AHU-5.

4.6 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222
ECM 10	Install Low-Flow DHW Devices	0	0.0	19	\$81	\$143	\$80	\$63	0.8	2,222

ECM 10: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

4.7 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$) *	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs) **	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		5,108	0.4	0	\$751	\$8,858	\$665	\$8,193	10.9	5,144
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	1,572	0.2	0	\$231	\$1,820	\$240	\$1,580	6.8	1,583
ECM 12	Refrigeration Controls	1,984	0.1	0	\$292	\$6,578	\$375	\$6,203	21.2	1,998
ECM 13	Vending Machine Control	1,551	0.2	0	\$228	\$460	\$50	\$410	1.8	1,562

ECM 11: Refrigerator/Freezer Case Electrically Commutated Motors

Replace shaded pole or permanent split capacitor (PSC) motors with electronically commutated (EC) motors in walk-in refrigerators. Fractional horsepower EC motors are significantly more efficient than mechanically commutated, brushed motors, particularly at low speeds or partial load. By using variable-speed technology, EC motors can optimize fan usage. Because these motors are brushless and use DC power, losses due to friction and phase shifting are eliminated.

Savings for this measure consider both the increased efficiency of the motor as well as the reduction in refrigeration load due to motor heat loss.

ECM 12: Refrigeration Controls

We evaluated installing additional controls to optimize the operation of the walk-in coolers.

Defrost controllers can be used to override defrost of evaporator fans when the defrost operation is not necessary, which reduces annual energy consumption. This measure is applicable to existing evaporator fans with a traditional electric defrost mechanism.

Many walk-in coolers and freezers have evaporator fans that run continuously. The measure adds a control system feature to automatically shut off evaporator fans when not needed.

Energy savings for each of the control measures account for reduction in compressor and fan operating hours as well as reduction in the refrigeration heat load as appropriate.

ECM 13: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and they power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

4.8 Custom Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$) *	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs) **	CO ₂ e Reduction (lbs)
Custom Measures		51,053	0.0	730	\$10,606	\$42,168	\$0	\$42,168	4.0	136,845
ECM 14	Retro-Commissioning Study	26,575	0.0	406	\$5,631	\$23,368	\$0	\$23,368	4.1	74,264
ECM 15	Sub Metering	24,477	0.0	324	\$4,975	\$18,800	\$0	\$18,800	3.8	62,581

ECM 14: Retro-Commissioning Study

Due to the complexity of today's HVAC systems and controls a thorough analysis and rebalance of heating, ventilation, and cooling systems should periodically be conducted. There are indications at this site that systems may be not be operating correctly or as efficiently as they could be. One important tool available to building operators to ensure proper system operation is retro-commissioning.

Retro-commissioning is a common practice recommended by the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE) to be implemented every few years. We recommend that you contact a reputable engineering firm that specializes in energy control systems and retro-commissioning. Ask them to propose a scope of work and an outline of the procedures and processes to be implemented, including a schedule and the roles of all responsible parties.

Once goals and responsibilities are established, the objective of the investigation process is to understand how the building is currently operating, identify the issues, and determine the most cost-effective way to improve performance. The retro-commissioning agent will review building documentation, interview building occupants, and inspect and test the equipment. Information is then compiled into a report and shared with facility staff, who will select which recommendations to implement after reviewing the findings.

The implementation phase puts the selected processes into place. Typical measures may include sensor calibration, equipment schedule changes, damper linkage repair and similar relatively low-cost adjustments -- although more expensive sophisticated programming and building control system upgrades may be warranted. Approved measures may be implemented by the agent, the building staff, or by subcontractors. Typically, a combination of these individuals makes up the retro-commissioning team.

After the approved measures are implemented, the team will verify that the changes are working as expected. Baseline and post-case measurements will allow building staff to monitor equipment and ensure that the benefits are maintained.

A high-level evaluation of potential savings and costs is provided for demonstration purposes only. It is a screening evaluation for the potential in HVAC Control Improvements. Based on industry standards and previous project experience, the potential energy savings may be up to 15% of existing HVAC energy use. The average cost of retro-commissioning studies and control improvements is \$0.30 per square foot. Actual savings and costs will need to be outlined by the specific contractor engaged to perform the study. For the purposes of this report, we have conservatively estimated savings to be 2% of the total HVAC energy consumption baseline.

ECM 15: Sub Metering

Facility staff expressed interest in utility sub metering key buildings which are currently served by a master meter and the central plant. Utility submeters alone do not save energy, but they are a useful tool under the right circumstances. Utility sub-meters can provide facility staff with real-time energy use data for specific buildings, information that enhances the potential for greater energy management activities. Revenue grade submeters are a tool that allow owners to bill tenants or departments for the energy consumed in the spaces they occupy. Better resolution on building system performance can lead to occupant behavioral changes which often result in reduced energy use.

A high-level evaluation of potential savings and costs is provided for demonstration purposes only. Based on industry standards and case studies, the potential energy savings may be up to 5% of existing energy usage. For the purposes of this report, a conservative assumed savings of 1% was applied to building allocated electrical and natural gas consumption of the sub metered buildings based on the premise of occupant behavioral changes. For this building the following submeters are proposed: smart electric meter, steam flow meter, and chilled water flow meter. Meter costs for the evaluation are based on average building use across the campus: smart electric meter \$2,400, steam flow meter \$6,700, and chilled water flow meter \$9,700. The actual scope of work and implementation costs must be provided by a contractor in the future. This measure is recommended for implementation based on the initial energy and economic results but primarily for enhancing the potential for greater energy management activities.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save between 5 to 20 percent of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, planned capital upgrades, and incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and will outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁵. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Weatherization

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. Materials used may include caulk, polyurethane foam, and other weather-stripping materials. There is an energy savings opportunity by reducing the uncontrolled air exchange between the outside and inside of the building. Blower door assisted comprehensive building air sealing will reduce the amount of air exchange which will in turn reduce the load on the buildings heating and cooling equipment and thus providing energy savings and increased occupant comfort.

Lighting Maintenance



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

⁵ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

Lighting Controls

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly. Adjust exterior lighting time clock controls seasonally as needed to match your lighting requirements.

Motor Short Cycling Reduction

Frequent stopping and starting of motors places substantial stress on rotors and other parts. This leads to wear and tear, lower efficiency, and higher maintenance costs. Adjust the load on the motor to limit the amount of unnecessary stopping and starting to improve motor performance.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control, or dampers that are stuck or improperly adjusted.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Steam Trap Repair and Replacement

Steam traps are a crucial part of delivering heat from the boiler to the space heating units. Steam traps are automatic valves that remove condensate from the system. If the traps fail closed, condensate can build up in the steam supply side of the trap which reduces the flow in the steam lines and thermal capacity of the radiators. Or they may fail open, allowing steam into the condensate return lines resulting in wasted energy, and water hammering. Losses can be significantly reduced by testing and replacing equipment as they start to fail. Repair or replace traps that are blocked or allowing steam to pass. Inspect steam traps as part of a regular steam system maintenance plan.

Water Heater Maintenance

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Compressed Air System Maintenance

Compressed air systems require periodic maintenance to operate at peak efficiency. A maintenance plan for compressed air systems should include:

- Inspection, cleaning, and replacement of inlet filter cartridges
- Cleaning of drain traps
- Daily inspection of lubricant levels to reduce unwanted friction
- Inspection of belt condition and tension
- Check for leaks and adjust loose connections
- Overall system cleaning

Contact a qualified technician for help with setting up periodic maintenance schedule.


Refrigeration Equipment Maintenance

Preventative maintenance keeps commercial refrigeration equipment running reliably and efficiently. Commercial refrigerators and freezers are mission-critical equipment that can cost a fortune when they go down. Even when they appear to be working properly, refrigeration units can be consuming too much energy. Have walk-in refrigeration and freezer and other commercial systems serviced at least annually. This practice will allow systems to perform to their highest capabilities and will help identify system issues if they exist.

Maintaining your commercial refrigeration equipment can save between 5 and 10 percent on energy costs. When condenser coils are dirty, your commercial refrigerators and freezers work harder to maintain the temperature inside. Worn gaskets, hinges, door handles or faulty seals cause cold air to leak from the unit, forcing the unit to run longer and use more electricity.

Regular cleaning and maintenance also help your commercial refrigeration equipment to last longer.

Plug Load Controls



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips⁶. Your local utility may offer incentives or rebates for this equipment.

⁶ For additional information refer to “Assessing and Reducing Plug and Process Loads in Office Buildings” <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or “Plug Load Best Practices Guide” <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

Computer Power Management Software

Many computers consume power during nights, weekends, and holidays. Screen savers are commonly confused as a power management strategy. This contributes to avoidable, excessive electrical energy consumption. There are innovative power management software packages available that are designed to deliver significant energy saving and provide ongoing tracking measurements. A central power management platform helps enforce energy savings policies as well as identify and eliminate underutilized devices.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense® website⁷ or download a copy of EPA's "WaterSense® at Work: Best Management Practices for Commercial and Institutional Facilities"⁸ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense® products where available.

⁷ <https://www.epa.gov/watersense>.

⁸ <https://www.epa.gov/watersense/watersense-work-0>.

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has **high** potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the **high** potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

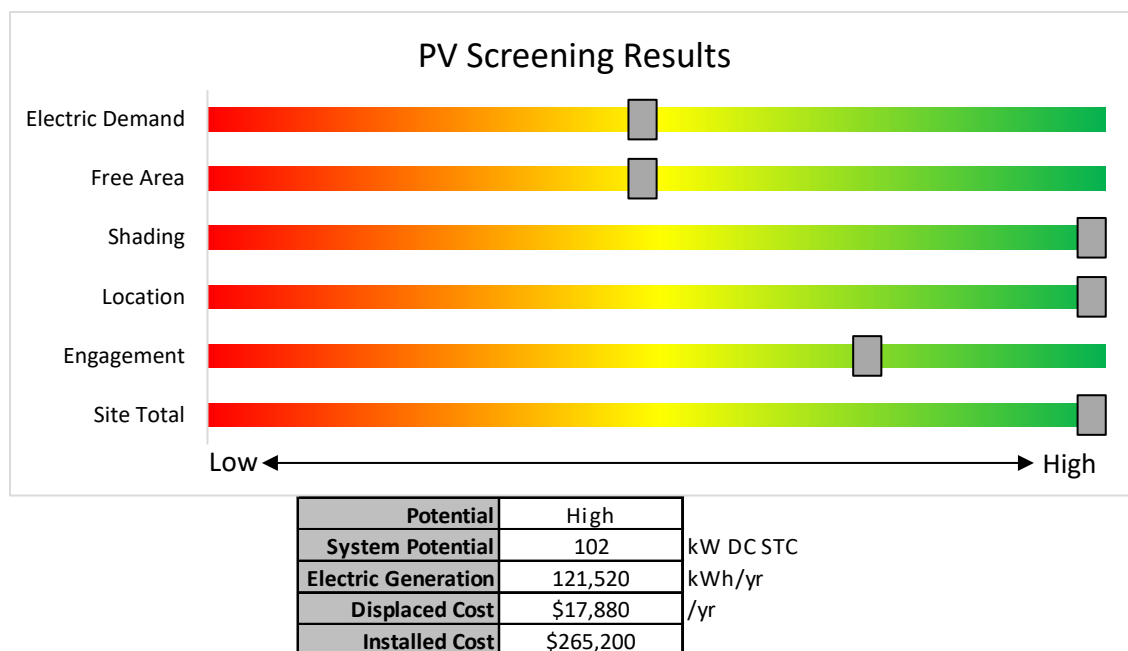


Figure 9 - Photovoltaic Screening

Transition Incentive (TI) Program

The TI program is a bridge between the Legacy SREC Program and a to-be determined Successor Incentive Program. The program is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn TRECs (Transition Incentive Renewable Energy Certificates). The Transition Incentive is structured as a factorized renewable energy certificate. The factors allow the TI Program to provide differentiated financial incentives for different types of solar installation.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

Transition Incentive (TI) Program: <https://www.njcleanenergy.com/renewable-energy/programs/transition-incentive-program>

- **Basic Info on Solar PV in New Jersey:** www.njcleanenergy.com/whysolar.
- **New Jersey Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs.
- **Approved Solar Installers in the New Jersey Market:** www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1.

6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has **no** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility **does not** appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

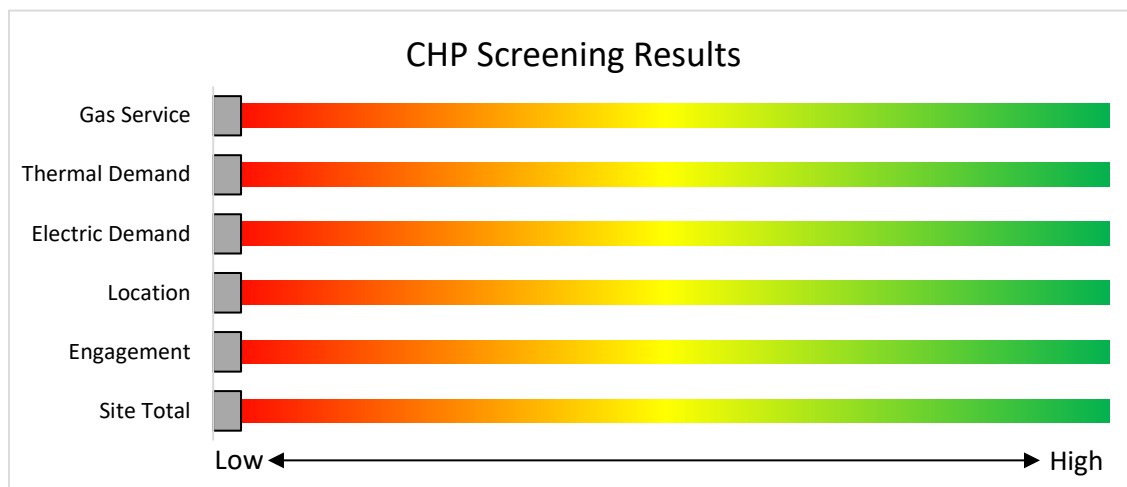


Figure 10 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey's Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Incentives are paid out in three installments. The first installment is meant to help offset the costs of the initial engineering study. The subsequent incentives are paid based on the level of energy savings up to 50% of the total project cost. See Section 7.3 for all incentive details.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			

7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficient equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers
Electric Unitary HVAC
Gas Cooling
Gas Heating
Gas Water Heating
Ground Source Heat Pumps
Lighting

Lighting Controls
Refrigeration Doors
Refrigeration Controls
Refrigerator/Freezer Motors
Food Service Equipment
Variable Frequency Drives

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.

7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Based on the site building and utility data provided, the facility does not meet the requirements of the current Direct Install program.

Incentives

The program pays up to 70 percent of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70 percent of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30 percent of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Pay for Performance - Existing Buildings



Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures that results in at least 15 percent source energy savings, and lighting cannot make up the majority of the savings.

P4P is a generally a good option for medium-to-large sized facilities looking to implement as many measures as possible under a single project to achieve deep energy savings. This program has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program.

For master metered campuses, such as The College of New Jersey, P4P eligibility is evaluated at the campus level. For the purposes of reporting P4P eligibility is being presented at all of the buildings. Final eligibility will be assessed once all of the reports are completed and will be addressed at the Exit Meeting. If the campus does not meet the 15% savings threshold based on measures identified during the LGEA Program process it is possible that additional measures could be identified at a later point in time, for example through further evaluation or the Energy Savings Improvement Program process.

Incentives

Incentives are based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

Contact one of the pre-approved consultants and contractors ("Partners"). Under direct contract to you, they will help further evaluate the measures identified in this report through development of the energy reduction plan), assist you in implementing selected measures, and verify actual savings one year after the installation. Your Partner will also help you apply for incentives.

Approval of the final scope of work is required by the program prior to installation. Installation can be done by the contractor of your choice (some P4P Partners are also contractors) or by internal staff, but the Partner remains involved throughout construction to ensure compliance with the program requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at www.njcleanenergy.com/P4P.

7.4 Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

Incentives

Eligible Technologies	Size (Installed Rated Capacity) ¹	Incentive (\$/kW)	% of Total Cost Cap per Project ³	\$ Cap per Project ³		
Powered by non-renewable or renewable fuel source ⁴	≤500 kW	\$2,000	30-40% ²	\$2 million		
Gas Internal Combustion Engine	>500 kW - 1 MW	\$1,000				
Gas Combustion Turbine	> 1 MW - 3 MW	\$550	30%	\$3 million		
Microturbine	>3 MW	\$350				
Fuel Cells with Heat Recovery						
Waste Heat to Power*	<1 MW	\$1,000	30%	\$2 million		
	> 1MW	\$500		\$3 million		

*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

How to Participate

You work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at www.njcleanenergy.com/CHP.

7.5 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

7.6 Transition Incentive (TI) Program

The TI program is a bridge between the Legacy SREC Program and a to-be determined Successor Incentive Program. The program is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn TRECs (Transition Incentive Renewable Energy Certificates). The Transition Incentive is structured as a factorized renewable energy certificate. The factors allow the TI Program to provide differentiated financial incentives for different types of solar installations. NJBPU calculates the value of a Transition Renewable Energy Certificate (TREC) by multiplying the base compensation rate (\$152/MWh) by the project's assigned factor (i.e. $\$152 \times 0.85 = \$129.20/\text{MWh}$). The TREC factors are defined based on the chart below:

Project Type	Factor
Subsection (t): landfill, brownfield, areas of historic fill	1.00
Grid supply (Subsection (r)) rooftop	1.00
Net metered non-residential rooftop and carport	1.00
Community solar	0.85
Grid supply (Subsection (r)) ground mount	0.60
Net metered residential ground mount	0.60
Net metered residential rooftop and carport	0.60
Net metered non-residential ground mount	0.60

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey TRECs.

Eligible projects may generate TRECs for 15 years following the commencement of commercial operations (also referred to as the "Transition Incentive Qualification Life"). After 15 years, projects may be eligible for a New Jersey Class I REC.

TRECs will be used by the identified compliance entities to satisfy a compliance obligation tied to a new Transition Incentive Renewable Portfolio Standard ("TI-RPS"), which will exist in parallel with, and completely separate from, the existing Solar RPS for Legacy SRECs. The TI-RPS is a carve-out of the current Class I RPS requirement. The creation of TRECs is based upon metered generation supplied to PJM-EIS General Attribute Tracking System ("GATS") by the owners of eligible facilities or their agents. GATS would create one TREC for each MWh of energy produced from a qualified facility.

TRECs will be purchased monthly by a TREC Administrator who will allocate the TRECs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan. The Transition Incentive Program online portal is now open to new applications effective May 1, 2020. There are instructions on "How and When to Transfer my SRP Registration to the Transition Incentive Program". If you are considering installing solar photovoltaics on your building, visit the following link for more information:

<https://www.njcleanenergy.com/renewable-energy/programs/transition-incentive-program>

8 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site and their energy and economic analyses are provided within this LGEA report. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning includes the review of multiple bids for project work, incorporate potential operational & maintenance (O&M) cost savings and maximize your incentive potential.

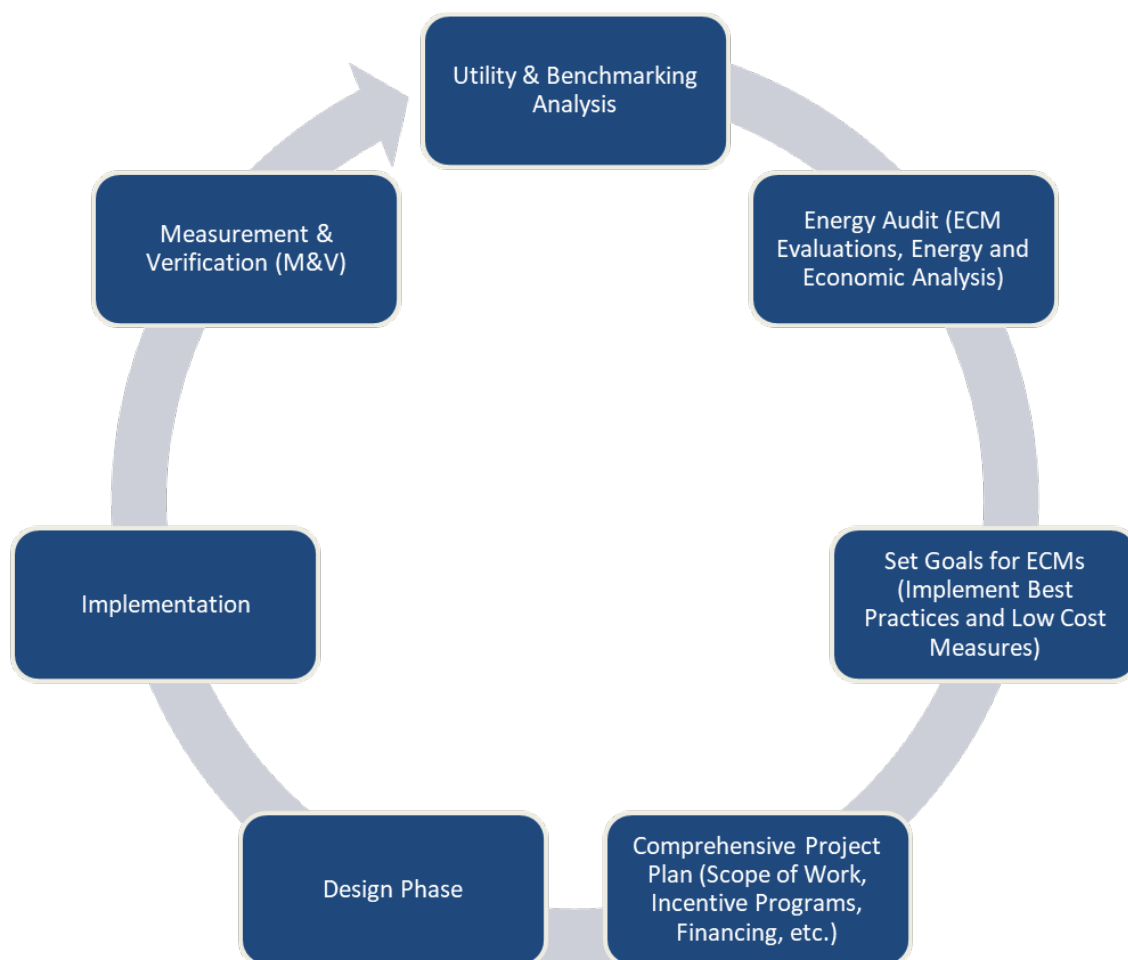


Figure 11 – Project Development Cycle

9 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

9.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁹.

9.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹⁰.

⁹ www.state.nj.us/bpu/commercial/shopping.html.

¹⁰ www.state.nj.us/bpu/commercial/shopping.html.

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Attic East	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Attic East	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,376	0.1	1,419	0	\$207	\$292	\$80	1.0
Attic West	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Attic West	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,376	0.1	1,419	0	\$207	\$292	\$80	1.0
Basement Electrical Room	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Basement Electrical Room	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.1	132	0	\$19	\$292	\$80	11.0
Basement Mechanical Space	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Basement Mechanical Space	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,688	3	Relamp	No	21	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,688	0.3	1,863	0	\$272	\$767	\$210	2.0
Basement Storage	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Basement Storage	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	345	0.1	105	0	\$15	\$453	\$50	26.2
Classroom 103	20	Compact Fluorescent: (3) 31W Double Biaxial Plug-In Lamps	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	20	LED Lamps: (3) 22W Biax Lamps	Occupancy Sensor	65	3,709	0.5	5,170	-1	\$756	\$1,350	\$130	1.6
Classroom 103	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 104	40	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	3,709	3	Relamp	No	40	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.7	4,896	-1	\$716	\$1,461	\$400	1.5
Classroom 107	41	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	41	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.9	9,255	-2	\$1,353	\$2,307	\$515	1.3
Classroom 107 (1)	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6
Classroom 144	40	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	40	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.8	9,030	-2	\$1,320	\$2,271	\$505	1.3
Classroom 145	40	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	40	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.8	9,030	-2	\$1,320	\$2,271	\$505	1.3
Classroom 208	27	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	27	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.6	6,095	-1	\$891	\$1,526	\$340	1.3
Classroom 209	31	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	31	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.7	6,998	-2	\$1,023	\$1,672	\$380	1.3
Closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Corridor 1st Floor East	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1st Floor East	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	1	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.0	244	0	\$36	\$72	\$10	1.8
Corridor 1st Floor East	6	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1st Floor East	22	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	22	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.4	5,365	-1	\$784	\$1,819	\$445	1.8

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Corridor 1st Floor West	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1st Floor West	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	1	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.0	244	0	\$36	\$297	\$10	8.1
Corridor 2nd Floor West	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 2nd Floor West	22	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	22	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.4	5,365	-1	\$784	\$2,494	\$990	1.9
Corridor 3rd East	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 3rd East	9	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	9	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.2	2,195	-1	\$321	\$1,102	\$405	2.2
Corridor 3rd West	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 3rd West	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	12	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.2	2,926	-1	\$428	\$1,320	\$540	1.8
Corridor Basement	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	4,289	0.0	522	0	\$76	\$298	\$20	3.6
Corridor Study Room 143A	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor Study Room 143A	7	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	6,216	4	None	Yes	7	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	40	4,289	0.0	540	0	\$79	\$270	\$35	3.0
Electrical Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Elevator Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Entrance Exit 2	1	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	5,376	5	None	Yes	1	LED - Fixtures: Ambient 2x2 Fixture	High/Low Control	40	3,709	0.0	67	0	\$10	\$225	\$0	23.1
Exterior Handicap Ramp	1	LED - Fixtures: Bollard Fixture	Photocell		21	4,380		None	No	1	LED - Fixtures: Bollard Fixture	Photocell	21	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior Recessed	7	Compact Fluorescent: (1) 32W A19 Screw-In Lamp	Photocell		32	4,380	3	Relamp	No	7	LED Lamps: (1) 22W Screw-In Lamp	Photocell	22	4,380	0.0	294	0	\$43	\$121	\$7	2.6
Exterior Recessed	37	LED - Fixtures: Downlight Pendant	Photocell		17	4,380		None	No	37	LED - Fixtures: Downlight Pendant	Photocell	17	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior Wall Pack	11	Compact Fluorescent: (1) 34W A19 Screw-In Lamp	Photocell		34	4,380	3	Relamp	No	11	LED Lamps: (1) 24W Screw-In Lamp	Photocell	24	4,380	0.0	491	0	\$72	\$189	\$11	2.5
Exterior Wall Pack	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		30	4,380		None	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	30	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior Wall Pack	1	Metal Halide: (1) 400W Lamp	Photocell		458	4,380	1	Fixture Replacement	No	1	LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture	Photocell	137	4,380	0.0	1,404	0	\$207	\$583	\$100	2.3
Handicap Entrance	4	Compact Fluorescent: (1) 24W G25 Screw-In Lamp	Wall Switch	S	24	5,376	3, 5	Relamp	Yes	4	LED Lamps: (1) 17W Screw-In Lamp	High/Low Control	17	3,709	0.0	267	0	\$39	\$326	\$8	8.2
Handicap Entrance	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Lab Storage	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	8	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.1	132	0	\$19	\$292	\$80	11.0
Lobby 1st Floor	24	Compact Fluorescent: (2) 26W G25 Screw-In Lamps	Wall Switch	S	52	6,216	3, 5	Relamp	Yes	24	LED Lamps: (2) 18W Screw-In Lamp	High/Low Control	36	4,289	0.3	4,011	-1	\$586	\$2,111	\$936	2.0
Lobby 1st Floor	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0

	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years	
Lobby 2nd Floor	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0	
Lobby 2nd Floor	7	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	7	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.1	1,707	0	\$249	\$957	\$315	2.6	
Lobby Attic	8	Compact Fluorescent: (1) 13W G25 Screw-In Lamp	Wall Switch	S	13	6,216	3, 5	Relamp	Yes	8	LED Lamps: (1) 9W Screw-In Lamp	High/Low Control	9	4,289	0.0	334	0	\$49	\$202	\$16	3.8	
Lobby Attic	12	Compact Fluorescent: (1) 26W G25 Screw-In Lamp	Wall Switch	S	26	6,216	3, 5	Relamp	Yes	12	LED Lamps: (1) 18W Screw-In Lamp	High/Low Control	18	4,289	0.1	1,003	0	\$147	\$978	\$444	3.6	
Lobby Attic	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0	
Lobby Attic	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	4,289	0.2	2,349	-1	\$343	\$779	\$405	1.1	
Lobby Attic	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	6,216	3, 5	Relamp	Yes	12	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	4,289	0.2	2,926	-1	\$428	\$1,320	\$540	1.8	
Lobby STEM Bldg	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0	
Lobby STEM Bldg	6	LED - Fixtures: Downlight Recessed	Wall Switch	S	13	6,216	5	None	Yes	6	LED - Fixtures: Downlight Recessed	High/Low Control	13	4,289	0.0	150	0	\$22	\$225	\$0	10.2	
Mechanical - Attic	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0	
Mechanical - Attic	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	3	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.1	198	0	\$29	\$219	\$60	5.5	
Office Room 140	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,709	0.1	677	0	\$99	\$226	\$50	1.8	
Public Phone Room	6	Compact Fluorescent: (2) 26W G25 Screw-In Lamps	Wall Switch	S	52	5,376	3, 4	Relamp	Yes	6	LED Lamps: (2) 18W Screw-In Lamp	Occupancy Sensor	36	3,709	0.1	867	0	\$127	\$573	\$59	4.1	
Receiving Area	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	1,354	0	\$198	\$489	\$95	2.0	
Restroom - Men	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$343	\$55	4.4	
Restroom - Men	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	633	0	\$92	\$217	\$30	2.0	
Restroom - Men's 2nd Floor	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	5,376	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,709	0.0	114	0	\$17	\$33	\$6	1.6	
Restroom - Men's 2nd Floor	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$73	\$20	0.8	
Restroom - Men's 2nd Floor	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9	
Restroom - Women 1st Floor	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	S	15	5,376	4	None	Yes	1	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,709	0.0	24	0	\$4	\$0	\$0	0.0	
Restroom - Women 1st Floor	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	633	0	\$92	\$487	\$65	4.6	
Restroom - Women 2nd Floor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	677	0	\$99	\$380	\$65	3.2	
Restroom - Women 2nd Floor	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$290	\$40	2.0	
Room 102 - Communication Room	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6	
Room 104A	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6	

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Room 107A	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	5,376	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	731	0	\$107	\$254	\$40	2.0
Room 107A (1)	2	Linear Fluorescent - T12: 4' T12 (40W) - 6L	Wall Switch	S	254	5,376	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (6) 4' Lamps	Occupancy Sensor	87	3,709	0.2	2,086	0	\$305	\$390	\$60	1.1
Room 107A (1)	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	1,580	0	\$231	\$526	\$105	1.8
Room 108 - Study Room	10	LED - Fixtures: Ambient 1x4 Fixture	Occupancy Sensor	S	32	3,709		None	No	10	LED - Fixtures: Ambient 1x4 Fixture	Occupancy Sensor	32	3,709	0.0	0	0	\$0	\$0	\$0	0.0
Room 110 Environmental Lab	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$343	\$20	4.9
Room 111 Research Lab	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.4	4,063	-1	\$594	\$1,197	\$250	1.6
Room 112 Research Lab	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,376	0.0	177	0	\$26	\$37	\$10	1.0
Room 113 Research Lab	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	226	0	\$33	\$37	\$10	0.8
Room 113 Research Lab	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.0	211	0	\$31	\$342	\$45	9.7
Room 113A	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.0	422	0	\$62	\$261	\$40	3.6
Room 114 Research Lab	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$343	\$55	4.4
Room 114 Research Lab	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.0	211	0	\$31	\$72	\$10	2.0
Room 116 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 117 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 118 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 119 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 119 Office (1)	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 120 Office (1)	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 122 Lab	6	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	5,376	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,709	0.1	686	0	\$100	\$465	\$71	3.9
Room 126 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 127 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 128 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 129 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 130 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 131 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Room 132	9	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	9	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.2	1,898	0	\$277	\$922	\$125	2.9
Room 134	26	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	26	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.5	5,483	-1	\$801	\$2,424	\$330	2.6
Room 137	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$189	\$40	2.3
Room 138	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6
Room 139	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$189	\$40	2.3
Room 140	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,376	0.0	177	0	\$26	\$37	\$10	1.0
Room 141	13	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	13	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.3	2,935	-1	\$429	\$745	\$165	1.4
Room 142 Janitorial	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Room 143 Lab	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 143 Lab	16	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	16	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.3	3,612	-1	\$528	\$854	\$195	1.2
Room 143A Study	4	LED - Fixtures: Downlight Recessed	Occupancy Sensor	S	13	3,709		None	No	4	LED - Fixtures: Downlight Recessed	Occupancy Sensor	13	3,709	0.0	0	0	\$0	\$0	\$0	0.0
Room 143B	2	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	5,376	4	None	Yes	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	40	3,709	0.0	133	0	\$19	\$116	\$20	4.9
Room 143C	2	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	5,376	4	None	Yes	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	40	3,709	0.0	133	0	\$19	\$116	\$20	4.9
Room 143D	2	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	5,376	4	None	Yes	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	40	3,709	0.0	133	0	\$19	\$116	\$20	4.9
Room 143E	2	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	5,376	4	None	Yes	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	40	3,709	0.0	133	0	\$19	\$116	\$20	4.9
Room 143F	3	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	5,376	4	None	Yes	3	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	40	3,709	0.0	200	0	\$29	\$270	\$35	8.0
Room 143G	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6
Room 143H	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$146	\$40	0.8
Room 143H	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,709	0.1	1,354	0	\$198	\$489	\$95	2.0
Room 143I	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6
Room 143K	4	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	40	5,376	4	None	Yes	4	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	40	3,709	0.0	267	0	\$39	\$270	\$35	6.0
Room 144A	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	1,580	0	\$231	\$526	\$105	1.8
Room 145A	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	1,580	0	\$231	\$526	\$105	1.8
Room 202 Chair Office	12	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	12	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.2	2,531	-1	\$370	\$1,140	\$155	2.7
Room 203 Office	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Room 204 Copy Room	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 205 Storage Room	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	4	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	500	0.1	58	0	\$8	\$290	\$40	29.5
Room 206 Conference Room	8	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	8	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.2	1,687	0	\$247	\$850	\$115	3.0
Room 213	41	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	41	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.9	9,255	-2	\$1,353	\$2,307	\$515	1.3
Room 213A	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	O	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	1,580	0	\$231	\$526	\$105	1.8
Room 214	42	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	42	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.9	9,481	-2	\$1,386	\$2,344	\$525	1.3
Room 216	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,709	0.0	229	0	\$33	\$65	\$12	1.6
Room 216	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.2	1,806	0	\$264	\$562	\$115	1.7
Room 217	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	1,354	0	\$198	\$489	\$95	2.0
Room 218	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.2	2,257	-1	\$330	\$635	\$135	1.5
Room 219	16	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	16	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.3	3,612	-1	\$528	\$854	\$195	1.2
Room 220	17	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	17	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.4	3,838	-1	\$561	\$1,161	\$240	1.6
Room 221	19	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	19	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.4	4,289	-1	\$627	\$1,234	\$260	1.6
Room 222	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.4	4,741	-1	\$693	\$1,307	\$280	1.5
Room 222A	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.2	2,032	0	\$297	\$599	\$125	1.6
Room 223 Electrical	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Room 226	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 227	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 228	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 229	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 230	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 232	10	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	10	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.2	2,109	0	\$308	\$995	\$135	2.8
Room 233	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 234 Closet	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	500	0.0	15	0	\$2	\$72	\$10	29.5
Room 235	17	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	17	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.3	3,585	-1	\$524	\$1,772	\$240	2.9

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Room 236	17	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	17	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.3	3,585	-1	\$524	\$1,772	\$240	2.9
Room 238	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 239	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 240	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	844	0	\$123	\$560	\$75	3.9
Room 243	43	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	43	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.8	9,069	-2	\$1,325	\$4,196	\$570	2.7
Room 244 Janitorial	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Room 246 Electrical	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Room 248	17	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	17	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.4	3,838	-1	\$561	\$1,161	\$240	1.6
Room 249	19	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	19	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.4	4,289	-1	\$627	\$1,234	\$260	1.6
Room 250	18	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	18	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.4	3,796	-1	\$555	\$1,844	\$250	2.9
Room 251	13	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	13	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.3	2,742	-1	\$401	\$1,212	\$165	2.6
Room 252 Ice Room	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	5,376	0.0	156	0	\$23	\$72	\$10	2.7
Room 253	21	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	21	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.4	4,429	-1	\$647	\$2,062	\$280	2.8
Room 254 Cold Room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$343	\$20	4.9
Room 255	41	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	41	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.8	8,647	-2	\$1,264	\$4,051	\$550	2.8
Room 255A	7	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	1,476	0	\$216	\$777	\$105	3.1
Room 256	40	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	40	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.8	8,436	-2	\$1,233	\$3,708	\$505	2.6
Room 256A	7	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	1,476	0	\$216	\$777	\$105	3.1
Room 257	41	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	41	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.8	8,647	-2	\$1,264	\$3,781	\$515	2.6
Room 257A	7	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	3,709	0.1	1,476	0	\$216	\$777	\$105	3.1
Room 300	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$343	\$20	4.9
Room 304	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 304	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	O	62	5,376	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.0	451	0	\$66	\$343	\$20	4.9
Room 304C	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6
Room 304D	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.2	2,032	0	\$297	\$599	\$125	1.6

Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Room 305	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 305	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,709	0.2	2,032	0	\$297	\$599	\$125	1.6
Room 305A	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,709	0.3	2,709	-1	\$396	\$708	\$155	1.4
Room 305B	3	Linear Fluorescent - T12: 4' T12 (40W) - 6L	Wall Switch	S	254	2,184		None	No	3	Linear Fluorescent - T12: 4' T12 (40W) - 6L	Wall Switch	254	2,184	0.0	0	0	\$0	\$0	\$0	0.0
Room 305B	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,709	0.4	4,063	-1	\$594	\$927	\$215	1.2
Room 305C	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,709	0.0	339	0	\$49	\$55	\$15	0.8
Room 305C	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,376	3, 4	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,709	0.3	2,709	-1	\$396	\$708	\$155	1.4
Room 306A	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	903	0	\$132	\$416	\$75	2.6
Room 307 Green House	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	1,580	0	\$231	\$526	\$105	1.8
Room 307A Green House	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.2	1,806	0	\$264	\$562	\$115	1.7
Room 307B Green House	36	Compact Fluorescent: (1) 18W A19 Screw-In Lamp	Wall Switch		18	2,184	3	Relamp	No	36	LED Lamps: (1) 13W Screw-In Lamp	Wall Switch	13	2,184	0.1	425	0	\$62	\$620	\$36	9.4
Room 307B Green House	1	Halogen Incandescent: (1) 1045W Greenhouse Light	Wall Switch		1,045	2,184		None	No	1	Halogen Incandescent: (1) 1045W Greenhouse Light	Wall Switch	1,045	2,184	0.0	0	0	\$0	\$0	\$0	0.0
Room 307B Green House	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,709	0.1	677	0	\$99	\$380	\$65	3.2
Room 307B Green House	2	Metal Halide: (1) 400W Lamp	Wall Switch		458	2,184		None	No	2	Metal Halide: (1) 400W Lamp	Wall Switch	458	2,184	0.0	0	0	\$0	\$0	\$0	0.0
Room 30A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,376	0.0	177	0	\$26	\$37	\$10	1.0
Stairs Lobby	5	Compact Fluorescent: (1) 24W G25 Screw-In Lamp	Wall Switch	S	24	5,376	3, 5	Relamp	Yes	5	LED Lamps: (1) 17W Screw-In Lamp	High/Low Control	17	3,709	0.0	334	0	\$49	\$126	\$10	2.4
Stairs Lobby	11	LED - Fixtures: High-Bay	Wall Switch	S	33	5,376	5	None	Yes	11	LED - Fixtures: High-Bay	High/Low Control	33	3,709	0.1	605	0	\$88	\$675	\$385	3.3
Stairs Basement	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs Basement	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,376	3, 5	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,709	0.1	1,580	0	\$231	\$706	\$315	1.7
Storage - Attic	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Storage - Attic	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	500		None	No	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	0	0	\$0	\$0	\$0	0.0
Storage Room 207	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	17	0	\$2	\$37	\$10	11.0
Vending Machine Room	6	Compact Fluorescent: (2) 26W G25 Screw-In Lamps	Wall Switch	S	52	5,376	3, 4	Relamp	Yes	6	LED Lamps: (2) 18W Screw-In Lamp	Occupancy Sensor	36	3,709	0.1	867	0	\$127	\$573	\$59	4.1

Motor Inventory & Recommendations

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Basement Mechanical Room	Medical Equipment	2	Air Compressor	7.5	89.5%	No	Brook Hansen	JJ-DA132SI-D	W	2,688		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Basement Mechanical Room	Medical Equipment	2	Air Compressor	15.0	91.0%	No	Baldor	M2513T	W	2,688		No	91.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Attic Mechanical Room	Pneumatic Controls	2	Air Compressor	2.0	86.5%	No	Baldor	EM3157T	W	500		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Basement Mechanical Room	Chilled Water System	1	Chilled Water Pump	25.0	92.4%	Yes	Marathon	6VC 284TTDC402GA A	B	407		No	92.4%	No		0.0	0	0	\$0	\$0	\$0	0.0
Basement Mechanical Room	Chilled Water System	1	Chilled Water Pump	25.0	92.4%	Yes	Marathon	6VC 284TTDC402GA A	B	407		No	92.4%	No		0.0	0	0	\$0	\$0	\$0	0.0
Attic Mechanical Room	Building Ventilation	1	Exhaust Fan	7.5	89.5%	No			W	6,216		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Fume Hood	1	Exhaust Fan	50.0	93.0%	No			W	2,190		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Fume Hood	1	Exhaust Fan	50.0	93.0%	No			W	2,190		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Fume Hood	1	Exhaust Fan	50.0	93.0%	No			W	2,190		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Fume Hood	1	Exhaust Fan	50.0	93.0%	No			W	2,190		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307A	Green House 307A	1	Exhaust Fan	0.3	65.0%	No			W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307A	Green House 307A	1	Exhaust Fan	0.3	65.0%	No			W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307A	Green House 307A	1	Exhaust Fan	0.3	65.0%	No			W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307A	Green House 307A	1	Exhaust Fan	0.3	65.0%	No			W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307A	Green House 307A	1	Exhaust Fan	0.3	65.0%	No			W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307B	Green House 307B	1	Exhaust Fan	0.3	65.0%	No	Multifan		W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307B	Green House 307B	1	Exhaust Fan	0.3	65.0%	No	Multifan		W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307B	Green House 307B	1	Exhaust Fan	0.3	65.0%	No	Multifan		W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Green House 307B	Green House 307B	1	Exhaust Fan	0.3	65.0%	No	Multifan		W	5,376		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Basement Mechanical Room	Heating Hot Water System	1	Heating Hot Water Pump	7.5	88.5%	Yes	Marathon	6VN213TTB4026 ANX	B	1,764	6	Yes	91.7%	No		0.1	292	0	\$43	\$1,154	\$0	26.9

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Basement Mechanical Room	Heating Hot Water System	1	Heating Hot Water Pump	7.5	88.5%	Yes	Marathon	6VN213TTB4026 ANX	B	1,764	6	Yes	91.7%	No		0.1	292	0	\$43	\$1,154	\$0	26.9
Basement Mechanical Room	Ground Water	2	Other	0.5	82.5%	No			W	200		No	82.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Elevator Room	Elevator	1	Other	30.0	74.0%	No	US Electrical Motors	SUB 210-46	W	450		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Basement Mechanical Room	Lab Waste	2	Process Pump	2.0	85.5%	No	Marathon	6VF182UTFW16 002AAM	W	336		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Attic Mechanical Room	Lab North	2	Process Pump	2.0	85.5%	No	Baldor	824Z04054	W	2,016		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Attic Mechanical Room	Lab South	2	Process Pump	1.5	78.5%	No	Baldor	35A13-82F5	W	8,760		No	78.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Attic Mechanical Room	AHU-4	1	Return Fan	5.0	89.5%	Yes	AO Smith	8184T	W	6,216		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Basement Mechanical Room	Basement Mechanical Room (HV-1)	1	Supply Fan	7.5	91.0%	No	Baldor	ER33111	B	6,216	7	No	91.0%	Yes	1	2.1	14,332	0	\$2,108	\$4,738	\$1,000	1.8
Attic Mechanical Room	Penthouse Mechanical Room North (HV-2)	1	Supply Fan	5.0	87.5%	No	MagneTek	E 227	B	6,216	7	No	89.5%	Yes	1	1.5	10,336	0	\$1,521	\$4,076	\$900	2.1
Attic Mechanical Room	Penthouse Mechanical Room South (HV-3)	1	Supply Fan	5.0	87.5%	No			B	6,216	7	No	89.5%	Yes	1	1.5	10,336	0	\$1,521	\$4,197	\$900	2.2
Attic Mechanical Room	AHU-1	1	Supply Fan	75.0	94.5%	Yes	Marathon	6B 365TTFS6036BR	B	6,216	6	Yes	95.4%	No		0.3	2,604	0	\$383	\$7,928	\$0	20.7
Attic Mechanical Room	AHU-2	1	Supply Fan	75.0	94.5%	Yes	Marathon	6B 365TTFS6036BR	B	6,216	6	Yes	95.4%	No		0.3	2,604	0	\$383	\$7,928	\$0	20.7
Attic Mechanical Room	AHU-3	1	Supply Fan	15.0	91.0%	Yes	MagneTek	D254T	B	6,216	6	Yes	93.0%	No		0.1	1,233	0	\$181	\$1,847	\$0	10.2
Attic Mechanical Room	AHU-4	1	Supply Fan	15.0	89.5%	Yes			B	6,216	6	Yes	93.0%	No		0.3	2,194	0	\$323	\$1,847	\$0	5.7
Attic Mechanical Room	AHU-5	1	Supply Fan	15.0	91.0%	No	Marathon		B	6,216	7	No	93.0%	Yes	1	4.4	29,773	0	\$4,380	\$7,041	\$1,200	1.3
Attic Mechanical Room	AHU-3	1	Return Fan	5.0	87.5%	Yes	MagneTek	E 227	B	6,216	6	Yes	89.5%	No		0.1	444	0	\$65	\$800	\$0	12.3
Basement Mechanical Room	Domestic Water System	1	Water Supply Pump	7.5	84.0%	No	US Electrical Motors	5720A	W	2,016	8	No	89.5%	Yes	1	0.9	5,592	0	\$823	\$4,660	\$1,000	4.4
Basement Mechanical Room	Domestic Water System	1	Water Supply Pump	7.5	84.0%	No	US Electrical Motors	5720A	W	2,016	8	No	89.5%	Yes	1	0.9	5,592	0	\$823	\$4,660	\$1,000	4.4

Packaged HVAC Inventory & Recommendations

		Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Roof	AHU-5 - Animal Rooms	1	Split-System	40.00		10.67		Trane	RAUCC404ET13A BDF00010	B	9	Yes	1	Split-System	40.00		12.50		3.3	21,362	0	\$3,143	\$44,545	\$3,400	13.1
Room 113A	Room 113A	1	Window AC	0.60		11.30		Sanyo	P0811	B		No							0.0	0	0	\$0	\$0	\$0	0.0

Electric Chiller Inventory & Recommendations

		Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Central Plant	Building Chilled Water	1	Water-Cooled Centrifugal Chiller	498.00	Central Plant	Proxy Chiller	W		No							0.0	0	0	\$0	\$0	\$0	0.0

Space Heating Boiler Inventory & Recommendations

		Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Central Plant	Building Space Heating	1	Forced Draft Steam Boiler	4,111	Central Plant	Proxy Boiler	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Central Plant	Building Chilled Water	1	Other	5,976	Central Plant	Proxy Steam Chiller	W		No						0.0	0	0	\$0	\$0	\$0	0.0

DHW Inventory & Recommendations

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Central Plant	Building	1	Indirect System	Central Plant	Proxy Boiler	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Low-Flow Device Recommendations

		Recommendation Inputs				Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Rest Rooms	10	20	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	19	\$81	\$143	\$80	0.8

Walk-In Cooler/Freezer Inventory & Recommendations

Existing Conditions					Proposed Conditions			Energy Impact & Financial Analysis							
Location	Cooler/Freezer Quantity	Case Type/Temperature	Manufacturer	Model	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Chamber 1 Room 110	1	Cooler (35F to 55F)	Heat Craft	BST021M6D		No	No	No	0.0	0	0	\$0	\$0	\$0	0.0
Chamber 2 Room 110B	1	Cooler (35F to 55F)	Heat Craft	BST030H2D	11, 12	Yes	Yes	Yes	0.1	1,210	0	\$178	\$2,799	\$205	14.6
Chamber 3 Room 110C	1	Cooler (35F to 55F)	Heat Craft	BST030H2D	11, 12	Yes	Yes	Yes	0.1	1,210	0	\$178	\$2,799	\$205	14.6
Room 254	1	Cooler (35F to 55F)	Heat Craft	BST021M2D	11, 12	Yes	Yes	Yes	0.1	1,136	0	\$167	\$2,799	\$205	15.5

Commercial Refrigerator/Freezer Inventory & Recommendations

	Existing Conditions					Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Room 216	1	Stand-Up Refrigerator, Solid Door (>50 cu. ft.)	Hobart		No		No	0.0	0	0	\$0	\$0	\$0	0.0
Room 216	1	Stand-Up Refrigerator, Solid Door (>50 cu. ft.)	Hobart		No		No	0.0	0	0	\$0	\$0	\$0	0.0

Commercial Ice Maker Inventory & Recommendations

	Existing Conditions					Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Ice Maker Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Room 122 Lab	1	Ice Making Head (≥450 lbs/day), Continuous	Hoshizaki		No		No	0.0	0	0	\$0	\$0	\$0	0.0
Room 252 Ice Room	1	Self-Contained Unit (<175 lbs/day), Continuous	Scotsman	AFE424A-1A	No		No	0.0	0	0	\$0	\$0	\$0	0.0



Plug Load Inventory


Existing Conditions						
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?	Manufacturer	Model
Building	2	Coffee Machine	800			
Building	121	Computer	125			
Building	18	Microwave	700			
Building	2	Paper Shredder	125			
Building	29	Small/Medium Printer	150			
Building	3	Large Printer/Copier	300			
Building	8	Projector	175			
Building	84	Residential Refrigerator	900			
Building	12	Mini Fridge	260			
Building	4	TV	200			
Building	1	Water Cooler	1,200			
Lab	80	Misc. Lab Equipment	1,000			
Room 304C	1	Animal Washer	4,500		Girton	194A

Vending Machine Inventory & Recommendations


Existing Conditions		Proposed Conditions			Energy Impact & Financial Analysis						
Location	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Vending Machine Room	1	Glass Fronted Refrigerated	13	Yes	0.1	1,209	0	\$178	\$230	\$50	1.0
Vending Machine Room	1	Non-Refrigerated	13	Yes	0.0	343	0	\$50	\$230	\$0	4.6

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



ENERGY STAR® Statement of Energy Performance



**ENERGY STAR®
Score¹**

The College of New Jersey

Primary Property Type: College/University
Gross Floor Area (ft²): 2,830,421
Built: 1855

For Year Ending: January 31, 2020
Date Generated: December 13, 2020

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
Property Address The College of New Jersey 2000 Pennington Road Ewing, New Jersey 08628	Property Owner The College of New Jersey 2000 Pennington Rd Ewing, NJ 08628 609-771-2874	Primary Contact David Matlack 2000 Pennington Road Ewing, NJ 08628 609-771-2874 sstewart@trccompanies.com	
Property ID: 5984875			

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI	Annual Energy by Fuel	National Median Comparison	
229 kBtu/ft²	Natural Gas (kBtu)	619,522,872 (96%)	National Median Site EUI (kBtu/ft²)
	Electric - Grid (kBtu)	28,774,949 (4%)	National Median Source EUI (kBtu/ft²)
			% Diff from National Median Source EUI
			43%
Source EUI	Annual Emissions		
258.3 kBtu/ft²	Greenhouse Gas Emissions (Metric Tons CO2e/year)		
			35,660

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer or Registered
Architect Stamp
(if applicable)

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR®	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge:</i> high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium:</i> a type of HID lamp
HSPF	<i>Heating seasonal performance factor:</i> a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value:</i> a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt:</i> equal to 1,000 Watts.
kWh	<i>Kilowatt-hour:</i> 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode:</i> a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide:</i> a type of HID lamp
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor:</i> a type of HID lamp
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program:</i> NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.
psig	<i>Pounds per square inch gauge</i>
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic:</i> refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	<i>Seasonal energy efficiency ratio:</i> a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	<i>Statement of energy performance:</i> a summary document from the ENERGY STAR® Portfolio Manager®.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC	<i>Solar renewable energy credit:</i> a credit you can earn from the state for energy produced from a photovoltaic array.
TREC	<i>Transition Incentive Renewable Energy Certificate:</i> a factorized renewable energy certificate you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use
VAV	<i>Variable air volume</i>
VFD	<i>Variable frequency drive:</i> a controller used to vary the speed of an electric motor.
WaterSense®	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.